

# A Reliable Micro-grid with Seamless Transition between Grid Connected and Islanded Mode for Residential Community with Enhanced Power Quality

Girish G. Talapur, *Student Member, IEEE*, H. M. Suryawanshi, *Senior Member, IEEE*, Lie Xu, *Senior Member, IEEE* and Amardeep B. Shitole, *Student Member, IEEE*,

**Abstract**—This paper presents a reliable micro-grid for residential community with modified control techniques to achieve enhanced operation during grid connected, islanded and re-synchronization mode. The proposed micro-grid is a combination of solar photo-voltaic (PV), battery storage system and locally distributed DG systems with residential local loads. A modified power control technique is developed such that, local load reactive power demand, harmonic currents and load unbalance is compensated by respective residential local DG. However, active power demand of all local residential load is shared between the micro-grid and respective local DG. This control technique also achieves constant active power loading on the micro-grid by supporting additional active power local load demand of respective residential DG. Hence, proposed modified power control technique achieves transient free operation of the micro-grid during residential load disturbances. An additional modified control technique is also developed to achieve seamless transition of micro-grid between grid connected mode and islanded mode. The dynamic performance of this micro-grid during grid connected, islanded and re-synchronization mode under linear and non-linear load variations is verified using real time simulator (RTS).

**Index Terms**—Distributed Generation, Micro-grid, Power Quality, Islanded Mode, Grid connected mode, re-synchronization.

## I. INTRODUCTION

CONSIDERING today's worldwide energy crises and global warming issues, power generation using renewable energy sources (RES) are gaining more importance in order to provide continuous and reliable power supply to all distributed local loads. Distributed generation (DG) units equipped with RES providing local distributed load demands forms a structure of micro-grid [1]. This micro-grid can operate either in grid connected mode or in islanded/standalone mode. In a micro-grid, battery energy storage system (BES) is

required for energy balancing in the system, especially when it is operating in islanded/standalone mode. Efficient utilisation of local DG units can be achieved by operating all DG's as constant power sources during grid connected mode of operation of micro-grid. In this case grid will maintain the micro-grid voltage [2], [3].

Some of the major challenging issues for smooth operation of the micro-grid are active power load sharing between DG's, harmonics compensation, unbalanced load compensation, reactive power compensation and transition from grid connected mode to islanded mode and vice versa [4], [5]. In literature different control schemes are presented to handle the afore said issues.

Control techniques presented for active and reactive power load sharing between DG's in the micro-grid are divided into two categories as decentralised control (without communication) and centralised control (with communication) [6], [7]. In decentralised control, droop method is used for load sharing between DG's in the micro-grid. It has become very popular due to plug and play type of operation of DG. In this method the active and reactive power sharing is based on their droop constant [8]. A virtual output impedance is incorporated in the droop method in order to achieve accurate active and reactive power sharing between DG's [9], [10]. The disadvantages of basic droop method is variation in voltage and frequency from nominal values at other than rated load conditions. In order to overcome this issue, Hierarchical control of droop method is presented in [11], [12] which comes under the category of centralised control with communication.

In centralised control, master-slave method and average power sharing method is used for active and reactive power sharing in the micro-grid [13]–[15]. Here, master DG should have high power rating [16]. The disturbances occurred in the micro-grid are handled by the master DG (i.e total transients are handled by the master DG). The major disadvantages of this method are the micro-grid is to be shutdown when master DG fails and all transients in micro-grid are handled by the master DG, therefore the burden on the single DG is high [16]. In [17], authors proposed hybrid load sharing method by combining droop and master-slave methods. Here, the DG's which are operated using droop method will act as master DG's and all other DG's are slaves. With this technique, the disadvantages of master-slave and droop method are overcome

Manuscript received October 4, 2017; revised January 24, 2018; accepted February 15, 2018. Paper 2017-IPCC-1087.R1, approved for publication in IEEE Transactions on Industry Applications by the Industrial Power Converter Committee of IEEE-IAS. This work was supported by the Department of Science and Technology, Government of India, Indo-UK collaborative project under Grant DST/RCUK/SEGES/2012/04.

G. G. Talapur, H. M. Suryawanshi, and A. B. Shitole are with the Department of Electrical Engineering, Visvesvaraya National Institute of Technology (VNIT), Nagpur 440011, India (e-mail: girish223@gmail.com, hms\_1963@rediffmail.com, amardeep.shitole@gmail.com).

L. Xu is with the Department of Electronic and Electrical Engineering, University of Strathclyde, Glasgow, UK (e-mail: lie.xu@strath.ac.uk).

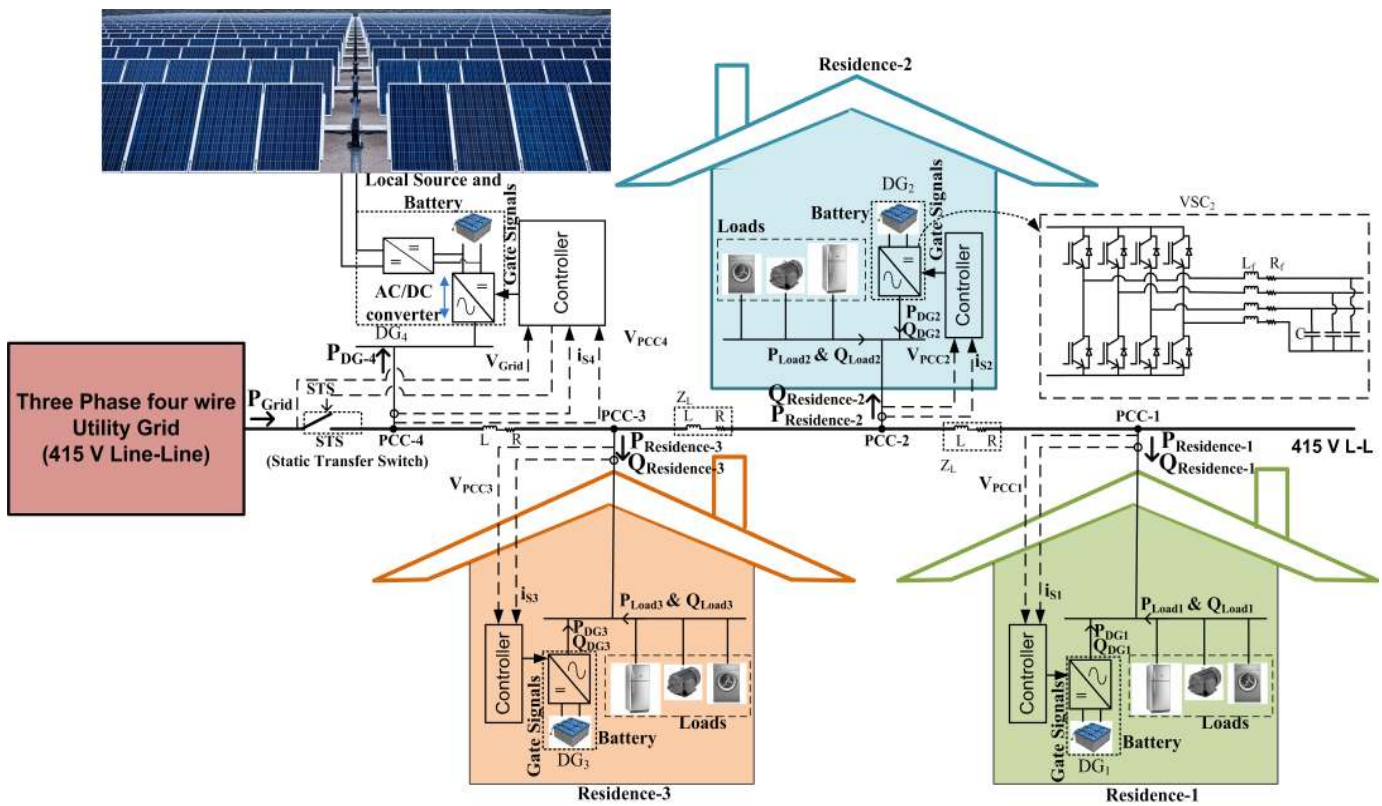


Fig. 1. Schematic representation of proposed grid connected micro-grid.

partially.

The non-linear loads demand harmonic currents in the micro-grid, which leads to distortion in micro-grid voltage. In [18], the harmonics are shared by incorporating active compensation in the controller of DG's. While in, [19], [20] harmonics are shared by adding additional loops in the droop controller of DG's. In the micro-grid, unbalanced loads will cause unbalance in the terminal voltages [21]. In [22], [23] the load unbalance current is shared between DG's without effecting its output voltage.

For seamless transition between grid connected and islanded mode, the additional converter is used as dispatch unit (DU) in [24]. Two PLLs are used in [25] for smooth transition between the modes of operation by minimizing the error between the phases of the PLL. In [26], a synchronizing DG is used for smooth transition during reconnection of micro-grid to the main grid. With the help of synchronizing DG the micro-grid instantaneous phase, frequency and instantaneous voltage is synchronized with the utility grid before reconnection. By this the transients in the system is avoided during transition from islanded mode to grid connected mode. In [27], Linear Quadratic Regulator theory based bumpless transfer scheme is used to achieve smooth transition between the islanded mode and grid connected mode.

This paper proposes, a micro-grid and its control technique to provide reliable power supply to a residential community with enhanced power quality and to achieve smooth operation of micro-grid under grid connected mode and islanded mode. However, the specific challenging issues need to be considered

in order to achieve aforesaid objective are: active power load sharing between DG's, reactive power compensation, harmonics compensation, unbalanced load compensation and seamless transition of micro-grid from grid connected mode to islanded mode and re-synchronization to grid. Therefore, the proposed micro-grid control technique is designed to resolve all these necessary issues and achieve smooth operation. The major contributions of this paper are

- 1) Developed a modified power control technique to achieve following objectives
  - Constant active power loading on the micro-grid from residential local loads, independent of local load variations. Therefore the frequency of the system will not be affected under dynamic load variations.
  - The entire reactive power demand from the local load is compensated by the respective local DG. Therefore, the system bus voltage is unaffected even under reactive power load variation.
  - The unbalance current and harmonics current demanded by the local residential loads are compensated by the respective local DG, in order to avoid micro-grid voltage distortion. Therefore, the proposed micro-grid is free from power quality related issues caused due to unbalanced and harmonics load current demand under both grid connected and islanded mode.
  - In micro-grid the load disturbances are taken care by respective local DGs. Hence, the micro-grid is transient free from the local load disturbances occurred

in each residence.

- 2) Developed a control technique for smooth transition from grid connected mode to islanded mode and re-synchronisation to grid.

The micro-grid achieves following advantages, with the proposed control technique of the DG's

- i) The dynamic response of system is increased with the proposed control of micro-grid during load disturbances.
- ii) The transition from grid connected mode to islanded mode and re-synchronisation to grid is achieved smoothly without affecting the micro-grid voltage during transition period.
- iii) The stability of the proposed micro-grid is increased due to transient free operation during the local load disturbances occurred in the residences.
- iv) In micro-grid only the active power sharing is done between DGs and the utility grid. If reactive power, harmonics and unbalanced currents are shared between the DGs and utility grid then the micro-grid voltage will be affected. To avoid aforesaid issue, the reactive power, harmonics and unbalanced currents demanded by the local residential loads are compensated by the respective local DG with the help of modified power control technique.

## II. SYSTEM CONFIGURATION

The schematic in Fig. 1 represents the proposed micro-grid for residential community. The micro-grid is interconnected to the main grid through the static transfer switch (STS). The STS is controlled by  $DG_4$  controller. Under healthy condition of the main grid, micro-grid is operated in grid connected mode. However during faulty conditions micro-grid is isolated from the main grid by opening the STS. When the fault is cleared islanded micro-grid is re-synchronised to the main grid by operating STS. In micro-grid each residence (residence-1, residence-2 and residence-3) comprises of local DG's ( $DG_1$ ,  $DG_2$  and  $DG_3$ ) and local loads. Each DG ( $DG_1$ ,  $DG_2$ ,  $DG_3$  and  $DG_4$ ) in the micro-grid is a voltage source converter (VSC) along with low pass filter  $L_f$ ,  $R_f$  and  $C$  at it's ac output side. In  $DG_1$ ,  $DG_2$  and  $DG_3$ , the dc side of VSC is connected with Battery storage system. In  $DG_4$ , the dc side of VSC is connected with solar PV and Battery storage system. R and L are equivalent line resistance and inductance.

## III. CONTROLLER DESIGN

The control technique of proposed micro-grid is designed such that, it can be operated in grid connected mode, islanded mode and re-synchronisation for grid connected mode. In grid connected mode all the DG's will connect as a constant power sources, here the micro-grid voltage is maintained by the main grid [28]. If any fault occurred in the main grid, then the micro-grid is disconnected from the main grid and operate in islanded mode.

### A. Modified power Control technique for $DG_1$ , $DG_2$ and $DG_3$

A modified power control technique is developed for local residential DG's ( $DG_1$ ,  $DG_2$  and  $DG_3$ ) in order to achieve:

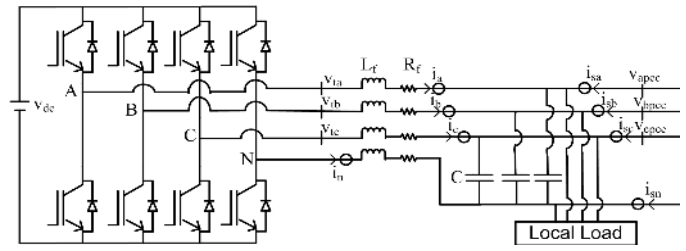


Fig. 2. Schematic of VSC of  $DG_1$ ,  $DG_2$ ,  $DG_3$  and  $DG_4$ .

- 1) Transient free micro-grid from the local disturbances occurred in the residences.
- 2) Constant loading on micro-grid from the residences even under local load variations.
- 3) Reactive power compensation, local unbalanced load compensation and harmonics compensation of local non-linear load.

Its realization is mainly depends on capability of battery energy storage, this is the limitation for this technique. In this control technique, the residential DG's are controlled by taking feedback signals as, PCC voltage of respective DG's, current supplied by micro-grid to the respective residence. The local DG's are controlled in such a way that respective residence should absorb constant reference active power from the micro-grid irrespective of disturbances. In order to achieve, constant active power loading, reactive power reference is assumed to zero and for supply balance current the neutral current is assumed to zero.

The reference active power ( $P_{ref1}$ ,  $P_{ref2}$  and  $P_{ref3}$ ) absorbed by the local residential loads from the micro-grid is estimated using pre-calculated average load demand of residential local loads ( $P_{avg1}$ ,  $P_{avg2}$  and  $P_{avg3}$ ).

$$P_{ref} = P_{avg} \quad (1)$$

To overcome the limitation of modified power control technique, the selected battery capacity should be 150% of average load demand of residential local loads, by this it is possible to simplify the complexity in control.

1) *Mathematical modelling of power control:* Applying KVL in Fig. 2, the terminal voltage equation at the output side of VSC is,

$$\vec{v}_t = R_f \vec{i} + L_f \frac{d\vec{i}}{dt} + \vec{v}_{pcc} \quad (2)$$

$$L_f \frac{d\vec{i}}{dt} = \vec{v}_t - R_f \vec{i} - \vec{v}_{pcc} \quad (3)$$

In order to achieve synchronisation, instantaneous phase angle of the micro-grid is estimated using synchronous reference frame (SRF) Phase lock loop (PLL). This phase angle is used for park's transformation and to estimate the reference active power current component in  $dq$ -frame.

$$I_{d-ref} = \frac{P_{ref}}{V_{pcc-d}} \quad (4)$$

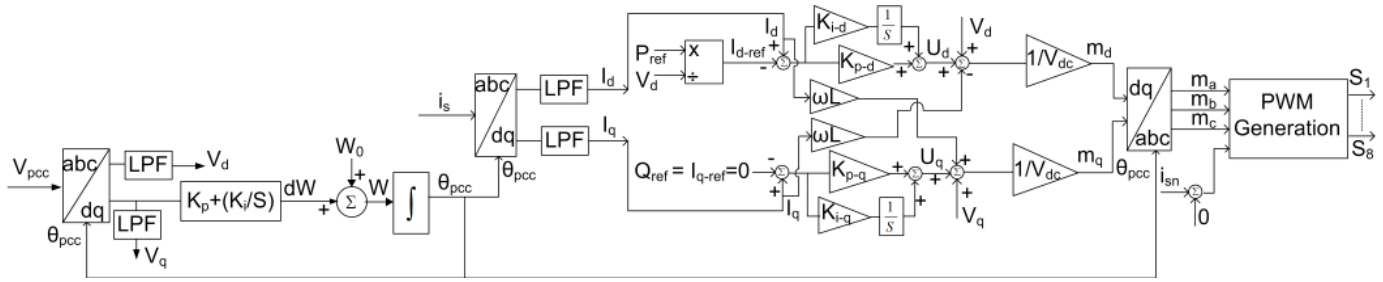


Fig. 3. Modified power Control technique for  $DG_1$ ,  $DG_2$  and  $DG_3$ .

Using park's transformation, equation (3) is transformed into synchronous  $dq$ -reference frame as,

$$V_{t-dq}e^{j\omega t} = RI_{dq}e^{j\omega t} + L\frac{dI_{dq}e^{j\omega t}}{dt} + V_{pcc-dq}e^{j\omega t} \quad (5)$$

By solving equation (5),

$$V_{t-dq} = j\omega LI_{dq} + RI_{dq} + L\frac{dI_{dq}}{dt} + V_{pcc-dq} \quad (6)$$

Where  $I_{dq}$  is state variable,  $V_{t-dq}$  is terminal voltage control input and  $V_{pcc-dq}$  is the disturbance input. In order to get desired control variable  $U_{dq}$ , error signal of  $dq$ -frame reference and actual current is passed through proportional and integral (PI) controller [29].

$$U_{dq} = RI_{dq} + L\frac{dI_{dq}}{dt} \quad (7)$$

Using equation (6) and (7),

$$V_{t-dq} = j\omega LI_{dq} + U_{dq} + V_{pcc-dq} \quad (8)$$

The VSC terminal voltage in  $dq$ -frame in terms of modulation index is,

$$V_{t-dq} = m_{dq}\frac{V_{dc}}{2} \quad (9)$$

Using equation (8) and (9),

$$m_{dq}\frac{V_{dc}}{2} = j\omega LI_{dq} + U_{dq} + V_{pcc-dq} \quad (10)$$

Decomposing equation (10) into real and imaginary parts,

$$m_d = \frac{2}{V_{dc}}(-\omega LI_q + U_d + V_{pcc-d}) \quad (11)$$

$$m_q = \frac{2}{V_{dc}}(\omega LI_d + U_q + V_{pcc-q}) \quad (12)$$

The modulating signals to drive the VSC in  $abc$ -frame are estimated by transforming equation (11) and (12). The block diagram representation of modified power control is shown in Fig. 3. The controller is designed in synchronous reference frame ( $dq$ -frame), for this the instantaneous phase is required. The PCC voltage is taken as feedback signal to extract the instantaneous phase of the micro-grid at respective PCC point. Currents supplied by the micro-grid to each residence ( $i_{sa}$ ,  $i_{sb}$  and  $i_{sc}$ ) is taken as feedback signal for controller to generate control variables  $m_a$ ,  $m_b$  and  $m_c$ . In order to generate the control variable  $m_n$ , reference neutral current is assumed zero and it is subtracted from the actual sensed neutral current.

### B. Modified Control technique of $DG_4$

The modified control technique for  $DG_4$  is designed in order to achieve power control mode during the grid connected mode of operation, seamless transition from grid connected mode to islanded mode, voltage control mode during islanded mode of operation and seamless re-synchronisation to the main grid from islanded mode of operation. When the micro-grid is operating in grid connected mode, the  $DG_4$  operates in power control mode. During the fault in main grid, the micro-grid is islanded from main grid and controller of  $DG_4$  is shifted to voltage control mode from power control mode. In this case, as micro-grid is isolated from main grid the instantaneous phase of the reference voltage is generated independently at 50 Hz frequency.

1) *Mathematical modelling of voltage controller:* In order to maintain reference voltage at the PCC4, the  $DG_4$  is designed to control in dual loop control by considering voltage across the filter capacitor and the current through the inductor [30]. Hence the reference current is

$$\vec{i}_{ref} = C\frac{d\vec{v}_{pcc4}}{dt} \quad (13)$$

The equation (13) in  $dq$ -frame is,

$$i_{ref-dq}e^{j\omega t} = C\frac{d(V_{pcc4-dq}e^{j\omega t})}{dt} \quad (14)$$

$$i_{ref-dq} = C\frac{dV_{pcc4-dq}}{dt} + j\omega CV_{pcc4-dq} \quad (15)$$

Where  $V_{pcc4-dq}$  is state variable. In order to get desired control variable  $i_{dq-c}$ , error signal of reference voltage ( $V_{dq-ref}$ ) in  $dq$ -frame and actual voltage is passed through PI controller.

$$i_{dq-c} = C\frac{dV_{pcc4-dq}}{dt} \quad (16)$$

$$i_{ref-dq} = i_{dq-c} + j\omega CV_{pcc4-dq} \quad (17)$$

Decomposing equation (17) into real and imaginary

$$i_{ref-d} = i_{d-c} - j\omega CV_{pcc4-q} \quad (18)$$

$$i_{ref-q} = i_{q-c} + j\omega CV_{pcc4-d} \quad (19)$$

The estimated reference in  $dq$ -frame is then used to obtain modulating signals required to drive  $DG_4$  VSC. These modulating signals are estimated by using mathematical model of power control from (2) to (12). So, the final modulating signals in  $dq$ -frame are

$$m_d = \frac{2}{V_{dc}}(-\omega LI_{q4} + U_{d4} + V_{pcc4-d}) \quad (20)$$

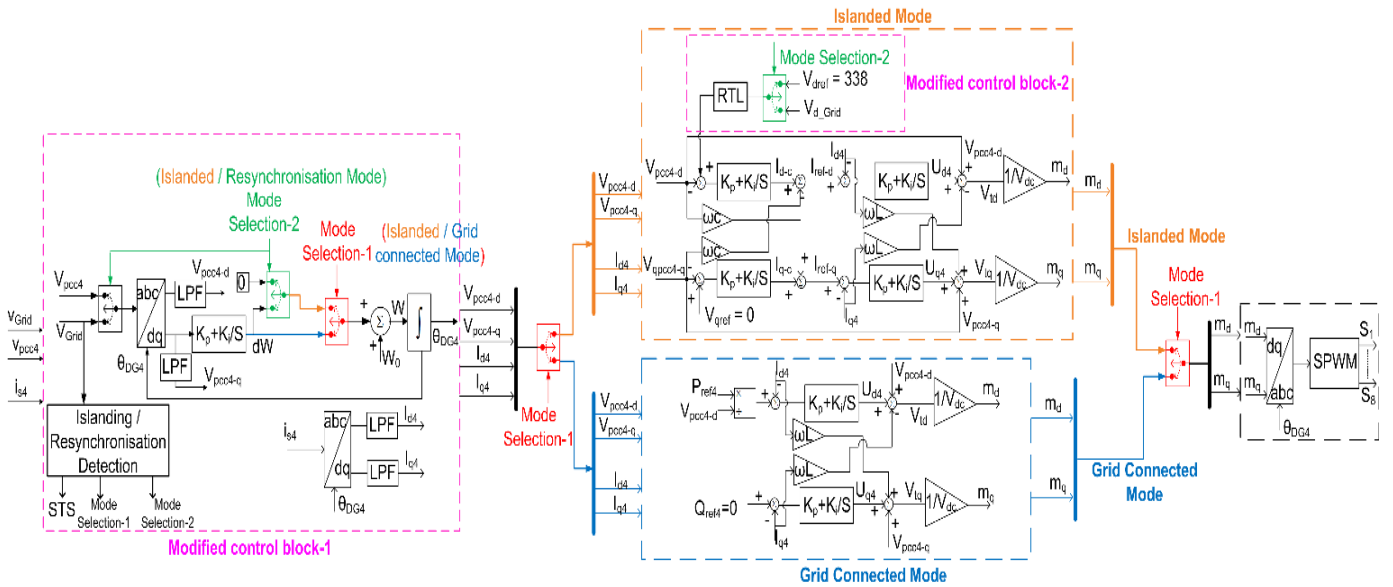


Fig. 4. Modified control technique for  $DG_4$  in micro-grid to achieve seamless transition between Grid connected and islanded mode .

$$m_q = \frac{2}{V_{dc}} (\omega L I_{d4} + U_{q4} + V_{pcc4-q}) \quad (21)$$

The modulating signals to drive the VSC in  $abc$ -frame are estimated by transforming equation (20) and (21).

Fig. 4 represents the block diagram of  $DG_4$  controller. In grid connected mode of operation, the  $DG_4$  is controlled as a power controlled source. Here, the synchronisation is done with the grid by using phase lock loop. Whenever fault occurred in the main grid, then the micro-grid is disconnected from the main grid by opening the static transfer switch and operate in islanded mode. While transferring micro-grid to islanded mode, the  $DG_4$  controller is switched from power control mode to voltage control mode. In islanded mode, the micro-grid voltage is maintained by  $DG_4$ . During this sudden mode transition, it is very important to accurately select instantaneous phase angle problem of instantaneous phase jump in the micro-grid voltage. Here, to avoid this, the instantaneous phase angle value for the reference voltage is obtained from the previous estimated value during grid connected mode. This is achieved by switching the mode selection-1 in modified control block-1 as shown in Fig. 4. In islanded mode, the instantaneous phase for the reference voltage is generated at 50 Hz frequency independently.

Whenever fault is cleared in the main grid, then the micro-grid is switched to grid connected mode. Before switching to grid connected mode, the micro-grid voltage is re-synchronised with the main grid voltage. For this, the grid voltage is taken as reference to the voltage controller by switching the mode selection-2 as shown in Fig. 4. Sudden change in reference voltage reflects as spike in the micro-grid voltage. So to avoid this, the reference voltage is always passed through rate limiter (RTL) as shown in modified block-2 of Fig. 4. From this, the voltage spike is reduced while changing the reference voltage. Once the micro-grid voltage is synchronised with the main grid voltage, then micro-grid is reconnected to main grid by closing the static transfer switch.

TABLE I  
THE MICRO-GRID SYSTEM PARAMETERS

Sr.No.	Parameter	Value
1	System Voltage	415V (L-L)
2	$DG_1$ Rating	20 kVA
3	$DG_2$ Rating	25 kVA
4	$DG_3$ Rating	15 kVA
5	$DG_4$ Rating	40 kVA
6	Line Impedance	1.334 Ohm, 3 mH
7	LC Filter ( $L_f$ , $R_f$ and $C$ )	6 mH, 0.15 $\Omega$ and 50 $\mu$ F
8	DC bus Voltage of each DG	760 V
9	Switching Frequency of each DG	3150 Hz

While transferring the micro-grid to grid connected mode, the  $DG_4$  controller is switched to power control mode by switching the mode selection-1 as shown in Fig. 4.

#### IV. PERFORMANCE EVALUATION OF PROPOSED MICRO-GRID USING REAL TIME SIMULATOR

The proposed micro-grid considered for the residential community is implemented in OPAL-RT real time simulator. The micro-grid parameters considered for real time implementation are given in Table I. The performance of proposed control scheme of DG's in micro-grid is evaluated in the following modes of operation

- Micro-grid in grid connected mode.
- Transition of micro-grid from grid connected mode to islanded mode.
- Micro-grid in islanded mode.
- Transition of micro-grid from islanded mode to grid connected mode.

##### A. Micro-grid in grid connected mode

When the micro-grid is operating in grid connected mode, then the micro-grid voltage is maintained by the main grid. The DG's in the micro-grid are controlled as power controlled

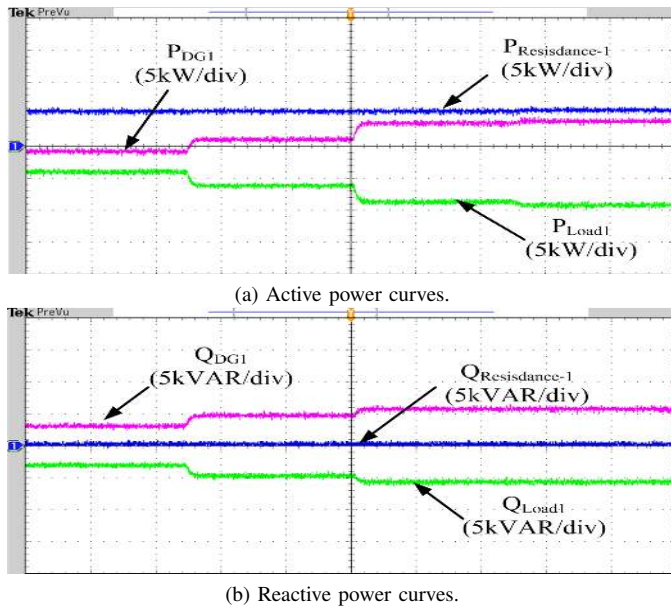


Fig. 5. Power curves in residence-1.

sources. The performance of proposed modified power control technique of DG's in micro-grid is evaluated under the load disturbances and variation in solar power availability of  $DG_4$ .

The  $DG_1$ ,  $DG_2$  and  $DG_3$  in residence-1, residence-2 and residence-3 are operate in charging mode and sharing mode. The major objectives of local DG's modified power control technique in residence-1, residence-2 and residence-3 are

- 1) To operate the residence at unity power factor in micro-grid,
- 2) To provide the transient free operation of micro-grid during each residential load disturbances (i.e the local load disturbances of residence-1, residence-2 and residence-3 should not reflect in micro-grid),
- 3) To absorb constant power from the micro-grid under residential load variations and maintain the power quality in the micro-grid by compensating the harmonics, unbalance load and reactive power demanded by the local loads in the residences.

With the knowledge of local load demand in the residences, the average load of the residence-1, residence-2 and residence-3 are predefined as 5kW, 8kW and 4kW. For simplicity the battery storage system capacity of each DG is selected as 150% of average local load demand. The local DG's in residence-1, residence-2 and residence-3 are controlled to absorb constant reference active power from the micro-grid. The reference power for  $DG_1$ ,  $DG_2$  and  $DG_3$  in residence-1, residence-2 and residence-3 are 5kW, 8kW and 4kW respectively.

The local load demand in residence-1 is 4kW active power and 3kVAR reactive power. But the reference power for residence-1 is 5kW active power, so the remaining 1kW is stored in battery by  $DG_1$  which is shown in Fig. 5(a). In order to operate the residence-1 at unity power factor in the micro-grid, the total reactive power demand by the local loads in residence-1 is supplied by  $DG_1$  as shown in Fig. 5(b). If the local load demand in residence-1 is increased to 6kW

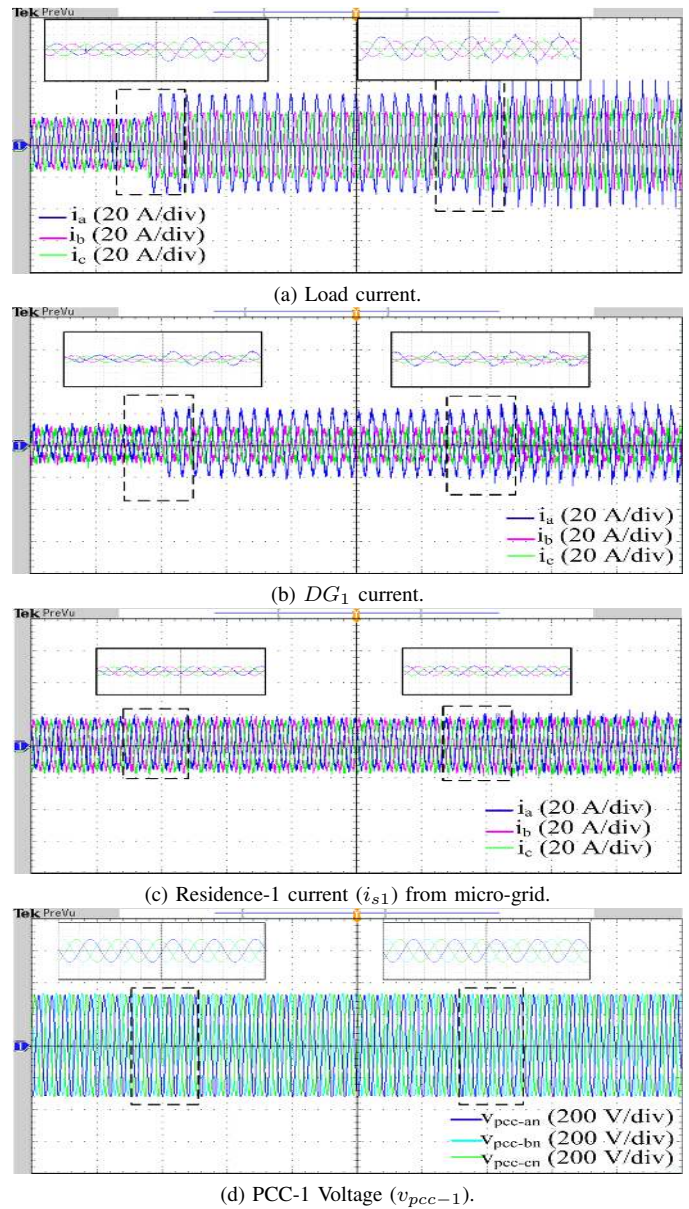


Fig. 6. Current waveforms in residence-1 and voltage at PCC-1.

active power and 4.5kVAR reactive power. Even though local load demand changed but the power demanded by residence-1 from micro-grid remains constant as 5kW. The additional 1kW active power is shared by  $DG_1$  as shown in Fig. 5(a). In Fig. 5 it is observed that the micro-grid is transient free from local disturbances occurred in residence-1. Further the load demand in residence-1 is increased to 7kW active power which is unbalance, 5KVAR reactive power and non-linear load (bridge rectifier with resistive load of 450  $\Omega$ ) is connected. The residence-1 absorbs constant 5kW active power at nearly unity power factor with balanced current, even though the local load is unbalance and nonlinear. The unbalance current, reactive power demand and harmonics are compensated by  $DG_1$  as shown in Fig. 6. The power absorbed by the residence-1 from micro-grid remains constant as 5kW. Even though the local residential load changes as shown in Fig. 6(a), it is observed that the PCC voltage remains constant as shown

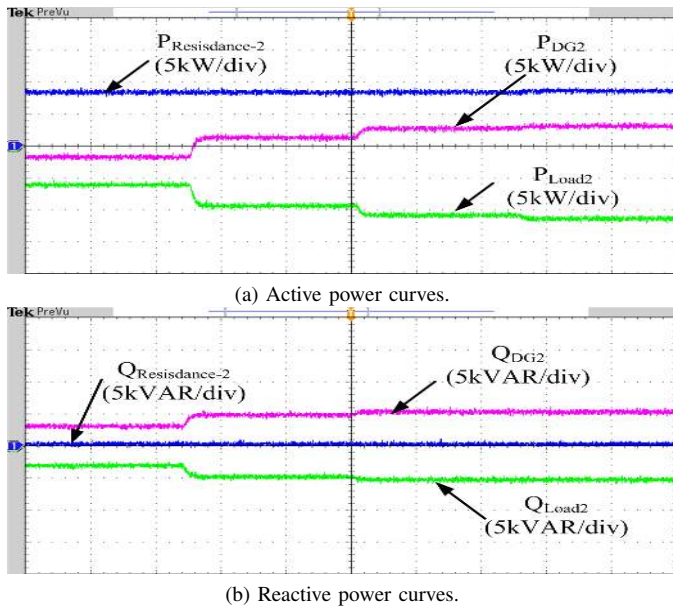


Fig. 7. Power curves in residence-2.

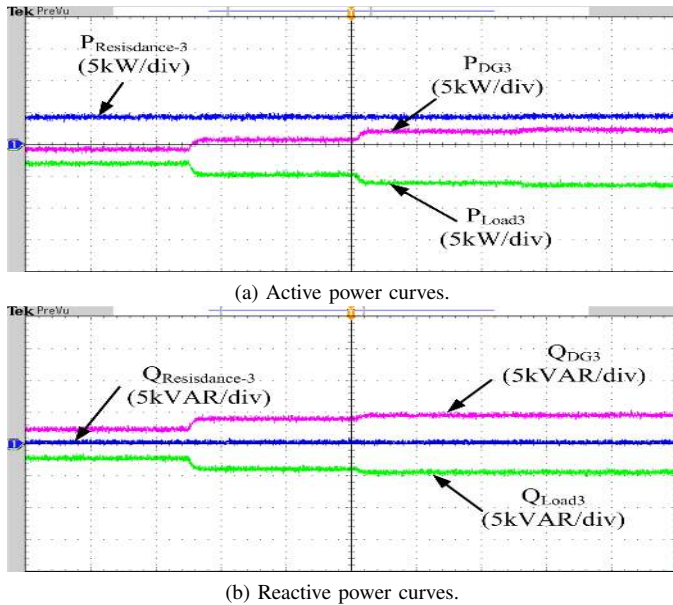


Fig. 8. Power curves in residence-3.

in Fig. 6(d). During dynamic load variations, in order to meet the local load variations, the control algorithm will change the modulating signal of the VSC of the respective DG, hence the PCC voltage is regulated.

Similarly, the dynamic performance of  $DG_2$  and  $DG_3$  controller in residence-2 and residence-3 are shown in Fig. 7 and Fig. 8. From figures it is observed that, both residences absorb constant active power from the main grid. However, sudden local load variations, reactive power demand, unbalanced current and harmonic current demand is compensated by respective residential DG.

The power input for  $DG_4$  is solar power along with BES. The rating of battery storage system of  $DG_4$  is selected as 150% of total average demand of micro-grid. The total demand in the micro-grid is 17kW (i.e sum of the power demand

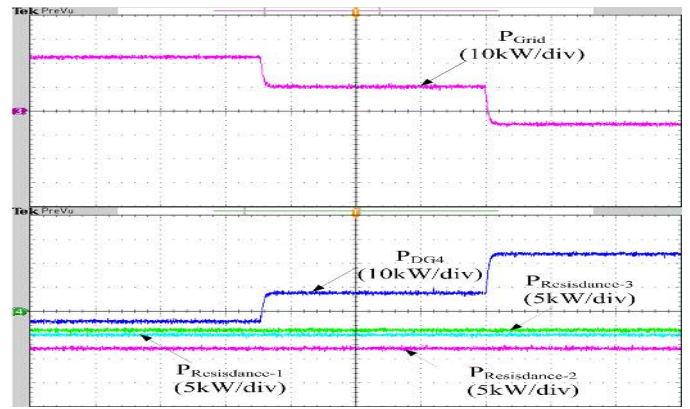


Fig. 9. Micro-grid power curves.

from the residence-1, residence-2 and residence-3). The  $DG_4$  operate in three mode,

- 1) Charging mode.
- 2) Sharing mode.
- 3) Feeding mode.

1) *Charging mode*: when the solar power is not available and battery storage system of  $DG_4$  is not fully charged, then the constant active power absorbed by the  $DG_4$  from main grid is completely utilized to charge the BES of  $DG_4$ . In addition the active power demands of residence-1, residence-2 and residence-3 is also supplied by the main grid as shown in Fig. 9.

2) *Sharing mode*: When the solar power available with  $DG_4$  is less than the total power demand from residence-1, residence-2 and residence-3, then the active power demanded by all residences is shared between main grid and  $DG_4$ . In Fig. 9, it is observed that solar power available with  $DG_4$  of 7kW is supplied to all residences. However, the addition power demand of 10kW is supplied by main grid.

3) *Feeding mode*: When the BES of  $DG_4$  is fully charged and the solar power available with  $DG_4$  is greater than the total active power demand by all residences, then the surplus power is injected into main grid. In Fig. 9, it is observed that out of 23kW solar power available with  $DG_4$ , 17kW active power is supply to all residences. However, additional active power of 6kW is injecting into main grid.

### B. Transition of micro-grid from grid connected mode to islanded mode

Under healthy grid condition the micro-grid is operating in grid connected mode. In this mode, proposed system power balance and the terminal voltage of the micro-grid is maintained by main grid. If any fault occurred in the main grid, then the micro-grid is disconnected from the main grid and operate in islanded mode. In this paper an intentional islanding is done, in order to observe the transition of micro-grid from grid connected mode to islanded mode. During this transition, the controller of  $DG_4$  is switched to voltage control mode from power control mode. The micro-grid voltage in islanded mode is maintained by  $DG_4$ . For this, the instantaneous phase angle value for the reference voltage is obtained from the

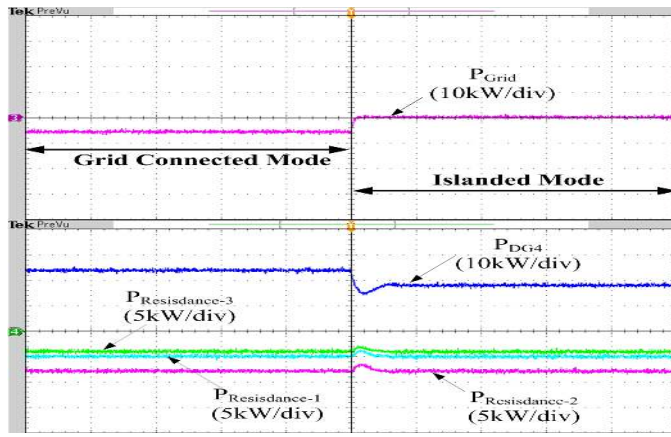


Fig. 10. Transition from grid connected to islanded mode.

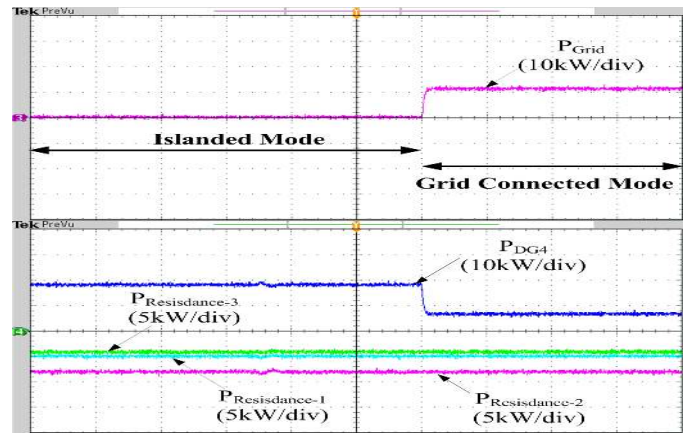


Fig. 12. Transition from islanded to grid connected mode.

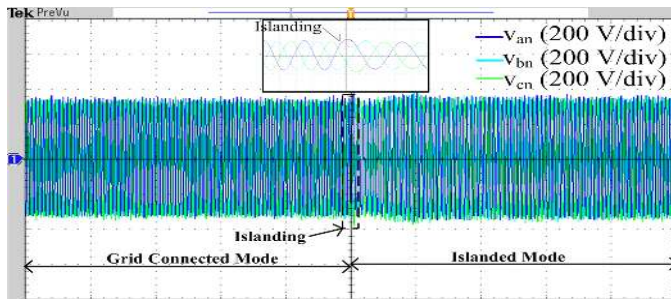


Fig. 11.  $PCC_4$  voltage during grid connected to islanded mode.

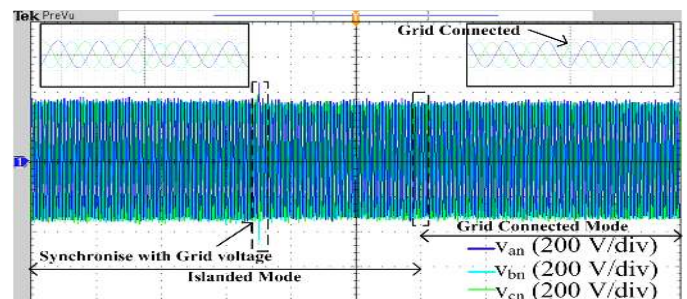


Fig. 13.  $PCC_4$  voltage during islanded to grid connected mode.

previous estimated value during grid connected mode. This is achieved by switching the mode selection-1 in modified control block-1 as shown in Fig. 4. From this the instantaneous phase jump is avoided and smooth transition is occurred from the grid connected mode to islanded mode as shown in Fig. 11.

### C. Micro-grid in islanded mode

During islanded mode of operation of micro-grid, the micro-grid voltage is maintained by the  $DG_4$ . In islanded mode  $DG_4$  is controlled as voltage source. In this mode of operation, the controller of  $DG_1$ ,  $DG_2$  and  $DG_3$  remains same as in grid connected mode. The residence-1, residence-2 and residence-3 demands constant load of 5kW, 8kW and 4kW which is completely supplied by the  $DG_4$ . However the local load disturbances are handled by the local DG's, these disturbances will not reflect in micro-grid as shown in Fig. 5, Fig. 6, Fig. 7 and Fig. 8. The harmonics and reactive power demand of local loads are compensated by the local DG's. Hence, proposed control scheme reduces the burden on  $DG_4$  due to load disturbances, harmonics and reactive power demand of all the residential loads.

### D. Transition of micro-grid from islanded mode to grid connected mode

When the main grid is in healthy condition (i.e grid fault is cleared), then the micro-grid is reconnected to the main grid. Before the reconnection of micro-grid with main grid, the

micro-grid voltage is synchronised with the voltage magnitude and instantaneous phase of main grid by switching the mode selection-2 as shown in modified control block-1 of Fig. 4. The reference voltage for  $DG_4$  is passed through rate limiter (RTL) as shown in modified control block-2 of Fig. 4, from this the spike in the micro-grid voltage is reduced while changing the voltage reference value. After the re-synchronisation of micro-grid voltage with main grid, the micro-grid is reconnected to the main grid by closing static transfer switch. From this, the smooth transition is occurred from the islanded mode to grid connected mode which can be observed in Fig. 13. During this mode, the controller of  $DG_4$  is switched to power control mode from voltage control. However, the controllers of remaining DG's in residence-1, residence-2 and residence-3 are unchanged.

## V. CONCLUSION

The performance of proposed micro-grid for the residential community under load disturbances, during grid connected mode, islanded mode and re-synchronisation of micro-grid to main grid is verified. The performance of modified power control technique is evaluated in order to achieve constant active power loading on the micro-grid by supplying additional active power residential load demand from respective residential DG. The residential sudden load variations, reactive power demand, unbalance current and harmonic current is compensated by respective residential DG. Hence, transient free operation of micro-grid is achieved. In addition, the smooth transition from



grid connected mode to islanded mode and re-synchronization to main grid is verified.

## REFERENCES

[1] R. H. Lasseter et al., "CERTS Microgrid Laboratory Test Bed," IEEE Trans. Power Del., vol. 26, no. 1, pp. 325-332, Jan. 2011.

[2] I. J. Balaguer, Q. Lei, S. Yang, U. Supatti, and F. Z. Peng, "Control for grid-connected and intentional islanding operations of distributed power generation," IEEE Trans. Ind. Electron., vol. 58, no. 1, pp. 147-157, Jan. 2011.

[3] A. B. Shitole et al., "Grid Interfaced Distributed Generation System With Modified Current Control Loop Using Adaptive Synchronization Technique," IEEE Trans. Ind. Informat., vol. 13, no. 5, pp. 2634-2644, Oct. 2017.

[4] M. H. J. Bollen et al., "Power Quality Concerns in Implementing Smart Distribution-Grid Applications," IEEE Trans. Smart Grid, vol. 8, no. 1, pp. 391-399, Jan. 2017.

[5] A. Tavakoli, M. Negnevitsky and K. M. Muttaqi, "A Decentralized Model Predictive Control for Operation of Multiple Distributed Generators in an Islanded Mode," IEEE Trans. Ind. Appl., vol. 53, no. 2, pp. 1466-1475, Mar./Apr. 2017.

[6] Y. Han, H. Li, P. Shen, E. A. A. Coelho and J. M. Guerrero, "Review of Active and Reactive Power Sharing Strategies in Hierarchical Controlled Microgrids," IEEE Trans. Power Electron., vol. 32, no. 3, pp. 2427-2451, Mar. 2017.

[7] S. M. Malik, X. Ai, Y. Sun, C. Zhengqi and Z. Shupeng, "Voltage and frequency control strategies of hybrid AC/DC microgrid: a review," IET Gener., Transmiss. Distrib., vol. 11, no. 2, pp. 303-313, Jan. 2017.

[8] M. C. Chandorkar, D. M. Divan and R. Adapa, "Control of parallel connected inverters in standalone AC supply systems," IEEE Trans. Ind. Appl., vol. 29, no. 1, pp. 136-143, Jan./Feb. 1993.

[9] K. De Brabandere, B. Bolsens, J. Van den Keybus, A. Woyte, J. Driesen and R. Belmans, "A Voltage and Frequency Droop Control Method for Parallel Inverters," IEEE Trans. Power Electron., vol. 22, no. 4, pp. 1107-1115, Jul. 2007.

[10] J. M. Guerrero, J. Matas, L. Garcia de Vicuna, M. Castilla and J. Miret, "Decentralized Control for Parallel Operation of Distributed Generation Inverters Using Resistive Output Impedance," IEEE Trans. Ind. Electron., vol. 54, no. 2, pp. 994-1004, Apr. 2007.

[11] F. Guo, C. Wen, J. Mao and Y. D. Song, "Distributed Secondary Voltage and Frequency Restoration Control of Droop-Controlled Inverter-Based Microgrids," IEEE Trans. Ind. Electron., vol. 62, no. 7, pp. 4355-4364, Jul. 2015.

[12] N. M. Dehkordi, N. Sadati and M. Hamzeh, "Fully Distributed Cooperative Secondary Frequency and Voltage Control of Islanded Microgrids," IEEE Trans. Energy Convers., vol. 32, no. 2, pp. 675-685, Jun. 2017.

[13] A. Mortezaei, M. G. Simes and F. P. Marafa, "Cooperative operation based master-slave in islanded microgrid with CPT current decomposition," in Proc. IEEE Power Energy Soc. General Meeting, Denver, CO, Jul. 2015, pp. 1-5.

[14] T. Caldognetto and P. Tenti, "Microgrids Operation Based on Master-Slave Cooperative Control," IEEE J. Emerg. Sel. Topics Power Electron., vol. 2, no. 4, pp. 1081-1088, Dec. 2014.

[15] X. Meng, Z. Liu, J. Liu, T. Wu, S. Wang and B. Liu, "A new master-slave based secondary control method for virtual synchronous generator," in Proc. IEEE 2nd Annu. Southern Power Electron. Conf., Auckland, New Zealand, Dec. 2016, pp. 1-4.

[16] V. Verma and G. G. Talpur, "Decentralized Master-Slave operation of microgrid using current controlled distributed generation sources," in Proc. IEEE Int. Conf. Power Electron. Drives Energy Syst., Bengaluru, India, Dec. 2012, pp. 1-6.

[17] A. Mortezaei, M. Simoes, M. Savaghebi, J. Guerrero and A. Al-Durra, "Cooperative Control of Multi-Master-Slave Islanded Microgrid with Power Quality Enhancement Based on Conservative Power Theory," IEEE Trans. Smart Grid, vol. PP, no. 99, pp. 1-1, doi:10.1109/TSG.2016.2623673

[18] U. Borup, F. Blaabjerg, and P. Enjeti, "Sharing of nonlinear load in parallel-connected three-phase converters," IEEE Trans. Ind. Appl., vol. 37, no. 6, pp. 1817-1823, Nov./Dec. 2001.

[19] T. Vandoorn, B. Meersman, J. D. Kooning, and L. Vandeveldel, "Controllable harmonic current sharing in islanded microgrids: DG units with programmable resistive behavior toward harmonics," IEEE Trans. Power Del., vol. 27, no. 2, pp. 831-841, Apr. 2012.

[20] C. Blanco, D. Reigosa, J. C. Vasquez, J. M. Guerrero and F. Briz, "Virtual Admittance Loop for Voltage Harmonic Compensation in Microgrids," IEEE Trans. Ind. Appl., vol. 52, no. 4, pp. 3348-3356, Jul./Aug. 2016.

[21] R. Kabiri, D. G. Holmes and B. P. McGrath, "Control of Active and Reactive Power Ripple to Mitigate Unbalanced Grid Voltages," in IEEE Trans. Ind. Appl., vol. 52, no. 2, pp. 1660-1668, Mar./Apr. 2016.

[22] D. De and V. Ramanarayanan, "Decentralized Parallel Operation of Inverters Sharing Unbalanced and Nonlinear Loads," IEEE Trans. Power Electron., vol. 25, no. 12, pp. 3015-3025, Dec. 2010.

[23] M. Savaghebi, A. Jalilian, J. C. Vasquez and J. M. Guerrero, "Autonomous Voltage Unbalance Compensation in an Islanded Droop-Controlled Microgrid," IEEE Trans. Ind. Electron., vol. 60, no. 4, pp. 1390-1402, Apr. 2013.

[24] M. N. Arafat, A. Elrayyah and Y. Sozer, "An Effective Smooth Transition Control Strategy Using Droop-Based Synchronization for Parallel Inverters," IEEE Trans. Ind. Appl., vol. 51, no. 3, pp. 2443-2454, May/Jun. 2015.

[25] J. Wang, N. C. P. Chang, X. Feng and A. Monti, "Design of a Generalized Control Algorithm for Parallel Inverters for Smooth Microgrid Transition Operation," IEEE Trans. Ind. Electron., vol. 62, no. 8, pp. 4900-4914, Aug. 2015.

[26] T. L. Vandoorn, B. Meersman, J. D. M. De Kooning and L. Vandeveldel, "Transition From Islanded to Grid-Connected Mode of Microgrids With Voltage-Based Droop Control," IEEE Trans. Power Syst., vol. 28, no. 3, pp. 2545-2553, Aug. 2013.

[27] D. Das, G. Gurralla and U. J. Shenoy, "Linear Quadratic Regulator-Based Bumpless Transfer in Microgrids," IEEE Trans. Smart Grid, vol. 9, no. 1, pp. 416-425, Jan. 2018.

[28] A. B. Shitole, H. M. Suryawanshi, G. G. Talapur and S. Sathyan, "Performance improvement of grid interfaced three level diode clamped inverter under various power quality events," in Proc. 26th IEEE Int. Symp. Ind. Electron., Edinburgh, UK, Jun. 2017, pp. 821-826.

[29] A. Yazdani and R. Iravani, Voltage-Sourced Converters in Power Systems: Modeling, Control, and Applications. Hoboken, NJ, USA: Wiley, 2010, pp.204-221.

[30] J. Rocabert, A. Luna, F. Blaabjerg and P. Rodriguez, "Control of Power Converters in AC Microgrids," IEEE Trans. Power Electron., vol. 27, no. 11, pp. 4734-4749, Nov. 2012.



**Girish G. Talapur** (S'16) received the B.Tech. degree in electrical and electronics engineering from the RGM College of Engineering and Technology, Nandyal, India, in 2009, and the M.Tech. degree in power systems from Delhi Technological University, New Delhi, India, in 2012. He is currently working toward the Ph.D. degree in electrical engineering with the Visvesvaraya National Institute of Technology, Nagpur, India.

From 2013 to 2014, he was with the Industrial Electronics Group, CSIR-Central Electronics Engineering Research Institute, Pilani, India. His research interests include high density power converters, distributed generation, ac microgrid, power quality, and dc microgrid.



**Hiralal M. Suryawanshi** (M'06-SM'12) received the B.E. degree in Electrical Engineering from Walchand College of Engineering, Sangli, India, in 1988 and M.E. degree in Electrical Engineering from Indian Institute of Science, Bangalore, in 1994. He has been awarded Ph.D. degree by Nagpur University, Nagpur (India) in 1999.

He is currently working as Professor in the Department of Electrical Engineering, Visvesvaraya National Institute of Technology, Nagpur, (India). He is Chair Professor of INAE. He is an Associate Editor of IEEE Transaction on Industrial Electronics, USA. He has received Fellow of Indian National Academy of Engineering (FNAE) in 2012 for his outstanding research. He has received IETE-Bimal Bose Award in 2009 and IETE-Biman Behari Sen Memorial Award in 2017 for his leadership in Power Electronics in India. His research interests include the field of Power Electronics, emphasising developmental work in the area of resonant converters, power factor correction, active power filters, FACTS devices, multilevel converters and electric drives.



**Lie Xu** (M'03–SM'06) received the B.Sc. degree in Mechatronics from Zhejiang University, Hangzhou, China, in 1993, and the Ph.D. degree in Electrical Engineering from the University of Sheffield, Sheffield, UK, in 2000.

He is currently a Professor at the Department of Electronic and Electrical Engineering, University of Strathclyde, Glasgow, UK. He previously worked in Queen's University of Belfast and ALSTOM T&D, Stafford, UK. His research interests include power electronics, wind energy generation and grid integration, and application of power electronics to power distribution and transmission.



**Amardeep B. Shitole** (S'15) received the B.E. degree in electrical engineering from the Government College of Engineering, Karad, India, in 2008, and the M.Tech. degree in power systems (electrical engineering) from the College of Engineering, Pune, India, in 2012. He is currently working toward the Ph.D. degree in electrical engineering with the Visvesvaraya National Institute of Technology, Nagpur, India.

His research interests include power electronics, renewable energy integration, high power density converters, ac microgrid, and power quality.