

A REVIEW OF EFFECT OF WELDING AND POST WELD HEAT TREATMENT ON MICROSTRUCTURE AND MECHANICAL PROPERTIES OF GRADE 91 STEEL

Merchant Samir Y¹

¹Lecturer, Fabrication Technology Department, Sir B.P. Institute, Bhavnagar, Gujarat, India

Abstract

Today getting high thermal efficiency in thermal and nuclear power plant is a big challenge. Many new material are developed. SA 335 grade 91 steel is modified high chrome-moly martensitic steel. This material is having excellent toughness and high temperature creep strength. During welding, this material is having tremendous change in its microstructure and hence mechanical property. Many research works were done in this area. This paper discusses weld ability of P91 material. Effect of different welding process, type of filler wire, its chemical composition and type of flux is discussed in this paper. PWHT is necessary after welding of P91 steel. PWHT temperature and its duration affects phase transformation and mechanical properties of weld metal, HAZ and parent metal. Major focus is given on hardness, creep resistance and notch toughness.

Keywords - P91, Welding, Microstructure, Toughness, Creep, Hardness, PWHT

-----***-----

1. INTRODUCTION

The major problem of steam power plant is its requirement of double heating of steam for produce steam of temperature above 600°C and 300 bar pressure. The CO₂ omission is the second big problem. So it is necessary to develop such a material which can produce steam at 500°C to 600°C temperature and pressure of 180 – 300 bar. Increase in thermal efficiency of material can reduce CO₂ emission by 20% due to reduce in fossil fuel consumption. For such application a material should have high strength at elevated temperature and good oxidation corrosion resistance at elevated temperature. This led to development of Cr-Mo martensitic steel with Cr 1 to 12%. Other element required to improve corrosion and creep resistance are Nb, V, Mo and W. This allows the operating temperature from 560°C to 650°C. For this 9Cr-1Mo-0.2V steel is very popular which is known as P91 steel [1]. P91 material is widely used in fabrication of process equipment for nuclear and steam power plant. P91 material is having very good creep resistance and corrosion resistance at elevated temperature. This material is having low thermal coefficient of expansion. The steel ASTM A335 Gr. P91 is a high-Cr martensitic heat-resistant steel and is applied particularly to large diameter thick-walled pipes in thermal power plants [2]. The chemical composition and mechanical properties of P91 material are in Table-1 & Table-2 [3][4]. Fig 1 shows microstructure of P91 steel [5].

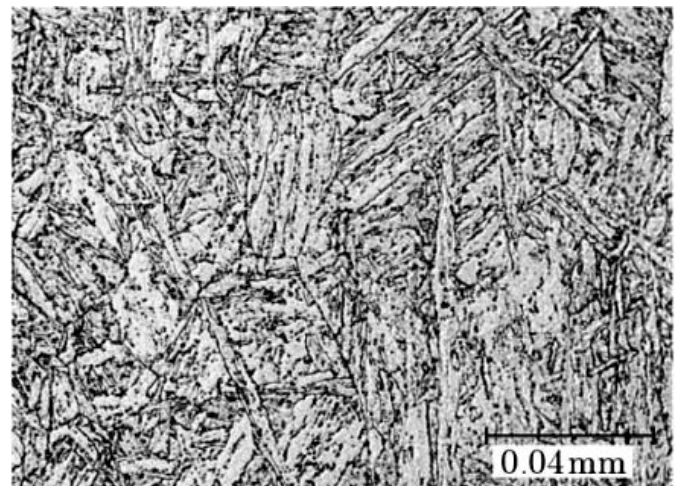


Fig.1 Microstructure of P91 steel, etched state (2% HNO₃+ ethyl alcohol), light microscope, magnification 500X [5]

2. WELDING OF P91 STEEL

2.1 Weldability P91 Steel:

P91 steel material is selected for its better creep resistance property at elevated temperature. But during welding this property is deteriorated. With increase in Cr % from 1 to 12% microstructure of weld metal and HAZ varies from ferritic to fully martensitic. Weld may also contain some amount of delta-ferrite. The weld joint becomes very hard. Preheating is not having that much influence on the weld joint hardness. Due to high harden ability of P91 steel weld joint makes it susceptible for cold cracking. So P91 steel weld joint needs a PWHT immediately after completion of welding [6]. PWHT is to be carried out at optimal temperature. For heavy thickness weld joint if PWHT is not done at optimal temperature, creep and creep resistance properties may

suffered. Air quenching of P91 is done to produce tempered martensite in combination with vanadium nitride, niobium carbonitride and $M_{23}C_6$ type carbide particles [7]. Composition of weld fusion zone is determined chemical composition of base metal, filler metal and percentage of dilution. Heat affected zone is adjacent to weld fusion zone which is having different micro structural and mechanical properties than base metal and weld metal. In creep rupture testing this HAZ fails at low stress level as type IV fracture. Softening zone and fine grain particle zone is having less creep resistance than the remaining base metal. So the weld joint becomes susceptible to premature type IV creep failure. A PWHT becomes helpful in improvement of weld joint from type IV failure [2][8][9]. It was observed that rupture location of weld joint of P91 steel shifted from weld metal at higher stress condition to fine grain HAZ adjacent to base metal zone at a lower stress condition [10].

2.2 Selection of Welding Process

Selection of welding process for P91 steel depends on welding position, plate thickness, filler metal, flux, shielding gas composition and PWHT temperature and duration. Following welding processes may be used [3]

- 1) GTAW
- 2) SMAW welding
- 3) MAG – welding massive wire
- 4) MAG – welding core wire
- 5) SAW
- 6) FCAW

If we compare welding of P91 steel by GTAW and SMAW process hardness of weld metal is more in case of GTAW but hardness of HAZ and base metal is less as compared to SMAW process. Fig-2 shows the hardness profile of weld joint by both processes [11][12]. By GTAW process toughness of weld metal can be achieved up to 220 J at 20°C because of high purity of microstructure and less content of absorbed oxygen into weld metal. GTAW process produce small weld bead. By SMAW toughness 50J to 95J at 20°C can be achieved after adequate PWHT. Therefore SMAW process can be used to achieve minimum toughness value 47 J specified by EN 1557 : 1999. By SAW process a wide and scattered range of weld metal toughness 35J to 70J at 20°C can be achieved. So this process can produce weld joint having some shortfall of requirement of 47 J. SAW process can be selected for achieving high productivity. By FCAW process toughness can be achieved up to 25J to 35J at 20°C. This is less than the required toughness of 47J. So satisfactory impact toughness can be achieved by PWHT at 760°C for 4 to 5 hours. In FCAW process content of oxygen weld metal may be upto 600 ppm to 1000 ppm. Due to this weld joint hardness increase and toughness decrease. To reduce oxidation silicon content increase up to 0.3% this tends to increase in δ -ferrite phase. A shielding gas Ar-CO₂ (80-20) to Ar-CO₂ (95-5) can be used. This improve toughness 10 % and reduce oxygen level less than 100 ppm. Table-3 shows the toughness requirement of P91 weld joint as per European specification BS EN 1599: 1997 [13].

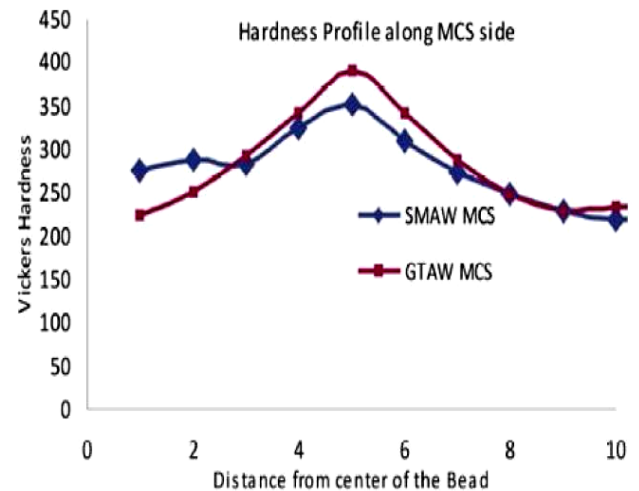


Fig-2 Hardness profile for SMAW and GTAW along medium carbon steel side [12]. The distance shown on the X-axis is in mm.

2.3 Consumable

A good quality P91 weld joint can be obtained only when proper chemical composition of weld metal is obtained. For SAW process basic flux is preferred over other types of flux to avoid contamination of molten weld metal by oxygen and nitrogen. For SMAW electrode selected for P91 steel is E-9015-B9-H4. It contains 0.08-0.13% C, 1.25 % Mn, 0.3% Si, 0.1 % S and P each, 1% Ni, 8-10.5% Cr, and 0.85-1.2% Mo. Additional elements are V, Cu, Al, Nb, and N in small amount. The welding polarity selected is DCEP. The main thing of this electrode is that it contains very low hydrogen less than 4 ml per 100 gms of weld metal. Backing of electrode is strongly recommended. Though P91 material is having hardening problem during welding, it is very highly susceptible for hydrogen induced crack (HIC) [14][15].

2.4 Welding Procedure

Generally P91 steel is welded with 400-550 F preheat and inter pass temperature. Weld joint is slowly cooled in air up to 200°F which is slightly less than M_f temperature 212°F. Then it is followed by PWHT. Care must be taken that austenite will transform to martensite before PWHT, otherwise it will transform in martensite after PWHT which makes weld joint hard and reduce its toughness. For automatic welding root run is welded with GTAW and followed by FCAW or SAW of getting high production rate. Welding of wide flat bead with slight weaving and high travel speed is selected. After welding dye penetrate test is done in same manner like with other material. But special attention is given to this material for its high HIC susceptibility. PWHT immediately is performed after welding [14][15]. Table-4 shows metal toughness and hardness obtained by welding from GTAW, SMAW, GTAW and GMAW processes [13].

3. POST WELD HEAT TREATMENT OF P91 STEEL

3.1 Post Weld Heat Treatment


After welding of P91 material PWHT is required without considering the thickness. It is very much essential part of fabrication process to obtain sound weld joint properties. For a small tubes PWHT is required at 750°C to 775°C for 2 hours holding time. Generally the soaking temperature for PWHT of P91 material is less than the lower critical temperature i.e. 788°C but due to error of operator or thermo couple if temperature goes above lower critical temperature than P91 material shows very erratic behavior. Above lower critical temperature martensite of P91 material once again convert in austenite and than during cooling it will convert in untempered martensite which is hard and brittle. In such case reheating is required. After welding the weld joint is cooled up to preheat temperature which is less than M_f temperature than heat treatment is done. Due to this austenite convert in martensite and this martensite will convert in tempered martensite during heat treatment. If the cooling temperature is reduced up to room temperature than all the austenite may convert in martensite but the problem of hydrogen induced cracking may observed. So it is not advisable. PWHT cycle may adopted for P91 steel shown in table - 5 [12][15][17][18].

Table –5 PWHT Cycle For P91 Material Heating Below A-1 Temperature


Sr No.	Description	Value
1	Heating rate	40 °C/hour
2	Soaking temperature	740 – 775 °C
3	Soaking time	2 – 8 hours
4	Cooling rate	80 °C / hour
5	Unloading temperature	300 °C

3.2 Effect of PWHT on Microstructure of P91 Steel:


Fig 3 (A),(B),(C),(D) shows the microstructure of P91 as unwelded base metal, as welded metal, after PWHT at 760°C for 3 hours and after PWHT at 760°C for 6 hrs[1].

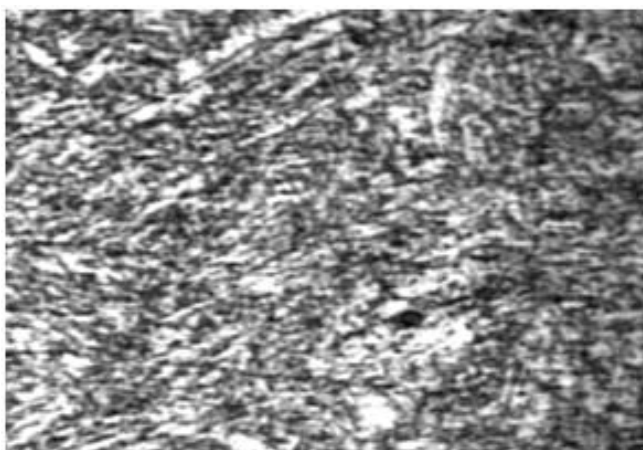


(A)

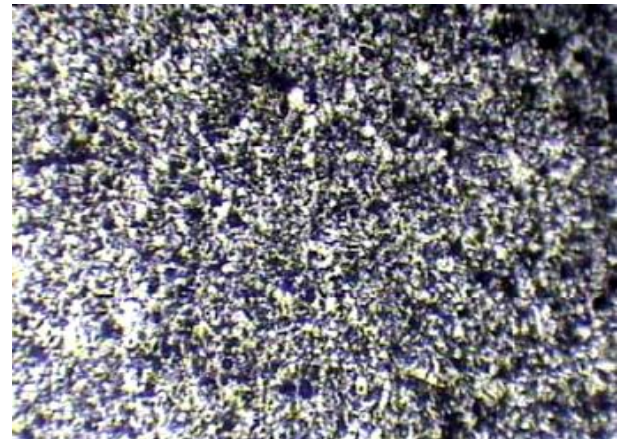

(B)

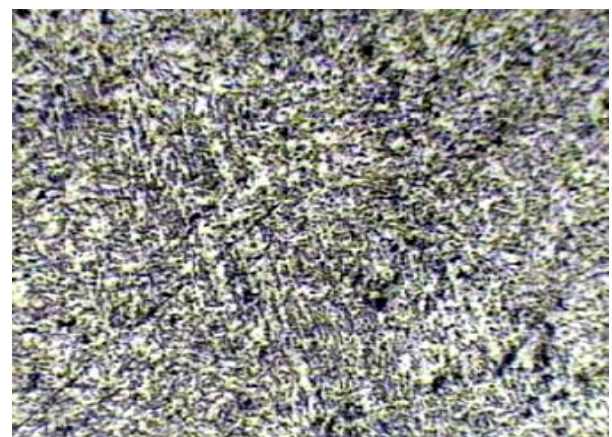

(C)

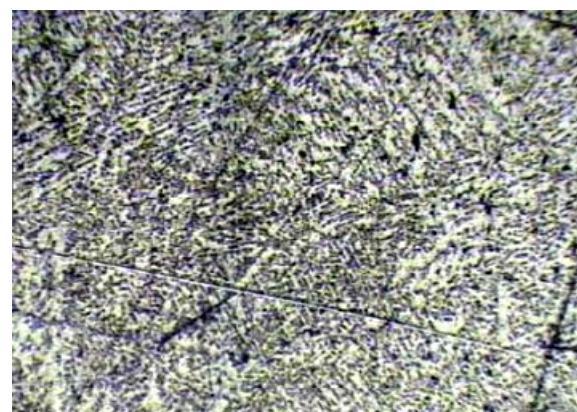

(D)

Fig.-3 Optical Micrograph of P91 weld joint [1].

From microstructure it is observed that in as received base metal P91 metal is having fully tempered martensite microstructure. After welding some ferrite flakes can be observed. After PWHT at 760°C for 3 hours the ferrite distribution in martensite becomes more uniform. This shows grain structure refinement. This will improve toughness of weld metal and HAZ [1][18].

3.3 Influence of δ -Ferrite Phase on P91 Weld Joint:

During welding of P91 material δ -ferrite phase is produced in the weld joint. Due to the presence of δ -ferrite phase, the toughness of the weld joint decreases. As per EN 1557 : 1999, the required toughness for the P91 weld joint for a successful hydro test is 47 Joules at room temperature of 20°C [19]. Weld toughness is influenced by the welding process, chemical composition of the filler metal, shielding gas used, PWHT temperature and duration. If the volume of δ -ferrite is increased above 2 %, the toughness is reduced significantly [20][21][22]. Fig. 4 shows the presence of δ -ferrite in the tempered martensite matrix of P91 as a welded joint [23]. FCAW welding with F4 type flux has a high silicon content compared to SMAW electrode. Silicon is a very powerful ferrite stabilizer. Due to this, δ -ferrite is more in the case of welding with FCAW. As the welded joint microstructure has a needle-like grain structure, the hardness of the joint increases and toughness is decreased. With an increase in PWHT duration, this grain structure changes and the quantities of precipitates increase, as shown in Fig. 5 [23]. The Scheider formula is used to calculate Cr_{eq} and Ni_{eq} is as under :

$$Cr_{eq} = Cr + 2Si + 1.5Mo + 5V + 1.75Nb + 0.75W \quad (1)$$

$$Ni_{eq} = Ni + 0.5Mn + 30C + 25N + 0.3Cu \quad (2)$$

$$\text{Ferrite factor} = Cr_{eq} - Ni_{eq} \quad (3)$$



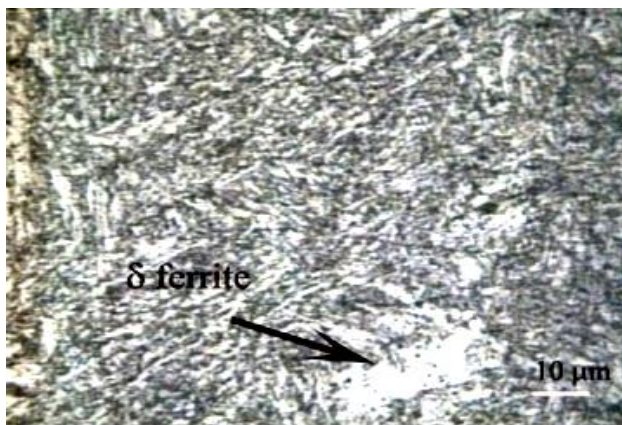


Fig. 4 Presence of δ -ferrite in tempered martensite matrix of P91 as a welded joint [23].

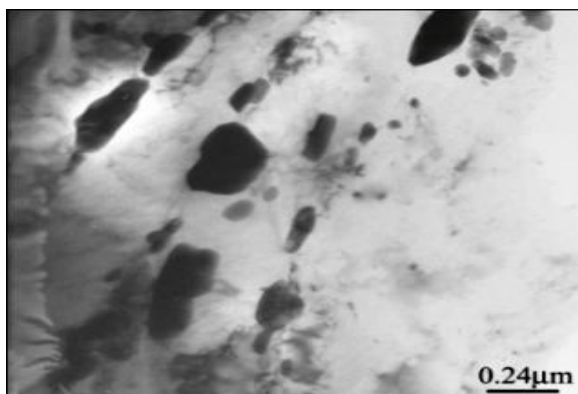

(a)

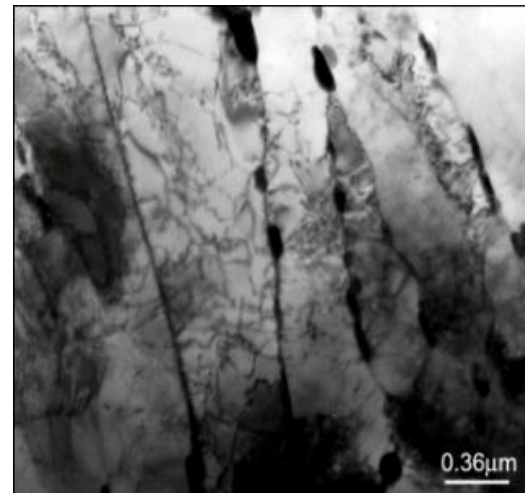

(b)

Fig. 5 Influence of PWHT duration on the microstructure of welds (a) 760°C for 2 hr (b) 760°C for 5 hr [23]

To obtain a fully martensitic microstructure, the value of Cr_{eq} is more than 13.5 and the difference between Cr_{eq} and Ni_{eq} is less than 8. V and Nb are reducing the toughness of the weld joint, and if they are present when welding with acidic flux, the toughness decreases more. To counterbalance it, PWHT duration is to be increased. In an acidic flux system, microinclusions are more and coarser ($>5\mu m$) compared to a basic flux inclusion system ($<5\mu m$). The coarser microinclusions behave like needles and, in connection with V + Nb, reduce the toughness of the weld. So, an acidic flux system can incorporate the V + Nb up to 0.18 % wt. maximum compared to a basic flux system 0.31 % wt. V + Nb and flux system have a more significant effect on P91 weld joint toughness (47 Joules) compared to the ferrite factor. With an increase in PWHT temperature and duration, the δ -ferrite phase is decreased [23].

4. EFFECT OF WELDING AND PWHT ON MECHANICAL PROPERTIES

4.1 Hardness:

The hardness of the HAZ of the P91 weld joint is over 350 Hv. This hardness level is the limiting hardness value for most of the carbon steel. The reasons for this high hardness of the weld joint is the presence of alloying elements and the formation of martensite in the weld metal and HAZ. At this high hardness, if hydrogen is dissolved in the weld metal, it can produce hydrogen-induced cracks. After PWHT at a temperature of 750°C, the hardness of the weld joint is reduced. With an increase in PWHT duration from 2 hours to 6 hours, the hardness of the P91 weld metal and HAZ is reduced due to phase transformation from martensite to ferrite [18]. As shown in Fig. 6, with an increase in PWHT temperature, the hardness of P91 steel is decreased, but its rate of decrease in hardness is reduced as the temperature increases from 750°K to 1040°K for 1 hr [12].

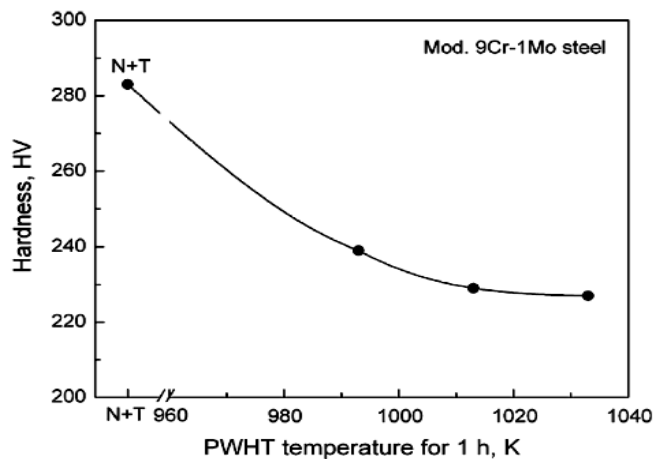


Fig.6 Relation between PWHT temperature and hardness [12]

4.2 Creep

Many power plant pipes are failed in services due to creep at high temperature. In pipes working at high pressure and temperature in power plant, type IV cracks due to creep develop in HAZ. During creep test of P91 pipe welded joint at 625°C, it was observed that type IV creep crack was produced in the HAZ low temperature zone near the parent metal. Thus by making HAZ properties uniform and matched with parent metal the type IV creep failure can be reduced [24]. With increase in PWHT from 600°C to 760°C temperature, minimum and average creep rate is increased. After rise in PWHT temperature above 820°C minimum and average creep rate is sharply increased. With increase in PWHT temperature from 600°C and duration 2 hrs to 840°C and duration 8 hrs creep rate increased and creep resistance decreased [2]. If weld joint is normalized and cooled up to 200°C then tempered, it has lowest creep rate [17].

4.3 Toughness

Impact toughness of P91 material is very much required for applying hydrostatic pressure. In power generation plant high pressure steam is essential at above 600°C. Impact toughness of P91 weld metal is decreased very rapidly in as welded condition. This shortfall can be improved by PWHT. Applying PWHT at 760°C for 3 hours can improve toughness equal to base metal. With increase in PWHT duration impact toughness is increased further. Fig-7 shows the effect of PWHT on impact toughness [1].

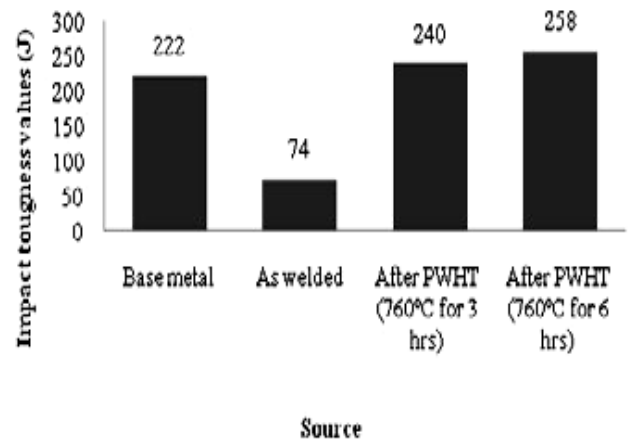


Fig.- 7 Effect of PWHT on impact toughness [1].

5. CONCLUSION

After review of work of many researcher in the field of welding and PWHT of P91 steel following conclusions have been obtained :

1. Welding process and selection of consumable affects the microstructure and mechanical properties of P91 steel.
2. PWHT is necessary to improve microstructure and mechanical properties of P91 steel. It produce more homogeneous microstructure in weld metal and HAZ. It reduce crack susceptibility of weld metal.
3. With increase in PWHT temperature and duration tempering of P91 steel occurred. So tempered martensite is produced. Due to it hardness, tensile strength are decreased and ductility, impact toughness above 47 J are increased.
4. If PWHT temperature increases than lower critical temperature, creep strain rate and creep ductility increases and rupture time decreases. Rupture location moves towards weld fusion zone. Precipitation and growth of carbide particles increases with increase in PWHT temperature above A1 line. δ -ferrite phase increase with increases in PWHT temperature so creep resistance and toughness both are decreased. Re-tempering decreases creep rate.
5. Increasing number of cycle of PWHT does not give any significant benefit on mechanical properties of P91 weld metal. Only PWHT cycle with appropriate soaking temperature and duration is sufficient.
6. PWHT at 750°C is best suited for maintaining uniform hardness of base metal, HAZ and weld metal. It neither increases hardness of weld metal nor softness of base metal.

REFERENCES

- [1] Devinder Pal Singh, Mithlesh Sharma, Jaspal Singh Gill, "Effect of Post Weld Heat Treatment on the Impact Toughness and Microstructural Property", IJRMET Volume-3, Issue- 2, May – Oct-2013, pp 216-219.

- [2] Dr. Leijun Li, "Effect of Post-Weld Heat Treatment on Creep Rupture Properties of Grade 91 Steel Heavy Section Welds", Mechanical & Aerospace Engineering, Utah State University (435)797-8184, 2012.
- [3] Material data sheet, editor Thyssenkrupp Materials International GmbH, Technical Sales / Quality_Management, Am Thyssenhaus 1.
- [4] ASME sec II-A, Boiler And Pressure Vessel Code, Ferrrous Material Specification, SA 335 / SA 335M, pp 573 -584.
- [5] Katarzyna Makowska , Zbigniew L. Kowalewski, Boleslaw Augustyniak, Leszek Piotrowski "Determination Of Mechanical Properties Of P91 Steel By Means Of Magnetic Barkhausen Emission", Journal Of Theoretical And Applied Mechanics, Warsaw. Volume-52, Issue-1, 2014, pp. 181-188.
- [6] "Welding Technology For Engineers", Editors : Baldev raj, V Shankar & A. K. Bhaduri, Narosa Publishing House, third reprint – 2009, pp 22-36.
- [7] Hattestrand, M., and Andren, H., 2001, "Evaluation Of Particle Size Distributions Of Precipitates In A 9% Chromium Steel Using Energy filtered Transmission Electron Microscopy", Micron, Volume-32, pp 789-797
- [8] Newell, N., 2007, "Guideline for Welding Creep Strength-Enhanced Ferritic Alloys", EPRI, March 2007.
- [9] Tabuchi, M., et al, 2001, "Creep Crack Growth Behavior In The HAZ Of Weldment Of W Containing High Cr Steel", Intl J. Pressure Vessels and Piping, Volume-78, pp 779-784.
- [10] Watanabe, T.,M. Tabuchi, M. Yamazaki, T. Tanabe and H. Hongo , "Creep Damage Evaluation Of 9Cr-1Mo-V-Nb Steel Welded Joints Showing Type IV Fracture", Intl. J. Pressure Vessels and Piping, 83, 2005, pp 63-71.
- [11] Husnain Shabir, Khalid. H. Hashmi, Ghulam Zakria, Shahid Khalil, Mahboob Alam and Muhammad Farooq, "Characterization Of Dissimilar Alloys Welding Techniques With Enhanced Galvanic Corrosion", World Applied Sciences Journal, 29, 2014, pp. 89-95.
- [12] Jonas Ohlsson, "Effects of different heat treatments on hardness of Grade 91 steel", karlstand Univeristy, 2014.
- [13] Z Zhang*, J C M Farrar* and A M Barnes**, "Weld Metals for P91 – Tough Enough?", * Metrode Products Limited, U.K,**TWI Ltd., U.K.
- [14] Siddharth Pant and Swati Bhardwaj, "Properties and Welding Procedure for Grade 91 Alloy Steel", International Journal of Engineering Research and Technology, Volume 6, Number 6 (2013), pp. 767-772.
- [15] Sperko Engineering Services, Inc. " Welding "Grade 91" Alloy Steel", May, 2007, pp 1-5.
- [16] B.K. Choudhary, J. Christopher, D.P. Rao Palaparti, E. Isaac Samuel, M.D. Mathew, "Influence of temperature and post weld heat treatment on tensile stress-strain and work hardening behaviour of modified 9Cr-1Mo steel", Materials and Design, Volume-52, 2013, pp. 58-65.
- [17] M. L. Santella, R. W. Swindeman, R. W. Reed and J. M. Tanzosh, "Martensite formation in 9 Cr-1 Mo steel weld metal and its effect on creep behavior",Oak Ridge National Laboratory, Oak Ridge, Tennessee 37831, Babcock & Wilcox Company, Barberton, Ohio 44203.
- [18] Nattaphon TAMMASOPHON, Weerasak HOMHRAJAI, Gobboon LOTHONGKUM, "Effect of Postweld Heat Treatment on Microstructures and Hardness of TIG, Weldment between P22 and P91 Steels with Inconel 625 Filler Metal " Journal of Metals, Materials and Minerals, Volume-21, Issue-1, pp.93-99, 2011.
- [19] E. L. Bergquist, Consumables And Welding Modified 9Cr-1 Mo Steel. Svetsaren, (1 -2), 1999, 2 -5.
- [20] M. Sireesha, S. K. Albert, and S. Sundaresan, "Microstructure And Mechanical Properties Of Weld Fusion Zones In Modified 9Cr-1 Mo Steel". Journal of Materials Engineering Performance, Volume-10, Issue- 3, 2001, 320 - 330.
- [21] J. Onoro, "Martensite Microstructure Of 9 - 12% Cr Steel Weld Metals", Journal of Materials Processing Technology, Volume-180, 2006, pp-137 -142.
- [22] Barnes, "The Influence Of Composition On Micro Structural Development And Toughness Of Modified 9%Cr-1 Mo Weld Metals", TWI report, 509/ 1995, 1995.
- [23] B. Arivazhagan, M. Kamaraj, "A Study On Influence Of D-Ferrite Phase On Toughness Of P91 Steel Welds", White Paper, Steel-Grips.Com 2013, pp.19-24.
- [24] T.H. Hyde, A.A. Becker, W. Sun, A. Yaghi, J.A. Williams and S. Concari, "Determination Of Creep Properties For P91 Weldment Materials At 625", 5th International Conference on Mechanics and Materials in Design, Porto-Portugal, 24-26 July 2006, pp 1-13.

BIOGRAPHY



Samir Y. Merchant is working as a senior lecturer in Fabrication Technology Department, Sir Bhavsinhji Polytechnic Institute, Bhavnagar, Gujarat, India since 2004. He obtained M.E. Mechanical Engineering (Production Engineering) from M.S. University, Vadodara with First Rank in 2010.

Table -1 Chemical Composition Of P-91 Material

Element	C	Si	Mn	P	S	Al	Cr	Mo	Ni	V	N	Nb
Percent	0.08-0.12	0.2-0.5	0.3-0.6	≤0.02	≤0.01	≤0.04	8-9.5	0.85-1.05	≤0.4	0.18-0.25	0.03-0.07	0.06-0.1

Table-2 Mechanical Properties Of P-91 Material

Yield strength	Tensile strength	Elongation	Impact energy at 20 C	Hardness HRC
415 N/mm ²	≤ 585 N/mm ²	20%	220 J	25

Table-3 Mechanical Property Requirements for Weld Metals of Various Specifications for P91 Material [13]

Type	Specification	Shielding Gas	Tensile strength MPa	Yield strength at 0.2% Offset MPa	Elongation n %	Toughness requirement @20°C Avg/Min. J	Preheat and interpass temperature, °C	Postweld condition	PWHT procedure
Parent steel	Type-91		585-850	415	20	(>41)			730-780 °C
Covered electrode	BS EN 1599:1997; ECrMo91B		585	415	17	47/38 ^a	200-300	PWHT	750-770 °C 2 to 3 hrs
Solid wire	Pr EN 12070:1996; CrMo91		585	415	17	47/38 ^a	250-350	PWHT	750-760 °C 3 hrs
Covered electrode & solid wire	GEC- Alsthom 30/658		No mechanical property specified, but expected to exceed the parent steel properties					PWHT	
Covered electrode	AWS A5.5-96 E90XX-B91		620	530	17	Not specified ^b	232-288	PWHT	730-760 °C 1 hrs
Solid wire	AWS A5.28-96 ER90S-B9	Argon ^c 5% O ₂	620	410	16	Not specified ^b	150-260	PWHT	730-760 °C 1 hrs

a: Minimum average from three test specimens and only one single value lower than minimum average is permitted.
b: AWS does not specify impact requirements for E90XX-B9 or ER90S-B9, but the non-mandatory appendices to A5.5-96 and A5.28-96 propose that a test criterion should be agreed by the purchaser and supplier.
c: Other gas mixture can be used as agreed between the purchaser and supplier.

Table-4 Weld Metal Toughness And Hardness Properties Of Various Processes [13]

Process	Consumable type	Size, mm	Typical impact energy at ambient temperature, J	Typical lateral expansion at ambient temp. mm	Typical hardness, HV (10Kg)
GTAW	Solid wire	2.4	100-240	2.0-2.5	240-260
	MCW	1.2	100-150	1.8-2.1	240-260
SMAW	Covered electrode	2.5, 3.2, 4.0, 5.0	30-90	0.7-2	230-250
SAW	Solid wire	2.4	30-70	0.5-1.0	240-260
	MCW	1.6	25-70	0.4-0.8	240-260
GMAW	FCW	1.2	10-40	0.15-0.6	230-270
	MCW	1.2, 1.6	30-40	0.4-0.5	240-260

PWHT – 755-760°C x 2 – 5 hours followed by furnace cool.
MCW – Metal Core Wire
FCW – Flux Core Wire