

Advancement on Thermal Comfort in Educational Buildings Current Issues and Way Forward

Lamberti, Giulia ; Salvadori, Giacomo ; Leccese, Francesco ; Fantozzi, Fabio ; Bluysen, P.M.

DOI

[10.3390/su131810315](https://doi.org/10.3390/su131810315)

Publication date

2021

Document Version

Final published version

Published in

Sustainability

Citation (APA)

Lamberti, G., Salvadori, G., Leccese, F., Fantozzi, F., & Bluysen, P. M. (2021). Advancement on Thermal Comfort in Educational Buildings: Current Issues and Way Forward . *Sustainability*, 13(18), [10315].
<https://doi.org/10.3390/su131810315>

Important note

To cite this publication, please use the final published version (if applicable).
Please check the document version above.

Copyright

Other than for strictly personal use, it is not permitted to download, forward or distribute the text or part of it, without the consent of the author(s) and/or copyright holder(s), unless the work is under an open content license such as Creative Commons.

Takedown policy

Please contact us and provide details if you believe this document breaches copyrights.
We will remove access to the work immediately and investigate your claim.

Review

Advancement on Thermal Comfort in Educational Buildings: Current Issues and Way Forward

Giulia Lamberti ^{1,*}, Giacomo Salvadori ¹, Francesco Leccese ¹, Fabio Fantozzi ¹
and Philomena M. Bluysen ²

¹ School of Engineering, University of Pisa, 56122 Pisa, Italy; giacomo.salvadori@unipi.it (G.S.); francesco.leccese@unipi.it (F.L.); fabio.fantozzi@unipi.it (F.F.)

² Faculty of Architecture and the Built Environment, Delft University of Technology, 2628 Delft, The Netherlands; P.M.Bluysen@tudelft.nl

* Correspondence: giulia.lamberti@phd.unipi.it

Abstract: The thermal environment in educational buildings is crucial to improve students' health and productivity, as they spend a considerable amount of time in classrooms. Due to the complexity of educational buildings, research performed has been heterogeneous and standards for thermal comfort are based on office studies with adults. Moreover, they rely on single dose-response models that do not account for interactions with other environmental factors, or students' individual preferences and needs. A literature study was performed on thermal comfort in educational buildings comprising of 143 field studies, to identify all possible confounding parameters involved in thermal perception. Educational stage, climate zone, model adopted to investigate comfort, and operation mode were then selected as confounding parameters and discussed to delineate the priorities for future research. Results showed that children often present with different thermal sensations than adults, which should be considered in the design of energy-efficient and comfortable educational environments. Furthermore, the use of different models to analyse comfort can influence field studies' outcomes and should be carefully investigated. It is concluded that future studies should focus on a more rational evaluation of thermal comfort, also considering the effect that local discomfort can have on the perception of an environment. Moreover, it is important to carefully assess possible relationships between HVAC systems, building envelope, and thermal comfort, including their effect on energy consumption. Since several studies showed that the perception of the environment does not concern thermal comfort only, but it involves the aspects of indoor air, acoustic, and visual quality, their effect on the health and performance of the students should be assessed. This paper provides a way forward for researchers, which should aim to have an integrated approach through considering the positive effects of indoor exposure while considering possible individual differences.

Keywords: thermal comfort; indoor environmental quality; educational buildings; energy consumptions; local discomfort



Citation: Lamberti, G.; Salvadori, G.; Leccese, F.; Fantozzi, F.; Bluysen, P.M. Advancement on Thermal Comfort in Educational Buildings: Current Issues and Way Forward. *Sustainability* **2021**, *13*, 10315. <https://doi.org/10.3390/su131810315>

Academic Editors: Mitja Košir and Manoj Kumar Singh

Received: 27 July 2021

Accepted: 9 September 2021

Published: 15 September 2021

Publisher's Note: MDPI stays neutral with regard to jurisdictional claims in published maps and institutional affiliations.



Copyright: © 2021 by the authors. Licensee MDPI, Basel, Switzerland. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

1. Introduction

Students spend a good part of the day in schools, and, especially when considering children, they are particularly exposed to an unfavourable indoor environmental quality (IEQ) [1]. Therefore, the relations between classroom characteristics and comfort should be carefully investigated [2]. As the aim of educational buildings is to provide the best learning conditions for students and teachers [3], classrooms should be designed to improve concentration and to stimulate the learning process [4–6], but also be climate-responsive [7]. Since the thermal environment can largely affect students' wellbeing, it is also fundamental to ensure thermal comfort in classrooms to improve students' health and productivity [8].

For the assessment of thermal comfort, several indices have been developed [9], but Fanger's rational (or heat-balance) [10] and the adaptive models [11–13] are the most commonly used. Indeed, it is necessary to raise questions regarding students' possibility

to adapt, as at different educational levels adaptation may differ, and, especially at low educational levels, teachers are the only ones who can actively modify the thermal environment [14]. Nevertheless, it should be noted that children and adults do not always have the same thermal perception, therefore pupils' preference on the thermal environment should be considered, as it could help to co-design classrooms [15]. Furthermore, in educational buildings, different activities are carried out, which can influence the thermal comfort evaluation especially at a high metabolic rate [16].

In educational buildings, the duration of field studies varied largely from less than a week to a whole year [17], and they were performed according to three classes [18]: (i) Class III, based on measurements of indoor temperature and humidity at a certain height; (ii) Class II, including field measurements of the six basic parameters in one location at a certain height; (iii) Class I, comprising the measurement of all the environmental parameters at three different heights (0.1, 0.6, 1.2 m) to evaluate local discomfort. Most studies in schools were performed according to Class II [17], while Class III was used for investigations of the adaptive model [19,20]. Only a few papers have been based on Class I [21–24], and in these cases draught, radiant asymmetry, vertical air temperature difference, and floor temperature were measured [22,25,26]. Alternatively, other IEQ aspects were included in the investigation, such as CO₂ concentration [4,27,28] or other factors of IEQ, such as noise level [29–31] or illumination level on the work plane [32–34]. Furthermore, as the goal for the buildings of tomorrow is to combine the aspects of energy efficiency and comfort [35], studies were also focused on the impact of thermal comfort on energy efficiency [22,36]. Indeed, due to the complexity of the parameters that influence buildings' performance and indoor environment, it is crucial to focus on the aspects that contribute to determining the health and wellbeing of the occupants, also in relation to architectural and HVAC system design, towards a multi-objective approach to building performance.

The measurement of environmental parameters has been often combined with subjective measurement, which consisted of various types of questionnaires [17]. The first ones included questions regarding thermal sensation and preference, while recent studies also include the evaluation of local thermal comfort, humidity sensation and preference, air velocity sensation and preference, personal regulation, preferred adaptive strategies, information on the clothing worn, and the activity performed prior to the survey [25,37,38]. Simplified questionnaires for children were also provided, to ensure the correctness of the collected data [39,40]. Recently, questionnaires have also included aspects of health and performance of students [6,41,42]. Both longitudinal and transversal surveys were used by researchers, but it was never defined how long the survey should be and how many respondents are necessary for the evaluation of thermal comfort in educational buildings [17,43].

Given the complexity of these environments, there is a lack of standards dealing with thermal comfort in educational buildings, as current regulations such as ISO 7730 [44], ASHRAE 55 [45], and EN 16798-1 [46] seem to be not sufficient to provide comfortable conditions for students and teachers. Indeed, these standards refer to data recorded in laboratories [44] or field studies using comfort data recorded on healthy adults in buildings across the world [11,13], which do not take into account student and teacher individual preferences. Indeed, standards were often developed for environments such as offices, thus, they do not include the peculiarities of educational buildings and they are often based on dose-response models that are not able to explain people's individual preferences and needs.

In conclusion, thermal comfort in educational buildings has been largely investigated and there are many models and indices that have been used with this purpose. However, there are still problems that should be solved, which do not emerge clearly due to the rapid growth of scientific literature. Studies have been often carried out based on the experience of single researchers, rather than adopting a coordinated effort of predetermined directions to develop consistent solutions and guidelines. There is then the need for a collection, a rationalised classification, and analysis of these studies to inspect the present state, aimed

at identifying the current issues and to guide future research towards solutions to such problems. This paper aims at filling this gap, highlighting the current issues in thermal comfort studies, and proposing new directions for research with the purpose of integrating the interactions between humans and the environment.

2. Methods

2.1. Search Strategy

The literature search was performed on the electronic databases Scopus, ScienceDirect, Google Scholar, and Researchgate in the period from March to November 2020. The search keywords used in the databases were {"thermal comfort"} AND {"classroom" OR "class" OR "educational buildings"}, using an integrated search in the title, keywords, and abstract of the papers. Moreover, the selected references were analysed individually to extract relevant information. The following inclusion criteria were selected: (i) original peer-reviewed articles; (ii) field studies investigating thermal comfort and related aspects of IEQ in educational buildings; (iii) full text published in English. Exclusion criteria were: (i) studies not focused on building engineering (e.g., articles focused on physiological or psychological aspects only); (ii) articles investigating energy consumptions only; (iii) simulation studies which did not include field measurements; (iv) books, book chapters, and conference reviews. Review articles were inspected, but not included in the classification of the studies in educational buildings.

Thanks to the possibility to analyse the number of resulting articles, Scopus was used as the primary database to continue this review. From the initial search using the selected keywords, 958 documents were extracted, and following removal of the ones without an English full-text, 916 articles remained. Of these, 445 were research articles, 409 conference papers, 27 were reviews, 18 book chapters, 2 books, and 15 conference reviews. In total, 854 papers (research and conference articles) were then analysed, as well as the 27 review articles. From the title and abstract inspection, the final number of articles considered was 143. Figure 1 shows the geographical distribution of thermal comfort studies in educational buildings, while Figure 2 shows the increase in thermal comfort studies in educational buildings over time.

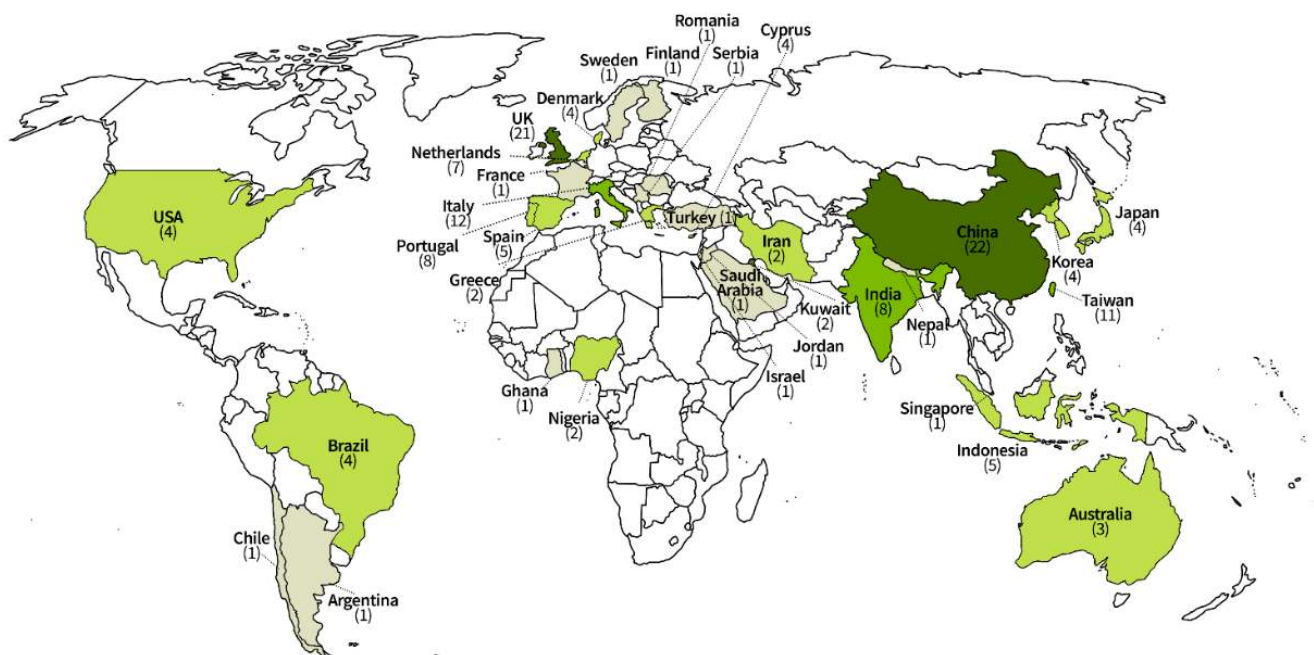


Figure 1. Geographical distribution of the studies on thermal comfort in educational buildings over time.

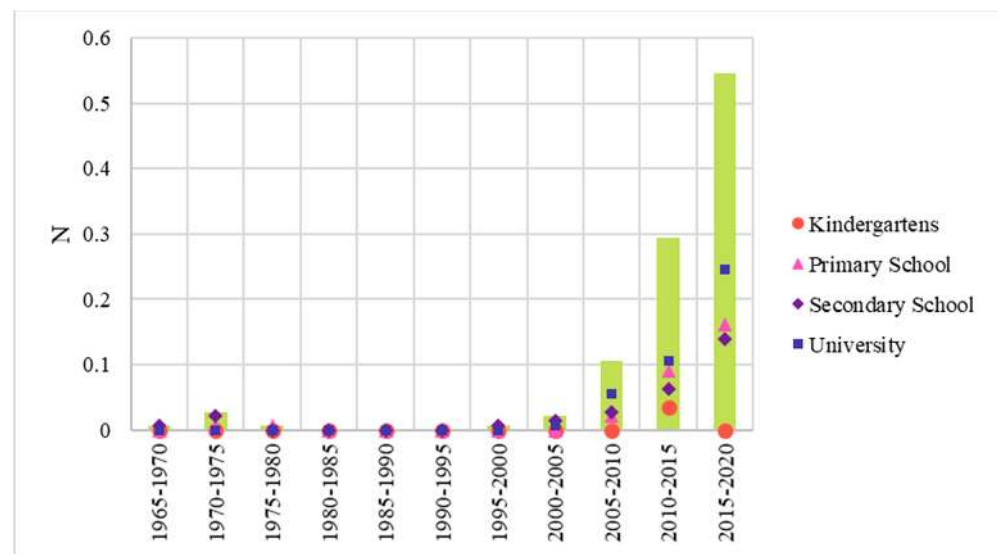


Figure 2. Normalized number of studies (N) on thermal comfort in educational buildings. The normalization is done with respect to the total number (143) of considered publications.

2.2. Data Extraction and Analysis

Data were extracted from the selected articles, analysing the full text. For the discussion, the year, location of the study, educational stage, climate zone, model used to determine thermal comfort, building's operation mode, and period of the survey were derived, when available. These characteristics were selected because they can possibly explain individual differences in thermal perception. From the analysis of the existing literature, the current issues were identified, and new directions of research were proposed (Figure 3).

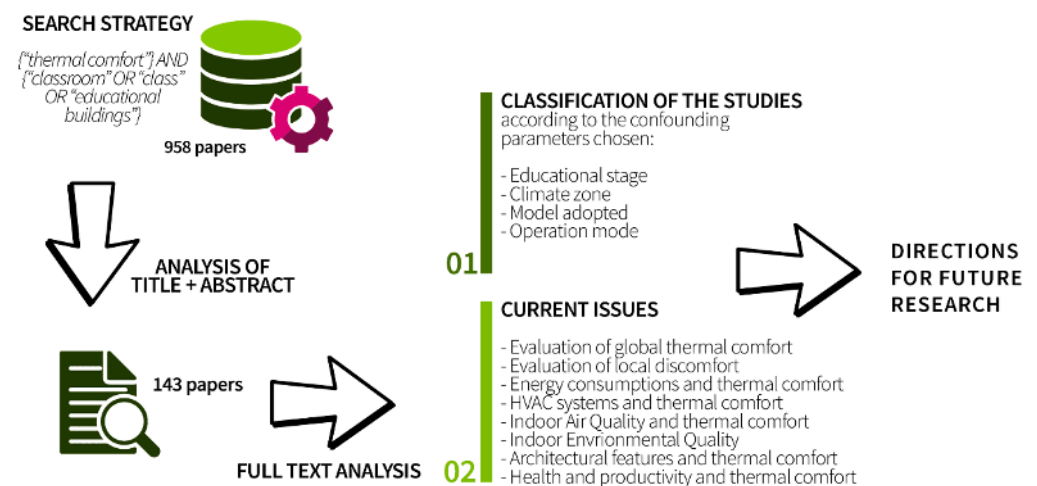


Figure 3. Methodology and supporting material used to define the directions for future research.

3. Classification of the Studies

By conducting a detailed analysis of the obtained results, it was possible to identify the main categories in which the studies, currently present in the literature, can be grouped. The investigation was based on manual grouping, which was conducted after an accurate inspection of the full text of the selected papers. It resulted that there were four main confounding parameters often identified by researchers as the main causes of differences in thermal sensations among students: the educational stage, climate zone, the model adopted, and operation mode. Table 1 shows the variability of comfort temperatures between the different categories found in the analysed studies. The influence of these

confounding parameters on the thermal perception and the results of the analysis are discussed below.

Table 1. Variability of comfort temperatures between the different categories found in the analysed studies. The number of papers considered are reported in the parenthesis. Data extracted from [47].

| Characteristics | | Comfort Temperature | |
|-------------------|---------------------------|---------------------|----------|
| | | Min (°C) | Max (°C) |
| Educational stage | Kindergarten (4) | 20.7 | 26.0 |
| | Primary school (40) | 14.7 | 30 |
| | Secondary school (39) | 14.7 | 35 |
| | University (60) | 15.5 | 31.5 |
| Climate zone | Group A (21) | 20.0 | 31.0 |
| | Group B (13) | 14.7 | 25.0 |
| | Group C (97) | 14.7 | 35.0 |
| | Group D (12) | 16.0 | 26.0 |
| Model adopted | Rational (38) | 15.0 | 30.7 |
| | Adaptive (23) | 14.7 | 29.2 |
| | Both (34) | 16.0 | 31.0 |
| | Others (48) | 14.7 | 35.0 |
| Operation mode | Air conditioned (38) | 14.7 | 26.9 |
| | Naturally ventilated (51) | 14.7 | 31.5 |
| | Mixed mode (45) | 15.7 | 30.0 |

3.1. Educational Stage

The educational stage is the most important aspect that should be evaluated when considering thermal comfort in educational buildings. At different educational stages, students present various ages, diverse possibilities to adapt, and carry out different activities, which can influence their metabolic rate and their capability to respond correctly to questionnaires regarding thermal sensation and preference. Indeed, the age can be a crucial factor for the perception of the thermal environment, also due to the different physiological and psychological characteristics of the pupils. Furthermore, the presence of outdoor activities and stationary or transient conditions, which are determined by the duration of lectures, is also a function of the educational stage. Finally, the density of the classroom can also affect the perception of the thermal environment. Most studies were carried out in universities, followed by secondary and primary schools, and kindergartens (Figure 4).

The evaluation of thermal comfort in kindergartens is a recent topic, developed for the first time in 2012 [48], and only a few works can be found in the literature. The focus of previous studies was mostly on the development of new comfort models for the children, both rational [49] and adaptive [50]. Since children at that age do not present with reading or writing skills yet, researchers also aimed at creating a specific questionnaire for thermal comfort assessment [51]. Studies indicated that pre-school children present comfort temperatures 0.5 °C lower in summer and 3.3 °C in winter [52].

In primary schools, the first work on thermal comfort dates back to 1975 [19], which estimated thermal neutrality from over 6000 assessments obtained. At this educational stage, in most cases children prefer cooler environments, showing that the PMV model underestimates mean thermal sensation up to 1.5 scale point [53], and children present comfort temperatures about 4 °C to 2 °C lower than the predictions from rational and adaptive models, respectively [54]. It is also important to highlight the differences between

children's and teachers' thermal sensation [55], as it is more difficult to reach thermal comfort for pupils. Indeed, children present with a lower comfort temperature [56], at least 3 °C lower than adults during cooling seasons [57], and they are also less sensitive to temperature changes than adults [11]. This different perception can be attributed to children's higher metabolic rate, as their activities involve several games including physical exercise, as well as their limited possibility to adapt [52], the influence of the characteristics of their home environments, and outdoor playing, which may alter their thermal perception [47]. It was also demonstrated that social background and behaviour can influence children's thermal preference [58]. Furthermore, thermal comfort models seem to predict inaccurately the thermal sensation of pupils, as the PMV index usually overestimates the perception of scholars, while the adaptive model predicts higher comfort temperatures than the actual ones [59–61].

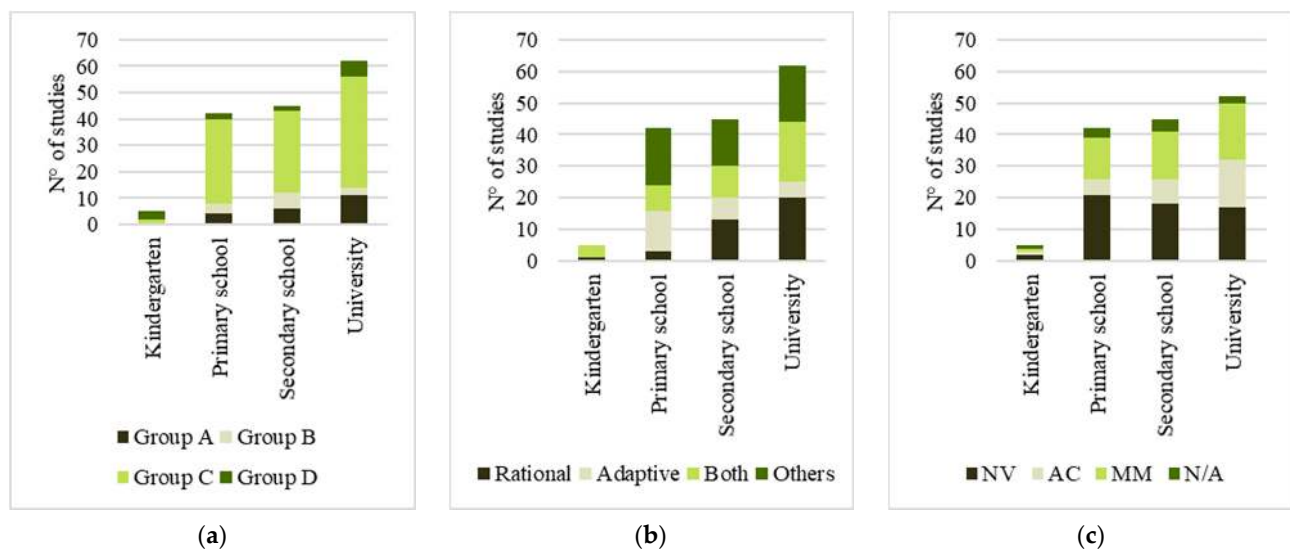


Figure 4. Number of studies divided according to the educational stage in different climate zones (a), the model adopted (b), and operation mode (c). Legend: NV = naturally ventilated, AC = air-conditioned, MM = mixed-mode, N/A = not available.

In secondary schools, students can give more reliable information on their thermal state and preference, therefore it is easier for researchers to compare their subjective response to the objective analysis. At this educational stage, several studies showed differences in thermal sensations and neutral temperatures despite the climate, season, and operation modes being the same [17], which can be a specific problem when trying to set the comfort temperatures for the achievement of students' wellbeing. For example, children preferred cooler environments than adults [62–64] even in the tropics [65], and thermal preference changed during summer months [66]. Moreover, students generally accepted cool thermal sensations faster than warm thermal sensations [67]. In the past, more emphasis has been given to the importance of energy savings rather than learning conditions [68,69], therefore there are gaps in the literature considering the improvement of students' performance in relation to the indoor environmental conditions. For air-conditioned buildings, there is evidence that HVAC systems do not always enhance comfort, but they may also be a cause of global and local thermal discomfort [70].

In universities, students have a greater possibility to adapt, and they may be in transient conditions since the duration of the lectures is shorter than at other educational stages. However, even though Fanger's theory was based on experiments carried out on university students, researchers found some divergencies between the predicted thermal sensation obtained with PMV and the real thermal sensation from questionnaires. This can be attributed to several problems related to students' possibility to adapt, adjusting their clothing [24,38,71], or controlling the environment [38,71,72]. Even psychological adaptation can play a fundamental role in adapting to the thermal environment [24].

Furthermore, students may be in transient conditions, as the time they remain in the classroom is limited and they often move outdoors. Differences in neutral temperatures were found in laboratories and classrooms [73,74], in different seasons [23,75,76], and due to gender differences [77].

3.2. Climate Zone

The classification per climate zone is relevant, since different climatic conditions can influence the thermal perception and preference of students due to adaptive processes. Considering that thermal history can affect students' thermal comfort [78], the classification per climate zone is relevant in the perspective of improving environmental conditions and reducing energy consumptions in the global warming era. Indeed, the current challenge for building designers is to provide low-energy buildings while enhancing thermal comfort, especially under warmer conditions caused by climate change [79]. According to the Köppen–Geiger climate classification [80], there are five different climate groups (from A to E), divided according to the seasonal precipitation and temperature patterns. The climate zone can influence students' possibility to acclimatise, influences the indoor environment from the outdoor conditions, but also affects the thermal insulation of the clothing worn by students. Most studies have been carried out in the climate Group C, as can be noticed in Figure 5.

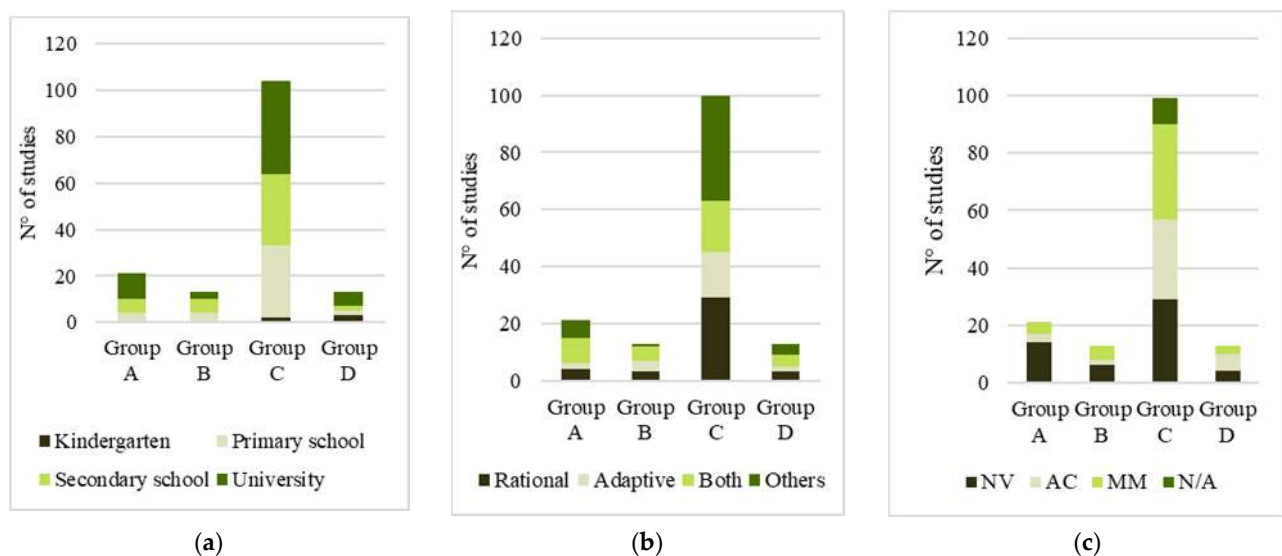


Figure 5. Number of studies divided according to the climate zone at different educational stages (a), model adopted (b) and operation mode (c). Legend: NV = naturally ventilated, AC = air-conditioned, MM = mixed-mode, N/A = not available.

Group A includes the tropical climates and about 15% of the studies (22 studies) were carried out in this climate, mostly in naturally ventilated classrooms, applying both rational and adaptive models (Figure 5). Studies were carried out in India, Brazil, Indonesia, Malaysia, Singapore, Nigeria, USA, and Ghana, as reported in Appendix A. In Group A, the range of comfort temperature varied between 20.0 °C and 31.0 °C, indicating large differences in the same climate zones [17], which makes the comparison of neutral temperatures difficult. In Group A, students had a higher heat tolerance and they adapted to the thermal environment, while the temperatures largely exceeded the comfort range given by the standards [17]. These facts are particularly relevant, as they can have a consistent impact on energy conservation strategies, although some studies show that in the past twenty years the comfort temperature has decreased due to the increasing use of air conditioners [81].

Group B includes dry (arid and semi-arid), hot, and cold climates. In this climate zone, only 9% (13 studies) of the studies were carried out. Thermal comfort was investigated during the whole year and used both rational and adaptive models (Figure 5). Studies were

carried out in Jordan, Cyprus, Chile, Iran, China, Kuwait, and Saudi Arabia (Appendix A). In Group B, comfort temperature varied between 14.7 °C and 25.0 °C, indicating less of a difference than in Group A [17]. Nevertheless, these values also exceed the comfort range given by standards, probably due to adaptation.

Group C includes temperate climates and comprises various types of climates, therefore temperature variations and adaptability within it can be large. Most studies were carried out in this group (69%, 99 studies) (Figure 5), and included investigations in several countries (Appendix A). Studies were carried out in all the seasons in naturally ventilated and air-conditioned buildings, using both adaptive and rational models (Figure 5). The first studies were carried out in the UK [66,82], which also presents the highest number of investigations along with China and Italy. The comfort temperatures varied between 14.7 °C and 35.0 °C [17]. This variation is probably because in Group C there is a wide range of climates, therefore students are exposed to various weather conditions. In this climate zone, students showed a great capability to adapt, especially the ones exposed to wider climate variations [83].

Group D includes continental climates, and limited research has been performed in this climate zone (8%, 12 studies). Studies were conducted in naturally ventilated and air-conditioned buildings during all the seasons using rational and adaptive models (Figure 5). They were carried out in China, Korea, Romania, Sweden, Finland, Turkey, and Nepal (Appendix A). The comfort temperature ranged between 16.0 °C and 26.0 °C [17], showing a large variability in students' preferences.

Group E includes polar and arctic climates, with an average temperature below 10 °C. No study on thermal comfort in educational buildings was found for this climate zone.

3.3. Model Adopted

The model adopted to analyse thermal comfort in educational buildings is relevant, as it can influence the predicted thermal sensation. Studies were carried out using the rational model (27%, 38 studies), adaptive model (16%, 23 studies) separately or together (24%, 34 studies), or other indicators (33%, 48 studies) (Figure 6). Indeed, different models can lead to diverse conclusions on the thermal state of students; therefore, it is fundamental to choose the model that is the closest to their real thermal sensation, according to their diverse characteristics and needs. Studies showed that none of the models accurately predict the thermal sensation of students. Rational and adaptive models should be combined to improve the prediction of the thermal environment, as they are complementary and not contradictory [18].

The rational model is generally applicable to air-conditioned spaces where occupants are in steady-state conditions with limited possibility to adapt. However, these conditions do not always occur in educational buildings, which leads to an overestimation or underestimation of the thermal sensation. Furthermore, the rational model is often incompatible in temperate and tropical climates [17]. To overcome these problems, corrections of PMV index, such as ePMV [63,67] or aPMV [84] have been provided and used by researchers to assess the thermal environment in educational buildings (Appendix A). Even though this model seems to be, in most cases, too inaccurate to predict thermal comfort in educational buildings, it is still widely used by researchers. However, it should be noted that the reliability of the PMV index largely depends on the precision of the assessment input parameters [85], which must be carefully evaluated to avoid misleading results.

In educational buildings, students often have adaptive opportunities. Most studies reported higher comfort temperatures than the ones predicted by the adaptive model, while lower comfort temperatures were found in secondary schools and compatible results in universities [17]. These results are consistent with the assumption of the adaptive model that considers occupants as able to modify their environment to achieve thermal comfort. This type of adaptation is typical of university students, which show comfort temperatures in line with the ones predicted by the adaptive model [17].

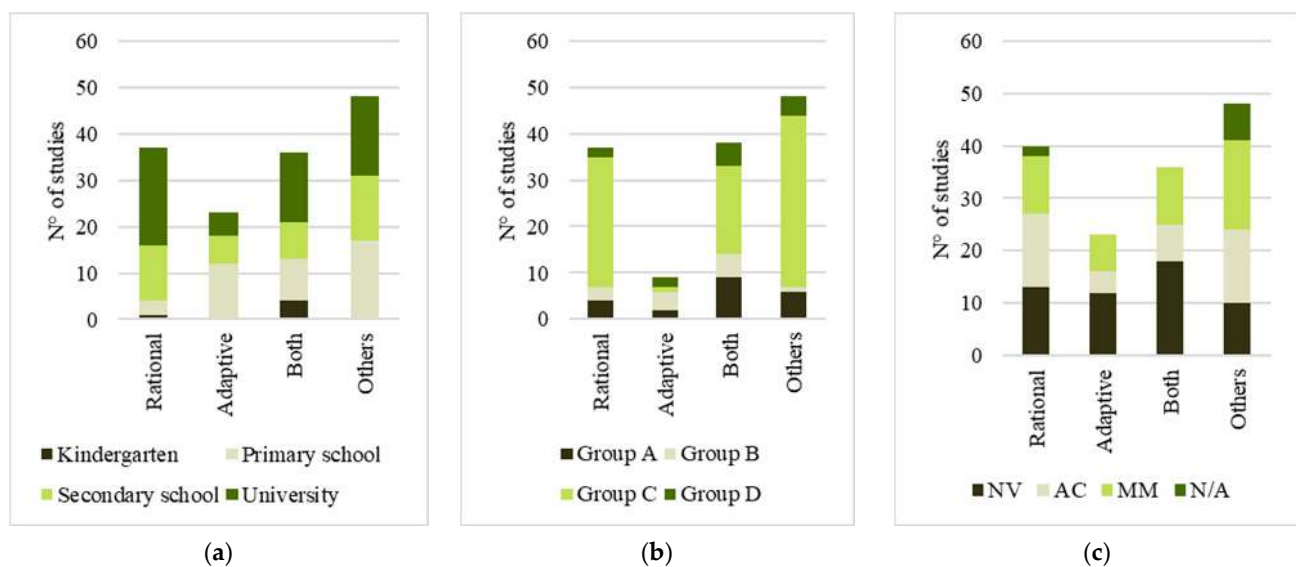


Figure 6. Number of studies divided according to the model adopted, at different educational stages (a), climate zone (b) and operation mode (c). Legend: NV = naturally ventilated, AC = air-conditioned, MM = mixed-mode, N/A = not available.

3.4. Operation Mode

The operation mode of the classroom can also influence the thermal perception of the students, as they experience diverse thermal environments in them (i.e., steady-state in air-conditioned, transient in free-running buildings). The operation mode influences the indoor environmental conditions also as a function of the outdoor climate, and different comfort temperatures can be found in relation to the operation mode. Furthermore, it defines the adaptation of the students and their control of the thermal environment, which can regulate their thermal perception. Most studies were carried out in naturally ventilated (NV) classrooms, followed by mixed-mode (MM) and air-conditioned (AC) schools (Figure 7).

In naturally ventilated buildings, the possibility to adapt is limited to the opening/closing of doors and windows. Several studies on primary schools were performed in naturally ventilated classrooms, and less in secondary schools, universities, and kindergartens (Figure 7). In climates A and B, natural ventilation is often used as the operation mode of classrooms, and less in climates C and D, as the colder climates need the presence of HVAC systems to achieve comfort in buildings (Figure 7). In most studies, the adaptive and rational models were both used, while when considered separately, the adaptive model was used in more cases than the rational (Figure 7). In particular, in hot-humid climates, observed comfort temperatures in naturally ventilated classrooms were found to be about 1.7 °C lower than the ASHRAE-recommended value [86], showing the importance of carefully evaluating comfort temperature also for energy savings. Furthermore, in naturally ventilated classrooms, students expressed comfort even when the environmental parameters were out of the standard's comfort zone [67,87]. These results are consistent with the adaptive hypothesis [13], which implies that humans can adapt behaviourally, physiologically, and psychologically to the environmental conditions to which they are subjected.

About 30% of the studies (38 papers) were performed in air-conditioned classrooms (Figure 7), where HVAC systems were switched on during the investigation period. The highest number of studies in air-conditioned classrooms was in universities, followed by secondary, primary schools, and kindergartens (Figure 7). The heating system was switched on during the winter in temperate climates and longer in colder climates (Group D), while the increasing use of cooling systems during summer, especially in warmer climates, could be detected. Climate Groups C and D were often investigating air-conditioned classrooms, and researchers usually used the rational model to assess thermal comfort. Only a few studies used the adaptive model as well as both models (Figure 7), even if adaptive behaviours were observed in air-conditioned schools [87]. Field studies in air-

conditioned schools were also carried out to design energy efficient classrooms [88], with evident implications on students' wellbeing and energy consumptions.

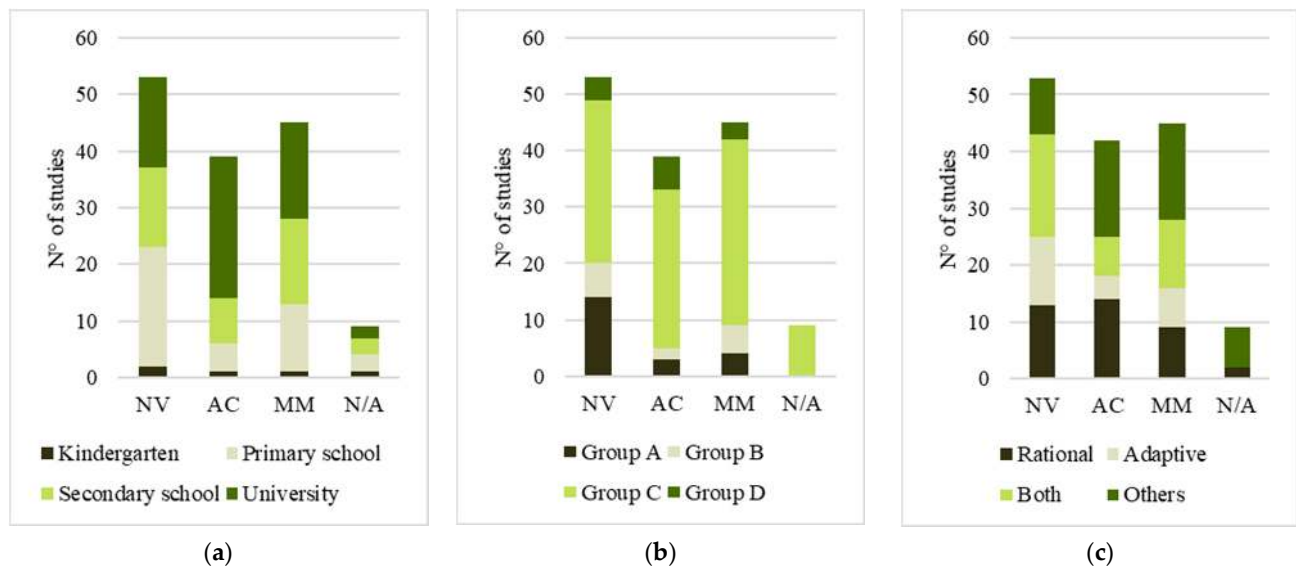


Figure 7. Number of studies divided according to the operation mode, at different educational stages (a), climate zone (b) and model adopted (c). Legend: NV = naturally ventilated, AC = air-conditioned, MM = mixed-mode, N/A = not available.

Studies in mixed-mode buildings were often investigating the thermal environment during several seasons (Appendix A). Most studies in mixed-mode classrooms were equally distributed in secondary, primary schools, and universities (Figure 7). Climate Group C was the most investigated and both rational and adaptive models were used, both separately or together (Figure 7). This operation mode should be carefully evaluated, as the comfort temperatures and needs of the occupants vary according to the season of investigation and the operation mode of the classroom. Differences in students' performance between conditioned and naturally ventilated classrooms were also evaluated [89], but no significant difference was found. In this direction, studies comparing air-conditioned and naturally ventilated spaces did not show different neutral temperatures, preferred temperatures, and thermal acceptability [75].

4. Current Issues

In this section, the complete selection of the studies was analysed to identify the most common issues that are present in the evaluation of thermal comfort in classrooms, which are reported in the following paragraphs.

4.1. Evaluation of Global Thermal Comfort

Most of the investigations on global thermal comfort have been focused on field measurements only, both objective and subjective, while few studies compared on-site measurements with simulations. There is no agreement on how global thermal comfort should be assessed, as different models and indices to assess thermal comfort were applied (Figure 8). Among them, the most common were the rational and the adaptive models (Appendix A). Some researchers were focused on the assessment of air temperature and relative humidity only in Portuguese school buildings [68,69], evaluating the impact of refurbishments on the indoor environment [69] and also in relation to other aspects of IEQ [2,34]. Indices such as effective temperature ET [19], new effective temperature ET* [73,77], corrected effective temperature CET [19], tropical summer index TSI [90], or the PMV correction for naturally ventilated buildings [91] were also calculated. The corrections of PMV index, ePMV [63,67] and aPMV [84], were also applied. In several studies,

the operative temperature was assessed, and the neutral temperature was derived from the subjective responses of the students [75,92,93]. It was deduced that pupils' thermal sensation is higher than adults [59], and that their thermal sensation is not related to indoor temperature only, but also to their home environment [58]. Furthermore, thermal sensation changed during the class hour and adaptation occurred after about 20 min after entering the classroom [94]. In some cases, the outdoor environmental conditions were considered [49,58,95], as they can also influence the perception of the indoor environment. The main purpose of these studies was to assess the environmental conditions in educational buildings [51]. For this reason, new algorithms and models were provided for scholars [49,96,97], and adaptive comfort equations obtained from regression analysis were developed for children [50,61] to assess the comfort temperatures in different educational stages and all classrooms [47]. Ranges of comfort temperatures were also provided for classrooms, considering different educational stages and climate zones [17,47]. To consider the applicability and the differences between predictive models of thermal comfort, some researchers performed a comparison between them [63]. However, it lacks agreement among researchers in regards to the model that should be used to evaluate global thermal comfort, which is one of the current issues that should be faced.

4.2. Evaluation of Local Discomfort

Recently, the assessment of local discomfort has become increasingly relevant, as it can have a great influence on people's wellbeing, but also on energy consumption. However, it lacks sufficient scientific evidence regarding the importance of local discomfort on students' wellbeing. The main causes of local discomfort found in classrooms were draught risk [21,31,98], vertical air temperature difference [21,99,100], warm and cool floors [21,99,101], and radiant asymmetry [21,25,98,99,101]. Studies were performed using the UCB Berkeley model for thermal comfort [26], questionnaires including specific questions on local discomfort [21] and its causes [25], and in some cases, occupants were asked to report the part of the body that was subjected to local discomfort [22]. The purpose of these studies varies from evaluating the percentage of dissatisfied students due to local discomfort [98] and the difference between global and local thermal comfort [22], to investigating the relation between local thermal comfort and productivity [25]. Even if a growing interest in this topic can be detected, only a few studies were carried out, and broader knowledge on the issue of local discomfort is needed.

4.3. Energy Consumptions and Thermal Comfort

The impact of thermal comfort on energy consumption is a debated topic that was faced by researchers in different ways. The evaluation of energy consumption has been carried out through on-site measurements, simulations, or in climate chambers approximating the conditions of the typical classrooms. In some cases, researchers investigated the direct relationship between energy consumption and thermal comfort [22,36,102]. Energy consumption was also compared to thermal comfort in association with indoor air quality [103] and visual comfort [104,105]. The concerns about energy savings were compared to ventilation strategies [95,106], HVAC systems operation, and architectural features [107,108]. Researchers also compared refurbished and non-refurbished educational buildings, which resulted in a reduction of consumption for renovated schools [93,102,109]. An investigation into the influence of shading devices on indoor environmental quality and energy consumption was also performed [110]. Finally, an algorithm to improve thermal comfort and indoor air quality and reduce consumption, using the least amount of energy from air conditioning and ventilation fans, was developed [111]. This analysis showed the importance of combining the issue of consumption with thermal comfort studies to enhance students' wellbeing and reduce energy requirements. However, it is still difficult to propose solutions that reduce energy consumption without compromising thermal comfort for children and adults.

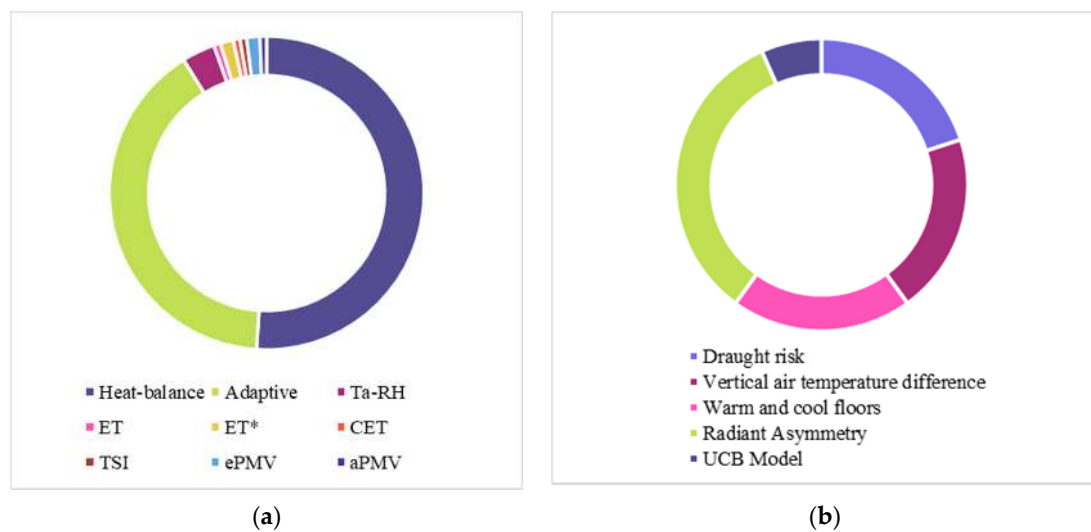


Figure 8. Indices used by researchers to investigate global (a) and local (b) thermal comfort in classrooms.

4.4. HVAC Systems and Thermal Comfort

The evaluation of thermal comfort is fundamental for heating, ventilation, and air conditioning system installation and settings, and has become increasingly important in recent years [17]. Regarding heating and cooling systems, studies have been carried out to compare traditional and innovative systems in terms of thermal comfort improvement [112]. Other investigations have been carried out to design better conditioning systems in educational buildings [88]. Through assessing comfort temperatures, it is possible to reduce the need for heating and cooling systems and maximise the energy savings without impairing thermal comfort [113]. Concerning ventilation strategies, their impact on thermal comfort and IAQ was investigated [27]; as well as the effectiveness of different types of ventilation, such as natural, hybrid ventilation, and air conditioning [114]; the acceptance of thermal conditions; and energy use considering different ventilation strategies and exhaust configurations [106]. Thermal comfort was also analysed considering stratum ventilation using a pulsating air supply [115], and in relation to gender differences [116], showing an improved thermal comfort in comparison to a conventional constant air supply. Then, field studies were carried out to compare the conditions found in educational buildings with the criteria in the standards [117]. Since ventilation systems often create a non-uniformity into the environment due to the air distribution, researchers analysed the possibility to improve comfort through managing these non-uniformities, considering thermal preferences [118]. The investigations of the HVAC systems' impact on thermal comfort are very heterogeneous because different types of conditioning systems exist. To provide guidelines for their design and installation, it is necessary to understand their impact on students' wellbeing, while being aware of their individual needs, and not only focusing on energy consumption.

4.5. Indoor Air Quality and Thermal Comfort

Indoor air quality (IAQ) has been often investigated together with thermal comfort, as they are important aspects to ensure health and wellbeing in classrooms. CO₂ concentration was the parameter measured most frequently [68,119] and was compared with the threshold limit values given by standards. In some cases, the CO₂ concentration was found to be below the threshold values given by standards [117,120,121], and, in other cases, no correlation was found between CO₂ concentration and number of people [94]. Instead, in naturally ventilated buildings, CO₂ concentration was found to be very high when windows were closed [122]. No correlation was found in classrooms between CO₂ values and students' feelings of tiredness [59]. From CO₂ concentration decay in classrooms, the air change per hour and the ventilation effectiveness in these spaces were determined [123].

From a comparison between refurbished and non-refurbished buildings, it was seen that the renovated constructions improved thermal comfort, but increased the CO₂ concentration, and therefore reduced indoor air quality [109]. The impact of different ventilation modes on thermal comfort and CO₂ levels was also evaluated [27,69,124], as well as the relation between IAQ and thermal comfort [2]. In some cases, the concentration of other pollutants, such as VOCs, NO₂, and CO was measured and correlated to the outdoor conditions [125–127]. The subjective perception of air quality was correlated to the environmental conditions, which showed that the perceived environmental quality was highly correlated to parameters, such as air temperature and ventilation rates [6]. There is a need to understand the relationship between indoor air quality and thermal comfort perception, and to understand how to improve them without increasing energy consumption.

4.6. Indoor Environmental Quality

Indoor environmental quality (IEQ), which includes thermal comfort, air quality, visual, and acoustic quality, can affect students' health, comfort, and productivity. Indeed, research is increasingly focusing on multi-domain approaches to indoor environmental perception and behaviour [128,129], inspecting the various aspects of IEQ on people's comfort and satisfaction [130]. The evaluation of IEQ through objective and subjective measurements has been often carried out, while also considering the psychological and physiological impact on occupants' comfort [4,33], and pupils' performance [131] or symptomatology [132]. Indeed, the perception of the environment includes the four aspects of IEQ and can have an impact on students' health and learning abilities [41,70,131], but also on their wellbeing [6,32]. In some cases, the subjective assessment was performed through questionnaires to evaluate the perception, preferences, and needs regarding IEQ in classrooms [133], but also statistical surveys have been carried out [134]. Thermal comfort was frequently associated with lighting quality, considering different configurations of architectural characteristics [32,110] and the impact on energy consumption [105,108]. Since thermal perception is strongly related to acoustic, visual, and air quality, researchers should not focus on the evaluation of thermal comfort only, but on all the aspects of IEQ.

4.7. Architectural Features and Thermal Comfort

Thermal comfort in buildings is closely related to their architectural features, including dimensions, window-wall ratio, presence of shading systems, building orientation, articulation of classrooms, and the properties of the building envelope [17]. Most researchers considered classrooms as uniform spaces, however, due to solar radiation or to the position of ventilation systems, classrooms are usually non-uniform environments, and therefore thermal discomfort may occur locally. The influence of buildings' envelope on thermal comfort was evaluated [110], considering the effect of different types of insulated roofs (e.g., PCM, composite) on the possibility of overheating of classrooms [135]. In addition, dynamic characteristics of the envelope were evaluated and through the application of films that allow the control of solar radiation [136,137]. In some studies, researchers assessed the improved conditions of a renovation [138] or compared different types of school building constructions (light weight and medium weight) [60]. The relation between classroom characteristics and thermal comfort was also investigated [2,139], including the influence of a façade design to prevent overheating and improve daylight requirements [140], and the use of natural ventilation and ceiling fans to improve comfort [141]. The influence of shading systems and window configuration, including the glass ratio and glass properties, on occupants' comfort and energy demands were also assessed [97,142]. Additionally, studies were performed to allow building designers to choose the best configurations to improve comfort and reduce energy demands [108], in addition to considering the influence of the local climate on the architectural project [107]. Finally, the effect of building design on learning rate and perception was investigated in some works [143,144]. Despite its importance, studies on thermal comfort involving these aspects are not frequent and

should be increased to provide guidance to building designers, aimed at improving indoor conditions and reducing consumptions.

4.8. Health and Productivity and Thermal Comfort

In the past, students' productivity has been inspected in regard to air quality [27] through the analysis of their performance in relation to different aspects of schoolwork (numerical or language-based) under different ventilation rates [145], or through providing them diverse tests measuring arithmetic concentration, performance speed, task performance accuracy, and visual memory [124]. Students' learning efficiency was also evaluated in relation to the characteristics of the shading systems [142] and increased classroom temperature [146]. Scholars' performance has been related to all the aspects of indoor environmental quality [41,131,147] and to the thermal environment only [148,149]. The influence of IEQ on health and productivity has been demonstrated as a function of Fanger's PMV and personal factors [25]. Researchers showed that students' health and productivity depend on buildings' features [2,143]. Thermal sensation as well as IEQ have been correlated to health-related issues that can occur as students pass a considerable amount of time in educational buildings [6,42,150]. It must be noted that the assessment of the influence of the thermal environment on health and productivity is not easy, as several variables can influence students' performance and wellbeing. Researchers have tried to determine students' performance through questionnaires, in which they were self-reporting their productivity [41], or through the measurement of speed errors [149]. Furthermore, the effect of the microclimate in classrooms was assessed through the measurement of cardiac autonomic control (ECG) and cognitive performances of the students [151]. This issue remains a very interesting and debated topic, as it still lacks a generally accepted scientific method to assess the influence of the thermal environment on students' health and productivity.

5. Conclusions and Directions for Future Research

The investigation of the current literature showed that researchers focused on different issues, adopting diverse models and indices to investigate thermal comfort in classrooms. However, to provide healthy and human-centred buildings, it is important to focus on students' individual needs and preferences, and not only on single dose-response relationships that have been established for the average adult. It is also clear that the focus should be on preventing negative effects as well as creating positive effects for human health. Indeed, even if the environmental conditions comply with guidelines, in several cases the prolonged stay indoors is not healthy [152]. An integrated approach that considers the positive and negative effects of indoor exposure is therefore needed, including the individual preferences and needs of the occupants [152]. To achieve this integrated approach, several aspects must be accounted for (Figure 9), while considering the individual differences that may be present in relation to the diverse educational stages, climate zone, model adopted, and operation mode.

From this analysis, it was possible to outline the current issues and delineate the directions for future research. However, it is important to note the limitations that the present study may have. The manual grouping of the confounding parameters, which was useful for the direct control of the information contained in the scientific literature, could be combined with statistic methods to test other possible classifications (e.g., country in which the study was carried out, period of investigation, year). Furthermore, the grouping per climate zone may present some limitations, as they include different countries that are characterised by diverse sociocultural backgrounds, and therefore the variability of comfort temperature can be very high. Even the different educational systems might affect the opportunities to adapt and therefore the comfort temperature. These considerations highlight that it is difficult to generalise indications regarding thermal comfort in educational buildings. On the contrary, from this review, it emerged the necessity of studies aiming at meeting the needs of the students, in order to provide human-centred buildings.

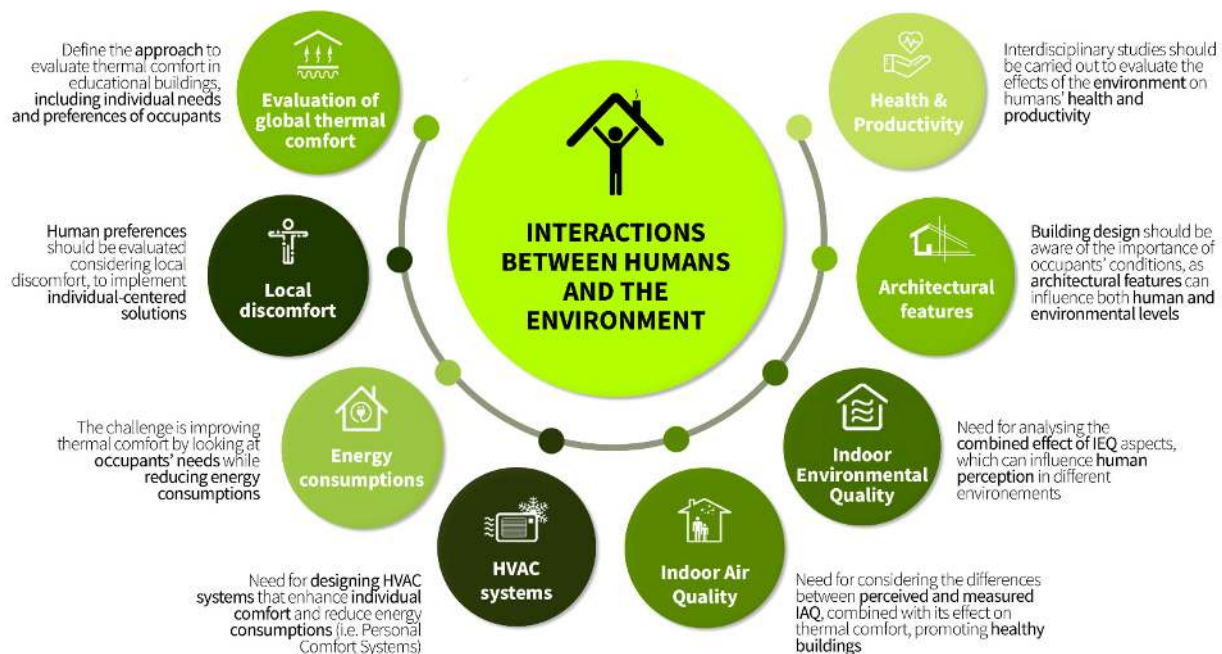


Figure 9. Directions for future research on thermal comfort in educational buildings.

The evaluation of global thermal comfort was carried out using different models and indices, but, in several cases, individual needs were not analysed. Given the variety of indices that have been used for comfort assessment, it is important to define a model for the evaluation of global thermal comfort in classrooms, which should take into account the individual needs and preferences of occupants.

The same concerns are related to local thermal discomfort, even if few studies were carried out on this topic. From this review it can be concluded that local discomfort is an important issue that should be assessed not only to inspect students' satisfaction but also to investigate the reasons for the higher productivity of students located in certain positions in the classrooms, to provide solutions that are more individual-centred.

Regarding energy demands, the literature showed that high consumptions are often connected to the characteristics of the building's envelope and to the improper control of HVAC systems. Students' dissatisfaction was often related to warm sensations during winter and cold sensations in summer, due to the extensive use of HVAC systems [47]. Since thermal comfort is also a function of the ventilation strategy, building designers need to consider the configurations that minimise consumptions and improve occupants' wellbeing. The aim is then to provide comfort in classrooms and reduce energy demands by looking at occupants' needs and preferences [153].

In this direction, HVAC systems can have a great impact on people's comfort and energy consumptions. Studies including different ventilation regimes are necessary. Moreover, in order to inspect people's needs, studies on personal comfort systems (PCS), which operate at the individual level are needed.

However, thermal comfort evaluation should not overlook the interaction with other environmental aspects since they all contribute to the human perception of the environment. The integration of IAQ in thermal comfort studies is necessary and should include objective and subjective measurements, working towards human-centred buildings. There is a need to consider the differences between perceived and measured IAQ, combined with its effect on thermal comfort.

Moreover, future studies should focus on the healing power of indoor environments that involve all the IEQ aspects, including thermal comfort, air, visual, and acoustic qualities. Indeed, people are subjected to a combination of them, and only through the analysis of their combined effect is it possible to understand humans' perception.

This review showed the need for research in order to understand the relation between thermal comfort and architectural features, to improve indoor environmental conditions and wellbeing in classrooms. This is necessary to guide building designers, which should be aware of the importance of occupants' conditions, as architectural features can influence the perception both at human (i.e., influence of personal control on perception) and environmental (i.e., providing uniform/non-uniform environments) levels.

Furthermore, as the indoor environment can affect students' health and productivity, it is fundamental to investigate it not as a single dose-response system only, but include interactions at both human and environmental levels to define a methodology for understanding the impact of the indoor environment on them.

All these issues showed that thermal comfort in educational buildings is still a very debated topic. In this way, there is the need to analyse them, considering their effect on individuals and their interactions with the environment. After the COVID-19 pandemic, the importance of ensuring healthy environments became even more evident, also due to the increasing amount of time that people spend indoors. Indeed, the pandemic period revealed the difficulties in providing sufficient indoor air quality, which should be enhanced without compromising thermal comfort and energy consumptions. There is the necessity to adapt educational buildings to the pandemic and post-pandemic periods, which should be considered together with climate change issues and needs identified before the pandemic.

This review, which critically analyses the studies according to different confounding parameters, highlighted the current issues and defined a way forward in research, represented a contribution in this direction, and will guide researchers and building designers towards a human-centred approach, which is currently lacking.

Author Contributions: Conceptualization, G.L., G.S., F.L., F.F. and P.M.B.; methodology, G.L., G.S., F.L., F.F. and P.M.B.; formal analysis, G.L., G.S., F.L., F.F. and P.M.B.; writing—original draft preparation, G.L.; writing—review and editing, G.S., F.L., F.F. and P.M.B.; funding acquisition, G.S., F.L., F.F. All authors have read and agreed to the published version of the manuscript.

Funding: The research was partially funded by the University of Pisa with the "Ateneo 2020 Funds", assigned to individual researchers following an annual evaluation of the research products of the last 4 years by a Selected Scientific Commission.

Institutional Review Board Statement: Not applicable.

Informed Consent Statement: Not applicable.

Conflicts of Interest: The authors declare no conflict of interest.

Appendix A. Studies on Thermal Comfort in Educational Buildings

In this Appendix, the analysis of the 143 selected studies is reported. Table A1 shows the studies on thermal comfort in educational buildings extracted from the literature, including the relevant information necessary for the analysis:

- Author(s).
- Year of publication.
- Location of the study (country).
- Educational stage, which comprises kindergartens, primary, secondary schools, and universities.
- Climate zone, which is analysed according to the Köppen–Geiger classification (where A: tropical climates; B: dry (arid and semi-arid) hot and cold climates; C: temperate climates; D: continental climates; E: polar and arctic climates).
- Model adopted, which includes rational, adaptive, both (rational + adaptive), and others (where other indices or models were adopted, as described in Section 4).
- Operation mode, which consists of naturally ventilated (NV), air-conditioned (AC), and mixed-mode (MM) buildings.
- Period of the survey, which expresses the season of measurements.
- Reference.

Table A1. Studies on thermal comfort in educational buildings extracted from the literature.

| Author(s) | Year | Location | Educational Stage | Climate Zone | Model Adopted | Operation Mode | Time of Survey | References |
|-------------------|------|-------------|-------------------------------|--------------|---------------|----------------|----------------------|------------|
| Auliciems A. | 1969 | UK | Secondary school | C | Others | AC | Autumn–Spring–Winter | [82] |
| Auliciems A. | 1972 | UK | Secondary school | C | Others | AC | Autumn–Spring–Winter | [148] |
| Auliciems | 1973 | UK | Secondary school | C | Others | NV | Spring–Summer | [66] |
| Humphreys | 1973 | UK | Secondary school | C | Others | NV | Spring–Summer | [62] |
| Auliciems | 1975 | Australia | Primary school | C | Others | AC | Autumn–Winter | [19] |
| Humphreys | 1977 | UK | Primary school | C | Others | NV | Summer | [154] |
| Kwok et al. | 1998 | USA | Secondary school | A | Both | MM | Autumn–Winter | [155] |
| Kwok et al. | 2003 | Japan | Secondary school | C | Adaptive | MM | Summer | [87] |
| Wong et al. | 2003 | Singapore | Secondary school | A | Rational | NV | Summer | [67] |
| Krüger et al. | 2004 | Brazil | University | C | Others | NV | Summer–Winter | [34] |
| Hu et al. | 2006 | China | University | C | Others | MM | Summer–Winter | [73] |
| Hwang et al. | 2006 | Taiwan | University | C | Rational | MM | Summer | [77] |
| Corgnati et al. | 2007 | Italy | University | C | Rational | AC | All seasons | [29] |
| Wargocki et al. | 2007 | Denmark | Secondary school | C | Others | NV | Summer | [145] |
| Wargocki et al. | 2007 | Denmark | Secondary school | C | Rational | NV | Summer | [146] |
| Zhang et al. | 2007 | China | University | C | Rational | NV | Spring | [92] |
| Cheng et al. | 2008 | Taiwan | University | C | Rational | MM | Autumn–Spring–Summer | [75] |
| Theodosiou et al. | 2008 | Greece | Primary school | C | Others | MM | Autumn–Spring–Winter | [103] |
| Al-Rashidi et al. | 2009 | Kuwait | Secondary school | B | Both | AC | - | [63] |
| Buratti et al. | 2009 | Italy | University | C | Both | AC | Spring–Winter | [99] |
| Corgnati et al. | 2009 | Italy | University | C | Both | NV | Autumn–Spring | [98] |
| Hwang et al. | 2009 | Taiwan | Primary + Secondary school | C | Both | NV | Autumn–Winter | [86] |
| Mumovic et al. | 2009 | UK | Secondary school | C | Rational | MM | Winter | [31] |
| Zeiler et al. | 2009 | Netherlands | Primary school | C | Rational | AC | Spring–Winter | [112] |
| Yao et al., | 2010 | China | University | C | Both | NV | Spring | [24] |
| Cao et al. | 2011 | China | University | D | Rational | AC | Summer–Winter | [76] |
| Jung et al. | 2011 | South Korea | University | C | Both | MM | Autumn–Spring | [156] |
| Liu et al. | 2011 | Japan | University | C | Others | MM | Summer–Winter | [123] |
| Al-Rashidi et al. | 2012 | Kuwait | Primary school | B | Others | MM | Spring | [27] |
| Conceicao et al. | 2012 | Portugal | Kindergarten | C | Both | MM | Summer–Winter | [49] |
| De Giuli et al. | 2012 | Italy | Primary school | C | Adaptive | NV | Spring | [4] |
| Lee et al. | 2012 | China | University | C | Rational | AC | - | [70] |
| Liang et al. | 2012 | Taiwan | Primary +Secondary school | C | Adaptive | NV | Autumn–Winter | [97] |

Table A1. Cont.

| Author(s) | Year | Location | Educational Stage | Climate Zone | Model Adopted | Operation Mode | Time of Survey | References |
|---------------------|------|-----------|------------------------|--------------|---------------|----------------|----------------------|------------|
| Maki et al. | 2012 | Japan | University | C | Others | AC | Spring–Summer | [104] |
| Puteh et al. | 2012 | Malaysia | Secondary school | A | Others | NV | - | [150] |
| Teli et al. | 2012 | UK | Primary school | C | Both | NV | Spring–Summer | [53] |
| Barbhuiya et al. | 2013 | UK | University | C | Others | AC | Spring–Winter | [95] |
| Barrett et al. | 2013 | UK | Primary school | C | Others | MM | All seasons | [151] |
| D’Ambrosio et al. | 2013 | Italy | Primary + Secondary | C | Rational | NV | Summer–Winter | [21] |
| Fabbri et al. | 2013 | Italy | Kindergarten | C | Rational | - | Autumn | [50] |
| Pereira et al. | 2013 | Portugal | Secondary school | C | Rational | MM | Spring–Winter | [157] |
| Teli et al. | 2013 | UK | Primary school | C | Others | NV | Spring–Summer | [59] |
| Wargocki et al. | 2013 | Denmark | Secondary school | C | Rational | AC | Summer | [149] |
| Yang et al. | 2013 | USA | University | C | Others | AC | Winter | [144] |
| Baruah et al. | 2014 | India | University | C | Rational | NV | Spring–Winter | [91] |
| Choi et al. | 2014 | USA | University | C | Others | AC | - | [41] |
| De Giuli et al. | 2014 | Italy | Primary school | C | Both | MM | Spring–Summer–Winter | [33] |
| Gao et al. | 2014 | Denmark | Primary school | C | Adaptive | AC | All seasons | [42] |
| Katafygiotou et al. | 2014 | Cyprus | Secondary school | C | Others | - | - | [36] |
| Mishra et al. | 2014 | India | University | A | Both | NV | Spring–Winter | [72] |
| Mishra et al. | 2014 | India | University | A | Both | NV | Spring–Winter | [5] |
| Pereira et al. | 2014 | Portugal | Secondary school | C | Rational | NV | Spring | [158] |
| Serghides et al. | 2014 | Cyprus | University | C | Rational | AC | Summer–Winter | [105] |
| Teli et al. | 2014 | UK | Primary school | C | Both | NV | Summer | [60] |
| Turunen et al. | 2014 | Finland | Primary school | D | Others | AC | Spring–Summer | [6] |
| Wang et al. | 2014 | China | University | D | Adaptive | AC | Spring–Winter | [23] |
| Yun et al. | 2014 | Korea | Kindergarten | D | Both | NV | Spring–Summer | [48] |
| Almeida et al. | 2015 | Portugal | Secondary school | C | Others | MM | Spring–Summer–Winter | [68] |
| Almeida et al. | 2015 | Portugal | Secondary school | C | Adaptive | MM | Spring | [69] |
| Barrett et al. | 2015 | UK | Secondary school | C | Others | MM | All seasons | [147] |
| De Dear et al. | 2015 | Australia | Secondary school | C | Both | MM | Summer | [83] |
| Fong et al. | 2015 | China | University | C | Rational | AC | - | [106] |
| Huang et al. | 2015 | Taiwan | Primary school | C | Adaptive | NV | Autumn–Spring–Summer | [159] |
| Huang et al. | 2015 | Taiwan | Primary school | C | Adaptive | MM | Autumn–Spring | [114] |
| Mishra et al. | 2015 | India | University | A | Rational | MM | Autumn–Summer | [89] |
| Nam et al. | 2015 | Korea | Kindergarten | D | Both | AC | Spring–Summer | [51] |

Table A1. Cont.

| Author(s) | Year | Location | Educational Stage | Climate Zone | Model Adopted | Operation Mode | Time of Survey | References |
|---------------------------|------|-----------------|--|--------------|---------------|----------------|----------------------|------------|
| Nico et al. | 2015 | Italy | University | C | Both | NV | - | [160] |
| Almeida et al. | 2016 | Portugal | Primary + Secondary + University | C | Both | NV | Spring | [101] |
| Liu et al. | 2016 | China | Secondary school | B | Rational | NV | Winter | [161] |
| Vittal et al. | 2016 | India | University | A | Both | NV | Winter | [90] |
| Castilla et al. | 2017 | Spain | University | C | Others | - | - | [139] |
| Hadad et al. | 2017 | Iran | Primary school | B | Both | MM | Autumn–Summer–Winter | [55] |
| Martinez-Molina et al. | 2017 | Spain | Primary school | C | Rational | MM | Autumn–Winter | [54] |
| Mishra et al. | 2017 | Netherlands | University | C | Adaptive | AC | Spring | [94] |
| Montazami et al. | 2017 | UK | Primary school | C | Adaptive | NV | Summer | [56] |
| Montazami et al. | 2017 | UK | Primary school | C | Adaptive | NV | Summer | [58] |
| Stazi et al. | 2017 | Italy | Primary school | C | Adaptive | AC | Spring–Winter | [162] |
| Teli et al. | 2017 | UK | Primary school | C | Adaptive | NV | All seasons | [61] |
| Trebilcock et al. | 2017 | Chile | Primary school | B | Adaptive | NV | Summer–Winter | [163] |
| Wang et al. | 2017 | China | University | D | Both | AC | Autumn–Spring–Winter | [164] |
| Zaki et al. | 2017 | Malaysia, Japan | University | A, C | Both | MM | Winter–Spring | [74] |
| Bajc et al. | 2018 | Serbia | University | C | Rational | MM | Winter | [25] |
| Bluyssen et al. | 2018 | Netherlands | Primary school | C | Others | MM | Spring | [2] |
| Fang et al. | 2018 | China | University | C | Both | AC | Autumn–Summer | [26] |
| Hamzah et al. | 2018 | Indonesia | Secondary school | A | Rational | NV | Summer | [65] |
| Kim et al. | 2018 | Australia | Secondary school | C | Both | MM | Autumn | [37] |
| Kumar et al. | 2018 | India | University | A | Both | NV | Spring–Summer | [71] |
| Singh et al. | 2018 | India | University | A | Both | NV | Spring–Summer | [38] |
| Aghniaey et al. | 2019 | USA | University | C | Both | AC | Summer | [113] |
| Ali et al. | 2019 | Jordan | Secondary school | B | Both | NV | - | [102] |
| Barbic et al. | 2019 | Italy | University | C | Others | AC | - | [151] |
| Bluyssen et al. | 2019 | Netherlands | Primary school | C | Others | MM | Spring | [165] |
| Branco et al. | 2019 | Portugal | Primary school | C | Others | MM | All seasons | [125] |
| Calama-González et al. | 2019 | Spain | Secondary school | C | Adaptive | NV | All seasons | [110] |
| Campano et al. | 2019 | Spain | Secondary school | C | Both | MM | Autumn–Summer–Winter | [166] |
| Chen et al. | 2019 | Taiwan | Primary school | C | Others | NV | Summer | [142] |
| Chen et al. | 2019 | Taiwan | University | C | Rational | MM | Spring | [167] |
| Chitaru et al. | 2019 | Romania | Secondary school | D | Rational | NV | Summer–Winter | [122] |

Table A1. Cont.

| Author(s) | Year | Location | Educational Stage | Climate Zone | Model Adopted | Operation Mode | Time of Survey | References |
|-------------------------------|------|-------------|-------------------------------|--------------|---------------|----------------|----------------------|------------|
| Colinart et al. | 2019 | France | Secondary school | C | Others | - | All seasons | [138] |
| Costa et al. | 2019 | Brazil | University | A | Others | MM | Summer | [107] |
| Fabozzi et al. | 2019 | Italy | University | C | Both | MM | Summer | [168] |
| Haddad et al. | 2019 | Iran | Primary school | B | Adaptive | NV | Autumn–Spring–Winter | [169] |
| Hamzah et al. | 2019 | Indonesia | University | A | Others | AC | Spring | [88] |
| Heracleous et al. | 2019 | Cyprus | University | B | Adaptive | MM | Winter | [170] |
| Huang et al. | 2019 | China | University | D | Others | AC | Spring | [171] |
| Jindal | 2019 | India | Secondary school | A | Adaptive | NV | All seasons | [96] |
| Jing et al. | 2019 | China | University | C | Rational | AC | Winter | [22] |
| Karyono et al. | 2019 | Indonesia | University | A | Others | AC | - | [81] |
| Korateng et al. | 2019 | Ghana | University | A | Adaptive | NV | Spring–Summer | [172] |
| Lawrence et al. | 2019 | UK | University | C | Rational | MM | Summer–Winter | [93] |
| Li et al. | 2019 | China | University | C | Others | AC | Summer | [116] |
| Liu et al. | 2019 | China | University | B | Rational | NV | Winter | [84] |
| Liu et al. | 2019 | China | University | C | Rational | NV | Winter | [173] |
| Monna et al. | 2019 | Palestina | Secondary school | C | Others | MM | All seasons | [174] |
| Ranjbar | 2019 | Turkey | University | D | Others | MM | Summer–Winter | [124] |
| Shen et al. | 2019 | China | University | C | Rational | NV | Summer–Winter | [175] |
| Shrestha et al. | 2019 | Nepal | Secondary school | D | Adaptive | NV | Autumn | [120] |
| Simanic et al. | 2019 | Sweden | Primary school | D | Others | MM | All seasons | [117] |
| Tian et al. | 2019 | China | University | C | Rational | AC | Summer | [115] |
| Toyinbo et al. | 2019 | Nigeria | Primary school | A | Others | NV | - | [127] |
| Vallarades et al. | 2019 | Taiwan | University | C | Rational | AC | Summer | [111] |
| Zhang et al. | 2019 | Netherlands | Primary school | C | Others | - | Spring | [14] |
| Zhang et al. | 2019 | Netherlands | Primary school | C | Others | - | Spring | [133] |
| Al-Khatri et al. | 2020 | Arabia | Secondary school | B | Both | AC | Summer | [176] |
| Barbosa et al. | 2020 | Portugal | Secondary school | C | Others | MM | Spring–Winter | [109] |
| Boutet et al. | 2020 | Argentina | Primary + Secondary school | C | Others | - | All seasons | [32] |
| Campano- Laborda et al. | 2020 | Spain | Secondary school | C | Others | MM | Spring–Winter | [132] |
| da Silva Júnior et al. | 2020 | Brazil | Secondary school | A | Rational | AC | Summer | [177] |
| Hamzah et al. | 2020 | Indonesia | Primary school | A | Both | NV | Spring | [178] |
| Heracleous et al. | 2020 | Cyprus | Secondary school | B | Adaptive | MM | Summer–Winter | [179] |
| Jiang et al. | 2020 | China | Secondary school | B | Both | MM | Winter | [119] |

Table A1. Cont.

| Author(s) | Year | Location | Educational Stage | Climate Zone | Model Adopted | Operation Mode | Time of Survey | References |
|------------------|------|-----------|-------------------|--------------|---------------|----------------|----------------------|------------|
| Jowkar et al. | 2020 | UK | University | C | Others | MM | - | [78] |
| Jowkar et al. | 2020 | UK | University | C | Adaptive | MM | Autumn–Winter | [180] |
| Jowkar et al. | 2020 | UK | University | C | Others | AC | Autumn–Spring–Winter | [181] |
| Korsavi et al. | 2020 | UK | Primary school | C | Adaptive | MM | All seasons | [182] |
| Liu et al. | 2020 | China | University | B | Rational | NV | Autumn–Spring | [183] |
| Liu et al. | 2020 | China | University | D | Rational | MM | Autumn–Winter | [100] |
| Munonye et al. | 2020 | Nigeria | Primary school | A | Both | NV | Autumn–Spring | [184] |
| Papadopoulos et. | 2020 | Greece | University | C | Rational | AC | Winter | [126] |
| Pistore et al. | 2020 | Italy | Secondary school | C | Others | - | - | [134] |
| Talarosha et al. | 2020 | Indonesia | Primary school | A | Others | NV | Spring | [121] |
| Wang et al. | 2020 | China | Secondary school | C | Rational | AC | Summer | [131] |
| Zhang et al. | 2020 | China | University | C | Rational | - | - | [118] |

References

1. Bluysen, P.M. Health, Comfort and Performance of Children in Classrooms—New Directions for Research. *Indoor Built Environ.* **2016**, *26*, 1040–1050. [[CrossRef](#)]
2. Bluysen, P.M.; Zhang, D.; Kurvers, S.; Overtoom, M.; Ortiz-Sanchez, M. Self-Reported Health and Comfort of School Children in 54 Classrooms of 21 Dutch School Buildings. *Build. Environ.* **2018**, *138*, 106–123. [[CrossRef](#)]
3. Mendell, M.; Heath, G. Do Indoor Pollutants and Thermal Conditions in Schools Influence Student Performance? A Critical Review of Literature. *Indoor Air* **2005**, *15*, 27–52. [[CrossRef](#)]
4. De Giuli, V.; Da Pos, O.; De Carli, M. Indoor Environmental Quality and Pupil Perception in Italian Primary Schools. *Build. Environ.* **2012**, *56*, 335–345. [[CrossRef](#)]
5. Mishra, A.K.; Ramgopal, M. Thermal Comfort Field Study in Undergraduate Laboratories—An Analysis of Occupant Perceptions. *Build. Environ.* **2014**, *76*, 62–72. [[CrossRef](#)]
6. Turunen, M.; Toyinbo, O.; Putus, T.; Nevalainen, A.; Shaughnessy, R.; Haverinen-Shaughnessy, U. Indoor Environmental Quality in School Buildings, and the Health and Wellbeing of Students. *Int. J. Hyg. Environ. Health* **2014**, *217*, 733–739. [[CrossRef](#)] [[PubMed](#)]
7. Fantozzi, F.; Hamdi, H.; Rocca, M.; Vegnuti, S. Use of Automated Control Systems and Advanced Energy Simulations in the Design of Climate Responsive Educational Building for Mediterranean Area. *Sustainability* **2019**, *11*, 1660. [[CrossRef](#)]
8. Lamberti, G.; Fantozzi, F.; Salvadori, G. Thermal Comfort in Educational Buildings: Future Directions Regarding the Impact of Environmental Conditions on Students' Health and Performance. In Proceedings of the 2020 IEEE International Conference on Environment and Electrical Engineering and 2020 IEEE Industrial and Commercial Power Systems Europe (EEEIC/I&CPS Europe), Madrid, Spain, 9–12 June 2020; pp. 1–6.
9. Fantozzi, F.; Rocca, M. An Extensive Collection of Evaluation Indicators to Assess Occupants' Health and Comfort in Indoor Environment. *Atmosphere* **2020**, *11*, 90. [[CrossRef](#)]
10. Fanger, P.O. *Thermal Comfort. Analysis and Applications in Environmental Engineering*; Danish Technical Press: Copenhagen, Denmark; McGraw-Hill: New York, NY, USA, 1970.
11. Humphreys, M.; Nicol, F.; Roaf, S. *Adaptive Thermal Comfort: Foundations and Analysis*; Routledge: London, UK, 2016; ISBN 978-0-415-6916-1.
12. Nicol, F.; Humphreys, M.; Roaf, S. *Adaptive Thermal Comfort: Principles and Practice*; Routledge: London, UK, 2012; p. 175, ISBN 978-0-203-12301-0.
13. de Dear, R.; Brager, G.S.; Cooper, D. Developing an Adaptive Model of Thermal Comfort and Preference—Final Report on RP-884. *ASHRAE Trans.* **1997**, *104*, 1–13.
14. Zhang, D.; Bluysen, P.M. Actions of Primary School Teachers to Improve the Indoor Environmental Quality of Classrooms in the Netherlands. *Intell. Build. Int.* **2019**, *13*, 1–13. [[CrossRef](#)]
15. Bluysen, P.M.; Kim, D.H.; Eijkelenboom, A.; Ortiz-Sanchez, M. Workshop with 335 Primary School Children in The Netherlands: What Is Needed to Improve the IEQ in Their Classrooms? *Build. Environ.* **2020**, *168*, 106486. [[CrossRef](#)]
16. Fantozzi, F.; Lamberti, G. Determination of Thermal Comfort in Indoor Sport Facilities Located in Moderate Environments: An Overview. *Atmosphere* **2019**, *10*, 769. [[CrossRef](#)]
17. Zomorodian, Z.S.; Tahsildoost, M.; Hafezi, M. Thermal Comfort in Educational Buildings: A Review Article. *Renew. Sustain. Energy Rev.* **2016**, *59*, 895–906. [[CrossRef](#)]
18. Brager, G.S.; de Dear, R.J. Thermal Adaptation in the Built Environment: A Literature Review. *Energy Build.* **1998**, *27*, 83–96. [[CrossRef](#)]
19. Auliciems, A. Warmth and Comfort in the Subtropical Winter: A Study in Brisbane Schools. *J. Hyg.* **1975**, *74*, 339–343. [[CrossRef](#)]
20. James, A.-D.; Koranteng, C. An Assessment of Thermal Comfort in a Warm and Humid School Building at Accra, Ghana. *Pelagia Res. Libr. Adv. Appl. Sci. Res.* **2012**, *2012*, 3.
21. D'Ambrosio Alfano, F.R.; Ianniello, E.; Palella, B.I. PMV-PPD and Acceptability in Naturally Ventilated Schools. *Build. Environ.* **2013**, *67*, 129–137. [[CrossRef](#)]
22. Jing, S.; Lei, Y.; Wang, H.; Song, C.; Yan, X. Thermal Comfort and Energy-Saving Potential in University Classrooms during the Heating Season. *Energy Build.* **2019**, *202*, 109390. [[CrossRef](#)]
23. Wang, Z.; Li, A.; Ren, J.; He, Y. Thermal Adaptation and Thermal Environment in University Classrooms and Offices in Harbin. *Energy Build.* **2014**, *77*, 192–196. [[CrossRef](#)]
24. Yao, R.; Liu, J.; Li, B. Occupants' Adaptive Responses and Perception of Thermal Environment in Naturally Conditioned University Classrooms. *Appl. Energy* **2010**, *87*, 1015–1022. [[CrossRef](#)]
25. Bajc, T.; Banjac, M.; Todorović, M.; Stevanović, Ž. Experimental and Statistical Survey on Local Thermal Comfort Impact on Working Productivity Loss in University Classrooms. *Therm. Sci.* **2018**, *2018*, 379–392. [[CrossRef](#)]
26. Fang, Z.; Zhang, S.; Cheng, Y.; Fong, A.M.L.; Oladokun, M.O.; Lin, Z.; Wu, H. Field Study on Adaptive Thermal Comfort in Typical Air Conditioned Classrooms. *Build. Environ.* **2018**, *133*, 73–82. [[CrossRef](#)]
27. Al-Rashidi, K.; Loveday, D.; Al-Mutawa, N. Impact of Ventilation Modes on Carbon Dioxide Concentration Levels in Kuwait Classrooms. *Energy Build.* **2012**, *47*, 540–549. [[CrossRef](#)]

28. Franco, A.; Leccese, F. Measurement of CO₂ Concentration for Occupancy Estimation in Educational Buildings with Energy Efficiency Purposes. *J. Build. Eng.* **2020**, *32*, 101714. [[CrossRef](#)]
29. Corgnati, S.P.; Filippi, M.; Viazzo, S. Perception of the Thermal Environment in High School and University Classrooms: Subjective Preferences and Thermal Comfort. *Build. Environ.* **2007**, *42*, 951–959. [[CrossRef](#)]
30. Leccese, F.; Rocca, M.; Salvadori, G. Fast Estimation of Speech Transmission Index Using the Reverberation Time: Comparison between Predictive Equations for Educational Rooms of Different Sizes. *Appl. Acoust.* **2018**, *140*, 143–149. [[CrossRef](#)]
31. Mumovic, D.; Palmer, J.; Davies, M.; Orme, M.; Ridley, I.; Oreszczyn, T.; Judd, C.; Critchlow, R.; Medina, H.A.; Pilmoor, G.; et al. Winter Indoor Air Quality, Thermal Comfort and Acoustic Performance of Newly Built Secondary Schools in England. *Build. Environ.* **2009**, *44*, 1466–1477. [[CrossRef](#)]
32. Boutet, M.L.; Hernández, A.L.; Jacobo, G.J. Methodology of Quantitative Analysis and Diagnosis of Higo-Thermal and Lighting Monitoring for School Buildings in a Hot-Humid Mid-Latitude Climate. *Renew. Energy* **2020**, *145*, 2463–2476. [[CrossRef](#)]
33. De Giuli, V.; Zecchin, R.; Corain, L.; Salmaso, L. Measurements of Indoor Environmental Conditions in Italian Classrooms and Their Impact on Children's Comfort. *Indoor Built Environ.* **2014**, *24*, 689–712. [[CrossRef](#)]
34. Krüger, E.L.; Zannin, P.H.T. Acoustic, Thermal and Luminous Comfort in Classrooms. *Build. Environ.* **2004**, *39*, 1055–1063. [[CrossRef](#)]
35. Li, Q.; Zhang, L.; Zhang, L.; Wu, X. Optimizing Energy Efficiency and Thermal Comfort in Building Green Retrofit. *Energy* **2021**, *237*, 121509. [[CrossRef](#)]
36. Katafygiotou, M.C.; Serghides, D.K. Thermal Comfort of a Typical Secondary School Building in Cyprus. *Sustain. Cities Soc.* **2014**, *13*, 303–312. [[CrossRef](#)]
37. Kim, J.; de Dear, R. Thermal Comfort Expectations and Adaptive Behavioural Characteristics of Primary and Secondary School Students. *Build. Environ.* **2018**, *127*, 13–22. [[CrossRef](#)]
38. Singh, M.K.; Kumar, S.; Ooka, R.; Rijal, H.B.; Gupta, G.; Kumar, A. Status of Thermal Comfort in Naturally Ventilated Classrooms during the Summer Season in the Composite Climate of India. *Build. Environ.* **2018**, *128*, 287–304. [[CrossRef](#)]
39. Fabbri, K. *Indoor Thermal Comfort Perception: A Questionnaire Approach Focusing on Children*; Springer: Cham, Germany, 2015; ISBN 978-3-319-18650-4.
40. Haddad, S.; King, S.; Osmond, P.; Heidari, S. Questionnaire Design to Determine Children's Thermal Sensation, Preference and Acceptability in the Classroom. In Proceedings of the 28th PLEA International Conference, Lima, Peru, 7 November 2012.
41. Choi, S.; Guerin, D.; Kim, H.; Brigham, J.K.; Bauer, T.A. Indoor Environmental Quality of Classrooms and Student Outcomes: A Path Analysis Approach. *J. Learn. Spaces* **2014**, *2*, 2013–2014.
42. Gao, J.; Wargocki, P.; Wang, Y. Ventilation System Type, Classroom Environmental Quality and Pupils' Perceptions and Symptoms. *Build. Environ.* **2014**, *75*, 46–57. [[CrossRef](#)]
43. Mishra, A.K.; Ramgopal, M. Field Studies on Human Thermal Comfort—An Overview. *Build. Environ.* **2013**, *64*, 94–106. [[CrossRef](#)]
44. ISO 7730. *Ergonomics of the Thermal Environment—Analytical Determination and Interpretation of Thermal Comfort Using Calculation of the PMV and PPD Indices and Local Thermal Comfort Criteria*; ISO: Geneva, Switzerland, 2006.
45. ASHRAE. *ANSI/ASHRAE Standard 55: Thermal Environmental Conditions for Human Occupancy*; ASHRAE: Peachtree Corners, GA, USA, 2004.
46. EN 16798-1. *Energy Performance of Buildings—Ventilation for Buildings—Part 1: Indoor Environmental Input Parameters for Design and Assessment of Energy Performance of Buildings Addressing Indoor Air Quality, Thermal Environment, Lighting and Acoustics*; CEN: Bruxelles, Belgium, 2019.
47. Singh, M.K.; Ooka, R.; Rijal, H.B.; Kumar, S.; Kumar, A.; Mahapatra, S. Progress in Thermal Comfort Studies in Classrooms over Last 50 Years and Way Forward. *Energy Build.* **2019**, *188*, 149–174. [[CrossRef](#)]
48. Rupp, R.F.; Vásquez, N.G.; Lamberts, R. A Review of Human Thermal Comfort in the Built Environment. *Energy Build.* **2015**, *105*, 178–205. [[CrossRef](#)]
49. Yun, H.; Nam, I.; Kim, J.; Yang, J.; Lee, K.; Sohn, J. A Field Study of Thermal Comfort for Kindergarten Children in Korea: An Assessment of Existing Models and Preferences of Children. *Build. Environ.* **2014**, *75*, 182–189. [[CrossRef](#)]
50. Conceição, E.Z.E.; Gomes, J.M.M.; Antão, N.H.; Lúcio, M.M.J.R. Application of a Developed Adaptive Model in the Evaluation of Thermal Comfort in Ventilated Kindergarten Occupied Spaces. *Build. Environ.* **2012**, *50*, 190–201. [[CrossRef](#)]
51. Fabbri, K. Thermal Comfort Evaluation in Kindergarten: PMV and PPD Measurement through Datalogger and Questionnaire. *Build. Environ.* **2013**, *68*, 202–214. [[CrossRef](#)]
52. Nam, I.; Yang, J.; Lee, D.; Park, E.; Sohn, J.-R. A Study on the Thermal Comfort and Clothing Insulation Characteristics of Preschool Children in Korea. *Build. Environ.* **2015**, *92*, 724–733. [[CrossRef](#)]
53. Mors, S.; Hensen, J.L.M.; Loomans, M.G.L.C.; Boerstra, A.C. Adaptive Thermal Comfort in Primary School Classrooms: Creating and Validating PMV-Based Comfort Charts. *Build. Environ.* **2011**, *46*, 2454–2461. [[CrossRef](#)]
54. Teli, D.; Jentsch, M.F.; James, P.A.B. Naturally Ventilated Classrooms: An Assessment of Existing Comfort Models for Predicting the Thermal Sensation and Preference of Primary School Children. *Energy Build.* **2012**, *53*, 166–182. [[CrossRef](#)]
55. Martínez-Molina, A.; Boarin, P.; Tort-Ausina, I.; Vivancos, J.-L. Post-Occupancy Evaluation of a Historic Primary School in Spain: Comparing PMV, TSV and PD for Teachers' and Pupils' Thermal Comfort. *Build. Environ.* **2017**, *117*, 248–259. [[CrossRef](#)]

56. Haddad, S.; Osmond, P.; King, S. Revisiting Thermal Comfort Models in Iranian Classrooms during the Warm Season. *Build. Res. Inf.* **2017**, *45*, 457–473. [[CrossRef](#)]
57. Montazami, A.; Gaterell, M.; Nicol, F.; Lumley, M.; Thoua, C. Developing an Algorithm to Illustrate the Likelihood of the Dissatisfaction Rate with Relation to the Indoor Temperature in Naturally Ventilated Classrooms. *Build. Environ.* **2017**, *111*, 61–71. [[CrossRef](#)]
58. Montazami, A.; Gaterell, M.; Nicol, F.; Lumley, M.; Thoua, C. Impact of Social Background and Behaviour on Children's Thermal Comfort. *Build. Environ.* **2017**, *122*, 422–434. [[CrossRef](#)]
59. Teli, D.; James, P.A.B.; Jentsch, M.F. Thermal Comfort in Naturally Ventilated Primary School Classrooms. *Build. Res. Inf.* **2013**, *41*, 301–316. [[CrossRef](#)]
60. Teli, D.; Jentsch, M.F.; James, P.A.B. The Role of a Building's Thermal Properties on Pupils' Thermal Comfort in Junior School Classrooms as Determined in Field Studies. *Build. Environ.* **2014**, *82*, 640–654. [[CrossRef](#)]
61. Teli, D.; Bourikas, L.; James, P.A.B.; Bahaj, A.S. Thermal Performance Evaluation of School Buildings Using a Children-Based Adaptive Comfort Model. *Sustain. Synerg. Build. Urban Scale* **2017**, *38*, 844–851. [[CrossRef](#)]
62. Humphreys, M.A. Clothing and thermal comfort of secondary school children in summertime. In *Thermal Comfort and Moderate Heat Stress*; Langdon: London, UK, 1973.
63. Al-Rashidi, K.E.; Loveday, D.L.; Al-Mutawa, N.K. Investigating the Applicability of Different Thermal Comfort Models in Kuwait Classrooms Operated in Hybrid Air-Conditioning Mode. In *Sustainability in Energy and Buildings*; Howlett, R.J., Jain, L.C., Lee, S.H., Eds.; Springer: Berlin/Heidelberg, Germany, 2013; pp. 347–355, ISBN 978-3-642-36645-1.
64. Kim, J.; Zhou, Y.; Schiavon, S.; Raftery, P.; Brager, G. Personal Comfort Models: Predicting Individuals' Thermal Preference Using Occupant Heating and Cooling Behavior and Machine Learning. *Build. Environ.* **2018**, *129*, 96–106. [[CrossRef](#)]
65. Hamzah, B.; Gou, Z.; Mulyadi, R.; Amin, S. Thermal Comfort Analyses of Secondary School Students in the Tropics. *Buildings* **2018**, *8*, 56. [[CrossRef](#)]
66. Auliciems, A. Thermal Sensations of Secondary Schoolchildren in Summer. *J. Hyg.* **1973**, *71*, 453–458. [[CrossRef](#)]
67. Wong, N.H.; Khoo, S.S. Thermal Comfort in Classrooms in the Tropics. *Energy Build.* **2003**, *35*, 337–351. [[CrossRef](#)]
68. Almeida, R.M.S.F.; de Freitas, V.P.; Delgado, J.M.P.Q. Indoor Environmental Quality in Classrooms: Case Studies. In *School Buildings Rehabilitation: Indoor Environmental Quality and Enclosure Optimization*; Almeida, R.M.S.F., de Freitas, V.P., Delgado, J.M.P.Q., Eds.; Springer International Publishing: Cham, Germany, 2015; pp. 31–57, ISBN 978-3-319-15359-9.
69. Almeida, R.M.S.F.; de Freitas, V.P. IEQ Assessment of Classrooms with an Optimized Demand Controlled Ventilation System. *Energy Procedia* **2015**, *78*, 3132–3137. [[CrossRef](#)]
70. Lee, M.C.; Mui, K.W.; Wong, L.T.; Chan, W.Y.; Lee, E.W.M.; Cheung, C.T. Student Learning Performance and Indoor Environmental Quality (IEQ) in Air-Conditioned University Teaching Rooms. *Build. Environ.* **2012**, *49*, 238–244. [[CrossRef](#)]
71. Kumar, S.; Singh, M.K.; Mathur, A.; Mathur, J.; Mathur, S. Evaluation of Comfort Preferences and Insights into Behavioural Adaptation of Students in Naturally Ventilated Classrooms in a Tropical Country, India. *Build. Environ.* **2018**, *143*, 532–547. [[CrossRef](#)]
72. Mishra, A.K.; Ramgopal, M. Thermal Comfort in Undergraduate Laboratories—A Field Study in Kharagpur, India. *Build. Environ.* **2014**, *71*, 223–232. [[CrossRef](#)]
73. Hu, P.F.; Liu, W.; Jiang, Z. Study on Indoor Thermal Sensation of Young College Students in the Area Which Is Hot in Summer and Cold in Winter. *Age* **2006**, *18*, 18–23.
74. Zaki, S.A.; Damiati, S.A.; Rijal, H.B.; Hagishima, A.; Abd Razak, A. Adaptive Thermal Comfort in University Classrooms in Malaysia and Japan. *Build. Environ.* **2017**, *122*, 294–306. [[CrossRef](#)]
75. Cheng, M.-J.; Hwang, R.-L.; Lin, T.-P. Field Experiments on Thermal Comfort Requirements for Campus Dormitories in Taiwan. *Indoor Built Environ.* **2008**, *17*, 191–202. [[CrossRef](#)]
76. Cao, B.; Zhu, Y.; Ouyang, Q.; Zhou, X.; Huang, L. Field Study of Human Thermal Comfort and Thermal Adaptability during the Summer and Winter in Beijing. *Energy Build.* **2011**, *43*, 1051–1056. [[CrossRef](#)]
77. Hwang, R.-L.; Lin, T.-P.; Kuo, N.-J. Field Experiments on Thermal Comfort in Campus Classrooms in Taiwan. *Energy Build.* **2006**, *38*, 53–62. [[CrossRef](#)]
78. Jowkar, M.; de Dear, R.; Brusey, J. Influence of Long-Term Thermal History on Thermal Comfort and Preference. *Energy Build.* **2020**, *210*, 109685. [[CrossRef](#)]
79. Holmes, M.J.; Hacker, J.N. Climate Change, Thermal Comfort and Energy: Meeting the Design Challenges of the 21st Century. *Energy Build.* **2007**, *39*, 802–814. [[CrossRef](#)]
80. Beck, H.E.; Zimmermann, N.E.; McVicar, T.R.; Vergopolan, N.; Berg, A.; Wood, E.F. Present and Future Köppen-Geiger Climate Classification Maps at 1-Km Resolution. *Sci. Data* **2018**, *5*, 180214. [[CrossRef](#)] [[PubMed](#)]
81. Karyono, T.; Heryanto, S.; Faridah, I. Thermal Comfort Study of University Students in Jakarta, Indonesia. In Proceedings of the 8th Windsor Conference, Windsor, UK, 10–13 April 2014; pp. 1276–1285.
82. Auliciems, A. Thermal Requirements of Secondary Schoolchildren in Winter. *J. Hyg.* **1969**, *67*, 59–65. [[CrossRef](#)]
83. De Dear, R.; Kim, J.; Candido, C.; Deuble, M. Adaptive Thermal Comfort in Australian School Classrooms. *Build. Res. Inf.* **2015**, *43*, 383–398. [[CrossRef](#)]
84. Liu, J.; Yang, X.; Jiang, Q.; Qiu, J.; Liu, Y. Occupants' Thermal Comfort and Perceived Air Quality in Natural Ventilated Classrooms during Cold Days. *Build. Environ.* **2019**, *158*, 73–82. [[CrossRef](#)]

85. D'Ambrosio Alfano, F.; Olesen, B.W.; Palella, B.; Riccio, G.; Pepe, D. Fifty Years of PMV Model: Reliability, Implementation and Design of Software for Its Calculation. *Atmosphere* **2019**, *11*, 49. [[CrossRef](#)]
86. Hwang, R.-L.; Lin, T.-P.; Chen, C.-P.; Kuo, N.-J. Investigating the Adaptive Model of Thermal Comfort for Naturally Ventilated School Buildings in Taiwan. *Int. J. Biometeorol.* **2009**, *53*, 189–200. [[CrossRef](#)]
87. Kwok, A.G.; Chun, C. Thermal Comfort in Japanese Schools. *Sol. Energy* **2003**, *74*, 245–252. [[CrossRef](#)]
88. Hamzah, B.; Kusno, A.; Mulyadi, R. Design of Energy Efficient and Thermally Comfortable Air-Conditioned University Classrooms in the Tropics. *Int. J. Sustain. Energy* **2019**, *38*, 382–397. [[CrossRef](#)]
89. Mishra, A.K.; Ramgopal, M. A Comparison of Student Performance between Conditioned and Naturally Ventilated Classrooms. *Build. Environ.* **2015**, *84*, 181–188. [[CrossRef](#)]
90. Vittal, R. Perceived Thermal Environment of Naturally- Ventilated Classrooms in India. *Creat. Space* **2016**, *3*, 149–166. [[CrossRef](#)]
91. Baruah, P.; Singh, M.; Mahapatra, S. Thermal Comfort in Naturally Ventilated Classrooms. In Proceedings of the 30th International Plea Conference, Ahmedabad, India, 16–18 December 2014.
92. Zhang, G.; Zheng, C.; Yang, W.; Zhang, Q.; Moschandreas, D.J. Thermal Comfort Investigation of Naturally Ventilated Classrooms in a Subtropical Region. *Indoor Built Environ.* **2007**, *16*, 148–158. [[CrossRef](#)]
93. Lawrence, R.; Elsayed, M.; Keime, C. Evaluation of Environmental Design Strategies for University Buildings. *Build. Res. Inf.* **2019**, *47*, 883–900. [[CrossRef](#)]
94. Mishra, A.K.; Derks, M.T.H.; Kooi, L.; Loomans, M.G.L.C.; Kort, H.S.M. Analysing Thermal Comfort Perception of Students through the Class Hour, during Heating Season, in a University Classroom. *Build. Environ.* **2017**, *125*, 464–474. [[CrossRef](#)]
95. Barbhuiya, S.; Barbhuiya, S. Thermal Comfort and Energy Consumption in a UK Educational Building. *Build. Environ.* **2013**, *68*, 1–11. [[CrossRef](#)]
96. Jindal, A. Investigation and Analysis of Thermal Comfort in Naturally Ventilated Secondary School Classrooms in the Composite Climate of India. *Archit. Sci. Rev.* **2019**, *62*, 466–484. [[CrossRef](#)]
97. Liang, H.-H.; Lin, T.-P.; Hwang, R.-L. Linking Occupants' Thermal Perception and Building Thermal Performance in Naturally Ventilated School Buildings. *Appl. Energy* **2012**, *94*, 355–363. [[CrossRef](#)]
98. Corgnati, S.P.; Ansalidi, R.; Filippi, M. Thermal Comfort in Italian Classrooms under Free Running Conditions during Mid Seasons: Assessment through Objective and Subjective Approaches. *Build. Environ.* **2009**, *44*, 785–792. [[CrossRef](#)]
99. Buratti, C.; Ricciardi, P. Adaptive Analysis of Thermal Comfort in University Classrooms: Correlation between Experimental Data and Mathematical Models. *Build. Environ.* **2009**, *44*, 674–687. [[CrossRef](#)]
100. Liu, G.; Jia, Y.; Cen, C.; Ma, B.; Liu, K. Comparative Thermal Comfort Study in Educational Buildings in Autumn and Winter Seasons. *Sci. Technol. Built Environ.* **2020**, *26*, 185–194. [[CrossRef](#)]
101. Almeida, R.M.S.F.; Ramos, N.M.M.; de Freitas, V.P. Thermal Comfort Models and Pupils' Perception in Free-Running School Buildings of a Mild Climate Country. *Energy Build.* **2016**, *111*, 64–75. [[CrossRef](#)]
102. Ali, H.H.; Al-Hashlamun, R. Assessment of Indoor Thermal Environment in Different Prototypical School Buildings in Jordan. *Alex. Eng. J.* **2019**, *58*, 699–711. [[CrossRef](#)]
103. Theodosiou, T.G.; Ordoumpozanis, K.T. Energy, Comfort and Indoor Air Quality in Nursery and Elementary School Buildings in the Cold Climatic Zone of Greece. *Energy Build.* **2008**, *40*, 2207–2214. [[CrossRef](#)]
104. Maki, Y.; Shukuya, M. Visual and Thermal Comfort and Its Relations to Exergy Consumption in a Classroom with Daylighting. *Int. J. Energy* **2012**, *11*, 481–492. [[CrossRef](#)]
105. Serghides, D.; Chatzinikola, C.K.; Katafygiotou, M. Comparative Studies of the Occupants' Behaviour in a University Building during Winter and Summer Time. *Int. J. Sustain. Energy* **2014**, *34*, 528–551. [[CrossRef](#)]
106. Fong, M.L.; Hanby, V.; Greenough, R.; Lin, Z.; Cheng, Y. Acceptance of Thermal Conditions and Energy Use of Three Ventilation Strategies with Six Exhaust Configurations for the Classroom. *Build. Environ.* **2015**, *94*, 606–619. [[CrossRef](#)]
107. Costa, M.L.; Freire, M.R.; Kiperstok, A. Strategies for Thermal Comfort in University Buildings-The Case of the Faculty of Architecture at the Federal University of Bahia, Brazil. *J. Environ. Manag.* **2019**, *239*, 114–123. [[CrossRef](#)] [[PubMed](#)]
108. Bakmohammadi, P.; Noorzai, E. Optimization of the Design of the Primary School Classrooms in Terms of Energy and Daylight Performance Considering Occupants' Thermal and Visual Comfort. *Energy Rep.* **2020**, *6*, 1590–1607. [[CrossRef](#)]
109. Barbosa, F.C.; de Freitas, V.P.; Almeida, M. School Building Experimental Characterization in Mediterranean Climate Regarding Comfort, Indoor Air Quality and Energy Consumption. *Energy Build.* **2020**, *212*, 109782. [[CrossRef](#)]
110. Calama-González, C.M.; Suárez, R.; Leon-Rodríguez, A.; Ferrari, S. Assessment of Indoor Environmental Quality for Retrofitting Classrooms with An Egg-Crate Shading Device in A Hot Climate. *Sustainability* **2019**, *11*, 1078. [[CrossRef](#)]
111. Valladares, W.; Galindo, M.; Gutiérrez, J.; Wu, W.-C.; Liao, K.-K.; Liao, J.-C.; Lu, K.-C.; Wang, C.-C. Energy Optimization Associated with Thermal Comfort and Indoor Air Control via a Deep Reinforcement Learning Algorithm. *Build. Environ.* **2019**, *155*, 105–117. [[CrossRef](#)]
112. Zeiler, W.; Boxem, G. Effects of Thermal Activated Building Systems in Schools on Thermal Comfort in Winter. *Build. Environ.* **2009**, *44*, 2308–2317. [[CrossRef](#)]
113. Aghniaey, S.; Lawrence, T.M.; Sharpton, T.N.; Douglass, S.P.; Oliver, T.; Sutter, M. Thermal Comfort Evaluation in Campus Classrooms during Room Temperature Adjustment Corresponding to Demand Response. *Build. Environ.* **2019**, *148*, 488–497. [[CrossRef](#)]

114. Huang, K.-T.; Hwang, R.-L. Parametric Study on Energy and Thermal Performance of School Buildings with Natural Ventilation, Hybrid Ventilation and Air Conditioning. *Indoor Built Environ.* **2015**, *25*, 1148–1162. [[CrossRef](#)]
115. Tian, X.; Zhang, S.; Lin, Z.; Li, Y.; Cheng, Y.; Liao, C. Experimental Investigation of Thermal Comfort with Stratum Ventilation Using a Pulsating Air Supply. *Build. Environ.* **2019**, *165*, 106416. [[CrossRef](#)]
116. Li, Y.; Tian, X.; Liao, C.; Cheng, Y. Effects of Gender on Thermal Comfort of Stratum Ventilation with Pulsating Air Supply. In *IOP Conference Series: Materials Science and Engineering*; IOP Publishing: Bristol, UK, 2019.
117. Simanic, B.; Nordquist, B.; Bagge, H.; Johansson, D. Indoor Air Temperatures, CO₂ Concentrations and Ventilation Rates: Long-Term Measurements in Newly Built Low-Energy Schools in Sweden. *J. Build. Eng.* **2019**, *25*, 100827. [[CrossRef](#)]
118. Zhang, S.; Lu, Y.; Lin, Z. Coupled Thermal Comfort Control of Thermal Condition Profile of Air Distribution and Thermal Preferences. *Build. Environ.* **2020**, *177*, 106867. [[CrossRef](#)]
119. Jiang, J.; Wang, D.; Liu, Y.; Di, Y.; Liu, J. A Field Study of Adaptive Thermal Comfort in Primary and Secondary School Classrooms during Winter Season in Northwest China. *Build. Environ.* **2020**, *175*, 106802. [[CrossRef](#)]
120. Shrestha, M.; Rijal, H. Study on Adaptive Thermal Comfort in Naturally Ventilated Secondary School Buildings in Nepal. In *IOP Conference Series: Materials Science and Engineering*; IOP Publishing: Bristol, UK, 2019; Volume 294, p. 012062. [[CrossRef](#)]
121. Talarosha, B.; Satwiko, P.; Aulia, D.N. Air Temperature and CO₂ Concentration in Naturally Ventilated Classrooms in Hot and Humid Tropical Climate. In *IOP Conference Series: Earth and Environmental Science*; IOP Publishing: Bristol, UK, 2020; Volume 402, p. 012008. [[CrossRef](#)]
122. Chitaru, G.M.; Istrate, A.; Catalina, T. Numerical Analysis of the Impact of Natural Ventilation on the Indoor Air Quality and Thermal Comfort in a Classroom. *E3S Web Conf.* **2019**, *111*, 01023. [[CrossRef](#)]
123. Liu, S.; Yoshino, H.; Mochida, A. A Measurement Study on the Indoor Climate of a College Classroom. *Int. J. Vent.* **2011**, *10*, 251–262. [[CrossRef](#)]
124. Ranjbar, A. Analysing the Effects of Thermal Comfort and Indoor Air Quality in Design Studios and Classrooms on Student Performance. In *IOP Conference Series: Earth and Environmental Science*; IOP Publishing: Bristol, UK, 2019; Volume 609, p. 042086. [[CrossRef](#)]
125. Branco, P.; Ferraz, M.; Martins, F.; Sousa, S. Quantifying Indoor Air Quality Determinants in Urban and Rural Nursery and Primary Schools. *Environ. Res.* **2019**, *176*, 108534. [[CrossRef](#)]
126. Papadopoulos, G.; Panaras, G.; Tolis, E.I. Thermal Comfort and Indoor Air Quality Assessment in University Classrooms. In *IOP Conference Series: Earth and Environmental Science*; IOP Publishing: Bristol, UK, 2020; Volume 410, p. 012095. [[CrossRef](#)]
127. Toyinbo, O.; Phipatanakul, W.; Shaughnessy, R.; Haverinen-Shaughnessy, U. Building and Indoor Environmental Quality Assessment of Nigerian Primary Schools: A Pilot Study. *Indoor Air* **2019**, *29*, 510–520. [[CrossRef](#)]
128. Schweiker, M.; Ampatzi, E.; Andargie, M.S.; Andersen, R.K.; Azar, E.; Barthelmes, V.M.; Berger, C.; Bourikas, L.; Carlucci, S.; Chinazzo, G.; et al. Review of Multi-domain Approaches to Indoor Environmental Perception and Behaviour. *Build. Environ.* **2020**, *176*, 106804. [[CrossRef](#)]
129. Leccese, F.; Rocca, M.; Salvadori, G.; Belloni, E.; Buratti, C. Towards a Holistic Approach to Indoor Environmental Quality Assessment: Weighting Schemes to Combine Effects of Multiple Environmental Factors. *Energy Build.* **2021**, *245*, 111056. [[CrossRef](#)]
130. Bourikas, L.; Gauthier, S.; Khor Song En, N.; Xiong, P. Effect of Thermal, Acoustic and Air Quality Perception Interactions on the Comfort and Satisfaction of People in Office Buildings. *Energies* **2021**, *14*, 333. [[CrossRef](#)]
131. Wang, D.; Song, C.; Wang, Y.; Xu, Y.; Liu, Y.; Liu, J. Experimental Investigation of the Potential Influence of Indoor Air Velocity on Students' Learning Performance in Summer Conditions. *Energy Build.* **2020**, *219*, 110015. [[CrossRef](#)]
132. Campano Laborda, M.; Domínguez-Amarillo, S.; Fernandez-Aguera, J.; Acosta, I. Indoor Comfort and Symptomatology in Non-University Educational Buildings: Occupants' Perception. *Atmosphere* **2020**, *11*, 357. [[CrossRef](#)]
133. Zhang, D.; Ortiz, M.A.; Bluysen, P.M. Clustering of Dutch School Children Based on Their Preferences and Needs of the IEQ in Classrooms. *Build. Environ.* **2019**, *147*, 258–266. [[CrossRef](#)]
134. Pistore, L.; Pittana, I.; Cappelletti, F.; Romagnoni, P.; Gasparella, A. Analysis of Subjective Responses for the Evaluation of the Indoor Environmental Quality of an Educational Building. *Sci. Technol. Built Environ.* **2020**, *26*, 195–209. [[CrossRef](#)]
135. Chang, S.F.; Hwang, R.L.; Huang, K.T. Improvement of Thermal Comfort in Naturally Ventilated Classrooms by Phase Change Material Roofs in Taiwan. In *IOP Conference Series: Materials Science and Engineering*; IOP Publishing: Bristol, UK, 2019; Volume 609, p. 042034. [[CrossRef](#)]
136. Orosa, J.A.; Oliveira, A.C. A Field Study on Building Inertia and Its Effects on Indoor Thermal Environment. *Renew. Energy* **2012**, *37*, 89–96. [[CrossRef](#)]
137. Salandin, A.; Vettori, M.; Vettori, S. Thin Solar Film Application for Improving Thermal Comfort in Classrooms. In *Construction and Building Research*; Springer: Dordrecht, The Netherlands, 2014; pp. 531–538, ISBN 978-94-007-7789-7.
138. Colinart, T.; Bendouma, M.; Glouanec, P. Building Renovation with Prefabricated Ventilated Façade Element: A Case Study. *Energy Build.* **2019**, *186*, 221–229. [[CrossRef](#)]
139. Castilla, N.; Llinares, C.; Bravo, J.M.; Blanca, V. Subjective Assessment of University Classroom Environment. *Build. Environ.* **2017**, *122*, 72–81. [[CrossRef](#)]

140. Kiil, M.; Simson, R.; de Luca, F.; Thalfeldt, M.; Kurnitski, J. Overheating and Daylighting Evaluation for Free-Running Classroom Designs. In *IOP Conference Series: Materials Science and Engineering*; IOP Publishing: Bristol, UK, 2019; Volume 352, p. 012059. [[CrossRef](#)]
141. Camacho-Montano, S.C.; Cook, M.; Wagner, A. Avoiding Overheating in Existing School Buildings through Optimized Passive Measures. *Build. Res. Inf.* **2020**, *48*, 349–363. [[CrossRef](#)]
142. Chen, Y.H.; Hwang, R.L.; Huang, K.T. Sensitivity Analysis of Envelope Design on the Summer Thermal Comfort of Naturally Ventilated Classrooms in Taiwan. In *IOP Conference Series: Materials Science and Engineering*; IOP Publishing: Bristol, UK, 2019; Volume 609, p. 042035. [[CrossRef](#)]
143. Barrett, P.; Zhang, Y.; Moffat, J.; Kobbacy, K. A Holistic, Multi-Level Analysis Identifying the Impact of Classroom Design on Pupils' Learning. *Build. Environ.* **2013**, *59*, 678–689. [[CrossRef](#)]
144. Yang, Z.; Becerik-Gerber, B.; Mino, L. A Study on Student Perceptions of Higher Education Classrooms: Impact of Classroom Attributes on Student Satisfaction and Performance. *Build. Environ.* **2013**, *70*, 171–188. [[CrossRef](#)]
145. Wargocki, P.; Wyon, D.P. The Effects of Outdoor Air Supply Rate and Supply Air Filter Condition in Classrooms on the Performance of Schoolwork by Children (RP-1257). *HVACR Res.* **2007**, *13*, 165–191. [[CrossRef](#)]
146. Wargocki, P.; Wyon, D.P. The Effects of Moderately Raised Classroom Temperatures and Classroom Ventilation Rate on the Performance of Schoolwork by Children (RP-1257). *HVACR Res.* **2007**, *13*, 193–220. [[CrossRef](#)]
147. Barrett, P.; Davies, F.; Zhang, Y.; Barrett, L. The Impact of Classroom Design on Pupils' Learning: Final Results of a Holistic, Multi-Level Analysis. *Build. Environ.* **2015**, *89*, 118–133. [[CrossRef](#)]
148. Auliciems, A. Classroom Performance as a Function of Thermal Comfort. *Int. J. Biometeorol.* **1972**, *16*, 233–246. [[CrossRef](#)] [[PubMed](#)]
149. Wargocki, P.; Wyon, D.P. Providing Better Thermal and Air Quality Conditions in School Classrooms Would Be Cost-Effective. *Build. Environ.* **2013**, *59*, 581–589. [[CrossRef](#)]
150. Puteh, M.; Ibrahim, M.H.; Adnan, M.; Che'Ahmad, C.N.; Noh, N.M. Thermal Comfort in Classroom: Constraints and Issues. *Procedia-Soc. Behav. Sci.* **2012**, *46*, 1834–1838. [[CrossRef](#)]
151. Barbic, F.; Minonzio, M.; Cairo, B.; Shiffer, D.; Dipasquale, A.; Cerina, L.; Vatteroni, A.; Urechie, V.; Verzelletti, P.; Badilini, F.; et al. Effects of Different Classroom Temperatures on Cardiac Autonomic Control and Cognitive Performances in Undergraduate Students. *Physiol. Meas.* **2019**, *40*, 054005. [[CrossRef](#)] [[PubMed](#)]
152. Bluysen, P. The Need for Understanding the Indoor Environmental Factors and Its Effects on Occupants through an Integrated Analysis. In *IOP Conference Series: Materials Science and Engineering*; IOP Publishing: Bristol, UK, 2019; Volume 609, p. 022001. [[CrossRef](#)]
153. Ortiz, M.A.; Bluysen, P.M. Developing Home Occupant Archetypes: First Results of Mixed-Methods Study to Understand Occupant Comfort Behaviours and Energy Use in Homes. *Build. Environ.* **2019**, *163*, 106331. [[CrossRef](#)]
154. Humphreys, M.A. A Study of the Thermal Comfort of Primary School Children in Summer. *Build. Environ.* **1977**, *12*, 231–239. [[CrossRef](#)]
155. Kwok, A.G. Thermal Comfort in Tropical Classrooms. *ASHRAE Trans.* **1998**, *104*, 1031–1047.
156. Jung, G.J.; Song, S.K.; Ahn, Y.C.; Oh, G.S.; Im, Y.B. Experimental Research on Thermal Comfort in the University Classroom of Regular Semesters in Korea. *J. Mech. Sci. Technol.* **2011**, *25*, 503–512. [[CrossRef](#)]
157. Dias Pereira, L.; Cardoso, E.; Gameiro da Silva, M. Indoor Air Quality Audit and Evaluation on Thermal Comfort in a School in Portugal. *Indoor Built Environ.* **2013**, *24*, 256–268. [[CrossRef](#)]
158. Dias Pereira, L.; Raimondo, D.; Corgnati, S.P.; Gameiro da Silva, M. Assessment of Indoor Air Quality and Thermal Comfort in Portuguese Secondary Classrooms: Methodology and Results. *Build. Environ.* **2014**, *81*, 69–80. [[CrossRef](#)]
159. Huang, K.T.; Huang, W.P.; Lin, T.P.; Hwang, R.L. Implementation of Green Building Specification Credits for Better Thermal Conditions in Naturally Ventilated School Buildings. *Build. Environ.* **2015**, *86*, 141–150. [[CrossRef](#)]
160. Nico, M.A.; Liuzzi, S.; Stefanizzi, P. Evaluation of Thermal Comfort in University Classrooms through Objective Approach and Subjective Preference Analysis. *Appl. Ergon.* **2015**, *48*, 111–120. [[CrossRef](#)]
161. Liu, Y.; Jiang, J.; Wang, D.; Liu, J. The Indoor Thermal Environment of Rural School Classrooms in Northwestern China. *Indoor Built Environ.* **2016**, *26*, 662–679. [[CrossRef](#)]
162. Stazi, F.; Naspi, F.; Ulpiani, G.; Di Perna, C. Indoor Air Quality and Thermal Comfort Optimization in Classrooms Developing an Automatic System for Windows Opening and Closing. *Energy Build.* **2017**, *139*, 732–746. [[CrossRef](#)]
163. Trebilcock, M.; Soto-Muñoz, J.; Yañez, M.; Figueroa-San Martín, R. The Right to Comfort: A Field Study on Adaptive Thermal Comfort in Free-Running Primary Schools in Chile. *Build. Environ.* **2017**, *114*, 455–469. [[CrossRef](#)]
164. Wang, Z.; Ning, H.; Zhang, X.; Ji, Y. Human Thermal Adaptation Based on University Students in China's Severe Cold Area. *Sci. Technol. Built Environ.* **2017**, *23*, 413–420. [[CrossRef](#)]
165. Bluysen, P.M.; Zhang, D.; Krooneman, A.-J.; Freeke, A. The Effect of Wall and Floor Colouring on Temperature and Draught Feeling of Primary School Children. *E3S Web Conf.* **2019**, *111*, 02032. [[CrossRef](#)]
166. Campano Laborda, M.; Domínguez-Amarillo, S.; Fernandez-Aguera, J.; Sendra, J. Thermal Perception in Mild Climate: Adaptive Thermal Models for Schools. *Sustainability* **2019**, *11*, 3948. [[CrossRef](#)]
167. Chen, P.-Y.; Chan, Y.-C. Developing the Methodology to Investigate the Thermal Comfort of Hot-Humid Climate under Different Ventilation Modes. *J. Phys. Conf. Ser.* **2019**, *1343*, 012149. [[CrossRef](#)]

168. Fabozzi, M.; Dama, A. Field Study on Thermal Comfort in Naturally Ventilated and Air-Conditioned University Classrooms. *Indoor Built Environ.* **2019**, *29*, 851–859. [[CrossRef](#)]
169. Haddad, S.; Osmond, P.; King, S. Application of Adaptive Thermal Comfort Methods for Iranian School children. *Build. Res. Inf.* **2019**, *47*, 173–189. [[CrossRef](#)]
170. Heracleous, C.; Michael, A. Experimental Assessment of the Impact of Natural Ventilation on Indoor Air Quality and Thermal Comfort Conditions of Educational Buildings in the Eastern Mediterranean Region during the Heating Period. *J. Build. Eng.* **2019**, *26*, 100917. [[CrossRef](#)]
171. Huang, M.; Zhang, G. Research on Thermal Environment of University Classrooms in Severe Cold Areas Based on Different Seating Rate. In *IOP Conference Series: Earth and Environmental Science*; IOP Publishing: Bristol, UK, 2019; Volume 330, p. 032064.
172. Koranteng, C.; Simons, B.; Essel, C. Climate Responsive Buildings: A Comfort Assessment of Buildings on KNUST Campus, Kumasi. *J. Eng. Des. Technol.* **2019**, *17*, 862–877. [[CrossRef](#)]
173. Liu, J.; Luo, Q.; Cai, T. Students Responses to Thermal Environments in University Classrooms in Zunyi, China. In *IOP Conference Series: Earth and Environmental Science*; IOP Publishing: Bristol, UK, 2019; Volume 592, p. 012168. [[CrossRef](#)]
174. Monna, S.; Baba, M.; Juaidi, A.; Barlet, A.; Bruneau, D. Improving Thermal Environment for School Buildings in Palestine, the Role of Passive Design. *J. Phys. Conf. Ser.* **2019**, *1343*, 012190. [[CrossRef](#)]
175. Shen, J.Y.; Kojima, S.; Ying, X.Y.; Hu, X.J. Influence of Thermal Experience on Thermal Comfort in Naturally Conditioned University Classrooms. *Lowland Technology International. Lowl. Technol. Int.* **2019**, *21*, 107–122.
176. Al-Khatri, H.; Alwetaishi, M.; Gadi, M. Exploring Thermal Comfort Experience and Adaptive Opportunities of Female and Male High School Students. *J. Build. Eng.* **2020**, *31*, 101365. [[CrossRef](#)]
177. Da Silva Júnior, A.; Mendonça, K.C.; Vilain, R.; Pereira, M.L.; Mendes, N. On the Development of a Simplified Model for Thermal Comfort Control of Split Systems. *Build. Environ.* **2020**, *179*, 106931. [[CrossRef](#)]
178. Hamzah, B.; Mulyadi, R.; Amin, S.; Kusno, A. Adaptive Thermal Comfort of Naturally Ventilated Classrooms of Elementary Schools in the Tropics. In *IOP Conference Series: Earth and Environmental Science*; IOP Publishing: Bristol, UK, 2020; Volume 402, p. 012021. [[CrossRef](#)]
179. Heracleous, C.; Michael, A. Thermal Comfort Models and Perception of Users in Free-Running School Buildings of East-Mediterranean Region. *Energy Build.* **2020**, *215*, 109912. [[CrossRef](#)]
180. Jowkar, M.; Rijal, H.B.; Brusey, J.; Montazami, A.; Carlucci, S.; Lansdown, T.C. Comfort Temperature and Preferred Adaptive Behaviour in Various Classroom Types in the UK Higher Learning Environments. *Energy Build.* **2020**, *211*, 109814. [[CrossRef](#)]
181. Jowkar, M.; Rijal, H.B.; Montazami, A.; Brusey, J.; Temeljotov-Salaj, A. The Influence of Acclimatization, Age and Gender-Related Differences on Thermal Perception in University Buildings: Case Studies in Scotland and England. *Build. Environ.* **2020**, *179*, 106933. [[CrossRef](#)]
182. Korsavi, S.S.; Montazami, A. Children's Thermal Comfort and Adaptive Behaviours; UK Primary Schools during Non-Heating and Heating Seasons. *Energy Build.* **2020**, *214*, 109857. [[CrossRef](#)]
183. Liu, J.; Yang, X.; Liu, Y. A Thermal Comfort Field Study of Naturally Ventilated Classrooms during Spring and Autumn in Xi'an, China. In *Proceedings of the 11th International Symposium on Heating, Ventilation and Air Conditioning (ISHVAC 2019)*; Wang, Z., Zhu, Y., Wang, F., Wang, P., Shen, C., Liu, J., Eds.; Springer: Singapore, 2020; pp. 1073–1081.
184. Munonye, C.; Ji, Y. Evaluating the Perception of Thermal Environment in Naturally Ventilated Schools in a Warm and Humid Climate in Nigeria. *Build. Serv. Eng. Res. Technol.* **2020**, *42*, 5–25. [[CrossRef](#)]