

# An interdisciplinary review of energy storage for communities: challenges and perspectives

David Parra<sup>a1</sup>, Maciej Swierczynski<sup>b</sup>, Daniel I. Stroe<sup>b</sup>, Stuart. A. Norman<sup>c</sup>, Andreas Abdon<sup>d</sup>, Jörg Worlitschek<sup>d</sup>, Travis O'Doherty<sup>a2</sup>, Lucelia Rodrigues<sup>e</sup>, Mark Gillott<sup>e</sup>, Xiaojin Zhang<sup>f</sup>, Christian Bauer<sup>f</sup>, Martin K. Patel<sup>a</sup>.

<sup>a</sup> Energy Efficiency Group, Institute for Environmental Sciences and Forel Institute, University of Geneva, Boulevard Carl-Vogt 66, 1205 Genève, Switzerland

<sup>b</sup> Department of Energy Technology, Aalborg University, Pontoppidanstræde 111, Aalborg 9220, Denmark

<sup>c</sup> E.ON UK plc. Ratcliffe on Soar, Nottingham NG11 0EE, UK

<sup>d</sup> Lucerne University of Applied Sciences & Arts. Technikumstrasse 21, 6048, Horw, Switzerland

<sup>e</sup> Department of Architecture and Built Environment, Faculty of Engineering, University of Nottingham, University Park, NG72RD UK

<sup>f</sup> Technology Assessment Group, Paul Scherrer Institut, Villigen PSI, Switzerland

## Abstract

Given the increasing penetration of renewable energy technologies as distributed generation embedded in the consumption centres, there is growing interest in energy storage systems located very close to consumers. These systems allow to increase the amount of renewable energy generation consumed locally, they provide opportunities for demand-side management and help to decarbonise the electricity, heating and transport sectors.

In this paper, the authors present an interdisciplinary review of community energy storage (CES) with a focus on its potential role and challenges as a key element within the wider energy system. The discussion includes: the whole spectrum of applications and technologies with a strong emphasis on end user applications; techno-economic, environmental and social assessments of CES; and an outlook on CES from the customer, utility company and policy-maker perspectives. Currently, in general only traditional thermal storage with water tanks is economically viable. However, CES is expected to offer new opportunities for the energy transition since the community scale introduces several advantages for electrochemical technologies such as batteries. Technical and economic benefits over energy storage in single dwellings are driven by enhanced performance due to less spiky community demand profile and economies of scale respectively. In addition, CES brings new opportunities for citizen participation within communities and helps to increase awareness of energy consumption and environmental impacts.

**Keywords:** energy storage; community; renewable energy technologies; interdisciplinary review

## Terminology

- CAPEX: capital expenditure

<sup>1</sup> e-mail: [david.parra@unige.ch](mailto:david.parra@unige.ch)

<sup>2</sup> Moved to Eastern and Midland Regional Assembly. Current e-mail address: [TODoherty@emra.ie](mailto:TODoherty@emra.ie)

Mis en forme : Polonais

Mis en forme : Polonais

Mis en forme : Polonais

- 39 • CES: community energy storage
- 40 • CHP: combined heat and power
- 41 • DHW: domestic hot water
- 42 • DSO: distribution system operator
- 43 • EV: electric vehicle
- 44 • ES: energy storage
- 45 • EV: electric vehicle
- 46 • FIT: feed-in tariff
- 47 • FC: fuel cell
- 48 • GHG: greenhouse gas
- 49 • HP: heat pump
- 50 • IRR: internal rate of return
- 51 • LCA: life cycle assessment
- 52 • Li-ion: lithium-ion
- 53 • PbA: lead-acid
- 54 • PCM: phase change material
- 55 • PEM: polymer electrolyte membrane
- 56 • PEMFC: polymer electrolyte membrane fuel cell
- 57 • PV: photovoltaics
- 58 • RE: renewable energy
- 59 • RTP: real-time-pricing
- 60 • SOFC: solid oxide fuel cell
- 61 • ToU: time-of-use

## 62 **1. Introduction**

63 The pressure to cut greenhouse gas (GHG) emissions and to save fossil fuels has directed  
64 attention to solutions that can contribute to meeting society's energy needs while minimising  
65 associated GHG emissions. The most widely endorsed solutions are renewable energy (RE)  
66 technologies and energy efficiency, while nuclear energy and carbon capture and storage  
67 are generally viewed more critically. RE has been the fastest growing technology and since  
68 2011 accounted for more than half of all capacity built in the power sector. In 2013, 22% of  
69 the global electricity supply was provided by RE sources (a 51.3% increase from 2004) [1].  
70 While the main contributor to that share, hydro (76.4% of the global renewable electricity  
71 generation), is a dispatchable supply source (run-off river installations to a lesser extent), the  
72 faster growing technologies, namely wind turbines and solar photovoltaics (PV) energy are  
73 stochastic since their generation profiles are intrinsically linked with the weather conditions  
74 [2]. Another important characteristic of solar PV and wind systems is their modularity. Solar  
75 and wind generators have been extensively installed within distributed power generation  
76 systems, i.e. close to the demand centres. This is particularly the case for PV since 48% and  
77 34%, respectively, of the total installed capacity correspond to installations with a nominal  
78 power lower than 50 kW<sub>p</sub> in the UK and 40 kW<sub>p</sub> in Germany, respectively [3, 4]. In contrast,  
79 the power capacity of both wind generators and wind farms are increasing due to economies  
80 of scale.

81 From the demand side perspective, key challenges arise from the decarbonisation of heating  
82 demand and the transport sector. In this context, coupling of low GHG electricity generation  
83 with heat pumps (HPs) and electric vehicles (EVs) are currently being proposed in several  
84 countries. For example, HPs accounted for 9% and 12% of the space heating supply in  
85 Germany and Switzerland in 2012 respectively [5], but this share is 30% for newly built  
86 houses in Germany. By 2030, between 17% and 29% of space heating demand in Germany

87 is expected to be provided by HPs according to market forecasts [6]. In view of further R&D  
88 needs and regulatory gaps [7] as well as prevailing market forces and consumer  
89 preferences, these technologies are expected to become dominant only within the 2030-  
90 2050 timeframe.

91 Against this background, technologies providing additional flexibility to energy systems  
92 should be implemented, however without relying on fossil fuels. Energy storage (ES) is  
93 attracting increasing attention as it improves the dispatchability of RE technologies while  
94 handling different energy carriers such as electricity, heat and gases and creates a more  
95 integrated energy system. Within the ES domain, community energy storage (CES) is  
96 emerging as a modular concept to be implemented close to energy consumption centres in  
97 connection with RE plants owned by end users. CES could support further penetration of  
98 distributed RE technologies through: i) allowing end users to shift surplus generation to meet  
99 their demand load later; ii) maintaining grid stability (i.e., by supplying matching capability,  
100 compensating peak demand and offering solutions for related balancing issues); iii)  
101 internalising system benefits into economic revenues when taking part in different markets  
102 e.g., electricity wholesale and frequency markets; iv) and catalysing grassroots initiatives  
103 with the participation of community members that facilitate the socio-economic development  
104 of the district/community.

105 Several review studies on ES have been published given its relevance for future energy  
106 systems. Some of the first reviews, for example by Ibrahim et al. [8], Chen et al. [9] and  
107 Huggins [10], discussed the ES concept and mission including the whole spectrum of ES  
108 applications, technologies and related key technical characteristics such as capacity,  
109 efficiency and durability. Other authors reviewed a part of the full spectrum of ES  
110 applications and related technologies, e.g. the review of electricity storage applications by  
111 Brunet [11]; a review of ES technologies for wind power applications by Díaz-González et al.  
112 [12]; and the review of phase change materials (PCMs) for building applications by Cabeza  
113 et al. [13]. Given the continuous attention to ES, recent reviews have become more specific,  
114 focussing on the recent development of a particular technology, application, scale and/or  
115 country. Some examples are the evaluations of Stan et al. on lithium-ion (Li-ion) batteries for  
116 power and automotive applications [14]; Niaz et al. on hydrogen storage [15]; Lyons et al. on  
117 demonstrations projects in UK distribution grids [16]; and a comparative analysis of the life  
118 cycle cost of different ES technologies by Zakeri et al. [17].

119 Considering the increased self-generation of energy and the modularity of several ES  
120 technologies, communities have been recently suggested as a key scale for energy systems  
121 [18, 19] and ES in particular, allowing to make use of significant technical advantages [20-  
122 22]; to exploit economic benefits [21, 23] and to engage local communities and promote  
123 social development linked with local RE supply [24-27]. Some reviews on CES have already  
124 been published. For example, Zhu et al. discussed distributed ES using battery technology  
125 for residential community applications [28]. B.P Roberts analysed its role for the  
126 development of smart grids [29] while Asgeirsson provided a brief update on the status of  
127 CES projects funded by Department of Energy (USA) [30]. All these previous studies and  
128 reviews on CES (and distributed ES in general) share similar characteristics. Firstly, the  
129 main focus was on technologies and applications supporting optimum electricity grid  
130 performance. Secondly, electricity and heat storage were discussed independently even  
131 though technologies such as HPs and combined heat and power (CHP) units connect both  
132 demands. Finally, no particular interest was paid to the role of end users (customers who  
133 consume and potentially generate energy, electricity and heat at home) although they are an  
134 important driver of the energy transition by purchasing and using RE and/or other lower  
135 carbon technologies. Therefore, there is a need for a more comprehensive review on CES

136 that considers the multiple benefits of CES holistically: a) including CES applications  
 137 depending on the involved stakeholder, i.e. end user, utility company and/or distribution  
 138 system operator (DSO); b) considering different temporal ES scales for both electricity and  
 139 heat; c) analysing the impacts of CES across the three pillars of sustainability (namely  
 140 economy, environment and society); and d) discussing the role of different stakeholders  
 141 such as end users, utility companies and policy-makers.

## 142 2. Scope of this review

143 CES has been suggested as an intermediate solution between single-home ES systems and  
 144 grid-scale ES systems, for balancing local intermittent RE generation and dynamic demand  
 145 loads including HPs and EVs in residential areas [29]. The scale of single home, community  
 146 and grid scale ES is schematically represented in Fig. 1 and compared in Table 1.


147 Table 1: Comparison of the features of ES implementation at different scales, adapted from [22].

	Bulk	Grid-scale	Community	Single home
<b>Most beneficial applications</b>	For generators and the network	For the network (regional electricity and/or heat network)	For the end users and the network	For the end user
<b>Scale (ES capacity)</b>	MWh-GWh	MWh	Tens or hundreds of kWh	Up to 20 kWh
<b>Location</b>	Connected to electricity transmission networks	Connected to electricity or heat transmission networks	Connected to local distribution networks	“Behind the meter” in single properties

148  
 149 Table 1 can serve as starting point for a comparative analysis of CES. Some of the  
 150 services potentially provided by CES systems have been previously investigated in single  
 151 homes or for distribution networks (typically next to the transformer between the transmission  
 152 and distribution grids). Therefore, methodological aspects, results and/or demonstrations  
 153 from ES utilised in single homes, districts or distribution networks are also included in this  
 154 review when relevant but differences with the CES scale are highlighted when necessary.  
 155 The residential sector is the centre of attention of this study but commercial buildings can be  
 156 also integrated within communities. In this case, the CES capacity requirements may be  
 157 different given the different demand patterns of commercial buildings. As remote  
 158 communities isolated from the main electricity network have already been identified in the  
 159 literature as one of the most important economic and sustainable applications of CES  
 160 systems [31], they will not be part of the scope of this work. However, some of the technical  
 161 conclusions elaborated in this study, mainly those related to ES technologies, mini-grids and  
 162 end user applications, also apply for off-grid applications and autonomous communities.  
 163 This review is not limited geographically but most examples are taken from countries with  
 164 fast diffusion of RE and other low carbon technologies and in the case of thermal storage,  
 165 with temperate climate. Results are primarily taken from experience made with existing  
 166 systems although some ex-ante modelling is considered for future developments.

167

Mis en forme : Police :11 pt

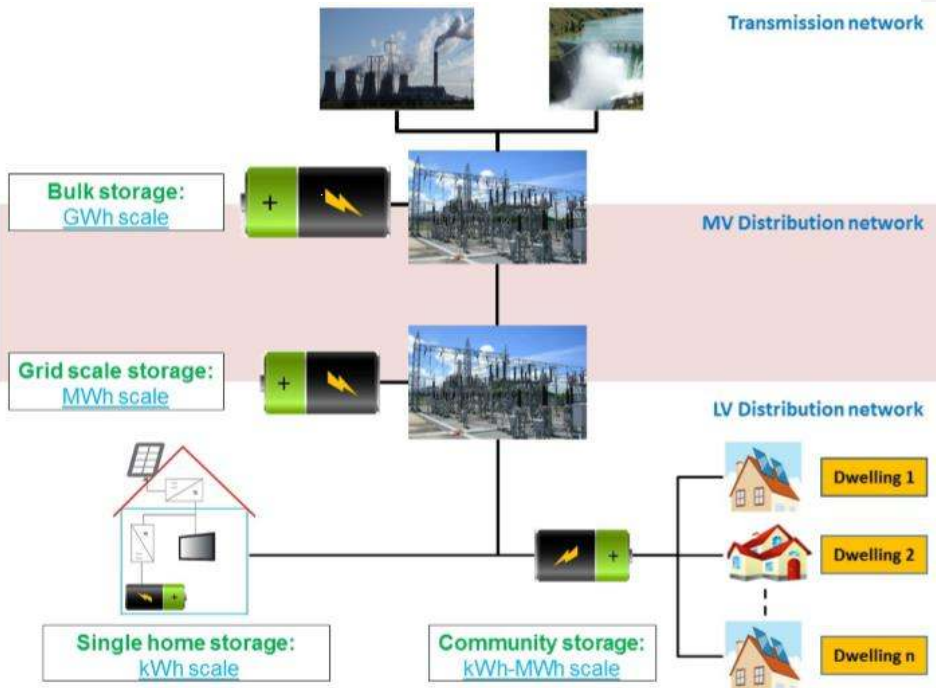

168

169 *Fig. 1: Schematic representation of the scale of CES studied in this paper in comparison with single*  
 170 *home and grid-scale ES.*

171 From a technology perspective, the solutions presented in this paper are those which are the  
 172 most suitable for community applications without addressing mobility applications. Thus,  
 173 technologies such as pumped-hydro and compressed-air ES are not considered in this  
 174 review because they are not modular for the community scale (typically they are used for the  
 175 MW/GW scale) and they have special requirements in terms of geographical locations [10].  
 176 Furthermore, 'power' technologies such as flywheels and supercapacitors are only  
 177 considered as part of hybrid systems due to their limited ES capability [9, 32-34] which are  
 178 not well-matched to the demands required by CES applications.

### 179 3. End user applications

180 CES applications which have a direct impact on the energy bills of end users are discussed  
 181 in this section. For example, CES could be utilised for increasing the amount of locally-  
 182 consumed energy generated from RE plants; or shifting part of the electricity import to off-  
 183 peak periods; and/or reducing the capacity rating of a heat supply system. In this study,  
 184 these applications are referred to as "end user applications" [21, 35]. The first variant of this  
 185 application, self-consumption, is described using solar PV as an example since it has been  
 186 the fastest-growing RE technology worldwide over the last decade (cumulative installed  
 187 capacity has grown at an average rate of approximately 50% per year) and is very suitable  
 188 for the built environment [36]. However, similar self-consumption strategies are being utilised  
 189 for other RE generators implemented in the built environment, namely solar thermal  
 190 collectors and wind generators.


191

192

193

194

### 3.1 PV strategies beyond self-consumption

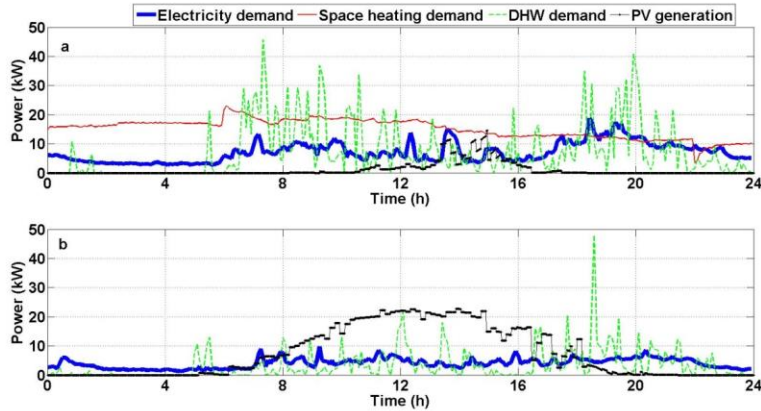

195

196

197 *Fig. 2: Electricity, domestic hot water (DHW) and space heating monitored demands and as well as*  
198 *simulated PV generation from a 25 kW PV array in a 12-dwelling low carbon community (Minergie*  
199 *standard) located in Geneva: (a) 15 January; and (b) 15 July [37]*

200 Volatile energy production by PV systems causes mismatch between peak-demands periods  
201 of power production and consumption on a daily basis as shown in Fig. 2 for a low  
202 community in Geneva. This creates technical (voltage and frequency variation) and  
203 economic challenges (expensive dispatch due to the use of more costly generation sources)  
204 in the electricity system as discussed in Section 6. Fig. 2 also illustrates the seasonal  
205 mismatch since more PV energy is generated during summer days when demand is lower.  
206 At the moment, the most common usage for PV-coupled CES systems is maximisation of  
207 self-consumption. It aims to shift any surplus PV generation to meet local demand later. PV  
208 self-consumption has been intensively investigated in single homes given the important  
209 penetration of PV technology at this scale [38, 39]. However, by means of model-based  
210 assessments, Parra et al. determined the levelised cost of batteries for communities ranging  
211 from a single home up to 100 homes and concluded that the community approach reduced  
212 the levelised cost by 37% as compared to single-home residential battery systems in a  
213 projected 2020 scenario in the UK (assumed electricity price and discount rate of 0.24  
214 US\$<sup>3</sup>/kWh and 10% respectively) [22]. This improvement was possible due to the benefits  
215 of aggregation of demands across the various homes (see Fig. 3) on the battery  
216 and the reduction of the capital expenditure (CAPEX) due to economies of scale [22].

217

<sup>3</sup> 1.4 is the assumed conversion rate between British pound and US dollar

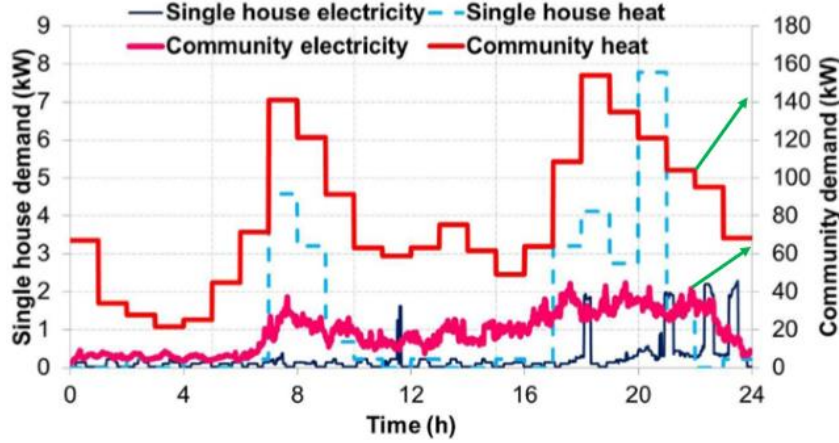


Fig. 3: Electricity and heat demand (both space heating and DHW) of a single home and 50 homes monitored in a community located in the UK (Milton Keynes) with a temporal resolution of 1 minute and 1 hour respectively.

The economic driver for performing PV self-consumption is the higher price of the electricity imported to a dwelling (i.e. purchased),  $P_i$  (US\$/kWh), in comparison to the value assigned to the exported PV electricity (i.e. sold),  $P_{ex}$  (US\$/kWh).  $P_{ex}$  corresponds to the electricity price in the wholesale market or alternatively to a feed-in tariff (FiT) support scheme. The price of imported electricity  $P_i$  is three to four times larger than  $P_{ex}$  [40]. Therefore, PV self-consumption is more attractive in countries which limited (or removed) the FiT related to the electricity export, a decision which is increasingly being taken because of the high societal costs of FiTs, achievement of grid parity (Germany) [41] and/or support policy change after a certain level of installed capacity has been reached as well as a more market-oriented strategy (e.g., UK and Switzerland) [42] [43]. Equation (2), derived from Equation (1), is used to determine the revenue generated by performing PV self-consumption in which  $E_{char}$  (kWh) and  $E_{dis}$  (kWh) refer to the CES charge and discharge [22]. The round trip efficiency of the CES system,  $\eta$ , is the ratio of the battery discharge to the charge including the efficiency of the bidirectional inverter.

$$Rev_{PVSC} = E_{dis} \times P_i - E_{char} \times P_{ex} \quad (1)$$

$$Rev_{PVSC} = E_{char} \times P_i \times \left( \eta - \frac{P_{ex}}{P_i} \right) \quad (2)$$

In addition to the available surplus PV energy, the most important parameters for maximising the value created by PV self-consumption are the electricity retail price ( $P_i$ ) and the round trip efficiency of the CES system. The available surplus energy depends on the local irradiance and the rating of the PV installation (relative to the local community demand), while the economic benefits are proportional to the PV penetration of the community (defined as the percentage of homes with a PV installation), with percentages higher than 75% needed for minimising the levelised cost and maximising the profitability [22]. Germany ( $P_i$  equal to 0.33 US\$/kWh), Denmark (0.36 US\$/kWh) and Australia (0.26<sup>5</sup> US\$/kWh) are examples of

<sup>4</sup> 1.15 is the assumed conversion rate between EURO and US dollar

<sup>5</sup> 0.77 is the assumed conversion rate between Australian dollar and US dollar

246 countries where PV self-consumption is attractive at the moment from a retail electricity price  
 247 perspective. The round trip efficiency strongly depends on the ES technology utilised for  
 248 CES. Li-ion batteries, which are discussed in Section 7.2, with a round trip efficiency ranging  
 249 from 80-90% [44] are the most suitable technology for the required daily charge/discharge  
 250 cycles. According to Fig. 2, the battery could potentially charge up to 6 hours on a daily  
 251 basis but this is typically reduced to 2 hours due to optimum techno-economic sizing (in order  
 252 to maximize the number of days the battery is fully charged) [22]. However, other  
 253 technologies including PbA batteries [22], hydrogen, redox batteries [45] and hot water tanks  
 254 [46] have also been utilised and analysed both in modelling and experimental work. Recent  
 255 research has also addressed how PV-coupled CES could be utilised in order to introduce  
 256 further benefits to the electrical system beyond self-consumption. The main strategies for  
 257 PV-coupled CES systems are outlined in Table 2.

258 *Table 2: Different control strategies which could be implemented with a CES system connected to a*  
 259 *PV system.*

PV strategies	References
<b>Maximisation of self-consumption</b>	[22, 47, 48]
<b>Reduction of peak export</b>	[49, 50]
<b>Reduction of peak import</b>	[47, 49]
<b>Advanced Battery management</b>	[51, 52]
<b>PV electricity constant supply</b>	[53, 54]
<b>Seasonal storage</b>	[55, 56]
<b>Reduction of PV output variation/control of ramp-rates</b>	[47, 57]
<b>Fully programmable PV production profile</b>	[58, 59]

### 260 3.2 Demand strategies beyond load shifting

261 Given its location near to end-users, CES systems can also be operated to perform cost-  
 262 optimisation of (retail) electricity tariffs which vary throughout the day, i.e. time-varying tariffs.  
 263 These tariffs are offered by utility companies in order to translate the wholesale market price  
 264 (i.e. system fuel cost) by hour to end users and/or promote the smoothing of the daily  
 265 demand peak by using more cost-effective base load generation. By analogy with PV self-  
 266 consumption, the revenue of a CES system performing demand load shifting can be  
 267 determined using Equation (4) derived from Equation (3), in which  $P_{i-p}$ ,  $P_{i-op}$  and *period* refer  
 268 to the peak electricity import price, off-peak electricity import price and the number of  
 269 periods of the tariff.

$$270 \text{Rev}_{DLS} = \sum_{p=1}^{\text{period}} E_{dis} \times P_{i-p} - E_{char} \times P_{i-op} \quad (3)$$

$$\text{Rev}_{DLS} = \sum_{p=1}^{\text{period}} E_{char} \times P_{i-p} \times \left( \eta - \frac{P_{i-op}}{P_{i-p}} \right) \quad (4)$$


271 In the context of CES systems, time-of-use (ToU) tariffs (defined as those in which the  
 272 number of periods and related price value are constant throughout the day and known by  
 273 customers in advance) have been the most studied options. Zheng et al. determined the  
 274 profit for 15 different ES technologies performing demand load shifting in an "average" single  
 275 house in USA. Profits varied from 1% to 48% of the annual electricity costs depending on  
 276 the technology and type of ToU tariff. Short-term ES became more competitive when the  
 277 ToU tariff included a capacity component but cost was still higher than profit for all ES  
 278 technologies [60]. Alternatively, tariffs in which the number of periods per day and/or the



279 price value vary depending on electricity prices in wholesale markets, i.e. real-time pricing  
280 (RTP) tariffs, have also been studied. Using a mixed-integer linear programming (MILP)  
281 framework, Erdinc et al. quantified the required battery capacity depending on different  
282 dynamic response based load patterns [61]. The coupling of CES and demand response  
283 programs was suggested in order to anticipate the optimum ES capacity. Parra et al.  
284 optimised CES systems using PbA and Li-ion technology for both ToU and RTP tariffs [62]  
285 for a projected scenario in 2020. The discharge value for demand load shifting was lower  
286 than for PV energy time-shift since the price of the exported electricity in Equation (2) is  
287 lower than the off-peak price in Equation (4). PbA batteries with a storage medium cost equal  
288 to 210 US\$/kWh were more economically viable than Li-ion batteries (storage medium cost  
289 of 430 US\$/kWh) for demand load-shifting (without rewarding demand peak shaving)  
290 because this application requires conservative ratios of power rating to energy capacity.  
291 Electricity and heat demand load shifting with hydrogen storage have also been  
292 experimentally demonstrated for a low carbon community in Nottingham (UK) [63]. The  
293 energy rating is decoupled from the power rating and this allowed the electrolyser to run at  
294 full load when the electricity price was very low and provided energy for days afterwards, i.e.  
295 operating as mid and long term ES (as compared to battery storage).

296 Beyond shifting energy demand (kWh) from peak to off-peak periods based on energy  
297 prices, CES systems have also the potential of minimising the electricity demand (grid  
298 import) peaks, so called demand peak-shaving. This application becomes more relevant for  
299 the residential sector when heating, cooling and/or EV demand loads are supplied with  
300 electricity-driven technologies [64]. Although this application is very relevant for DSOs in  
301 charge of distributing electricity to end users (and accordingly liable for the cost of upgrading  
302 the distribution infrastructure to meet any increase in peak demand), end users with a CES  
303 system can only economically benefit from it when the tariff has a capacity component [65]. A  
304 detailed analysis of end-user reactions and the related grid upgrade costs, i.e. residential  
305 price-reflectivity on capacity tariffs, was performed by Jargstorf et al. using capacity tariffs  
306 [66]. A case study led to the conclusion that an import capacity tariff does not guarantee a  
307 final cost reduction for the DSO but this changed when a capacity component on the PV  
308 injection was also added.

309 The spectrum of ES technologies available for peak shaving is wide, e.g. battery for  
310 communities with EVs and HPs [64]; PCM for space heating and freezer applications [67];  
311 cold thermal storage for cities in semiarid areas [68]; and cold thermal storage for  
312 commercial buildings [69]. The main drivers for the use of CES systems for managing  
313 electricity demand in communities together with the different types of tariffs which could be  
314 implemented to incentivise end users' participation are schematically presented in [Fig. 4](#)  
315 Regardless of the type of tariff, demand forecast techniques are required to maximise the  
316 techno-economic benefits, i.e. it is essential to anticipate how much CES capacity is required  
317 and when it should be available for shifting the demand to off-peak.

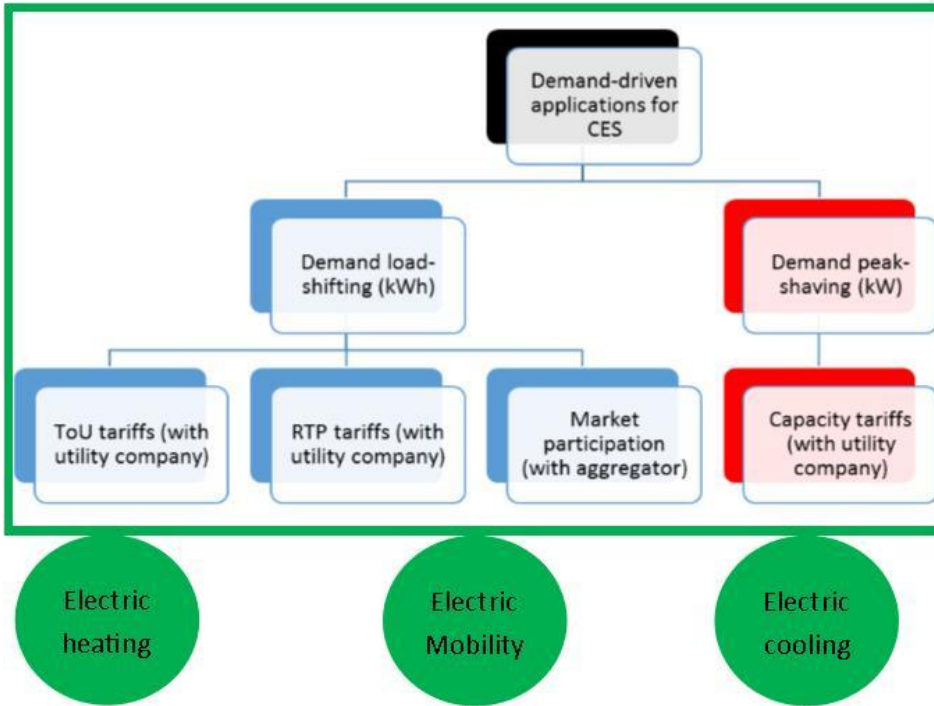


318

319 *Fig. 4: Schemat representation of the different drivers for the management of community demands by*  
 320 *CES systems*

321 **3.3 Heat supply and heat demand management**

322 From a demand perspective, both space heating and DHW demands require moderate  
 323 temperatures around 30°C and 55°C respectively, but the former is still 3-5 times larger in  
 324 new households in regions with temperate climate. Likewise, DHW demand remains fairly  
 325 constant over the year, but the space heating demand of a building typically has a significant  
 326 variation according to changing ambient conditions in different seasons. As shown in [Fig.](#)  
 327 for residential building located in Strasbourg (several different building envelopes being  
 328 considered: 15, 45 and 100 kWh/m<sup>2</sup> p.a.), the heating demand is zero in summer and  
 329 reaches its maximum in winter whereas the available solar energy shows the opposite  
 330 characteristics with a winter period peak supply of only one third of the summer peak supply.

331

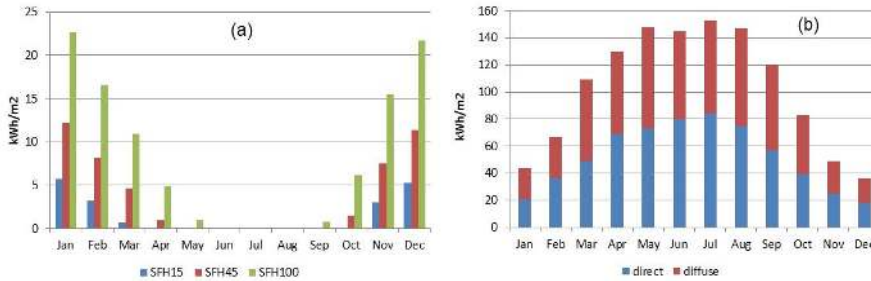

332

333 *Fig. 5: (a) Heating demand for a single family home in Strasbourg of different building envelope*  
334 *designs referred to as SHF 15, SHF 45 and SHF 100 (i.e. 15, 45 and 100 kWh/m<sup>2</sup> p.a.); (b) Available*  
335 *solar thermal energy. With permission from [70].*


336 The mismatch between heat demand and supply represents an opportunity for CES since  
337 several benefits can be generated by decoupling of the energy demand and supply. In the  
338 evaluation of Goh et al. [71], a seasonal storage solution in the form of a helical borehole  
339 CES is used for levelling the winter peak demand for several large buildings. In combination  
340 with a HP, this solution results in a system which only requires 1 kWh of electricity to  
341 generate 10 kWh of heat on an annual basis (i.e. annual coefficient of performance equal to  
342 10). During the colder seasons short term CES may be needed due to day and night  
343 variations in ambient temperature and the lack of solar energy supply during night. For this  
344 purpose water based thermal CES systems and PCMs may be applicable and it is also  
345 possible to use the building itself as a passive ES system [72]. PCMs integrated into the  
346 building envelope can provide energy savings and reductions in peak demand in the order of  
347 15-20% [73].

348 The use of thermal ES for demand peak shaving is also commonly found in building heating  
349 applications [74] and cooling applications [75] as a means of cost reduction. With the  
350 installation of cold water or ice storage, the investment cost of the chiller and cooling tower  
351 can be lowered and (in most cases) more importantly the electricity connection fee is  
352 significantly reduced. As discussed in the previous section, the exploitation of tariffs is also a  
353 factor that can incentivise thermal based CES as a supplement to chillers as well as HPs  
354 [69]. Although thermal based CES creates most value in terms of primary energy savings  
355 and GHG emission reductions in direct combination with RE sources, its integration with  
356 other efficient technologies such as CHPs and HPs is being proposed. For example, local  
357 electricity generation with CHP units may benefit from high electricity prices during peak  
358 electricity demand which often does not coincide with the peak heating demand [76].  
359 Likewise, electricity demand side management with thermal storage together with HPs,  
360 chillers or electrical boilers is also being used for reducing peak loads in the electricity grid  
361 [77] and may also displace fossil-based peak load units for electricity generation [78].

#### 362 **4. Distribution network applications and electricity markets**

363 The reduction of barriers for ES technologies to participate in the ancillary services markets  
364 has given a boost to ES penetration in the grid and the penetration is expected to continue  
365 increasing [79]. This is especially visible in California, where the Federal Regulatory  
366 Commission has removed barriers for ES systems to participate in ancillary service markets  
367 as well as introduced structural changes, which are favourable for fast reacting ES systems  
368 with high accuracy of the power output control increasing [79, 80]. There is a high number of

369 potential CES applications in the electricity markets and in the distribution network, as  
 370 schematically represented in Fig. 6 Fig. 6, which were so far mostly provided by non-  
 371 environmentally friendly generation units. In the following part, the overview of the most  
 372 important ancillary services for CES systems is presented. Given the fact that these  
 373 applications have been more analysed and detailed in the previous literature [ref1, ref2], only  
 374 a brief discussion of the full spectrum of electricity markets and distribution networks  
 375 applications is presented here.

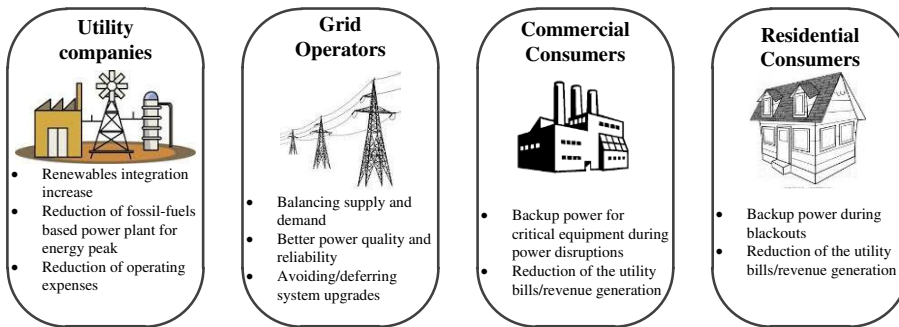

376

377 Fig. 6: Benefits from ES technologies across different segments of the power system [81-83].

#### 4.1 Arbitrage in the wholesale electricity market

378 This application is conceptually equivalent to demand load-shifting and the only difference  
 379 relies on the participation in the electricity wholesale market. Based on the market prices,  
 380 CES systems are charged with low price electricity (typically during periods with low  
 381 demands or large RE generation) and selling electricity later the price is high (typically at  
 382 peak demand periods) [81, 84]. The market participation is possible under the role of "an  
 383 aggregator" for communities enabling the interaction between the upper-level market and  
 384 end users [85] [86]. For this purpose, Arghandeh et al. presented a real-time control strategy  
 385 to maximize the revenue of CES systems operating in competitive markets [23]. The focus  
 386 was on the impact of key practical limiting factors including power feeder losses (with little  
 387 impact), accuracy versus computational time, price and demand load forecast (with a high  
 388 impact).

#### 4.2 Frequency regulation

390 It is one of the most popular and most profitable application of ES. For this service, CES  
 391 systems can contribute- suppressing the fluctuations of the frequency in a grid, which has a  
 392 source of imbalance between generation and load [87]. If a generator or a whole grid is  
 393 overloaded the generator slows down and the frequency drops. If the present load is less  
 394 than the present production, the generator speeds up, and the frequency increases [88].  
 395 Especially in grids with high wind penetration levels, sudden reduction of the wind resource  
 396 can significantly contribute to frequency drop [87]. Thus, a CES system should deliver power  
 397 (discharging) into the grid in case of electricity grid under frequency or consumes power from  
 398 the grid (charges/charging) for electricity grid over frequency [87]. Frequency regulation  
 399 services, depending on the required reaction time and time-scale is often divided into:  
 400 primary, secondary and tertiary [81]. CES systems are suitable for primary frequency  
 401 regulation service due to limited discharge time and fast responses.

#### 4.3 Distribution network capital deferral

403

**Commenté [MAS1]:** Koirala, Binod Prasad, et al. "Energetic communities for community energy: A review of key issues and trends shaping integrated community energy systems." *Renewable and Sustainable Energy Reviews* 56 (2016): 722-744.

Luo, Xing, et al. "Overview of current development in electrical energy storage technologies and the application potential in power system operation." *Applied Energy* 137 (2015): 511-536.

404 Grid in certain (usually rural) areas with weak transmission or distribution connections,  
405 connected wind power plants might not be able to operate with the full capacity because of  
406 the line and /or transformer overloading. Thus, by deploying ES downstream from regions of  
407 congested transmission, the need for more costly transmission and distribution system  
408 upgrades can be delayed or entirely eliminated [84, 89, 90].

#### 409 4.4 Other distribution network applications

410 RE sources are usually decoupled from the grid by the power electronics devices and in  
411 consequence, they do not provide the inertial response in the grid [88]. This influences the  
412 electricity system total inertia and in consequence, the grid frequency is more vulnerable to  
413 load and generation changes. Moreover, rapid drop or rise in the frequency could cause  
414 tripping of generating units or shedding of loads [91]. Thus, a fast reacting CES system could  
415 quickly deliver or absorb active power in proportion to the time derivative of system  
416 frequency and contribute to the grid stability as a result [92]. From a voltage perspective,  
417 utilities are trying to maintain voltage within specific limits (mainly in long lines) and this is  
418 normally performed by switching capacitors and tap changing of the regulators at the  
419 distribution substation [84]. CES systems together with power converters are able to inject  
420 and absorb reactive power and contribute to the voltage stability. In the case of power  
421 system unavailability, CES systems could also potentially provide black start capability by  
422 discharging stored energy for prolonged periods to supply power to specified loads when the  
423 grid is unavailable [93]. Additionally, a fast and accurate CES performance is able to  
424 eliminate or mitigate power fluctuations (e.g., harmonic signals, spikes and dips in voltage)  
425 or power disruptions and provide ride-through capability [91]. CES applications and their  
426 requirements are presented in [Table 3-Table 3](#).

427 Besides technical readiness of ES to provide distribution network services, the other  
428 important aspect is also the techno-economic viability which, for example, has been studied  
429 for different US cities in [ref3]. Moreover, Sardi et al. proposed a strategy for optimal  
430 allocation of multiple CES units in a distribution system with photovoltaic generation [ref 4].  
431 The proposed strategy is based on the cost-benefit analysis and it aims for maximizing net  
432 present value of the investment. Ho et al. developed recently a tool for optimal scheduling of  
433 energy storage in distributed energy generation system by taking into account uncertainty of  
434 varying weather conditions [ref 5].

435

436

437

438

439

440

441

442

443

444

445

**Commenté [MAS2]:** Knueven, Ben, et al. "Economic feasibility analysis and operational testing of a community energy storage system." *Energy Conversion Congress and Exposition (ECCE), 2016 IEEE. IEEE*, 2016.

**Commenté [MAS3]:** Sardi, Junainah, et al. "Multiple community energy storage planning in distribution networks using a cost-benefit analysis." *Applied Energy* 190 (2017): 453-463.

**Commenté [MAS4]:** Ho, Wai Shin, et al. "Optimal scheduling of energy storage for renewable energy distributed energy generation system." *Renewable and Sustainable Energy Reviews* 58 (2016): 1100-1107.

446  
447  
448  
449  
450  
451  
452

453 *Table 3: CES application for distribution network applications and electricity markets including their*  
454 *main characteristics [94-97]. Based on IEA data from the Technology Roadmap, Energy Storage ©*  
455 *OECD/IEA 2014, www.iea.org/statistics. Licence: www.iea.org/t&c; as modified by University of*  
456 *Geneva and Aalborg University.*

Application	Output (electrical, thermal)	Size (MW)	Discharge duration	Cycles	Response time
<b>Seasonal storage</b>	e,t	500-2000	Days to months	1 to 5 per year	day
<b>Arbitrage</b>	e	100-2000	8 hours to 24 hours	0.25 to 1 per day	>1 hour
<b>Frequency regulation</b>	e	1 to 2000	1 minute to 15 minutes	20 to 40 per day	1 min
<b>Load following</b>	e,t	1 to 2000	15 minutes to 1 day	1 to 29 per day	<15 min
<b>Voltage support</b>	e	1 to 40	1 second to 1 minute	10 to 100 per day	ms to second
<b>Black start</b>	e	0.1 to 400	1 hour to 4 hours	<1 per year	<1 hour
<b>T&amp;D congestion relief</b>	e,t	10 to 500	2 hours to 4 hours	0.14 to 1.25 per day	>1 hour
<b>T&amp;D infrastructure investment deferral</b>	e,t	1 to 500	2 hours to 5 hours	0.75 to 1.25 per day	<15 min
<b>Demand shifting &amp; peak reduction</b>	e,t	0.001 to 1	Minutes to hours	1 to 29 per day	< 1 hour
<b>Off-grid</b>	e,t	0.001 to 0.01	3 hours to 5 hours	0.75 to 1.5 per day	<15 min
<b>RE integration</b>	e,t	1 to 400	1 minute to hours	0.5 to 2 per day	< 10 min
<b>Waste heat utilization</b>	t	1 to 10	1 hour to 1 day	1 to 20 per day	< 15 min
<b>Combined heat and power</b>	t	1 to 5	Minutes to hours	1 to 10 per day	< 15 min
<b>Spinning reserve</b>	e	10 to 2000	15 minutes to 2 hours	0.5 to 2 per day	< 15 min
<b>Non-spinning reserve</b>	e	10 to 2000	15 minutes to 2 hours	0.5 to 2 per day	<15 min

457 **5. Electrochemical energy storage**

458 **5.1 Lead-acid batteries**

459 Lead-acid (PbA) batteries are the most mature battery ES technology available on the  
460 market ~~since it has been widely~~ used extensively in automotive applications (starting,  
461 lighting, and ignition) and battery-based uninterruptible power supplies [9, 32, 98]. ~~From the~~  
462 ~~design perspective, a large variety of PbA batteries are currently available [99].~~ Besides their  
463 commercial maturity, PbA batteries are having have relatively high efficiency (i.e., 70% -  
464 80%), low cost, and long calendar lifetime (i.e., 5 – 15 years) [9, 100]. However, traditional  
465 PbA batteries have a relatively short cycle-lifetime (e.g., 500 – 2000 cycles), are not suitable  
466 for cycling at partial state-of-charge ~~(i.e., PbA battery are typically held at full charge between~~  
467 ~~discharges)~~, have a limited charging power capability, and poor performance at low  
468 temperatures [9, 32, 98, 101]. Thus, conventional PbA batteries are less suitable for  
469 stationary CES applications ~~(e.g., CES applications)~~, where high power capability during  
470 charging and discharging, cycle at partial state-of-charge, and long lifetime are required. -To  
471 overpass the aforementioned drawbacks, improved advanced PbA batteries ~~(generically~~  
472 ~~called advanced PbA batteries)~~ were developed and are on the early deployment stage [32,  
473 98, 101]. ~~The most known improvement is the use of carbon, in different forms, in one of both~~  
474 ~~electrodes providing the advanced PbA battery with characteristics similar to those of~~  
475 ~~supercapacitors (at the anode side (Akhil et al., 2013)[101]. Other improvements have~~  
476 ~~considered the use of carbon-doped cathodes, high density positive active materials, and~~  
477 ~~silica-based electrolytes (Akhil et al., 2013).~~ The structure and features of some of the  
478 developed advanced PbA batteries are reported in the literature (Akhil et al., 2013; *McKeon*  
479 *et al., 2014, Terada et al. [102] and H. Yoshida et al. [103]*). Thus, advanced PbA batteries  
480 have reached much higher up to nine times higher power capability ~~(up to nine times)~~ and  
481 four to ten times increase in the cycle lifetime ~~(four to ten times)~~ than traditional PbA  
482 batteries, becoming able to provide power peaks and operate for an extended time at partial  
483 state-of-charge in CES applications.  
484

485 **5.2 Lithium-ion batteries**


486 Even though the first Li-ion batteries were commercialised in the beginning of the 1990s, this  
487 battery ES technology has become the fastest growing technology for stationary ES  
488 applications in recent years [32] because of their inherent higher gravimetric and volumetric  
489 energy density in comparison other traditional batteries (e.g., PbA batteries). First designs  
490 were based on graphite and lithium cobalt oxide (LiCoO<sub>2</sub>) as active materials, but currently  
491 Li-ion batteries are based on new and/or improved chemistries (e.g., LiFePO<sub>4</sub> and Li<sub>4</sub>Ti<sub>5</sub>O<sub>12</sub>)  
492 [9, 98, 104-106]. These Li-ion batteries are characterised by high gravimetric and volumetric  
493 energy density (i.e., 75-200 Wh/kg and 200-500 Wh/L), high efficiency (i.e., 90 – 95%), high  
494 power capability (e.g., up to 9 times the nominal power), long cycle and calendar lifetime  
495 (e.g., 8000 full cycles and 20 years), and operation over a wide temperature range (e.g., -  
496 20°C to 55°C) [9, 32, 104, 107-109]. Nevertheless, each Li-ion battery chemistry has its  
497 unique characteristics therefore none of them is capable of offering all the aforementioned  
498 characteristics. The final design will be optimised either for power or energy applications  
499 [14]. The main drawback of Li-ion batteries is related to their still high cost. As illustrated in  
500 Fig. 7~~Fig-7~~, the cost is enhanced by the presence of additional components such as the  
501 management system, which ensures the safe operation of the Li-ion batteries (i.e., protection  
502 for overcharging, over-discharging, and over-temperature) and cell voltage balancing [12,  
503 100, 110]. However, the cost of the Li-ion batteries is expected to decrease with their  
504 manufacturing on a large scale [32, 111]. Fig. 8~~Fig-8~~ illustrates the dropping price of Li-ion  
505 cells including its projection until 2020 for both consumer electronics Li-ion batteries and  
506 large format Li-ion cells, which are used in CES applications. - For example, Li-ion batteries

Commenté [DS5]: I think the name of the authors should be removed in order to be consistent with the rest of the paper.



507 based on the Nickel Manganese Cobalt chemistry are projected to have a price of 300  
 508 US\$/kWh by 2020, the current one being 600 US\$/kWh [112].


509  
 510

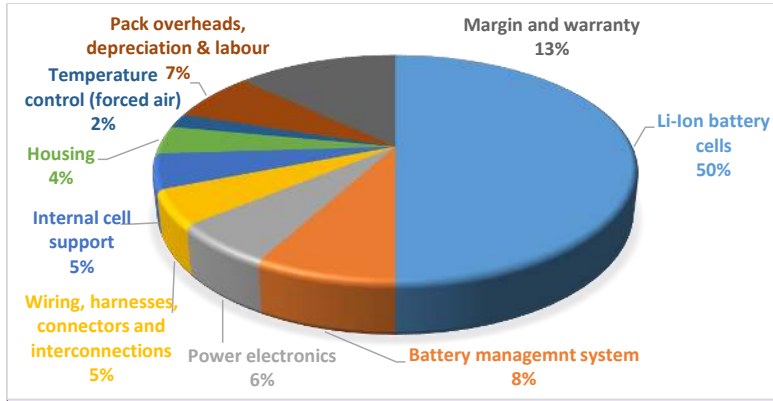

**Commenté [d6]:** Aalborg->two lines are missing from the pie to "Battery management system 8%" and "Margin and warranty 13%"

511  
 512 Fig. 7: Total cost breakdown for a 22kWh Li-ion battery pack used in electric vehicles based on data  
 513 provided by the International Renewable Energy Agency (IRENA) [113].

514

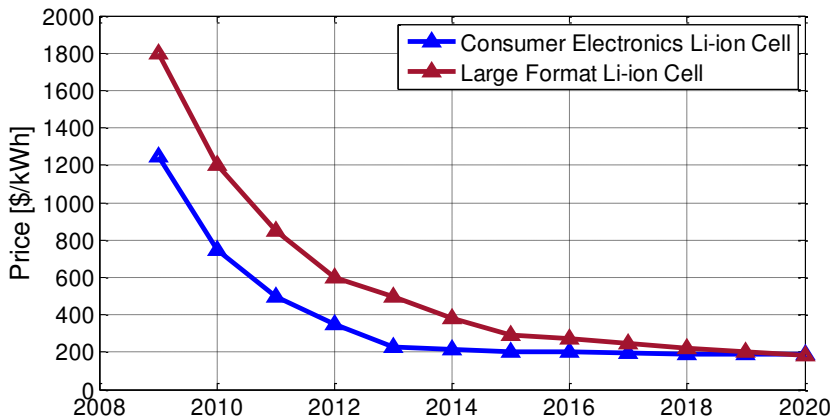

515  
 516 Fig. 8: Forecasted cost decrease (US\$) for Li-ion battery cells based on [111]<sup>6</sup>.

517 Because of their characteristics, Li-ion batteries are suitable for both short-term (i.e.,  
 518 minutes) and medium-term (i.e., up to 4 hours) applications such as frequency regulation,  
 519 voltage support, peak shaving, REs' grid integration etc. [32, 100]. By the end of 2013 a total  
 520 of 100 MW grid-connected Li-ion batteries have been installed worldwide for demonstration

<sup>6</sup> Waiting for permission from Navigant Research



521 and/or commercial purposes [32]; these installations have targeted both distributed systems  
 522 (e.g., 5-10 kW / 20 kWh) and larger grid-connected systems (e.g., 1 MW/ 0.25 MWh) [32].

523  
 524  
 525

### 5.3 Sodium-Sulphur battery

526 ~~Redox flow batteries were firstly described and proposed by Thaller [33] as attractive~~  
 527 ~~alternatives for pumped hydro and PbA battery ES solutions. Because of their features,~~  
 528 ~~which are summarized below, flow batteries represent a very suitable technology for mid~~  
 529 ~~and long term CES applications because of their features, which are summarized below~~  
 530 ~~[115-117]. Flow batteries employ two electrolytes (fully soluble redox couples/ electroactive~~  
 531 ~~species) that are stored in different tanks and pumped through a microporous membrane~~  
 532 ~~(cell stack) in which the chemical energy is converted into electricity [9, 33, 100, 115]. Unlike~~  
 533 ~~conventional batteries, flow batteries poses the unique advantage of having their power~~  
 534 ~~capability and energy decoupled from each other, which allows for a flexible design and easy~~  
 535 ~~scale-up [9, 32, 24, 115, 117]; while the power capability is determined by the size of the cell~~  
 536 ~~stack, the energy is determined by the volume of the tanks in which the electrolytes are~~  
 537 ~~stored and by the electrolytes' concentration [9, 100, 115]. Depending on the considered~~  
 538 ~~electrolytes' chemistry, different flow battery technologies have been developed that reached~~  
 539 ~~different maturity levels (from large-scale demonstration stage to early development stage),~~  
 540 ~~as summarized in Table 4 [9, 32, 100]; this is the case of the vanadium redox battery [34,~~  
 541 ~~as summarized in Table 4 [9, 32, 100]; this is the case of the vanadium redox battery [34,~~

542 Table 4: Main characteristics of different flow battery technologies.

Technology/ Properties	Voltage [V]	Efficiency	Lifetime	Maturity	Reference
<b>Vanadium-Redox (VRB)</b>	1.4 V	85 %	10 000 cycles	Commercial available; verified in field demonstrations	<a href="#">34, 115, 118, 119</a>
<b>Zinc Bromine (ZnBr)</b>	1.8 V	65 %	2 000 cycles	Early stage of field deployment and demo trials	<a href="#">34, 117</a>
<b>Polysulphide Bromine (PSB)</b>	1.5 V	75 %	N/A	No fully deployed systems available	<a href="#">34, 117</a>
<b>Iron Chromium (Fe/Cr)</b>	0.9 – 1.2 V	70 – 80 %	N/A	Early stage of field deployment and demo trials	<a href="#">32, 33, 116</a>

Tableau mis en forme

543  
 544 The main advantages of the flow batteries include: long calendar lifetime (i.e., 10 – 15 years,  
 545 depending on technology), high energy capability (i.e., up to 10 hours), no self-discharge  
 546 ~~(because the electrolytes are stored in separate tanks), fast response (i.e., few milliseconds~~  
 547 ~~– if cell stack), deep discharge capability (without safety and lifetime consequences [34, 115-~~  
 548 ~~117, 119]. Furthermore, flow batteries allow for a flexible design and easy scale-up since~~  
 549 ~~their energy and power are decoupled [9, 32, 34, 117]. The main drawback is their complex~~  
 550 ~~structure, which can cause reliability issues [98, 100].~~

### 5.65.4 Hydrogen

551 Hydrogen is considered as a promising form to store energy because of its high specific  
 552 energy density (33 kWh/kg) and volumetric density (it can be as high as 25g/L when it is  
 553

554 pressurized to 350 bar, or to 70g/L when it is liquefied) [120]. These characteristics together  
555 with the decoupling of the power and energy ratings make hydrogen very attractive for mid-  
556 term and long-term ES. The pathways of using hydrogen as an ES medium in communities  
557 are illustrated in Fig. 9. Power-to-gas is not part of this schematic representation and it  
558 discussed in this section since it is more economically viable for large scale plants, i.e.  
559 several MWs [121].

560 The first step to store electricity is achieved by electrolysis: when there is excess of electricity  
561 generated from RE sources, or electricity at low prices, an electrolyser system splits water  
562 into oxygen and hydrogen using DC electricity. There are three types of electrolysis  
563 technologies available: alkaline, polymer electrolyte membrane (PEM) and high temperature  
564 solid oxide electrolysers [122]. Alkaline electrolysis is the dominant technology in the market  
565 today due to its maturity and low cost (525 US\$/kW), whereas PEM electrolysis was  
566 commercialised at a later stage and offers higher power density (i.e. more compact systems)  
567 [123] as well as variable load operation including very low partial operation (5%). The main  
568 disadvantage is still the much larger price of the electrolyser stack due to material costs (e.g.,  
569 platinum for catalysts), around 1050 US\$/kW [124]. Alkaline and PEM are referred to as low-  
570 temperature electrolysis (typical temperatures between 50 °C and 80 °C), and they have  
571 efficiencies from 62% to 82%, which corresponds to 4.5 to 7.5 kWh of electricity consumption  
572 per Nm<sup>3</sup> of hydrogen production [122]. Solid oxide electrolysis is at the research and  
573 demonstration phases given the challenges of corrosion, seals, thermal cycling, and chrome  
574 migration, although it has gained more attention recently, because of its more efficient  
575 performance (voltage efficiency from 81% to 86%) in comparison with the other two  
576 technologies [125] and since it uses no noble metals.

577 The second step is the storage of hydrogen in a form of gas, liquid or as a metal hydride.  
578 When it is stored as gas, it typically requires high-pressure tanks with pressure at 350 bar or  
579 700 bar reducing the round trip efficiency because of the amount of energy required by the  
580 compressor. Another alternative is storage of hydrogen as a liquid requiring cryogenic  
581 temperatures because of its low boiling point. However, this conversion requires around  
582 30% of the LHV of the stored H<sub>2</sub> and therefore reduces the round trip efficiency as well.  
583 Compressed and liquid storage of H<sub>2</sub> do not offer the potential to meet the gravimetric and  
584 volumetric targets for on-board transport applications DOE [126]. And this is the driver for  
585 metal hydrides. Metal hydrides are promising means of storing hydrogen for applications with  
586 space constraint in terms of their safety condition (moderate temperature and pressure) and low  
587 energy to operate, but the current cost of around 5750 US\$/kg [127], and their constraints in weight  
588 and space are still the limiting factors for further applications

589

---

<sup>7</sup> 1.05 is the conversion rate assumed between the Swiss franc and the US dollar.

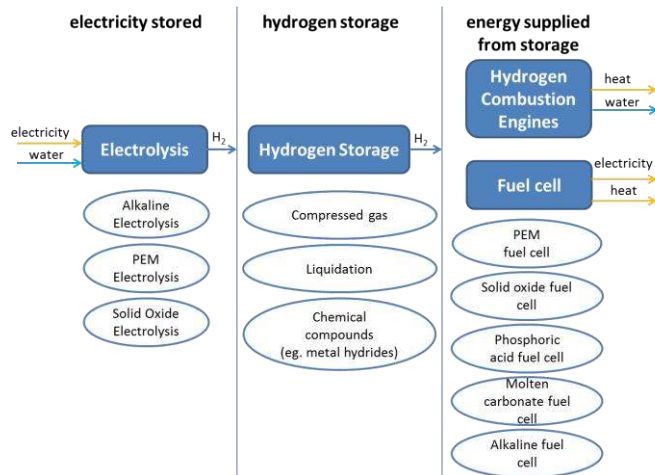


Fig. 9: Pathways using hydrogen as ES with options of different technologies

590

591

592 PEM fuel cells (PEMFCs) and solid oxide fuel cells (SOFCs) are the most common  
 593 technologies for generating both electricity and heat from hydrogen as combined heat and  
 594 power (CHP) generators. Main performance differences come from the operational  
 595 temperature and related materials for the stack, around 80 °C and 600-800 °C, respectively.  
 596 As a consequence, SOFCs offer higher electrical efficiency (up to 60 %) but are less suitable  
 597 for dynamic response and start-ups [55]. However, PEMFC and SOFC stacks are still  
 598 expensive, for example 500 \$/kW and 800 \$/kW for a 5 kW system [127]. Overall, a 50 kW  
 599 fuel cell (FC) system running as CHP has a current cost of 1029250 US\$ but mass  
 600 production and related economies of scale are expected to bring this value down to 115000  
 601 US\$ approximately [128].

602 From an application perspective, some studies were conducted applying hydrogen as CES,  
 603 with focus on distributed ES systems of relatively small size (20 kWh to 1 MWh), and storage  
 604 duration from minutes to months. Steward compared hydrogen and battery storage as CES  
 605 for a community of 100 residents Steward [129]. It was concluded that the low round-trip  
 606 efficiency of the hydrogen system (41%) causes high penalty in levelised cost of electricity  
 607 stored compared to batteries. However, hydrogen as ES medium allows to integrate more  
 608 RE, and has more flexibility than battery in larger systems. Alternatively, a hybrid system  
 609 comprising a 10 kWh Li-ion battery and hydrogen storage (with a 6 kW PEM electrolyser)  
 610 was proposed for a 7-home low carbon community (all houses were assumed to have a 3  
 611 kW PV system) as daily and long-time CES, the latter suggested since a seasonal mismatch  
 612 occurred despite the daily buffer offered a 10 kWh Li-ion battery [55]. It was found that such  
 613 a hybrid system is able to increase onsite consumption of PV energy, and reduce the  
 614 electricity export to the grid by 95% compared to a single home system with the same FC  
 615 system. Interestingly, a CES system using hydrogen technology was later built and tested  
 616 when performing PV energy time-shift and demand load-shifting in a real low carbon 7-home  
 617 community. In this case, mid-term ES was demonstrated when CES performed demand load  
 618 shifting and hydrogen was stored for use one day later [63].


### 619 5-75.5 Hybrid Energy Storage Systems

620 In most energy systems, examination of the load duration curves shows that there are  
 621 typically a small number of hours each year which have very high or very low extremes of

622 demand, with the larger portion of the year exhibiting intermediate load levels. High-power  
 623 peaks tend to have relatively short duration, and diversity of loads in larger communities  
 624 tends to flatten the demand curve meaning that extremes of demand are encountered less  
 625 often, but, importantly, high-power incidents do still occur (see [Fig. 3Fig-3](#)). Installing a  
 626 system to manage energy and power flows within a community means that the CES system  
 627 experiences - and can hopefully optimise - the peaks and troughs in demand and supply.  
 628 However, specifying a CES system which has the capability to manage both peak power  
 629 requirement (kW) over a few minutes, and has sufficient energy (kWh) to supply the  
 630 community for a number of hours, would possibly lead to specification of a large battery  
 631 system which may not actually be economically viable (in an electrochemical battery energy  
 632 to power ratio is fixed by the type of chemistry). So in some cases it may be better to install a  
 633 hybrid (multi-technology) ES system, where specific technologies are chosen for either their  
 634 energy capacity or their high power capability, but act together seamlessly as a single ES  
 635 system [130].

636  
 637 An example hybrid ES system is shown in [Fig. 10Fig-10](#), where the power vs. energy  
 638 for import and export from a community with on-site RE generation are shown with the dotted  
 639 blue line. If a single ES device was chosen so as to meet both the power and energy  
 640 requirements, this configuration (the red target symbol) may end up as significantly more  
 641 expensive than a hybrid ES solution made up of smaller building blocks (in this case three  
 642 different technologies) which still meet the power and energy requirements for the  
 643 community. One drawback of this approach is that configuration, optimisation and control  
 644 algorithms for a hybrid ES system are significantly more complicated than for a single-  
 645 technology solution.

646

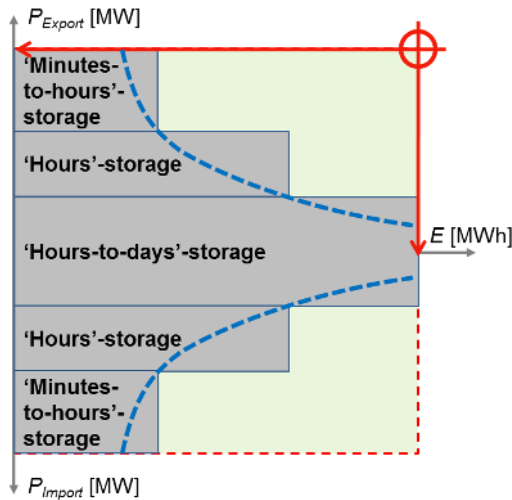

647  
 648 *Fig. 10: Diagram showing power and energy charging and discharging requirements for a CES system*  
 649 *(blue dotted line); a single CES system which meets these requirements (red target symbol); and a*  
 650 *generic hybrid system which also meets these requirements (grey boxes).*

651 Example building blocks to create hybrid systems may be: flywheels or supercapacitors for  
 652 high-power capabilities; PbA or Li-ion batteries for balanced energy and power; flow-batteries  
 653 or hydrogen for storage of energy – systems may be built using one or more of these  
 654 technologies depending on requirements. In this way, the combined performance  
 655 characteristics of the ES devices can be much more closely aligned with the actual demand  
 656 curve, so that each device is utilised optimally, and the CES owner does not pay for device

657 capabilities that are never used. Typically, the high power capability, short-term ES performs  
658 many charge-discharge cycles and so must be a technology with a long cycle lifetime – this  
659 tends to be a more expensive technology, but only a relatively small system is required to  
660 manage the higher frequency power fluctuations [131]. The longer-duration, lower-power part  
661 of the hybrid CES performs far fewer cycles, and hence this can be a low-cost technology  
662 focusing on storage of energy over longer time periods.

663  
664 Operationally, a hybrid CES system is challenging to manage [132], as it consists of multiple  
665 devices connected together, each of which have different performance characteristics,  
666 voltages, currents, states of charge, and rates of change of these parameters – unlike an  
667 ESS made up of modules of the same technology which should all have fairly similar  
668 characteristics and can act in unison. Dispatching of the sub-units can be based upon  
669 knowledge of the system demand curves and the likely duration of a certain level of power  
670 within the system [133]. High charge-rate sub-units should be dispatched to manage high-  
671 power, short-duration incidents, whilst low power devices can shift energy around over a  
672 period of minutes to hours. Germany is very much leading the way in demonstrating  
673 industrial-scale hybrid energy ES systems; key examples include: Braderup-Tinningstedt,  
674 Pellworm and M5Bat, which have implemented multiple ES technologies to provide  
675 optimised community and system solutions [133].

## 676 **6. Thermal Energy Storage**

677 Thermal energy storage for building heating and cooling purposes comprises several  
678 technologies with different characteristics as summarized in [Table 5Table–5](#). The most  
679 storage technology is hot water tanks with a temperature in the range of 55-60°C (to avoid  
680 water bacteria growth). Water tanks are also used for building heating and cooling storage  
681 purposes with the advantage that no heat exchanger is required between the storage and the  
682 energy carrier, i.e. reducing the exergy losses associated with the heating/cooling system  
683 that arises from heat exchange. The use of the storage material as the energy carrier also  
684 implies a high storage power to capacity ratio for demand peak shaving. The water tank may  
685 also be designed with thermal stratification and several supply ports as to minimise storage  
686 mixing losses associated with varying operation temperatures of a solar collector. In the  
687 cases of seasonal storage or small differences between supply and return temperatures the  
688 drawbacks of a water tanks are the relatively large space requirement and potentially also  
689 the cost of the large containers [134].

690 For a more compact storage design latent heat storage based on PCM may be applied [135],  
691 [136]. The heat of fusion of the PCM offers high energy density, for example 310 kJ/m<sup>3</sup>, 150  
692 kJ/m<sup>3</sup> and 370 kJ/m<sup>3</sup> for materials such as water, paraffin and salt hydrates, respectively [78].  
693 The material most commonly applied is water/ice technology due to the low cost of the PCM,  
694 high heat of fusion and the high thermal conductivity of ice which enhances storage  
695 discharge capability. Due to the low phase change temperature, ice/water is mainly used for  
696 building cooling and heating applications [74, 75]. The interest in water/ice as a seasonal  
697 storage material has however recently increased as an alternative to storage technologies  
698 that require deep drilling [137].

699 The technologies applied for seasonal energy storage are usually based on underground  
700 thermal energy storage as large quantities of energy can be stored by using natural materials  
701 of low cost (e.g., soil, water, rocks). A common technology for northern and middle European  
702 buildings is borehole thermal energy storage in combination with a HP [56]. As the CES is  
703 not insulated towards the surroundings the storage temperature should be kept at moderate  
704 level (typically below 30°C in charged state for a 150m deep hole) to avoid significant energy  
705 losses and the HP is used to raise the temperature to the required level. A second parameter  
706 which affects thermal storages without insulation is the storage volume; thermal losses scale

707 with storage surface area and capacity with storage volume which makes larger storages  
 708 more efficient. Another underground storage technology is the aquifer thermal storage that  
 709 has reached more than 2'000 installation in the Netherlands [138]. Although this technology  
 710 has higher energy density (as water is used as storage material) and also potentially lower  
 711 cost (as few boreholes are required), several geological conditions have to be fulfilled in  
 712 order for it to be applicable [139], This may limit its maximum technical and economic  
 713 potential as a result. A shallow underground technology is the pit thermal storage which is an  
 714 insulated excavation at the surface of the earth that may be filled with water, rock material  
 715 (gravel), sand or a mixture of these components. It may also have a cover of insulating  
 716 material for reducing the thermal losses. Several large pit storage projects have recently  
 717 been proposed in combination with solar thermal collectors supporting district heating  
 718 networks in Denmark [140]. An overview of different storage technologies for community  
 719 applications is given in [Table 5-Table-5](#).

720 *Table 5: Thermal energy storage systems for community applications based on research experience*  
 721 *and some published results [141].*

ES Technology	ES material	Temperature level* (°C)	ES time scale	Energy density (kWh/m <sup>3</sup> )
<b>Aquifer</b>	Soil/Rock/Sand/Water	5-30 °C	Months	30-40
<b>Borehole</b>	Soil	5-30 °C	Months	15-30
<b>Latent</b>	PCM	0-60 °C	Hours-Months	150-310
<b>Pit storage</b>	Water/Sand/Rock	5-60 °C	Months	10-50
<b>Water tank</b>	Water/Glycol	0-60°C	Hours-Months	20-50

## 722 7. Assessment of CES

### 723 7.1 Techno-economic assessment


724 The criteria applicable for techno-economic assessment of CES systems (thermal and  
 725 electricity) include cost, performance and value generation. From a techno-economic  
 726 perspective, the levelised cost of ES (LCOES) together with the internal rate of return (IRR)  
 727 and/or net present value (NPV) have been the most commonly used indicators since they  
 728 quantify the cost and value of the CES discharge using a life-cycle approach [142].

729 The business case of battery storage for communities strongly depends on both external  
 730 boundary conditions such as the prices of purchased and sold electricity, tariff structures,  
 731 etc.; and technology characteristics, e.g., cost (mainly CAPEX), durability and the related  
 732 ageing. [Fig. 11Fig-14](#) can be used to further understand the relationship between the IRR  
 733 and two key parameters, the storage medium cost and electricity prices in the case of Li-ion  
 734 batteries performing PV self-consumption. The results correspond to a 10-home community  
 735 in the UK in which 8 homes are assumed to have a 3 kW PV installation [21]. For this  
 736 community, the battery capacity (42 kWh) was optimised in order to maximise the  
 737 profitability. The reference case is represented by a storage Li-ion medium cost of 1820  
 738 US\$/kWh (1300 £/kWh) able to perform up to 3000 equivalent full cycles and a retail  
 739 electricity price of 0.23 US\$/kWh (16.3 p/kWh).

740 The relationship is more linear with the electricity price than the storage medium cost but on  
 741 the other hand the IRR is more sensitive to the storage medium cost. A cost of the storage  
 742 medium of 360 US\$/kWh (260 £/kWh) is the breakeven point for an electricity price of 0.23  
 743 US\$/kWh (16.3 p/kWh), while 430 US\$/kWh (310 £/kWh) is the breakeven point for an  
 744 electricity price of 0.27 US\$/kWh (19 p/kWh). When the storage medium cost was 360  
 745 US\$/kWh (260 £/kWh), the IRR values were positive for any electricity price projected by

746 2020 up to 9.2% when the electricity price is 0.43 US\$/kWh (31 p/kWh). However, the break-  
 747 even point is not reached if the storage medium cost is 1090 US\$/kWh (780 £/kWh, the IRR  
 748 was -1.6% when the electricity price was 0.43 US\$/kWh (31 p/kWh), equivalent to +90% in  
 749 Fig. 11).

750

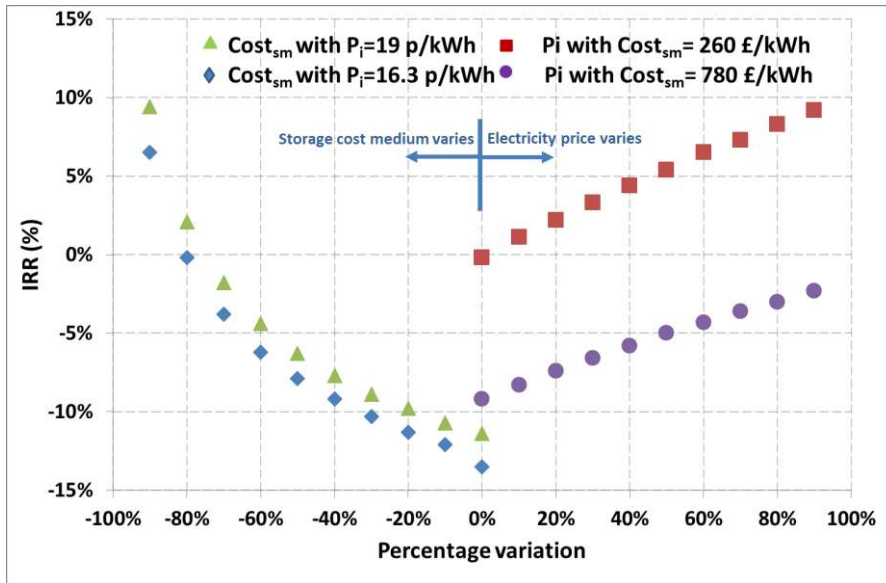


751


752 Fig. 11: Internal rate of return (IRR) of the optimum Li-ion battery (42 kWh) performing PV self-  
 753 consumption in a 10-home community in 2020 (community PV percentage of 76%) as a function of the  
 754 storage medium cost ( $Cost_{sm}$ , percentage variation over a reference cost of 1300 £/kWh equivalent to  
 755 1820 US\$/kWh i.e. 0% variation) for an electricity price of 0.23 US\$/kWh (16.3 p/kWh) and 0.27  
 756 US\$/kWh (19 p/kWh); and as a function of the imported electricity price ( $P_i$  percentage variation over a  
 757 reference price of 16.3 p/kWh equivalent to 0.23 US\$/kWh i.e. 0% variation) for a storage medium  
 758 cost of 360 US\$/kWh (260 £/kWh) and 1090 US\$/kWh (780 £/kWh).

759 Regarding thermal storage, the investment of hot water tanks is very sensitive to the  
 760 difference between the maximum storage and minimum supply temperatures. For example,  
 761 the investment cost (US\$/kWh) decreases by a factor of four if the temperature difference  
 762 increases from 10°C to 40°C using the same tank. A comparison of total costs of thermal  
 763 storage (short-term) using a steel tank (95°C, 3 bar) in a community is shown in Fig. 12Fig.  
 764 the case of long-term (seasonal) thermal storage, the size effect on the investment cost is  
 765 also significant. A comparison of cost data for water tanks, borehole thermal storage (BTES),  
 766 pit storage and aquifer storage (ATES) is given in Fig. 13Fig.-13. Regarding the value of  
 767 storage, there have recently been several investigations pointing out the potential benefits in  
 768 combination with HPs and chillers [77], [143]. It has been estimated that hot water tanks can  
 769 lead to electricity cost savings in the order of 35% for residential buildings with HPs if the  
 770 spot market electricity price is used as a reference [144]. Finally, a comparison between  
 771 thermal storage and battery storage is possible if the electricity stored is used for driving a  
 772 HP generating heat as an end product. As pointed out by Blarke et al., thermal storage is  
 773 currently economically more attractive [145].



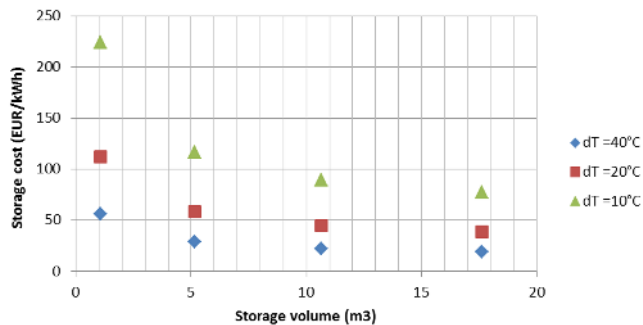

774  
 775 Fig. 12: Investment cost data for steel water tank (incl. thermal insulation) for short-term thermal  
 776 storage from a Swiss supplier [146].

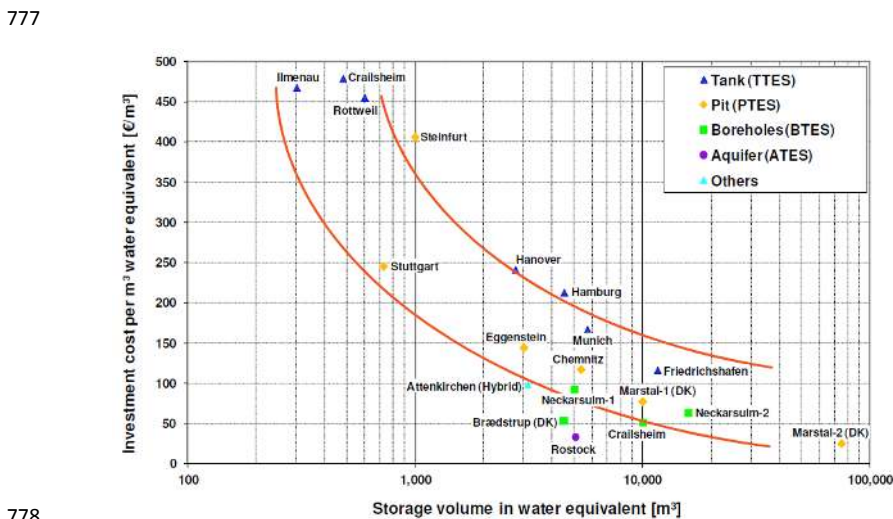

778  
 779 Fig. 13: Investment cost data for seasonal storage technologies, with permission from [139].

## 7.2 Socio-economic assessment

781 This section discusses the socio-economic implications of CES systems linked with local RE  
 782 generators. Since the penetration of CES systems faces similar socio-economic challenges  
 783 to those detected for other distributed energy technologies installed in communities, relevant  
 784 examples from other technologies are also discussed. Distributed energy generation and  
 785 storage provide a mechanism to address the issues of affordability of energy supply, energy  
 786 security and reduction of GHG emissions [20, 147]. The role of economics and project  
 787 finance is important as CAPEX per unit of energy supplied are relatively high for CES  
 788 compared to centralised energy systems under current market conditions [20]. In a survey of  
 789 132 non-adopters of microgeneration technology in the UK conducted by Caird and Roy  
 790 [148], the main barriers to uptake were the purchase price (86% of the respondents),  
 791 uncertainty regarding the payback period (68% of respondents) and size of available grants  
 792 (60% of respondents). In a survey of German house owners, Michelsen and Madlener [149]  
 793 reported that motivational factors varied according to the characteristics of the home owner



794 and features of the home. Claudy et al. [150] proposed that reasons against adoption of RE  
795 technology have a stronger influence on consumer behaviour than reasons for, and that  
796 greater emphasis should be placed on overcoming barriers to adoption of RE as opposed to  
797 emphasising reasons for adoption.

798 While the cost of electricity from PV-coupled battery systems is generally still above that of  
799 conventional energy [151], the production and installation costs of distributed ES are  
800 expected to continue to decrease in future due to greater expertise, increased productivity  
801 and economies of scale (see [Fig. 8](#)) [20]. Often community energy initiatives fail due to  
802 of long-term resourcing or of long-term supports [152]. In some states in Germany, nearly  
803 40% of the RE generation is owned by individuals and municipalities [146]. In Denmark, up to  
804 80% of the offshore wind schemes is characterised by community ownership. By contrast, in  
805 the UK community-owned energy schemes constitute approximately 1% of RE generation  
806 [153]. Unlike the UK, countries like Germany and Denmark have a rich heritage of local  
807 energy planning where local authorities have traditionally had a strong role in implementing  
808 decentralised energy projects [154]. Governments have an important role to play in terms of  
809 providing incentives [151], particularly financial. In Germany, in 2013 the government  
810 introduced an incentive scheme supporting the purchase of PV-coupled battery systems,  
811 covering up to 30% of the installation costs [155]. Since the scheme was launched uptake  
812 has been strong due to the desire for energy independence, and with more than 12,000  
813 storage systems installed by 2015 equipment prices have been falling [39, 156].

814 Shamsuzzoha et al. [157] found that acceptance rates for community RE projects were  
815 approximately twice as high as acceptance rates for larger projects in rural Scotland.  
816 Community energy projects have the ability to engage the community in energy issues,  
817 improve receptivity to RE and engender behaviour change [152]. Bomberg and McEwen  
818 [156, p443] argue that motivations for community action on energy issues need to be better  
819 understood, and that appealing to a communities' sense of uniqueness, identity and  
820 autonomy may be more effective than appealing to a communities' environmental  
821 conscience. Heiskanen et al. [158] and Rodrigues et al. [159] suggested that more focus  
822 should be placed on the community level and that energy users should be engaged in the  
823 role of citizens, and not only that of consumers.

824 CES can also have positive social implications [20]. Over a two year period the UK  
825 Department of Energy and Climate Change (DECC) provided £10 million funding for the  
826 installation of low carbon measures in 18 projects throughout the UK as part of the Low  
827 Carbon Communities Challenge [160]. Community awareness of local action on energy and  
828 climate change increased from 35% of households to 42%, and positive social outcomes  
829 were observed such as further engagement in community groups, associations and  
830 communal activities [160]. Community energy projects require interpersonal skills that may  
831 be as important as technical skills in overcoming challenges [152].

### 832 **7.3 Environmental assessment**

833 The environmental performance of CES technologies can be assessed using life cycle  
834 assessment (LCA), an internationally standardized methodology [161] that considers the  
835 environmental burdens of all involved products and services across their life cycles, including  
836 raw material production required for ES, storage manufacturing, energy required to deliver  
837 the stored energy at a later stage, other operation and maintenance of CES system, as well  
838 as the end-of-life of storage equipment, which is often not considered or simplified [162]. LCA  
839 assists in identifying opportunities to improve the environmental performance of CES system  
840 at various points in their life cycle, and it is usually conducted in four main steps: goal and  
841 scope definition; inventory analysis; impact assessment and interpretation.

842 Studies that assessed ES technologies using LCA in particular for CES systems are rare.  
843 Instead, there has been some research focusing on the assessment of ES in general, or for  
844 specific applications, such as load shifting, renewable electricity integration, etc. Most of  
845 these studies are for electricity storage, and usually employ the functional unit of 1 kWh of  
846 energy stored and supplied from system, and compare it with alternative technologies or  
847 baseline system without storage. Some studies use the unit capacity in power or unit weight  
848 of storage as functional unit [163], but this is less common. The ES technologies covered  
849 usually have a wide spectrum, but mostly fall into the major categories of mechanical  
850 storage, electrochemical storage and chemical storage. With regard to impact categories,  
851 most studies [164-166] focus on climate change, fossil resource depletion and cumulative  
852 energy demand, among which, climate change is the most popular indicator, while other  
853 impacts are less discussed.

854 So far battery technologies have been the most analysed technology, mainly due to their  
855 diverse technological variations and wide applications. Some previous studies focused on a  
856 specific type of battery (e.g. Li-ion battery, PbA battery, etc.), and some others compared  
857 different types of battery technologies. Most often, application in battery electric vehicles is  
858 considered [167-171]. However, battery systems in vehicles could also be applied for  
859 stationary applications with only slight technology modification. Sullivan and Gaines [162]  
860 reviewed the cradle-to-gate (until the battery is produced and “ready at the gate” of the  
861 factory, excluding usage and operation) life cycle inventory of PbA, nickel cadmium, nickel  
862 metal hydride, sodium sulfur, and Li-ion batteries. They also pointed out that inventory data  
863 for battery recycling are hardly available except for PbA batteries. Messagie, Oliveira [172]  
864 conducted a cradle-to-grave (including usage and operation, as well as the end-of-life fate)  
865 LCA study comparing lithium manganese oxide (LMO) battery and lithium iron phosphate  
866 (LFP) battery for EV. They found that the environmental performance of Li-ion battery  
867 storage systems is overall dependent on its efficiency and directly tied to the origin of  
868 electricity input to the battery storage. The temporal and geographical dimension of  
869 components production for the battery system can also vary their environmental  
870 performance, but differences in environmental impact are mostly observed in the  
871 manufacturing and recycling stages of Li-ion batteries. Longo, Antonucci [173] prepared an  
872 LCA study comparing sodium and nickel chloride batteries, reaching the conclusion that the  
873 manufacture of sodium and nickel chloride batteries contributed more than 60% of the  
874 environmental impact.

875 Oliveira, Messagie [163] compared the environmental performance of several ES technology  
876 applications in Belgium and pointed out that the performance of sodium sulfur battery shows  
877 the best environmental performance, and it is followed by molten salt battery, while the  
878 combination of electrolyser with a hydrogen operated FC performs worst. Denholm and  
879 Kulcinski [174] concluded that, although ES increases the input energy to produce electricity,  
880 the life cycle GHG emissions of storage systems when coupled with nuclear or RE sources is  
881 less than 400 tonnes CO<sub>2</sub> eq./GWh, which is substantially lower compared to the emissions  
882 of electricity produced from fossil fuels: between 475 and 1300 tonnes CO<sub>2</sub> eq./GWh.

883 LCA of thermal ES are less discussed in the literature, and are mostly focused on sensible  
884 heat storage using hot water [175-177], while sensible heat storage using other media (such  
885 as molten salt), and latent heat storage using PCM are less explored. Oró, Gil [178] studied  
886 three thermal energy storage systems using different sensible and latent heat storage,  
887 analyzed if the energy savings achieved by stored heat are enough to balance the  
888 environmental impact produced during the manufacturing and operation phase of each ES  
889 system, and found that thermal ES using high temperature concrete shows the lowest life  
890 cycle impact.

891 **8. CES perspectives and outlook**

892 **8.1 CES Demonstration projects**

893 To date, projects involving CES have tended to be at the level of a few tens of consumers at  
 894 most, driven by DSOs wishing to demonstrate the novel possibilities for ES technologies in  
 895 their networks, and often seeking to influence regulators to clarify whether DSOs can  
 896 own/operate ES assets; DSOs are typically forbidden in regulated markets to own/operate  
 897 'generation' assets to prevent them from competing against independent generators in the  
 898 wholesale electricity markets. Example projects include the McAlpine CES systems in  
 899 Charlotte, North Carolina [179, 180]. However, one of the most extensive demonstration  
 900 projects to date has been the American Electric Power (AEP) "gridSMART" project in Ohio,  
 901 deploying a fleet of eighty 25kW/ 25kWh CES units (totalling 2MW) on a single 13.2 kV  
 902 feeder [181]. The CES units provide local voltage-support and islanding capability for groups  
 903 of customers, whilst also providing utility-scale benefits through aggregation of the devices  
 904 via a 'Distributed Energy Management' (DEM) controller. A list of these and other CES  
 905 projects, together with the technologies and battery sizes employed, is given in [Table 6](#)

906 *Table 6: Summary of current CES projects and demonstrations showing the main characteristics.*

Name	Technology (Capacity)	Applications	Leader	Location	Starting date	Reference
Storage trial at Alkimos Beach residential development	Li-ion Battery (250 kW/1.1 MWh)	PV and demand management; grid stability	Synergy	Alkimos (Australia)	2016	[182]
CES for Toronto Hydro	Li-ion Batteries (550 kW/250; 3 units)	Grid stability, deferral of distribution costs and demand load shifting	eCAMION	Toronto (Canada)	2013	[183]
gridSMART project	Li-ion batteries (25kW/ 25kWh; up to 80 units) + NaS battery (1MW/ 6MWh)	Microgrid/ Smart Grid management; maximisation of self-consumption; peak demand management	AEP Ohio Power Company	Ohio (USA)	2009	[181]
CES for Grid Support	Li-ion batteries (25kW 50kWh; up to 20 units)	Back-up power; Peak demand management; voltage control; real/reactive power control	Detroit Edison (DTE)	Detroit (USA)	2013	[184]
Kelsterbach	Li-ion battery (50kW/ 135kWh)	Maximisation of self-consumption; optimisation of CHP	Süwag Erneuerbare Energien GmbH	Kelsterbach (Germany)	2014	[185]
Slough Zero-Carbon Homes	Li-ion battery (25kW/ 25kWh; 3 units)	Peak demand management; voltage control; real/reactive power control	Scottish & Southern Energy (SSE)	Chalvey (UK)	2012	[186]
S&C HQ CES	Li-ion battery (25kW/ 25kWh; 6 units)	Aggregation for Frequency Response	S&C Electric	Chicago (USA)	2014	[187]
Local Energy System project	Li-ion battery (500kW, 300kWh)	Microgrid management, maximisation of self-consumption	E.ON	Åstön (Sweden)	2016 (planned)	[185]
Ergon	Li-ion battery (25kW/ 100kWh; 20 units)	Upgrade deferral/ constraint management	Ergon Energy	Queensland (Australia)	2015	[188]
Creative Energy Homes	Hybrid: Li-ion (24 kWh) and hydrogen (155 kWh).	PV and demand side management; load shifting	University of Nottingham	Nottingham (UK)	2014	[21]
SENSIBLE project	X20 3kWh Li-ion	PV and demand	Siemens	Nottingham (UK)	2015	[26]

Mis en forme : Polonais

Mis en forme : Polonais

	and x2 20kWh PbA batteries	side management; grid stability; load shifting; cost reduction				
<b>McAlpine Circuit CES System</b>	Lithium Polymer Battery (50kW x 1h)	transformer-level peak shaving by integrating with residential level distributed resources and loads	Duke Energy	Charlotte (USA)	2011	[189]
<b>INGRID</b>	Hydrogen pressurized electrolyser (500 kW), pressure hydrogen storage tanks (1350 kg, 31 bar)	Storage of wind power	Enertrag AG	Prenzlau (Germany)	2011	[190]
<b>Crailsheim community</b>	40 m3 hot water storage & helical ground heat exchangers	Building heating (seasonal storage)	Baden-Württemberg	Crailsheim (Germany)	2014	[71]
<b>Suurstoffi</b>	Borehole heat exchangers	Building heating (seasonal storage)	University of Lucerne	Rotkreuz (Switzerland)	2012	[191]
<b>La Cigale</b>	Ice storage	Building heating (seasonal storage)	SIG, University of Geneva	Geneva (Switzerland)	2010	[74]

## 8.2 End users perspective

908 The role that end users play in the energy system has changed over the last decades and it  
909 continues to evolve. The increasing cost of energy firstly in the seventies and especially in  
910 recent years together with minimum energy efficient standards and related incentives have  
911 made customers pay more attention to energy efficiency measures to reduce their bills (e.g.,  
912 refurbishment of their homes with better insulated envelopes, more efficient appliances and  
913 related controls). However, the development of more efficient and less costly small-scale  
914 technologies such as solar PV and solar thermal energy have been the main reasons for the  
915 changing role of customers in the energy system. The end users' requirements and their  
916 interests are evolving as the energy system does and they require new services but they also  
917 want to play a more active role, as summarized in [Table 7](#). Some examples which  
918 illustrate the new position of end users are the increasing number of grassroots or bottom-up  
919 initiatives as well as top-down policies for low-carbon communities across many countries  
920 [192]; new applications for mobile phones, PCs and tablets which allow end users to monitor  
921 their energy generation and demand, amongst others; and the proliferation of R&D projects  
922 including end users as a research topic and/or project partners [193] and the first CES  
923 business cases sharing end users, utility companies and/or aggregators [194].

924 *Table 7: Different objectives for end users in the context of the energy transition.*

<b>Customers' energy objectives</b>
<b>Reducing their energy bills or keep them at similar levels</b>
<b>Generate and manage their own energy</b>
<b>Reduce their carbon footprint</b>
<b>Secure of supply guarantee</b>
<b>Monitoring and managing their own demand to take decisions in real-time</b>

926

927 Although these new requirements may be seen as challenging for generators, utility  
928 companies and governments, they can also be considered as potential opportunities. Given  
929 the wide range of service, economic and environment benefits introduced by CES systems  
930 stronger interaction amongst different stakeholders is advised in order to engage the  
931 maximum number of customers and advance in the energy transition as a result. Regarding  
932 the CES investment, two different options could be considered next to hybrid systems: (a)

Mis en forme : Police : (Par défaut) + Corps (Calibri), 11 pt

933 end users purchase a CES system which is connected with their RE generators; (b) or a  
934 different party, e.g., utility company, aggregator, energy service company (ESCO) and  
935 building service company purchases a CES system in order to manage the energy generated  
936 by the RE plants of end users. The first option would promote autarky in a future smart  
937 energy system while the second option should at least assure that energy bills are  
938 attractively reduced for end users. In this context, the development of new policies and  
939 business models including different services provided by CES (see Sections 4-5) and  
940 creating win-win situations for customers (who generate their own energy locally) and other  
941 stakeholders should be pursued.

### 942 **8.3 Utility perspective**

943 As the level of installed distributed RE generation increases, the requirement for – and  
944 economic case of – CES improves [22]. Technology improvements driving down the cost of  
945 both generation technologies and battery systems, plus an increasing focus on  
946 environmental concerns, localism and community engagement, should all help to significantly  
947 enhance the uptake of microgrid and community energy schemes. Most of these schemes  
948 will benefit from the installation of technologies to deliver system flexibility, and so it is likely  
949 that CES acting in conjunction with demand-side response will play a major part in many  
950 projects at this scale. As discussed in this manuscript, benefits of CES are split across the  
951 value chain, and effective monetisation of these multiple value streams will be key to  
952 implementing viable projects in the early stages.

953  
954 CES is likely to be provided by house-builders, PV installers, utilities and DSOs (or third  
955 parties supplying them storage as a service): some benefits will accrue to householders  
956 through lower bills or reduced service charges, etc., but the CES owners and DSOs will also  
957 wish to see financial benefits. The business models have yet to be fully developed, but some  
958 of the biggest challenges lie around accessing and monetising the multiple value streams,  
959 ensuring that all parties are able to clearly see the value, and pay and be remunerated for  
960 the benefits CES brings. Ownership models are one of the key enablers for CES: the  
961 owner/operator has to be able to balance likely costs and revenue streams over the lifetime  
962 of the asset in order to build a business case upfront for construction of the asset. If costs  
963 and revenue streams are too low, uncertain, or spread across too many sources, then the  
964 uncertainty in the business case may make such projects unviable. Conceivable ownership  
965 models run from “Merchant Services” (where e.g. the DSO builds, owns and operates the  
966 asset and has full operational control), through to “Contracted Services” (where a long-term  
967 contract is offered for 3<sup>rd</sup>-party provision and operation of a storage asset based on price or  
968 other control signals) [195]. There are advantages and disadvantages to each approach, plus  
969 the balance of risk needs to be considered between the recipient and the provider of the  
970 service. At this time, the relative merits of the various ownership models are being  
971 investigated through demonstration projects and industry consultations, whilst Regulators are  
972 defining the legislative landscape to enable new business models to flourish in the next few  
973 years.

974  
975 In many markets across the world, distribution grids are owned by regulated monopolies,  
976 who – in order to avoid potential conflicts of interest – are not also allowed to own generation  
977 assets. Hence DSOs are not normally permitted to own (large numbers of) electrical storage  
978 systems connected to their network, despite the fact that some of the benefits of embedded  
979 ES assets could accrue to them (to name a few: grid investment deferral, power quality, and  
980 feeder voltage regulation, for example). In terms of growing the market, there are strong  
981 synergies between EV take-up and CES roll-out [196]. Major Li-ion battery manufacturers  
982 have in recent years invested heavily in cell-production capacity across the world to gear up  
983 for EVs, and the resultant product enhancements, competition and over-supply in the market  
984 is rapidly driving down the price of Li-ion modules (see [Fig. 8Fig-8](#)), providing an opportunity  
985 other users of the technology to benefit, such as stationary battery suppliers. In terms of

986 specific synergies between EVs and CES markets, both require similar sized battery packs  
987 (a few tens of kWh), and there is the potential also to utilise the high remaining capacity  
988 (perhaps 70-80% of initial capacity) available in end-of-life EV battery packs, in a second life  
989 as a cheaper source of stationary electrical storage.

#### 990 **8.4 Policymakers perspective**

991 Widespread public support for RE measures has given policymakers the impression that  
992 public acceptance is not an issue, however, the evidence suggests there are problems when  
993 moving from the global to the local levels [197]. Prasad et al [27] argue that CES (and other  
994 distributed energy technologies) can only have a significant roles in future energy systems if  
995 all different actors, including local authorities and the government, are on board. Stephen  
996 Hall and Katy Roelich [198] describe four steps to achieve greater penetration of distributed  
997 energy schemes, these include better routes to market, increased tariffs for exported  
998 electricity, closer matching of energy supply and demand, and re-localising energy values.

999 Schemes such as FITs are an effective method for accelerating the growth of RE  
1000 technologies [199], Germany and Denmark have a long history of investment in FITs and  
1001 development of RE [200]. The UK government has proposed cuts of up to 87% to the  
1002 generation FITs (in contrast to the export tariff) for solar PV in an effort to reduce costs to the  
1003 consumer from government energy policies [201], these cuts will undoubtedly adversely  
1004 affect investment in solar PV and battery storage as a result. In addition, the complexity of  
1005 the UK state support system is an inhibiting factor in local ownership of energy projects [202].  
1006 Other types of taxes and levies can also impact the diffusion of CES schemes. For example,  
1007 in Germany taxes and levies need to be paid on electricity feeding in to the national grid by  
1008 CES systems [203-205]. Communities which are embedded in a single building (e.g., block  
1009 or flats) or alternatively new developments where the grid is privately owned have a  
1010 significant advantage over disaggregated communities in this regulatory environment.

1011 According to Stephen Hall and Katy Roelich [198] the complexity of the local energy sector is  
1012 such that even specialists are sometimes unsure of policy, regulatory and market aspects of  
1013 distributed energy. Therefore, there is a need for a shared learning platform in order to  
1014 provide policy and regulatory advice. Intermediaries play an important role in creating links  
1015 between projects and in creating shared infrastructure to support the development of the  
1016 sector and diffusion of knowledge [206], for example, Community Energy Scotland and  
1017 Community Energy England [207] provide advice to community energy groups, administer  
1018 grant schemes and regional specific funds, help prepare funding applications and provide  
1019 networking opportunities [156]. Bomberg and McEwen [156] attempted to identify factors  
1020 encouraging community mobilisation, their analysis found that state support was a crucial  
1021 factor, but it was partially offset by entrenched political and economic interests and closed  
1022 policymaking. Successful community mobilization depends on how well groups exploit state  
1023 resources and overcome these barriers.

1024 Small to medium sized schemes find it hard to compete with large energy providers [198].  
1025 Energy Service Companies (ESCOs) are companies created to produce and manage the  
1026 local delivery of energy. ESCOs have the potential to achieve scale economies, for example,  
1027 ESCOs may obtain discounts for the purchase of energy, reduced staff and material costs  
1028 and reduced purchase price for equipment [208]. The extent to which costs can be reduced  
1029 for a particular energy stream depends on the technical potential for improved conversion  
1030 and distribution of energy [208]. The ESCO model has similarities with other forms of  
1031 outsourcing and private investment in public infrastructure [208].

1032 There is an incentive for the ESCO to produce and manage energy as efficiently as possible  
1033 since it is usually the ESCO and not the customer that bears the cost of inefficiency, unlike

1034 energy utilities which sell units of electricity and the customer bears the cost of inefficiencies  
1035 [154]. Long-term commitment by governments to the ESCO concept is key. Energy  
1036 Efficiency and Sustainable Energy Action Plans that do not depend on political election  
1037 cycles can act as a vehicle for promoting ESCOs, in Denmark a strong energy efficiency  
1038 regulatory framework has been linked to a commitment to the ESCO model by local  
1039 administrations [209]. A supportive policy framework and dedicated ESCO legislation and  
1040 measures such as ESCO standards, certification schemes and financial supports are key  
1041 success factors, for example, in Spain and Sweden changes to procurement laws have  
1042 opened the market for long-term energy performance contracts [209].

### 1043 **conclusions**

1044 End user applications, namely PV self-consumption, load shifting and demand management  
1045 including electricity, heat and cooling are driving the penetration of CES. In contrast to other  
1046 potential applications also performed by CES systems which are considered to be 'power'  
1047 applications (e.g., voltage control and power quality), these are 'energy' applications, i.e.  
1048 cycles last for several hours and they are performed on a daily basis. Compared to ES  
1049 assets at other scales, CES can be i) more effective in (dynamically) balancing local supply  
1050 and demand than, for example, ES connected to the transmission network; and ii) more cost-  
1051 effective than ES located in single dwellings.

1052 From a CES application perspective, managing PV generation adds more value (and  
1053 potentially more profitability) than performing demand load-shifting since the difference  
1054 between the purchased (retail electricity price) and sold electricity price (wholesale electricity  
1055 price) is higher than the difference between peak and off-peak retail prices. On the other  
1056 hand, the levelised cost of CES systems could potentially be reduced when shifting the  
1057 demand load since daily demand requirements are greater than surplus PV energy.  
1058 However, CES systems using battery technology and only performing end user applications  
1059 are not profitable yet mainly because of the high cost of the technology. Therefore, these  
1060 'energy' applications should be complemented with other services based on the power  
1061 capability of CES systems. For example, smoothing both the PV power export and electricity  
1062 grid import is becoming more relevant as the penetration of PV systems, HPs and EVs  
1063 continues to increase. Additional value can be created by CES systems if capacity tariffs  
1064 form part of a customer's bill. Furthermore, participation in ancillary services markets (e.g.,  
1065 frequency control) and/or distribution network applications (e.g., distribution network capital  
1066 deferral) could also be included in the CES value proposition.

1067 Given its high round trip efficiency (90% approximately) and suitability for short-term and  
1068 mid-term storage cycles, Li-ion battery technology is expected to become the most  
1069 widespread electrochemical technology for CES systems. This will be driven by strongly  
1070 reducing Li-ion module prices (for example, from 600 \$/kWh in 2014 to 300 \$/kWh predicted  
1071 by 2020 for Li-ion batteries based on Nickel Manganese Cobalt chemistry). Flow batteries  
1072 are an attractive solution for mid-term CES applications despite their lack of maturity  
1073 because of their unique characteristic of decoupled energy and power rating. When  
1074 disregarding capacity tariffs, PbA batteries are presently more competitive than Li-ion  
1075 batteries for demand load shifting (with the battery capacity sized according to the demand  
1076 load occurring at peak time). However, Li-ion batteries are more economically viable for PV  
1077 self-consumption (with the battery sized according to surplus PV generation requirements)  
1078 and demand peak shaving. As the penetration of RE and low carbon technologies increases  
1079 during the energy transition, it is expected that hybrid systems (comprising different types of  
1080 electrochemical technologies, e.g., supercapacitors, Li-ion batteries, flow batteries and/or  
1081 hydrogen) may be required for some communities or districts in order to cover the full

1082 spectrum of applications, to meet the associated storage cycles with different temporal  
1083 scales (from seconds to weeks or months).

1084 Thermal storage will continue to be the most utilised CES solution for the next decade given  
1085 the dominance of space heating and DHW demand in the final energy consumption across  
1086 many countries with temperate climates and taking into account its cost competitiveness (the  
1087 CAPEX of thermal storage with hot water tanks, 57.5 US\$/kWh, is for example still one order  
1088 of magnitude lower than that of Li-ion batteries). An increased use of thermal storage is also  
1089 expected for power to heat applications (HPs, CHPs and chillers) and for managing  
1090 stochastic solar and wind energy. At the same time, seasonal thermal CES solutions are  
1091 required to mitigate the seasonal variability of the electricity output from these energy  
1092 sources. As thermal storage gains importance, the penetration of new thermal storage  
1093 concepts with enhanced energy density such as PCMs is expected to increase.

1094 There are several benefits related to the community approach. From a technical point of  
1095 view, the aggregation of demand profiles results in a less spiky overall profile in comparison  
1096 with a single house and this reduces the required discharge rate (relative to the battery  
1097 capacity). This reduction increases the round trip efficiency and equivalent full cycles of  
1098 electrochemical storage technologies. The levelised cost, value and profitability associated  
1099 with end user applications also improve due to better utilisation and performance. From a  
1100 CAPEX point of view, economies scale are, however, only expected for bi-directional  
1101 inverters, balance-of-plant installation and maintenance which account only for around 20%-  
1102 50% of the final cost depending on the battery chemistry and final design (i.e. no economies  
1103 of scale can be realized for the battery cells). However, a community battery system could  
1104 approximately halve the optimum capacity in comparison with an individual residential battery  
1105 system due to the positive effect of the aggregation of demands. Economies of scale are  
1106 also important for different thermal CES solutions.

1107 Regarding the environmental impact of CES systems, the development and use of a more  
1108 consistent and unified methodology for environmental evaluation of CES is needed in order  
1109 to perform cross comparison amongst various technologies and applications. LCA is being  
1110 recommended as the most comprehensive method at the moment, but different methods are  
1111 still used; and often, system boundaries and functional units of storage systems also vary.  
1112 Additionally, the results of LCA should be integrated with the techno-economic performance  
1113 in order to bring environmental considerations into the decision-making process and system  
1114 designs. From a socio-economic perspective and in combination with distributed wind and  
1115 solar power generation, CES provides a mechanism to address the issues of affordability,  
1116 energy security, and energy efficiency and consequently contribute to a reduction of GHG  
1117 emissions associated with individuals and communities. Importantly, it also provides  
1118 opportunities for further engagement of individuals in community activities, and the potential  
1119 to increase awareness of energy and environmental issues. Uptake may be increased if  
1120 more focus is placed on ensuring that energy users are engaged in CES as citizens, and not  
1121 only that of consumers.

1122 Regarding the ownership and related location of CES systems, different solutions may  
1123 coexist. CES systems can be offered by PV installers and/or house-builders therefore  
1124 installed in different communities (e.g., block of buildings) and paid by end users.  
1125 Alternatively, they can be operated and/or provided by utility companies and DSOs while  
1126 being connected to the RE plants and demand loads of the residential sector. The low  
1127 voltage side of the utility transformers is already being used for the latter case in USA.  
1128 Regardless of the type of ownership model, CES investments should be profitable but also  
1129 associated business models should develop win-win solutions for different stockholders  
1130 involved in the CES project and avoid free riders. Two examples of win-win solutions



1131 discussed in this manuscript are: (a) electricity tariffs with capacity components for both  
1132 electricity import and export; and (b) shared business and/or ownership models (including  
1133 both CAPEX and OPEX) when the value propositions include applications which benefit  
1134 different stakeholders. For example, the optimum management of local PV generation  
1135 benefits both the end user (e.g., self-consumption is driven by the difference between the  
1136 import and export electricity prices), and the utility company and/or DNO (e.g., the deferral of  
1137 distribution network investment). Moreover, utility companies could also benefit from  
1138 optimising the performance of CES systems for the electricity network and/or wholesale  
1139 markets. Likewise, hierarchical control techniques including both the community level, upper  
1140 level (e.g. distribution network and/or wholesale market) and maintenance should be applied  
1141 by the utility company (or aggregator).

1142 CES will have a significant role in future energy systems if all different actors, including local  
1143 authorities and the government, are on board. Uptake may also be enhanced through  
1144 financial incentives and regulatory frameworks established by policymakers. Similar to other  
1145 low carbon technologies such as PV and heat pumps, CES diffusion across different  
1146 countries will have a strong dependence on the regulatory context. The experience from  
1147 countries such as Denmark and Germany suggest that the success of CES depends on:  
1148 citizen engagement coupled with access to incentives, community rights over local grid  
1149 ownership, good management of energy generation and a stable policy support at the  
1150 community level. In addition, a simplification of the complex regulatory framework around  
1151 energy is needed to make it accessible to communities and communities' champions. A  
1152 supportive policy framework and dedicated ESCO legislation and measures such as ESCO  
1153 standards, certification schemes and financial supports could be key to the success of CES.  
1154 While creating similar benefits as ES implemented at the level of individual end users (e.g. in  
1155 private homes, apartment buildings or commercial buildings), the advantages of CES are  
1156 improved economies of scale (especially in aspects such as power electronics,  
1157 communications and control technologies) and the option of professional management as  
1158 well as system benefits at the level of the distribution grid. Last but not least, the community  
1159 scale has proven to be a catalyst for the engagement of citizens in the energy transition in  
1160 order to build a sustainable future, i.e. speed up RE penetration, increase energy awareness  
1161 and reduce the carbon footprint of communities.

## 1162 10. Acknowledgements

1163 This work was funded by the Commission for Technology and Innovation in Switzerland  
1164 (CTI) within the Swiss Competence Centre for Energy Research in Heat and Electricity  
1165 Storage (SCCER-HaE), contract number 1155000153. The authors would like to  
1166 acknowledge The Danish Council for Strategic Research for sponsoring the Advanced  
1167 Lifetime Predictions of Battery Energy Storage (ALPBES) project and the EU for funding part  
1168 of this research via the 'Transitioning towards Urban Resilience and Sustainability' TURAS  
1169 project (Grant No 282834).

## 1170 11. Bibliography

- 1171 1. International Energy Agency, I., *Medium-Term Renewable Energy Report 2015*. 2015.
- 1172 2. International Renewable Energy Agency, I., *Renewable Energy Integration in Power Grids*.  
1173 *Technology Brief*. 2015.
- 1174 3. Change, D.o.E.a.C., *Weekly solar PV installation and capacity (Registration date)- Week*  
1175 *ending 30th March 2014*, in *Month*. 2014: [https://www.gov.uk/government/statistics/solar-](https://www.gov.uk/government/statistics/solar-photovoltaics-deployment)  
1176 [photovoltaics-deployment](https://www.gov.uk/government/statistics/solar-photovoltaics-deployment).
- 1177 4. (BMW), B.f.W.u.E., *Marktanalyse Photovoltaik-Dachanlagen 2015*, Bundesministerium für  
1178 Wirtschaft und Energie (BMW).

Mis en forme : Danois

Code de champ modifié

Mis en forme : Danois

Mis en forme : Danois

- 1179 5. Arts, L.U.o.A.S.a., *IEA HPP Annex 42: Heat Pumps in Smart Grids Task 1: Market Overview, Switzerland*. 2014, Fraunhofer ISE.
- 1180
- 1181 6. ISE, F., *IEA HPP Annex 42: Heat Pumps in Smart Grids Task 1: Market Overview, Germany*. 2014, Fraunhofer ISE.
- 1182
- 1183 7. Tanaka, N., *Technology roadmap: Electric and plug-in hybrid electric vehicles*. International Energy Agency, Tech. Rep, 2011.
- 1184
- 1185 8. Ibrahim, H., A. Ilinca, and J. Perron, *Energy storage systems—characteristics and comparisons*. *Renewable and sustainable energy reviews*, 2008. **12**(5): p. 1221-1250.
- 1186
- 1187 9. Chen, H., et al., *Progress in electrical energy storage system: A critical review*. *Progress in Natural Science*, 2009. **19**(3): p. 291-312.
- 1188
- 1189 10. Huggins, R., *Energy storage*. 2010: Springer Science & Business Media.
- 1190 11. Brunet, Y., *Energy storage*. 2013: John Wiley & Sons.
- 1191 12. Díaz-González, F., et al., *A review of energy storage technologies for wind power applications*. *Renewable and Sustainable Energy Reviews*, 2012. **16**(4): p. 2154-2171.
- 1192
- 1193 13. Cabeza, L.F., et al., *Materials used as PCM in thermal energy storage in buildings: a review*. *Renewable and Sustainable Energy Reviews*, 2011. **15**(3): p. 1675-1695.
- 1194
- 1195 14. Stan, A.-I., et al. *Lithium ion battery chemistries from renewable energy storage to automotive and back-up power applications—An overview*. in *Optimization of Electrical and Electronic Equipment (OPTIM)*, 2014 International Conference on. IEEE.
- 1196
- 1197 15. Niaz, S., T. Manzoor, and A.H. Pandith, *Hydrogen storage: Materials, methods and perspectives*. *Renewable and Sustainable Energy Reviews*, 2015. **50**: p. 457-469.
- 1198
- 1199 16. Lyons, P., et al., *Design and analysis of electrical energy storage demonstration projects on UK distribution networks*. *Applied Energy*, 2015. **137**: p. 677-691.
- 1200
- 1201 17. Zakeri, B. and S. Syri, *Electrical energy storage systems: A comparative life cycle cost analysis*. *Renewable and Sustainable Energy Reviews*, 2015. **42**: p. 569-596.
- 1202
- 1203 18. Group, S.E.S.I., *The role of Community Energy Systems in the UK Resilient Energy Supply*. 2013, Technology Strategy Board.
- 1204
- 1205 19. Klein, S.J. and S. Coffey, *Building a sustainable energy future, one community at a time*. *Renewable and Sustainable Energy Reviews*, 2016. **60**: p. 867-880.
- 1206
- 1207 20. Rae, C. and F. Bradley, *Energy autonomy in sustainable communities—A review of key issues*. *Renewable and Sustainable Energy Reviews*, 2012. **16**(9): p. 6497-6506.
- 1208
- 1209 21. Parra Mendoza, D., *Optimum community energy storage for end user applications*. 2014, University of Nottingham.
- 1210
- 1211 22. Parra, D., et al., *Optimum community energy storage system for PV energy time-shift*. *Applied Energy*, 2015. **137**: p. 576-587.
- 1212
- 1213 23. Arghandeh, R., et al., *Economic optimal operation of Community Energy Storage systems in competitive energy markets*. *Applied Energy*, 2014. **135**: p. 71-80.
- 1214
- 1215 24. Dóci, G. and E. Vasileiadou, *“Let’s do it ourselves” Individual motivations for investing in renewables at community level*. *Renewable and Sustainable Energy Reviews*, 2015. **49**: p. 41-50.
- 1216
- 1217 25. van der Schoor, T. and B. Scholtens, *Power to the people: Local community initiatives and the transition to sustainable energy*. *Renewable and Sustainable Energy Reviews*, 2015. **43**: p. 666-675.
- 1218
- 1219 26. O’DOHERTY, T., RODRIGUES, L, GILLOTT, M, *The Role of Community-based Energy Management Schemes in Supporting Resilience*". In: Rodrigues, L. ed. *Sustainable Energy for a Resilient Future*, in *Sustainable Energy Technologies 2015*: Nottingham (UK).
- 1220
- 1221 27. Koirala, B.P., et al., *Energetic communities for community energy: a review of key issues and trends shaping integrated community energy systems*. *Renewable and Sustainable Energy Reviews*, 2016. **56**: p. 722-744.
- 1222
- 1223 28. Zhu, W., et al. *Overview of distributive energy storage systems for residential communities*. in *Energytech, 2012 IEEE*. 2012. IEEE.
- 1224
- 1225
- 1226
- 1227
- 1228
- 1229

- 1230 29. Roberts, B.P. and C. Sandberg, *The role of energy storage in development of smart grids*.  
1231 Proceedings of the IEEE, 2011. **99**(6): p. 1139-1144.
- 1232 30. Asgeirsson, H. *Status of the community energy storage deployment at DTE energy*. in *Power  
1233 and Energy Society General Meeting, 2011 IEEE*. 2011. IEEE.
- 1234 31. International Renewable Energy Agency, I., *The transformative Power of Storage: Developing  
1235 IRENA's Electricity Storage Roadmap*. 2014.
- 1236 32. Akhil, A.A., et al., *DOE/EPRI 2013 electricity storage handbook in collaboration with NRECA*.  
1237 2013: Sandia National Laboratories Albuquerque, NM, USA.
- 1238 33. Thaller, L.H. *Electrically rechargeable redox flow cells*. in *9th Intersociety energy conversion  
1239 engineering conference*.
- 1240 34. De Leon, C.P., et al., *Redox flow cells for energy conversion*. *Journal of Power Sources*, 2006.  
1241 **160**(1): p. 716-732.
- 1242 35. Eyer, J. and G. Corey, *Energy storage for the electricity grid: Benefits and market potential  
1243 assessment guide*. Sandia National Laboratories, 2010: p. 69-73.
- 1244 36. International Energy Agency, I., *Technology Roadmap: Solar Photovoltaic Energy - 2014  
1245 edition*. 2014.
- 1246 37. Zraggen, J.-M., *Bâtiments résidentiels locatifs à haute performance énergétique: objectifs et  
1247 réalités*. 2010, University of Geneva.
- 1248 38. Parra, D., G.S. Walker, and M. Gillott, *Modeling of PV generation, battery and hydrogen  
1249 storage to investigate the benefits of energy storage for single dwelling*. *Sustainable Cities  
1250 and Society*, 2014. **10**: p. 1-10.
- 1251 39. Hoppmann, J., et al., *The economic viability of battery storage for residential solar  
1252 photovoltaic systems—A review and a simulation model*. *Renewable and Sustainable Energy  
1253 Reviews*, 2014. **39**: p. 1101-1118.
- 1254 40. Parra, D. and M.K. Patel, *Effect of tariffs on the performance and economic benefits of PV-  
1255 coupled battery systems*. *Applied Energy*, 2016. **164**: p. 175-187.
- 1256 41. Wirth, H., *Recent Facts about Photovoltaics in Germany*. 2015, Fraunhofer ISE.
- 1257 42. Clover, I., *UK to propose drastic FIT cuts starting 2016*, in *PV Magazine*. *Photovoltaic market  
1258 & Technology*. 2015.
- 1259 43. Peschel, T., *Switzerland cuts feed-in tariff for photovoltaics*, S.W. ENERGY, Editor. 2014.
- 1260 44. International Renewable Energy Agency, I., *Battery storage for renewables: market status  
1261 and technology outlook*. 2015.
- 1262 45. Baumann, L. and E. Boggasch, *Experimental assessment of hydrogen systems and vanadium-  
1263 redox-flow-batteries for increasing the self-consumption of photovoltaic energy in buildings*.  
1264 *International Journal of Hydrogen Energy*, 2015.
- 1265 46. Parra, D., G.S. Walker, and M. Gillott, *Are batteries the optimum PV-coupled energy storage  
1266 for dwellings? Techno-economic comparison with hot water tanks in the UK*. *Energy and  
1267 Buildings*, 2016. **116**: p. 614-621.
- 1268 47. Alam, M., K.M. Muttaqi, and D. Sutanto, *Mitigation of rooftop solar PV impacts and evening  
1269 peak support by managing available capacity of distributed energy storage systems*. *Power  
1270 Systems, IEEE Transactions on*, 2013. **28**(4): p. 3874-3884.
- 1271 48. Ratnam, E.L., S.R. Weller, and C.M. Kellett, *An optimization-based approach to scheduling  
1272 residential battery storage with solar PV: Assessing customer benefit*. *Renewable Energy*,  
1273 2015. **75**: p. 123-134.
- 1274 49. Huq, K.M.M., et al. *An energy management system for a community energy storage system*.  
1275 in *Energy Conversion Congress and Exposition (ECCE), 2012 IEEE*. 2012. IEEE.
- 1276 50. Moshövel, J., et al., *Analysis of the maximal possible grid relief from PV-peak-power impacts  
1277 by using storage systems for increased self-consumption*. *Applied Energy*, 2015. **137**: p. 567-  
1278 575.
- 1279 51. Wolfs, P. and G.S. Reddy. *A receding predictive horizon approach to the periodic optimization  
1280 of community battery energy storage systems*. in *Universities Power Engineering Conference  
1281 (AUPEC), 2012 22nd Australasian*. 2012. IEEE.

- 1282 52. Neubauer, J., et al. *Analyzing the Effects of Climate and Thermal Configuration on Community*  
1283 *Energy Storage Systems*. in *Electrical Energy Storage Applications and Technologies (EESAT)*  
1284 *Conference*. 2013.
- 1285 53. Beltran, H., et al., *Evaluation of storage energy requirements for constant production in PV*  
1286 *power plants*. Industrial Electronics, IEEE Transactions on, 2013. **60**(3): p. 1225-1234.
- 1287 54. Jabalameli, N., et al. *Rooftop PV with battery storage for constant output power production*  
1288 *considering load characteristics*. in *Electrical and Electronics Engineering (ELECO), 2013 8th*  
1289 *International Conference on*. 2013. IEEE.
- 1290 55. Parra, D., M. Gillott, and G.S. Walker, *The role of hydrogen in achieving the decarbonization*  
1291 *targets for the UK domestic sector*. International Journal of Hydrogen Energy, 2014. **39**(9): p.  
1292 4158-4169.
- 1293 56. Hesaraki, A., S. Holmberg, and F. Haghighat, *Seasonal thermal energy storage with heat*  
1294 *pumps and low temperatures in building projects—A comparative review*. Renewable and  
1295 Sustainable Energy Reviews, 2015. **43**: p. 1199-1213.
- 1296 57. Alam, M., K.M. Muttaqi, and D. Sutanto, *A novel approach for ramp-rate control of solar PV*  
1297 *using energy storage to mitigate output fluctuations caused by cloud passing*. Energy  
1298 Conversion, IEEE Transactions on, 2014. **29**(2): p. 507-518.
- 1299 58. Delfanti, M., D. Falabretti, and M. Merlo, *Energy storage for PV power plant dispatching*.  
1300 Renewable Energy, 2015. **80**: p. 61-72.
- 1301 59. Bergner, J., et al. *Feed-in Power Limitation of Grid-Connected PV Battery Systems with*  
1302 *Autonomous Forecast-Based Operation Strategies*. in *29th European Photovoltaic Solar*  
1303 *Energy Conference and Exhibition*. 2014.
- 1304 60. Zheng, M., C.J. Meinrenken, and K.S. Lackner, *Agent-based model for electricity consumption*  
1305 *and storage to evaluate economic viability of tariff arbitrage for residential sector demand*  
1306 *response*. Applied Energy, 2014. **126**: p. 297-306.
- 1307 61. Erdinc, O., et al., *A new perspective for sizing of distributed generation and energy storage for*  
1308 *smart households under demand response*. Applied Energy, 2015. **143**: p. 26-37.
- 1309 62. Parra, D., et al., *Optimum community energy storage system for demand load shifting*.  
1310 Applied Energy, 2016. **174**: p. 130-143.
- 1311 63. Parra, D., M. Gillott, and G.S. Walker, *Design, testing and evaluation of a community*  
1312 *hydrogen storage system for end user applications*. International Journal of Hydrogen Energy,  
1313 2016.
- 1314 64. Fazeli, A., et al. *A novel stochastic modelling approach for electric vehicle charging power and*  
1315 *energy requirements*. in *Innovative Smart Grid Technologies Conference (ISGT), 2015 IEEE*  
1316 *Power & Energy Society*. 2015. IEEE.
- 1317 65. Leadbetter, J. and L. Swan, *Battery storage system for residential electricity peak demand*  
1318 *shaving*. Energy and Buildings, 2012. **55**: p. 685-692.
- 1319 66. Jargstorf, J., C. De Jonghe, and R. Belmans, *Assessing the reflectivity of residential grid tariffs*  
1320 *for a user reaction through photovoltaics and battery storage*. Sustainable Energy, Grids and  
1321 Networks, 2015. **1**: p. 85-98.
- 1322 67. Barzin, R., et al., *Peak load shifting with energy storage and price-based control system*.  
1323 Energy, 2015.
- 1324 68. Ruddell, B.L., F. Salamanca, and A. Mahalov, *Reducing a semiarid city's peak electrical*  
1325 *demand using distributed cold thermal energy storage*. Applied Energy, 2014. **134**: p. 35-44.
- 1326 69. Sun, Y., et al., *Peak load shifting control using different cold thermal energy storage facilities*  
1327 *in commercial buildings: A review*. Energy Conversion and Management, 2013. **71**: p. 101-  
1328 114.
- 1329 70. Dott, R., *The Reference Framework for System Simulations of the IEA SHC Task 44 / HPP*  
1330 *Annex 38, Part B: Buildings and Space Heat Load*. 2013, IEA.
- 1331 71. Gohl, N., et al., *Highly efficient, cost-effective solar-geothermal heat supply concept for multi-*  
1332 *family houses and small residential areas*, in *CISBAT 2015 - September 9-11, 2015 - Lausanne,*  
1333 *Switzerland*. 2015.

- 1334 72. Navarro, L., et al., *Thermal energy storage in building integrated thermal systems: A review. Part 2. Integration as passive system*. *Renewable Energy*, 2015. **85**: p. 1334-1356.
- 1335
- 1336 73. Kenisarin, M. and K. Mahkamov, *Passive thermal control in residential buildings using phase change materials*. *Renewable and Sustainable Energy Reviews*, 2016: p. 371-398.
- 1337
- 1338 74. CIGALE, S.C.D.H.L. *La Cigale*. 2013.
- 1339 75. Mastani Joybari, M., et al., *Heat and cold storage using phase change materials in domestic refrigeration systems: The state-of-the-art review*. *Energy and Buildings*, 2015. **106**: p. 111-124.
- 1340
- 1341
- 1342 76. Barbieri, E.S., F. Melino, and M. Morini, *Influence of the thermal energy storage on the profitability of micro-CHP systems for residential building applications*. *Applied Energy*, 2012. **97**: p. 714-722.
- 1343
- 1344
- 1345 77. Kreuder, L. and C. Spataru, *Assessing demand response with heat pumps for efficient grid operation in smart grids*. *Sustainable Cities and Society*, 2015. **19**: p. 136-143.
- 1346
- 1347 78. A. Arteconi, N.J.H., F. Polonara, *State of the art of thermal storage for demand-side management*. *Applied Energy*, 2012. **93**: p. 371-389.
- 1348
- 1349 79. Hinds, E. and J. Boyer-Dry, *The emergence of an electric energy storage market*. *The Electricity Journal*, 2014. **27**(2): p. 6-13.
- 1350
- 1351 80. Aecom, *Energy Storage Study: Funding and Knowledge Sharing Priorities*. 2015, Australian Renewable Energy Agency.
- 1352
- 1353 81. Energy, U.S.D.o., *Grid Energy Storage*. 2013.
- 1354 82. Energy Research, P., *The future role of energy storage in the UK*. 2011.
- 1355 83. Clean Energy, G., *Energy Storage and Electricity Markets: the value of storage to the power system and the importance of electricity in energy storage economics*. 2015.
- 1356
- 1357 84. Castillo, A. and D.F. Gayme, *Grid-scale energy storage applications in renewable energy integration: A survey*. *Energy Conversion and Management*, 2014. **87**: p. 885-894.
- 1358
- 1359 85. Di Giorgio, A. and F. Liberati, *Near real time load shifting control for residential electricity prosumers under designed and market indexed pricing models*. *Applied Energy*, 2014. **128**: p. 119-132.
- 1360
- 1361
- 1362 86. Pourmousavi, S.A., S.N. Patrick, and M.H. Nehrir, *Real-time demand response through aggregate electric water heaters for load shifting and balancing wind generation*. *Smart Grid, IEEE Transactions on*, 2014. **5**(2): p. 769-778.
- 1363
- 1364
- 1365 87. Świerczyński, M., et al., *Field Experience from Li-Ion BESS Delivering Primary Frequency Regulation in the Danish Energy Market*. *ECS Transactions*, 2014. **61**(37): p. 1-14.
- 1366
- 1367 88. Tielens, P. and D. Van Hertem, *Grid inertia and frequency control in power systems with high penetration of renewables*. status: published, 2012.
- 1368
- 1369 89. Fuel, C. and U. Hydrogen Joint, *Commercialisation of Energy Storage in Europe*. 2015, European Union.
- 1370
- 1371 90. Amor, M.B., et al., *Influence of wind power on hourly electricity prices and GHG (greenhouse gas) emissions: Evidence that congestion matters from Ontario zonal data*. *Energy*, 2014. **66**: p. 458-469.
- 1372
- 1373
- 1374 91. Kousksou, T., et al., *Energy storage: Applications and challenges*. *Solar Energy Materials and Solar Cells*, 2014. **120**: p. 59-80.
- 1375
- 1376 92. Kjaer, P.C., R. Larke, and G.C. Tarnowski. *Ancillary services provided from wind power plant augmented with energy storage*. in *Power Electronics and Applications (EPE), 2013 15th European Conference on*. IEEE.
- 1377
- 1378
- 1379 93. International Energy, A. *Technology Roadmap—Energy Storage*. IEA Paris, France.
- 1380 94. Rastler, D., *Electricity energy storage technology options: a white paper primer on applications, costs and benefits*. 2010: Electric Power Research Institute.
- 1381
- 1382 95. Black, V., *Cost and Performance Data for Power Generation Technologies*. Prepared for the National Renewable Energy Laboratory, 2012.
- 1383
- 1384 96. International Energy Agency, I., *Energy Technology Perspectives 2014. Harnessing Electricity's potential*. 2014, International Energy Agency, IEA.
- 1385

- 1386 97. International Energy, A., *Technology Roadmap. Energy Storage*. 2014, IEA Paris, France.
- 1387 98. Soloveichik, G.L., *Battery technologies for large-scale stationary energy storage*. Annual  
1388 review of chemical and biomolecular engineering, 2011. **2**: p. 503-527.
- 1389 99. Eckroad, S. and I. Gyuk, *EPRI-DOE handbook of energy storage for transmission & distribution*  
1390 *applications*. Electric Power Research Institute, Inc, 2003.
- 1391 100. Vazquez, S., et al., *Energy storage systems for transport and grid applications*. Industrial  
1392 Electronics, IEEE Transactions on, 2010. **57**(12): p. 3881-3895.
- 1393 101. McKeon, B.B., J.-i. Furukawa, and S. Fenstermacher, *Advanced lead-acid batteries and the*  
1394 *development of grid-scale energy storage systems*. Proceedings of the IEEE, 2014. **102**(6): p.  
1395 951-963.
- 1396 102. Terada, M. and H. Takabayashi, *Industrial Storage Device for Low-carbon Society*. Hitachi  
1397 Review, 2011. **60**(1): p. 23.
- 1398 103. Yoshida, H., et al. *Development of an ultra long-life (6000 cycles) VRLA for deep-cycle service*.  
1399 in *Proc. 13th Asian Battery Conf., Macau, China*. 2009.
- 1400 104. Scrosati, B. and J. Garche, *Lithium batteries: Status, prospects and future*. Journal of Power  
1401 Sources, 2010. **195**(9): p. 2419-2430.
- 1402 105. Xu, T., et al., *Lithium-ion batteries for stationary energy storage*. JOM, 2010. **62**(9): p. 24-30.
- 1403 106. Goodenough, J.B. and K.-S. Park, *The Li-ion rechargeable battery: a perspective*. Journal of  
1404 the American Chemical Society, 2013. **135**(4): p. 1167-1176.
- 1405 107. Stroe, A.-I., et al. *Performance model for high-power lithium titanate oxide batteries based on*  
1406 *extended characterization tests*. in *Energy Conversion Congress and Exposition (ECCE), 2015*  
1407 *IEEE*. IEEE.
- 1408 108. Stroe, D.-I., et al., *Accelerated lifetime testing methodology for lifetime estimation of Lithium-*  
1409 *ion batteries used in augmented wind power plants*. Industry Applications, IEEE Transactions  
1410 on, 2014. **50**(6): p. 4006-4017.
- 1411 109. Omar, N., et al. *Assessment of performance of lithium iron phosphate oxide, nickel*  
1412 *manganese cobalt oxide and nickel cobalt aluminum oxide based cells for using in plug-in*  
1413 *battery electric vehicle applications*. in *Vehicle Power and Propulsion Conference (VPPC), 2011*  
1414 *IEEE*. IEEE.
- 1415 110. Poullikkas, A., *A comparative overview of large-scale battery systems for electricity storage*.  
1416 *Renewable and Sustainable Energy Reviews*, 2013. **27**: p. 778-788.
- 1417 111. Jaffe, S. *The Lithium Ion Battery Market Supply and Demand*. in *Navigant Consulting Inc.*  
1418 *Presented at the ARPA-E Range Conference on January*. 2014.
- 1419 112. Grothoff, J.M., *BATTERY STORAGE FOR RENEWABLES: MARKET STATUS AND TECHNOLOGY*  
1420 *OUTLOOK*. 2015.
- 1421 113. International Renewable Energy Agency, I., *Road Transport: The cost of Renewable Solutions*.  
1422 2013.
- 1423 114. Kawakami, N., et al. *Development and field experiences of stabilization system using 34MW*  
1424 *NAS batteries for a 51MW wind farm*. in *Industrial Electronics (ISIE), 2010 IEEE International*  
1425 *Symposium on*. IEEE.
- 1426 115. Fabjan, C., et al., *The vanadium redox-battery: an efficient storage unit for photovoltaic*  
1427 *systems*. *Electrochimica Acta*, 2001. **47**(5): p. 825-831.
- 1428 116. Horne, C., et al., *Demonstration of EnerVault Iron-Chromium Redox Flow Battery*. 2014,  
1429 California Energy Commission.
- 1430 117. Weber, A.Z., et al., *Redox flow batteries: a review*. Journal of Applied Electrochemistry, 2011.  
1431 **41**(10): p. 1137-1164.
- 1432 118. Skyllas-Kazacos, M. and F. Grossmith, *Efficient vanadium redox flow cell*. Journal of the  
1433 Electrochemical Society, 1987. **134**(12): p. 2950-2953.
- 1434 119. Zeng, Y.K., et al., *A comparative study of all-vanadium and iron-chromium redox flow*  
1435 *batteries for large-scale energy storage*. Journal of Power Sources, 2015. **300**: p. 438-443.
- 1436 120. Miller, A.R., K.S. Hess, and D.L. Barnes. *Comparison of Practical Hydrogen-Storage Volumetric*  
1437 *Densities*. in *Proceedings of the NHA Annual Hydrogen Conference*. 2007.

- 1438 121. Parra, D. and M.K. Patel, *Techno-economic implications of the electrolyser technology and*  
1439 *size for power-to-gas systems*. International Journal of Hydrogen Energy, 2016. **41**(6): p.  
1440 3748-3761.
- 1441 122. Bhandari, R., C.A. Trudewind, and P. Zapp, *Life cycle assessment of hydrogen production via*  
1442 *electrolysis – a review*. Journal of Cleaner Production, 2014. **85**: p. 151-163.
- 1443 123. Bessarabov, D., et al., *PEM Electrolysis for Hydrogen Production: Principles and Applications*.  
1444 2016: CRC Press.
- 1445 124. Hofstetter, D., et al., *Power-to-Gas in Switzerland - Demand, Regulation, Economics,*  
1446 *Technical Potential*. 2014.
- 1447 125. Cai, Q., C.S. Adjiman, and N.P. Brandon, *Optimal control strategies for hydrogen production*  
1448 *when coupling solid oxide electrolyzers with intermittent renewable energies*. Journal of  
1449 Power Sources, 2014. **268**: p. 212-224.
- 1450 126. Walker, G., *Solid-state hydrogen storage: materials and chemistry*. 2008: Elsevier.
- 1451 127. Staffell, I. and R. Green, *The cost of domestic fuel cell micro-CHP systems*. International  
1452 Journal of hydrogen energy, 2013. **38**(2): p. 1088-1102.
- 1453 128. Berger, R., *Advancing Europe's energy system: stationary fuel cells in distributed generation |*  
1454 *Publications | Media | Roland Berger*. 2015.
- 1455 129. Steward, D., *Community Energy: Analysis of Hydrogen Distributed Energy Systems with*  
1456 *Photovoltaics for Load Leveling and Vehicle Refueling*. 2014, National Renewable Energy  
1457 Laboratory.
- 1458 130. Luo, X., et al., *Overview of current development in electrical energy storage technologies and*  
1459 *the application potential in power system operation*. Applied Energy, 2015. **137**: p. 511-536.
- 1460 131. Makarov, Y.V., et al., *Sizing Energy Storage to Accommodate High Penetration of Variable*  
1461 *Energy Resources*. IEEE Transactions on Sustainable Energy, 2012. **3**(1): p. 34-40.
- 1462 132. Tan, X., Q. Li, and H. Wang, *Advances and trends of energy storage technology in Microgrid*.  
1463 Electrical Power and Energy Systems, 2013. **44**: p. 179-191.
- 1464 133. Bocklisch, T., *Hybrid energy storage systems for renewable energy applications*. Energy  
1465 Procedia, 2015. **73**: p. 103-111.
- 1466 134. Mangold Dirk, M.O., Tziggili Ekaterini Primoudi, Thomas Schmidt, Markus Unterberger,  
1467 Beatrice Zeh, *Technisch-Wirtschaftliche Analyse Und Weiterentwicklung Der Solaren*  
1468 *Langzeit-Wärmespeicherung*. 2012, Solites.
- 1469 135. Moreno, P., et al., *The use of phase change materials in domestic heat pump and air-*  
1470 *conditioning systems for short term storage: A review*. Renewable and Sustainable Energy  
1471 Reviews, 2014. **39**: p. 1-13.
- 1472 136. Seddegh, S., et al., *Solar domestic hot water systems using latent heat energy storage*  
1473 *medium: A review*. Renewable and Sustainable Energy Reviews, 2015. **49**: p. 517-533.
- 1474 137. Winteler, C., et al., *Seasonal Performance of a Combined Solar, Heat Pump and Latent Heat*  
1475 *Storage System*. Energy Procedia, 2014. **48**: p. 689-700.
- 1476 138. Sommer, W., et al., *Optimization and spatial pattern of large-scale aquifer thermal energy*  
1477 *storage*. Applied Energy, 2015. **137**: p. 322-337.
- 1478 139. Schmidt, T., *Solar district heating guidelines - Fact sheet 7.2*. 2012. p. 13.
- 1479 140. Holm, L., *Long term experiences with solar district heating in Denmark*. 2012, EUROHEAT:  
1480 Brussels.
- 1481 141. Mathieu Riegger, D.M. *Seasonal thermal energy storage (STES)*. in *3rd Swiss Symposium*  
1482 *Thermal Energy Storage*. 2016. Lucerne (Switzerland).
- 1483 142. Jülch, V., et al., *A holistic comparative analysis of different storage systems using leveled*  
1484 *cost of storage and life cycle indicators*. Energy Procedia, 2015. **73**: p. 10.
- 1485 143. Cui, B., et al., *Effectiveness and life-cycle cost-benefit analysis of active cold storages for*  
1486 *building demand management for smart grid applications*. Applied Energy, 2015. **147**: p. 523-  
1487 535.

- 1488 144. Gwerder, D., et al., *Entwicklung einer optimalen Einheit aus Wärmepumpe und thermischem*  
1489 *Energiespeicher*, in *21. Wärmepumpentagung*. 2015, Swiss Federal Office of Energy:  
1490 Burgdorf, Switzerland. p. 1-12.
- 1491 145. Blarke, M.B., et al., *Thermal battery with CO2 compression heat pump: Techno-economic*  
1492 *optimization of a high-efficiency Smart Grid option for buildings*. *Energy and Buildings*, 2012.  
1493 **50**: p. 128-138.
- 1494 146. AG, J.E. 2016 [cited 2016 09.05.2016]; Available from: <http://jenni.ch/preise-2.html>.
- 1495 147. OVO Energy, *Community Energy White Paper April 2014*. 2014.
- 1496 148. Caird, S. and R. Roy, *Adoption and Use of Household Microgeneration Heat Technologies*. *Low*  
1497 *Carbon Economy*, 2010. **1**(2): p. 61-70.
- 1498 149. Michelsen, C.C. and R. Madlener, *Motivational factors influencing the homeowners' decisions*  
1499 *between residential heating systems: An empirical analysis for Germany*. *Energy Policy*, 2013.  
1500 **57**: p. 221-233.
- 1501 150. Claudy, M., R. Garcia, and A. O'Driscoll, *Consumer resistance to innovation—a behavioral*  
1502 *reasoning perspective*. *Journal of the Academy of Marketing Science*, 2015. **43**(4): p. 528-544.
- 1503 151. Mahesh, A. and K.S. Sandhu, *Hybrid wind/photovoltaic energy system developments: Critical*  
1504 *review and findings*. *Renewable and Sustainable Energy Reviews*, 2015. **52**: p. 1135-1147.
- 1505 152. Seyfang, G., et al., *A grassroots sustainable energy niche? Reflections on community energy in*  
1506 *the UK*. *Environmental Innovation and Societal Transitions*, 2014. **13**: p. 21-44.
- 1507 153. Committee, H.o.C.E.a.C.C., *Local Energy: Volume II Additional written evidence*. 2013, The  
1508 Stationery Office Limited. p. 14.
- 1509 154. Hannon, M.J. and R. Bolton, *UK Local Authority engagement with the Energy Service*  
1510 *Company (ESCo) model: Key characteristics, benefits, limitations and considerations*. *Energy*  
1511 *Policy*, 2015. **78**: p. 198-212.
- 1512 155. Mayer, J. *STATE INCENTIVE PROGRAM IS LAUNCHED FOR SOLAR STORAGE SYSTEMS*. 2013;  
1513 Available from: [http://www.solarenergystorage.org/en/staatliche-forderung-von-](http://www.solarenergystorage.org/en/staatliche-forderung-von-solarstromspeichern-gestartet/)  
1514 [solarstromspeichern-gestartet/](http://www.solarenergystorage.org/en/staatliche-forderung-von-solarstromspeichern-gestartet/).
- 1515 156. Bomberg, E. and N. McEwen, *Mobilizing community energy*. *Energy Policy*, 2012. **51**: p. 435-  
1516 444.
- 1517 157. Shamsuzzoha, A., A. Grant, and J. Clarke, *Implementation of renewable energy in Scottish*  
1518 *rural area: A social study*. *Renewable and Sustainable Energy Reviews*, 2012. **16**(1): p. 185-  
1519 191.
- 1520 158. Heiskanen, E., et al., *Low-carbon communities as a context for individual behavioural change*.  
1521 *Energy Policy*, 2010. **38**(12): p. 7586-7595.
- 1522 159. Rodrigues, L., Marsh, J., Kiamba, L., Gillott, M., O'Doherty, T., *The Case for Localised Energy*  
1523 *Management to Support Resilient Cities*, in *Passive and Low-Energy Architecture – PLEA 2016:*  
1524 *Cities, Buildings, People: Towards Regenerative Environments*. . 2016: Los Angeles.
- 1525 160. DECC, *Low Carbon Communities Challenge Evaluation Report 2012*, Department of Energy  
1526 and Climate Change: London, UK.
- 1527 161. ISO, *14040 Environmental management - Life cycle assessment - Principles and framework*  
1528 *2006*: Switzerland.
- 1529 162. Sullivan, J.L. and L. Gaines, *Status of life cycle inventories for batteries*. *Energy Conversion and*  
1530 *Management*, 2012. **58**: p. 134-148.
- 1531 163. Oliveira, L., et al., *Environmental performance of electricity storage systems for grid*  
1532 *applications, a life cycle approach*. *Energy Conversion and Management*, 2015. **101**(0): p.  
1533 326-335.
- 1534 164. Sternberg, A. and A. Bardow, *Power-to-What? - Environmental assessment of energy storage*  
1535 *systems*. *Energy & Environmental Science*, 2015. **8**(2): p. 389-400.
- 1536 165. Denholm, P. and G. Kulcinski, *Net energy balance and greenhouse gas emissions from*  
1537 *renewable energy storage systems 2003*, Energy Center of Wisconsin, Fusion Technology  
1538 Institute University of Wisconsin-Madison.



- 1539 166. Jülch, V., et al., *A Holistic Comparative Analysis of Different Storage Systems using Levelized*  
1540 *Cost of Storage and Life Cycle Indicators*. Energy Procedia, 2015. **73**: p. 18-28.
- 1541 167. Hawkins, T.R., O.M. Gausen, and A.H. Strømman, *Environmental impacts of hybrid and*  
1542 *electric vehicles—a review*. The International Journal of Life Cycle Assessment, 2012. **17**(8): p.  
1543 997-1014.
- 1544 168. Nordelöf, A., et al., *Environmental impacts of hybrid, plug-in hybrid, and battery electric*  
1545 *vehicles—what can we learn from life cycle assessment?* The International Journal of Life  
1546 Cycle Assessment, 2014: p. 1-25.
- 1547 169. Majeau-Bettez, G., T.R. Hawkins, and A.H. Strømman, *Life Cycle Environmental Assessment of*  
1548 *Lithium-Ion and Nickel Metal Hydride Batteries for Plug-In Hybrid and Battery Electric*  
1549 *Vehicles*. Environmental Science & Technology, 2011. **45**(10): p. 4548-4554.
- 1550 170. Zackrisson, M., L. Avellán, and J. Orlenius, *Life cycle assessment of lithium-ion batteries for*  
1551 *plug-in hybrid electric vehicles – Critical issues*. Journal of Cleaner Production, 2010. **18**(15):  
1552 p. 1519-1529.
- 1553 171. Notter, D.A., et al., *Contribution of Li-Ion Batteries to the Environmental Impact of Electric*  
1554 *Vehicles*. Environmental Science & Technology, 2010. **44**(17): p. 6550-6556.
- 1555 172. Messagie, M., et al., *11 - Environmental performance of lithium batteries: life cycle analysis,*  
1556 *in Rechargeable Lithium Batteries*, A.A. Franco, Editor. 2015, Woodhead Publishing. p. 303-  
1557 318.
- 1558 173. Longo, S., et al., *Life cycle assessment of storage systems: the case study of a sodium/nickel*  
1559 *chloride battery*. Journal of Cleaner Production, 2014. **85**: p. 337-346.
- 1560 174. Denholm, P. and G.L. Kulcinski, *Life cycle energy requirements and greenhouse gas emissions*  
1561 *from large scale energy storage systems*. Energy Conversion and Management, 2004. **45**(13–  
1562 14): p. 2153-2172.
- 1563 175. Raluy, R.G., et al., *Life Cycle Assessment of Central Solar Heating Plants with Seasonal*  
1564 *Storage*. Energy Procedia, 2014. **48**: p. 966-976.
- 1565 176. Comodi, G., et al., *Life cycle assessment and energy-CO2-economic payback analyses of*  
1566 *renewable domestic hot water systems with unglazed and glazed solar thermal panels*.  
1567 Applied Energy, 2016. **164**: p. 944-955.
- 1568 177. Simons, A. and S.K. Firth, *Life-cycle assessment of a 100% solar fraction thermal supply to a*  
1569 *European apartment building using water-based sensible heat storage*. Energy and Buildings,  
1570 2011. **43**(6): p. 1231-1240.
- 1571 178. Oró, E., et al., *Comparative life cycle assessment of thermal energy storage systems for solar*  
1572 *power plants*. Renewable Energy, 2012. **44**: p. 166-173.
- 1573 179. Kuznar, Z., *Duke Energy. NAATBatt Annual Meeting*. 2013: Austin, Texas.
- 1574 180. Reliability., D.D.o.E.O.o.E.D.E., *DOE GLOBAL ENERGY STORAGE DATABASE*. 2015.
- 1575 181. Thomas, P., T. Walker, and C. McCarthy, *Demonstration of Community Energy Storage fleet*  
1576 *for load leveling, reactive power compensation, and reliability improvement*. in *Power and*  
1577 *Energy Society General Meeting, 2012 IEEE*. 2012. IEEE.
- 1578 182. Australian Renewable Energy Agency, A., *Solar and storage trial at Alkimos Beach residential*  
1579 *development*. 2015.
- 1580 183. eCAMION, *eCAMION delivers Community Energy Storage to Toronto Hydro*. 2015.
- 1581 184. Alam, M.J.E., K.M. Muttaqi, and D. Sutanto, *Community energy storage for neutral voltage*  
1582 *rise mitigation in four-wire multigrounded LV feeders with unbalanced solar PV allocation*.  
1583 Smart Grid, IEEE Transactions on, 2015. **6**(6): p. 2845-2855.
- 1584 185. Hinz, H., B. Zuber, and J. Kilz, *Development of a hybrid power generation system*. in *PCIM*  
1585 *Europe 2014; International Exhibition and Conference for Power Electronics, Intelligent*  
1586 *Motion, Renewable Energy and Energy Management; Proceedings of*. 2014. VDE.
- 1587 186. Karvonen, A., et al. *Pathways to Zero Carbon Housing in the UK*. in *Workshop presentation*  
1588 *presented at the Zero Carbon Habitation workshop, February*. 2013.
- 1589 187. COMPANY, S.C.E. *S&C Energy Storage System to Provide Grid Support for PJM*. 2014.

- 1590 188. Timmerman, M. *In an Australian first, Ergon Energy expects to be installing new battery-*  
1591 *based technology called Grid Utility Support Systems (GUSS) to help power sections of its*  
1592 *electricity network by mid-2015.* 2015.
- 1593 189. Corporation, D.E. *Energy Storage.* 2015.
- 1594 190. Doering, R. *World's First Renewables Hydrogen Hybrid Power Plant Starts Production.* 2011  
1595 [cited 2016 Jan 16]; Available from: <http://www.hfcletter.com/Content/Renewplant.aspx>.
- 1596 191. VETTERLI, N. and M. SULZER. *Dynamic analysis of the low-temperature district network""*  
1597 *Suurstoffi"" through monitoring.* in *Proceedings of International Conference CISBAT 2015*  
1598 *Future Buildings and Districts Sustainability from Nano to Urban Scale.* 2015. LESO-PB, EPFL.
- 1599 192. Hobson, K., J. Hamilton, and R. Mayne, *Monitoring and evaluation in UK low-carbon*  
1600 *community groups: benefits, barriers and the politics of the local.* Local Environment,  
1601 2014(ahead-of-print): p. 1-13.
- 1602 193. Comission, E. *Empowering customers to save energy by informative billing (EMPOWERING).*  
1603 2015; Available from:  
1604 <https://ec.europa.eu/energy/intelligent/projects/en/projects/empowering>.
- 1605 194. Fitzgerald, G., *Aggregated Energy Storage Has Arrived.* 2015.
- 1606 195. UK Power Networks, B. *Smarter Network Storage – business model consultation.* 2013;  
1607 Available from: [http://innovation.ukpowernetworks.co.uk/innovation/en/Projects/tier-2-](http://innovation.ukpowernetworks.co.uk/innovation/en/Projects/tier-2-projects/Smarter-Network-Storage-(SNS)/Project-Documents/Smarter-Network-Storage-Business-model-consultation.pdf)  
1608 [projects/Smarter-Network-Storage-\(SNS\)/Project-Documents/Smarter-Network-Storage-](http://innovation.ukpowernetworks.co.uk/innovation/en/Projects/tier-2-projects/Smarter-Network-Storage-(SNS)/Project-Documents/Smarter-Network-Storage-Business-model-consultation.pdf)  
1609 [Business-model-consultation.pdf](http://innovation.ukpowernetworks.co.uk/innovation/en/Projects/tier-2-projects/Smarter-Network-Storage-(SNS)/Project-Documents/Smarter-Network-Storage-Business-model-consultation.pdf).
- 1610 196. Dudek, K. and R. Lane. *Synergy between Electrified Vehicle and Community Energy Storage*  
1611 *Batteries and Markets.* in *Power and Energy Society General Meeting.* 2011. San Diego, CA.
- 1612 197. Wüstenhagen, R., M. Wolsink, and M.J. Bürer, *Social acceptance of renewable energy*  
1613 *innovation: An introduction to the concept.* Energy Policy, 2007. **35**(5): p. 2683-2691.
- 1614 198. Stephen Hall and Katy Roelich *Local Electricity Supply: Opportunities, archetypes and*  
1615 *outcomes.* Ibuild/Realising Transition Pathways Independent Report, 2015.
- 1616 199. Couture, T. and Y. Gagnon, *An analysis of feed-in tariff remuneration models: Implications for*  
1617 *renewable energy investment.* Energy Policy, 2010. **38**(2): p. 955-965.
- 1618 200. Lipp, J., *Lessons for effective renewable electricity policy from Denmark, Germany and the*  
1619 *United Kingdom.* Energy Policy, 2007. **35**(11): p. 5481-5495.
- 1620 201. DECC, *Consultation on a review of the Feed-in Tariffs scheme.* 2015, Department of Energy  
1621 and Climate Change: London, UK.
- 1622 202. Warren, C.R. and R.V. Birnie, *Re-powering Scotland: Wind Farms and the 'Energy or*  
1623 *Environment?' Debate.* Scottish Geographical Journal, 2009. **125**(2): p. 97-126.
- 1624 203. Verbraucherschutz, B.d.J.u.f., *Verordnung über die Entgelte für den Zugang zu*  
1625 *Elektrizitätsversorgungsnetzen (Stromnetzentgeltverordnung - StromNEV) § 18 Entgelt für*  
1626 *dezentrale Einspeisung,* B.d.J.u.f. Verbraucherschutz, Editor.
- 1627 204. Markus, A., *Stromspeicher auf Quartiersebene –Analyse und Entwicklung eines*  
1628 *Geschäftsmodells zur lokalen Stromnutzung und Vermarktung im Quartier.* 2015, Albert-  
1629 Ludwigs-Universität Freiburg.
- 1630 205. V., B.d.E.-u.W.e., *Strompreisanalyse März 2015.* 2015.
- 1631 206. Hargreaves, T., et al., *Grassroots innovations in community energy: The role of intermediaries*  
1632 *in niche development.* Global Environmental Change, 2013. **23**(5): p. 868-880.
- 1633 207. England, C.E., *Community Energy England.* 2014.
- 1634 208. Sorrell, S., *The economics of energy service contracts.* Energy Policy, 2007. **35**(1): p. 507-521.
- 1635 209. Bertoldi, P., Boza-Kiss, B., Panev, S., Labanca, N., *ESCo Market Report 2013.* 2014, European  
1636 Commission Joint Research Centre, Institute for Energy and Transport Luxembourg.

1637