

Countercurrent index determination for the recuperative heat exchangers

GUŽELA Štefan^{1*}, DZIANIK František¹

¹ Slovak University of Technology in Bratislava, Faculty of Mechanical Engineering, Institute of Process Engineering, Námetie slobody 17, 812 31 Bratislava I, Slovakia, e - mail: stefan.guzela@stuba.sk

Abstract: The recuperative heat exchangers are an important part of the industrial plants. There are a number of such heat exchangers that differ in the arrangement of the streams. The knowledge of the flow arrangement of the streams is very important from a point of view of the heat exchangers calculations. There are various calculation methods, but only one takes into account the flow arrangement of the streams directly. The quantity that takes this into account is called the countercurrent index. The article deals with the determination of this quantity for a given recuperative heat exchanger.

KEYWORDS: heat exchanger calculation, countercurrent index, operating characteristic, number of transfer units, heat exchanger efficiency

1 Introduction

There are various calculation methods of the recuperative heat exchangers with two inlet and two outlet streams. Methods LMTD [1], ε -NTU [2], and θ -NTU [3] belong to the standard methods. All these methods use dimensionless quantities to describe heat exchangers. Each of the mentioned methods defines one key variable. In the case of LMTD method it is the quantity F , in the case of θ -NTU method it is the quantity θ , and in the case of ε -NTU method it is the quantity NTU. Without the knowledge of the key variable, it is not possible to perform the calculation of the heat exchanger.

There are also other methods but these do not define a new key variable. The interesting method is Roetzel-Spang method [4]. The novelty of this method lies in the graphical interpretation of the dimensionless quantities. This method also makes it possible to show in one diagram the recuperative heat exchanger which is characterized by the asymmetrical flow arrangement of the streams.

ε -NTU method is considered to be the most preferred calculation method of the recuperative heat exchangers. The reason is the fact that the heat exchanger calculation can be done without the need for iteration. This applies not only to the design calculation but also to the checking calculation of the heat exchanger. ε -NTU method works with the functional dependence $\varepsilon_i = P_i = f(NTU_i, R_i)$ by means of which the experimental data are evaluated. These are then presented in the literature by the graphs or by the analytical dependencies, e.g., [5-11].

Each heat exchanger is generally characterized by a different functional dependence $P_i = f(NTU_i, R_i)$. This is due to the fact that the heat exchangers differ from each other in the configuration – flow arrangement. This fact takes into account the countercurrent index (p_p) [12]. The aim of this paper is to point out that the heat exchanger can also be characterized by the variable p_p , including how to determine the value of this variable for a given recuperative heat exchanger.

2 Analytical dependencies for determining the countercurrent index

The dimensionless variables (including the key variables) used to describe the heat exchangers are clearly interrelated. This relationship according to [13] expresses the following equations:

$$\theta = \frac{P_i}{NTU_i} = \frac{FP_i}{NTU_{iC}}, \quad (1)$$

$$\frac{P_h}{P_c} = \frac{NTU_h}{NTU_c} = \frac{1}{R_h} = R_c, \quad (2)$$

$$\frac{1}{NTU_{iC}} = \frac{(1 - R_i)}{\ln[(1 - R_i P_i)/(1 - P_i)]}. \quad (3)$$

The above equations are valid provided that the heat exchanger with two inlet and two outlet streams operates in the stationary operation. The index i in these equations corresponds to either the index h or c .

However, it should be noted that the behavior of the heat exchanger is mainly determined by the weaker stream. It is a stream whose heat capacity (\bar{C}_p) has a smaller value. This is then denoted by the subscript min (or 1), i.e., $\bar{C}_{p\min} = \bar{C}_{p1} = \min\{\bar{C}_{ph}, \bar{C}_{pc}\}$. The second stream, whose heat capacity is larger, has then the subscript max (or 2). For these reasons, in the literature, it can be seen that the index i in Eqs. (1) to (3) corresponds to either the index min or max (1 or 2).

By combining the Eqs. (1) and (2), the general equation can be obtained:

$$\frac{1}{NTU_i} = \frac{F(1 - R_i)}{\ln[(1 - R_i P_i)/(1 - P_i)]}. \quad (4)$$

Any recuperative heat exchanger with two inlet and two outlet streams must comply with this equation.

According to [13], [14], the stationary operation of a recuperative heat exchanger with two inlet and two outlet streams is usually described by any combination of the three variables (except for variable NTU_{iC}) appearing in the Eq. (1). The variable NTU_{iC} is used less often in the description. This represents a limit case, because for each heat exchanger, according to [5], [14], the following equation applies: $NTU_{iC} = F \cdot NTU_i$. It is, therefore, possible to write:

$$f(NTU_i, P_i, R_i) = 0. \quad (5)$$

This equation represents the functional dependence used within the ε -NTU method, on the basis of which the graphical and analytical dependencies are constructed describing the stationary operation of the heat exchanger. An example is the equations given in the Tab. 1, as well as Fig. 1, or data given in the form of tables – Tab. 2. Fig. 2 shows the functional dependence $P_i = f(NTU_i, R_i)$ constructed on the basis of the data given in Tab. 2. These figures document the fact that each heat exchanger can be presented by a different method, each of which has its own advantages and disadvantages.

Tab. 1 Dimensionless temperature change of a given heat exchanger (ϵ) [7].

Heat exchanger with parallel flow	$\epsilon = \frac{1 - \exp[-NTU(1 + R)]}{1 + R}$
Heat exchanger with countercurrent flow	$\epsilon = \frac{1 - \exp[-NTU(1 - R)]}{1 - R \exp[-NTU(1 - R)]}$
1-2 heat exchanger (one shell-side pass, even number of tube-side passes)	$\epsilon = \frac{2}{(1 + R) + \sqrt{R^2 + 1} \frac{1 + \exp(-NTU\sqrt{R^2 + 1})}{1 - \exp(-NTU\sqrt{R^2 + 1})}}$
n - $2n$ heat exchanger (n shell-side passes, $2n$, $2n + 2$, $2n + 4$, etc. tube-side passes)	$\epsilon = \frac{(1 - \epsilon_a R)^n - (1 - \epsilon_a)^n}{(1 - \epsilon_a R)^n - R(1 - \epsilon_a)^n}$
	where ϵ_a is calculated as in 1-2 heat exchanger with $NTU = NTU/n$

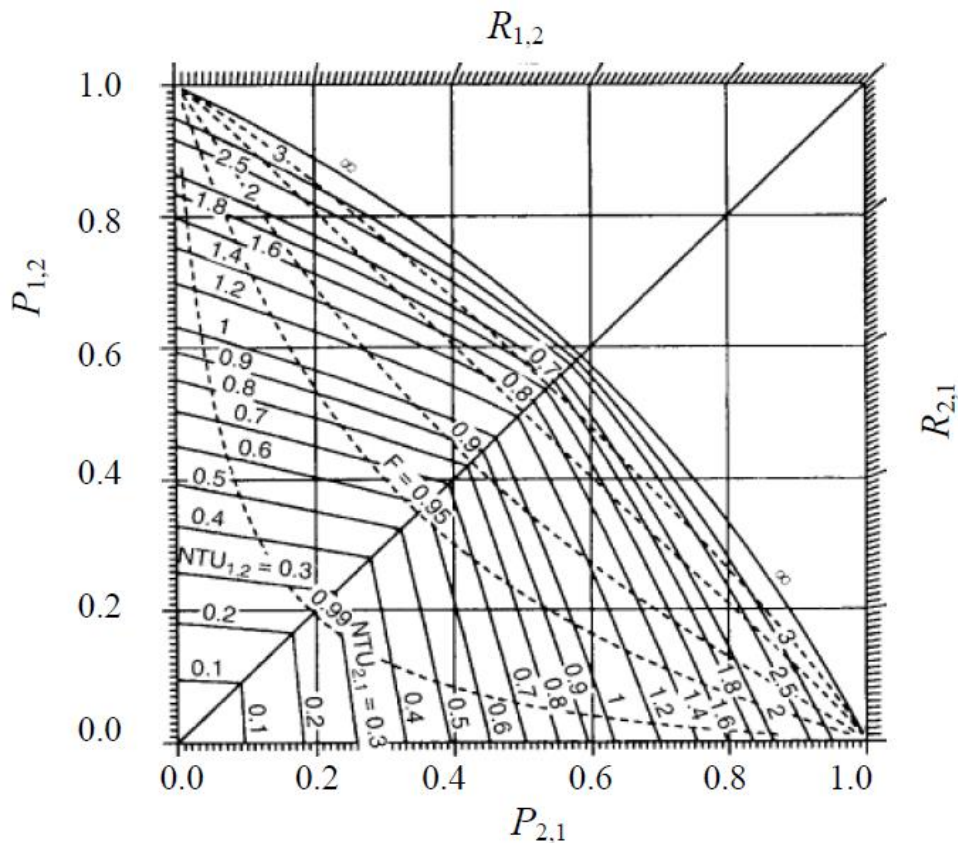


Fig. 1 Shell and tube heat exchanger with one shell-side and two tube-side passes [5].

Tab. 2 Dimensionless temperature change (P_{\min}) of 1-2 shell and tube heat exchanger with fluid mixing on the shell-side [6].

R_{\min} NTU _{min}	1.000	0.900	0.800	0.700	0.600	0.500	0.400	0.300	0.200	0.100	0.000
0.500	0.324	0.331	0.337	0.343	0.350	0.357	0.364	0.371	0.378	0.386	0.394
1.000	0.463	0.477	0.492	0.507	0.523	0.540	0.557	0.575	0.593	0.612	0.632
1.500	0.526	0.547	0.568	0.591	0.614	0.638	0.664	0.691	0.718	0.747	0.777
2.000	0.557	0.581	0.607	0.634	0.663	0.693	0.725	0.758	0.792	0.828	0.865
2.500	0.572	0.598	0.627	0.658	0.690	0.724	0.760	0.797	0.836	0.876	0.918
3.000	0.579	0.607	0.638	0.670	0.704	0.741	0.780	0.820	0.862	0.906	0.950
3.500	0.582	0.612	0.643	0.677	0.713	0.751	0.791	0.834	0.878	0.923	0.970
4.000	0.584	0.614	0.646	0.680	0.717	0.756	0.798	0.842	0.887	0.934	0.982

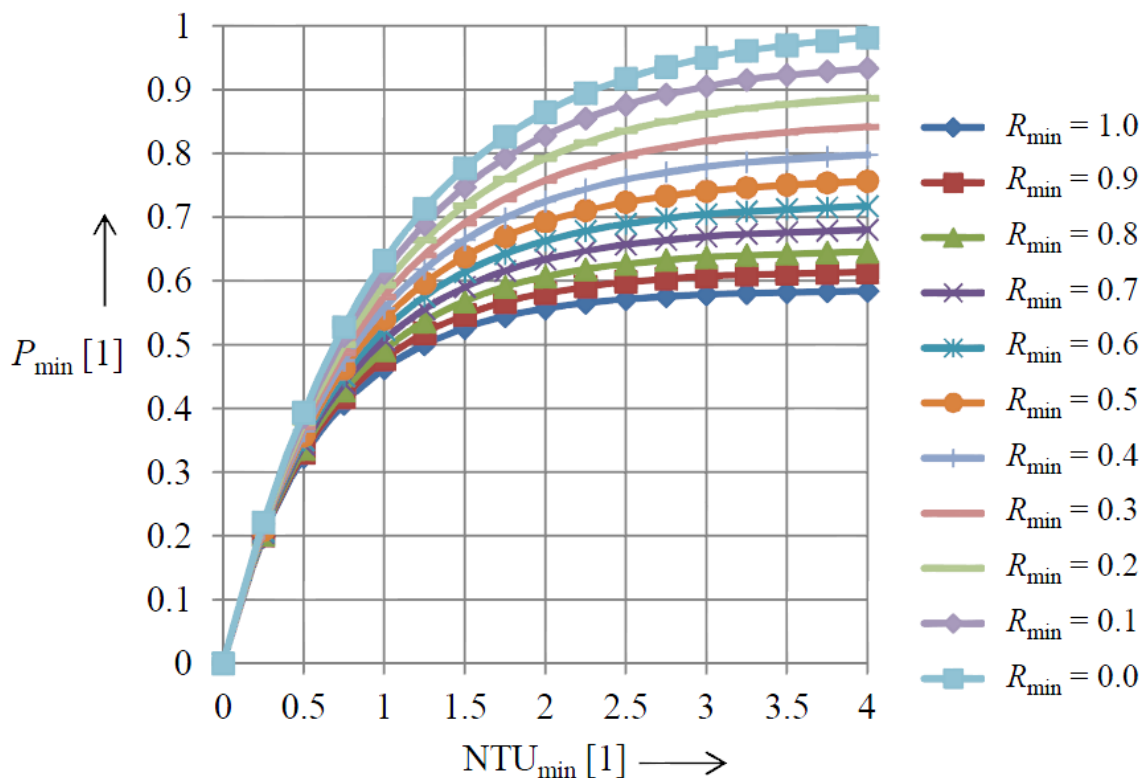


Fig. 2 The dependence of P_{\min} on NTU_{\min} for 1-2 shell and tube heat exchanger with fluid mixing on the shell-side, the parameter of the curves is R_{\min} .

By comparing some analytical dependencies compiled in accordance with the Eq. (5), it can be found that these are strikingly similar. The scientific community [15], [16] [17] has responded to this fact resulting in the following equation:

$$NTU_1 = \frac{1}{Z} \ln \left[\frac{2 - (1 + R_1 - Z)P_1}{2 - (1 + R_1 + Z)P_1} \right], \quad (6)$$

in which

$$Z = \sqrt{(1 + R_1)^2 - 4p_p R_1}.$$

In this equation, the subscript 1 pertains to variables representing a weaker flow (i.e., $NTU_1 = NTU_{\min}$, $R_1 = R_{\min}$, and $P_1 = P_{\min}$) [18]. It follows from the previous one (see Eq. (5)) that the stationary operation of any recuperative heat exchanger can be described

by the variables NTU_i , P_i , and R_i . This then means that p_p in Eq. (6) is the variable that distinguishes the type of heat exchanger - the flow arrangement of the streams. The value of this variable is in the range from 0.0 to 1.0 (i.e., $p_p \in \langle 0.0; 1.0 \rangle$). The limit values represent the double-tube heat exchanger with cocurrent flow ($p_p = 0.0$) and the double-tube heat exchanger with countercurrent flow ($p_p = 1.0$). If $p_p = 0.5$, then in this case it is 1-2 shell and tube heat exchanger with fluid mixing on the shell-side.

The specific value of the variable p_p is determined by the Eq. (6) and by the variables values NTU_i , P_i , and R_i representing the given operating state of the heat exchanger. If the operating states are expressed by other variables, then these must be converted to the values of the variables NTU_i , P_i , and R_i . The relationships mentioned above, or mentioned e.g., in [5], [13], [14], [19], can be used for conversion.

3 The determination of the countercurrent index value

The determination of the countercurrent index value (p_p) is relatively simple. The value of the variable p_p based on Eq. (6) can be assigned to each operating state which is characterized by the variables NTU_i , P_i , and R_i . The set of p_p values which is necessary to analyze is thus obtained. If the set of p_p shows no signs of the functional dependence and the p_p values are not very different from each other, the values obtained in this way are simply averaged to obtain the mean value of the countercurrent index. On the other hand, it is necessary to look for the functional dependence by which the influence of the given dimensionless variables on the value of the countercurrent index is described.

The procedure for determining the value of countercurrent index (p_p) for a given recuperative heat exchanger is as follows:

1. The values of the variables representing the given operating states of the heat exchanger are obtained. In this case, it will be data given in Tab. 2.
2. Based on Eq. 6, the values of the variable p_p will be determined separately for each operating state of the heat exchanger (i.e., for each i -th triplet of the values P_{\min} , R_{\min} , and NTU_{\min} listed in Tab. 2, the i -th value of the variable p_p is obtained, see Tab. 3). The p_p value is determined so that the condition $\Delta P_{\min} = P_{\min c} - P_{\min l} \leq 3 \cdot 10^{-4}$ is fulfilled (i.e., P_{\min} is determined with precision to three decimal places). The relative error for P_{\min} is identified based on the values showed in Tab. 3 (i.e., for each i -th value of p_p , a relative error is determined in terms of the relation $\delta = \frac{P_{\min c} - P_{\min l}}{P_{\min l}}$). Next, the overall value of the absolute values of the relative errors (i.e., $\delta_o = \sum_{i=1}^{i=n} |\delta_i|$, where $n = 88.0$) is determined. This is represented by the value 1.348 % ($\delta_o = 1.348$ %).
3. The mean value of the countercurrent index is determined as the arithmetic mean of the n -th values of p_p obtained in step 2 (i.e., $p_p = \frac{\sum_{i=1}^{i=n} p_{pi}}{n}$). In this case, $p_p = 0.499 \cong 0.50$. The graphical dependence $p_p = f(NTU_{\min})$ (Fig. 3) can also be constructed to better assess the constancy of the countercurrent index (see also the values listed in Tab. 3).
4. For completeness, the relative error (δ) is also determined for the case where P_{\min} is determined for each operating state of the heat exchanger on the basis of the mean value of p_p given in step 3. The overall value of the absolute values of the relative errors (i.e., $\delta_o = \sum_{i=1}^{i=n} \left| \left(\frac{P_{\min c} - P_{\min l}}{P_{\min l}} \right)_i \right|$, $n = 88.0$) is in this case represented by the value 3.454 %. Fig. 4 documents that this is a negligible value. In this figure, the data obtained from the literature (i.e., $P_{\min l}$) are compared with the data (i.e., $P_{\min c}$) determined

by calculation using Eq. 6, in which $p_p = 0.50$. It follows from the above in this case, that $p_p \cong 0.50$ can be considered as a constant in a given range of values.

Tab. 3 Countercurrent index (p_p) for individual operating states of 1-2 shell and tube heat exchanger with fluid mixing on the shell-side.

R_{\min} NTU _{min}	1.000	0.900	0.800	0.700	0.600	0.500	0.400	0.300	0.200	0.100	0.000
0.500	0.481	0.531	0.508	0.470	0.495	0.511	0.515	0.498	0.460	0.550	0.502
1.000	0.504	0.500	0.500	0.492	0.495	0.500	0.495	0.501	0.486	0.464	0.494
1.500	0.496	0.501	0.497	0.503	0.499	0.494	0.498	0.502	0.492	0.497	0.497
2.000	0.500	0.499	0.500	0.498	0.500	0.499	0.501	0.502	0.500	0.501	0.499
2.500	0.502	0.498	0.499	0.502	0.501	0.501	0.503	0.500	0.501	0.500	0.500
3.000	0.501	0.499	0.502	0.500	0.498	0.500	0.502	0.500	0.499	0.506	0.500
3.500	0.498	0.501	0.499	0.501	0.501	0.500	0.499	0.503	0.502	0.499	0.500
4.000	0.499	0.500	0.500	0.498	0.499	0.498	0.500	0.502	0.499	0.501	0.499

Tab. 3 is a key output of the above procedure for determining p_p . It provides the data without which it would not be possible to calculate a given recuperative heat exchanger. Having such a table for a given heat exchanger is the same as having data about the key variables F , NTU_{\min} , or θ . Therefore, it can be stated that p_p is also the key variable without which the Eq. 6 would be inapplicable. If the values of p_p are known, this equation is a convenient alternative to the common methods used to describe the heat exchangers.

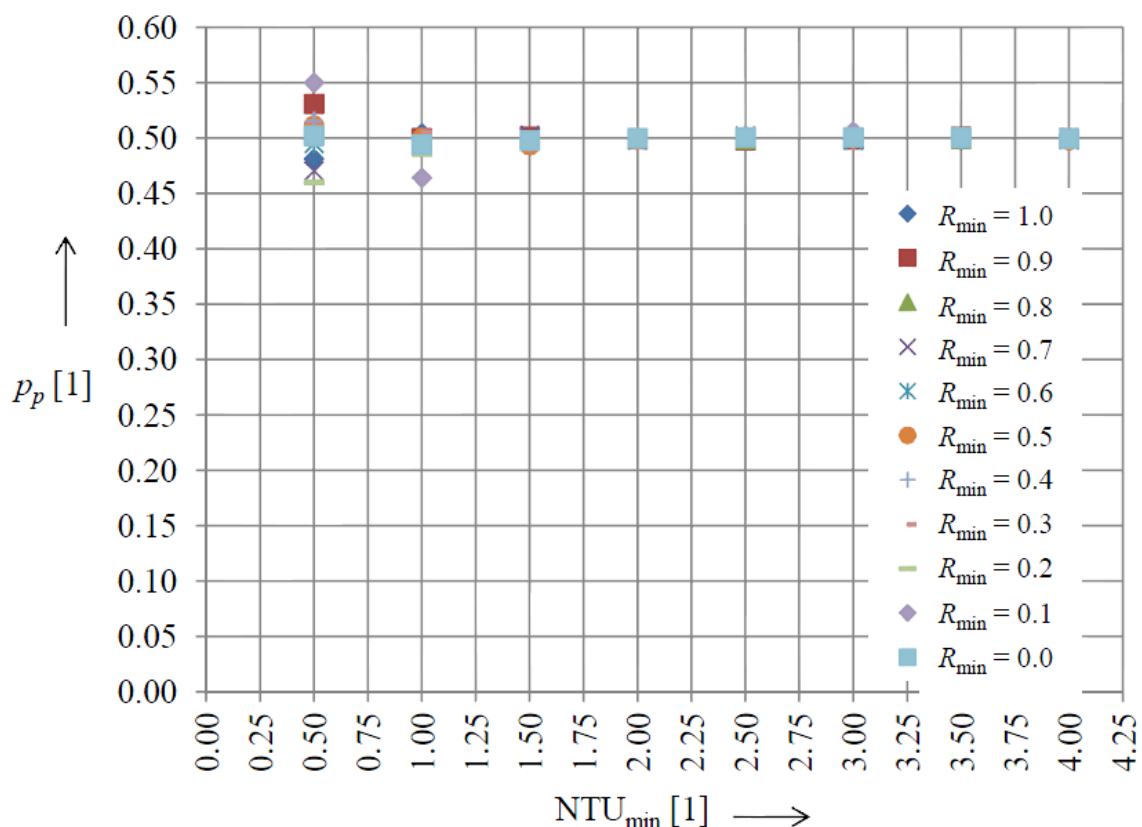


Fig. 3 The dependence of p_p on NTU_{\min} for 1-2 shell and tube heat exchanger with fluid mixing on the shell-side.



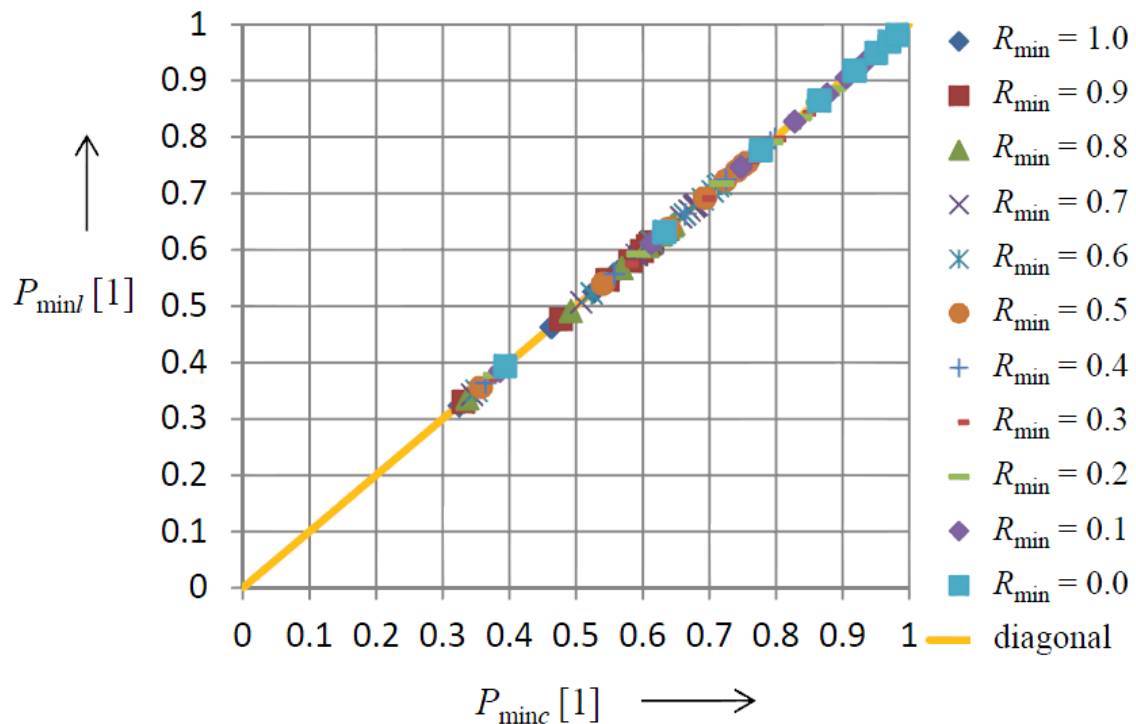


Fig. 4 The dependence P_{minl} on P_{minl} for 1-2 shell and tube heat exchanger with fluid mixing on the shell-side.

The last thing that can be said, the functional dependence $\delta_o = f(p_p)$ can be used for a quick assessment of whether the countercurrent index (p_p) will show signs of functional dependence. In this functional dependence, the overall value of the absolute values of the relative errors (i.e., $\delta_o = \sum_{i=1}^n |\delta_i|$, where $n = 88.0$) is determined for any possible value of the countercurrent index. If such a functional dependence is constructed, then it will have a local minimum (Fig. 5). This minimum characterizes the certain values of the variables p_p and δ_o . If δ_o approaches zero, p_p can be considered as a constant value for a given heat exchanger. The value thus determined should not differ significantly from the mean value specified in step 3 of the procedure for determining the value of the countercurrent index. Fig. 5 confirms this fact that in the case of this heat exchanger, $p_p = 0.5$.

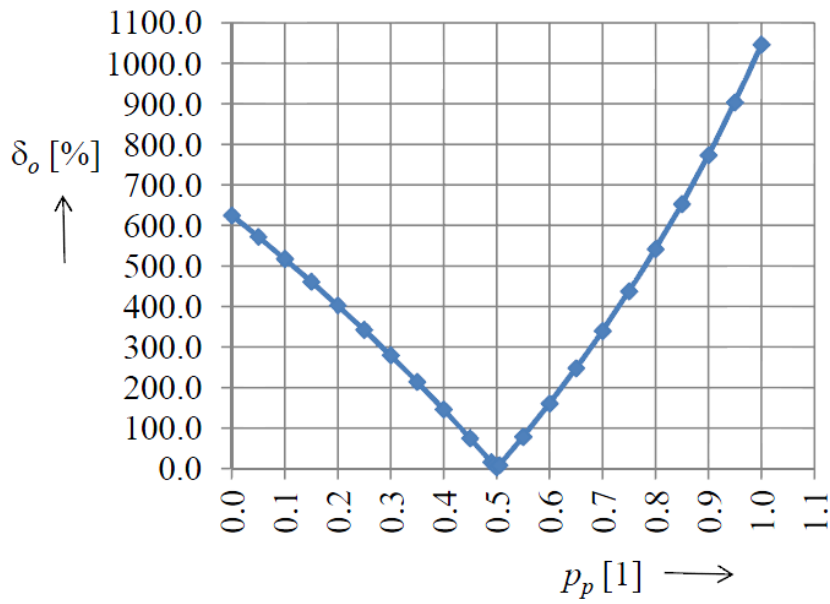

a) The overall behavior of the function $\delta_o = f(p_p)$.

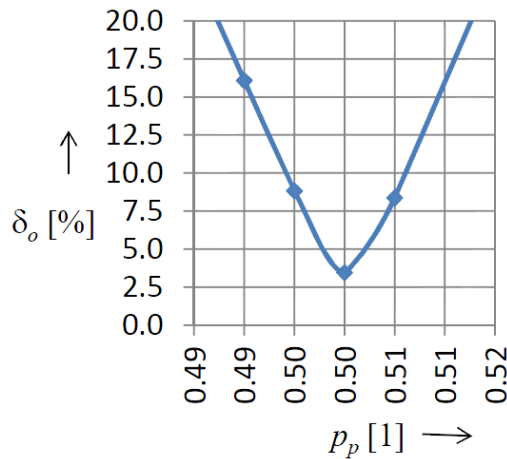

b) The detail of the local minimum.

Fig. 5 The dependence δ_o on p_p for 1-2 shell and tube heat exchanger with fluid mixing on the shell-side.

CONCLUSION

The main purpose of the article is to point out the fact that there is a general functional dependence which can be used to describe the individual operating states of a given heat exchanger. This dependence differs from other operating characteristics in that it works with the variable p_p . Countercurrent index (p_p) can also be considered as a key variable because without it the heat exchanger calculation would not be possible to perform. Determining the value of this variable is relatively simple, as is documented in this article. Therefore, if possible, it is suitable to try to assign this variable to a given heat exchanger. This variable can be presented either in the form of tabular data or by a certain average value with which the calculation can be performed with reasonable accuracy. However, the relevant data of the variables NTU_i , P_i , and R_i describing the given operating states of the recuperative heat exchanger must be available for the correct determination of the countercurrent index (p_p). The description of the heat exchanger by means

of the variable p_p has the advantage that the functional dependence, which makes it possible to describe the operation of the heat exchanger with sufficient accuracy, is known in advance.

ACKNOWLEDGEMENTS

This research did not receive any specific grant from funding agencies in the public, commercial, or not-for-profit sectors.

NOMENCLATURE

Latin Letters

C_p	– heat capacity flow rate at constant pressure [W/K]	P	– dimensionless temperature change [1]
NTU	– number of transfer units [1]	p_p	– countercurrent index [1]
F	– logarithmic mean temperature difference correction factor [1]	R	– heat capacity rate ratio [1]
		Z	– auxiliary parameter [1]

Greek Letters

δ	– relative error [%]	Φ	– heat efficiency [1]
ε	– dimensionless temperature change [1]	θ	– dimensionless mean temperature difference [1]

Subscripts

c	– cold medium, calculated value	min	– weaker stream, minimum
C	– pure countercurrent flow	n	– number of data
h	– hot medium	o	– total
i	– i -th medium, i -th operating state	$-$	– mean value
l	– value from the literature	1	– weaker stream
max	– stronger stream, maximum	2	– stronger stream

REFERENCES

- [1] Bowman R. A., Mueller A. C., Nagle W. M. “Mean temperature difference in design”, 62, ASME Transaction, **1940**.
- [2] Kays W. M., London A. L. “Compact heat exchangers”, 2nd ed., New York: McGraw-Hill Book Co., **1964**.
- [3] Mueller A. C., in Rohsenow W. M. and Hartlett J. P. “Handbook of heat transfer”, Sec. 18, Heat exchangers, pp. 1 – 113, New York: McGraw-Hill, **1973**.
- [4] Roetzel W., Spang B. “Vefbessertes Giagramm zur Berechnung von Wanneubertragern”, pp. 259 – 264, Warme- und Stoffubertragung, 25, **1990**.
- [5] “VDI Heat Atlas”, Second Edition, Springer-Verlag Berlin Heidelberg, **2010**. ISBN 978-3-540-77876-9
- [6] Hlavačka, V. “Termická účinnost vyměniků tepla, Technické příručky 1”, Praha-Běchovice, SVÚSS, **1988**.
- [7] Cao, E. “Heat Transfer in process Engineering”, The McGraw-Hill, **2010**. ISBN 978-0-07-162613-2.
- [8] Teke I., Ağra Ö., Demir H., Atayılmaz Ş. Ö. “Sizing, Selection, and comparison of heat exchangers considering the lowest saving-investment ratio corresponding to the area at

- the tag end of the heat exchanger”, *Energy* 78, pp. 114 – 121, **2014**. DOI:10.1016/j.energy.2014.08.035.
- [9] Cabezas-Gómez L., Saiz-Jabardo J. M., Navarro H. A., Barbieri P. E. L. “New thermal effectiveness data and formulae for some cross-flow arrangements of practical interest”, *International Journal of Heat and Mass Transfer* 69, pp. 237 – 246, **2014**. DOI: 10.1016/j.ijheatmasstransfer.2013.10.022
- [10] Navarro H. A., Cabezas-Go´mez b L. “A new approach for thermal performance calculation of cross-flow heat exchangers”, *International Journal of Heat and Mass Transfer* 48, pp. 3880 – 3888, **2005**. DOI: 10.1016/j.ijheatmasstransfer.2005.03.027
- [11] Vasconcelos Segundo E.H.d., Mariani V. C., Coelho L.d.S. “Design of heat exchangers using Falcon Optimization Algorithm”, *Applied Thermal Engineering* 156, pp.119 – 144, **2019**. DOI: 10.1016/j.applthermaleng.2019.04.038
- [12] Schneller J., Hlavačka V. “Význam termickej účinnosti při výpočtech jednoduchých i složitějších teplosměnných systémů”, *Strojírnoství* 6 (22), **1972**.
- [13] Jelemenský K., Šesták J., Žitný R. “Tepelné pochody”, 2. vydanie, Vydavateľstvo STU v Bratislave, **2004**. ISBN 80-227-2109-3.
- [14] Gužela Š., Dzianik F. “Some Facts Resulting from the Key Variables Used in the Description of the Recuperative Heat Exchangers”, *Strojnícky časopis – Journal of Mechanical Engineering* 68 (3), pp. 249 – 260, **2018**. DOI:10.2478/scjme-2018-0038
- [15] Belokon N. N. “Analitičeskije osnovy teplovogo rasčeta trubčatych pečej”, *Neftjanaja promyšlennost’*, **1941**.
- [16] Kanavec G. E. “Universalnyj metod rasčeta konečnych temperatur potokov v teploobmenných apparatach”, *Inst. gaza AN USSR, Kijev*, **1973**.
- [17] Trefny F. “Wärmeaustausch bei beliebiger Stromart”, *Chemie-Ing.-Techn.*, **1965**.
- [18] Gužela Š., Dzianik F. “The Recuperative Heat Exchangers – The Mean Temperature Difference in the Special Cases of Heat Transfer”, *Strojnícky časopis – Journal of Mechanical Engineering* 70 (1), pp. 47 – 56, **2020**. DOI: 10.2478/scjme-2020-0005
- [19] Gužela Š., Dzianik F., Juriga M., Kabát J. “Shell and Tube Heat Exchanger – the Heat Transfer Area Design Process”, *Strojnícky časopis – Journal of Mechanical Engineering* 67 (2), pp. 13 – 24, **2017**. DOI:10.1515/scjme-2017-0014