

Research Article

Design and Embedded Implementation of a Power Management Controller for Wind-PV-Diesel Microgrid System

M. Boussetta ¹, S. Motahir ², R. El Bachtiri,¹ A. Allouhi,¹ M. Khanfara,³ and Y. Chaibi ⁴

¹Innovative Technologies Laboratory, EST-Sidi Mohamed Ben Abdellah University, Fez, Morocco

²ENSA, Sidi Mohamed Ben Abdellah University, Fez, Morocco

³CED STI, FST, PERE Laboratory EST, Sidi Mohamed Ben Abdellah University, Fez, Morocco

⁴SmariLab Laboratory, Moroccan School of Engineering Science (EMSI), Rabat, Morocco

Correspondence should be addressed to M. Boussetta; mohammed.boussetta@usmba.ac.ma

Received 1 March 2019; Accepted 3 June 2019; Published 1 December 2019

Academic Editor: Pierluigi Guerriero

Copyright © 2019 M. Boussetta et al. This is an open access article distributed under the Creative Commons Attribution License, which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

This paper presents an implementation of real-time energy management systems (EMS) to maximize the efficiency of the electricity distribution in an isolated hybrid microgrid system (HMGS) containing photovoltaic modules, wind turbine, battery energy storage system, and diesel generator (DG) which is used as a backup source. These systems are making progress worldwide thanks to their respect for the environment. However, hybridization of several sources requires power flow control (PFC). For this reason, in this work, a proper energy management system is developed using LabVIEW software and embedded in a suitable platform for the real-time management of the hybrid energy system. The developed EMS is tested and validated through a small-scale application which accurately represents the case study of an isolated mosque located in a remote area of Morocco. The aim of this paper is to (i) propose a novel modelling method and real-time monitoring interface under the LabVIEW software based on the real data obtained by an optimal sizing previously made using Homer-pro software and (ii) implement the power control system on a low-consumption embedded platform that is the Raspberry-pi3.

1. Introduction

Access to energy is now considered as a central issue in the fight against poverty and economic development. The proportion of the world's population with access to electricity has gradually increased in recent years. However, despite these improvements, 1.1 billion people are still deprived of this essential service, with the majority of these people located in Africa. Among those who have gained access to electricity in the world since 2010, only 20% live in rural areas [1]. In Morocco, almost 1.3 million rural people are deprived of electricity; i.e., 88902 households do not have access to electricity [2]. Most of these rural homes are located in isolated or hard-to-access locations and do not allow connection to an electrical grid since the investment cost is very large and online losses become significant. It is then necessary to be able to install the infrastructures for electrification in sparsely populated areas and away from the main grid.

In recent years, rural electrification has been achieved with DG or with stand-alone renewable energy sources, including photovoltaics and wind power, which have been considered promising to meet the growing demand for energy and play a very important role in the clean energy production. However, renewable energy depends to a large extent on wind speed or solar radiation. In order to provide a continuous supply by taking advantage of the complementary nature of the two sources of energy, one solution is to hybridize the types of sources in the form of the microgrid.

HMS were considered attractive and preferred alternatives; indeed, the development of microgrid in rural areas makes it possible to electrify villages located far from the distribution grid with renewable energy sources (RES) in a more sustainable way. Another major factor in the development of microgrid systems is the sharp drop in the cost of renewable energies, which makes these energies competitive with traditional fossil fuels. Similarly, energy storage solutions are currently undergoing significant development due to

the improvement of different technologies and lower production costs. In addition to renewable energy sources, a HMGS may also incorporate an AC distribution system, a DC system, a storage system, power converters, loads, a ballast load, and an EMS or a supervisory system. In most cases, HMGS contain two buses: a DC bus for sources, DC loads, and batteries and an AC bus for AC generators and the distribution system.

The technoeconomic analysis of any hybrid renewable energy system (HRES) is highly essential to know its efficiency and economic viability, so several methods for optimal sizing have been proposed in the literature [3–11]. These works across the world have shown that a HRES is more economical than stand-alone energy systems. However, the intermittent nature of renewable energy sources requires proper power management in order to improve overall performance and increase the lifespan of the microgrid components. Therefore, adequate management of the energy flow through the HRES and the establishment of a supervisory system are essential.

Various control strategies and topologies for an autonomous hybrid system have been reported in the literature [12–17]. Mengi and Altas have proposed a new energy management technique for PV/wind/grid renewable energy system in [18]; likewise, an evaluation of three EMSs was carried out by [19] to identify the most effective one. In addition, [20] proposed four optimization techniques for resolving an economic dispatch problem; the application is made on the system connected and not connected to the grid. [21] seeks to develop a dynamic energy management model for microgrid-enabled production systems. [22, 23] proposed management architectures multiagent based with both centralized and decentralized energy. [24] developed a coordinated control strategy for a stand-alone hybrid system with the aim of maintaining the battery state between 70% and 80% and maintaining the DG power above 40% of its nominal value. Likewise, a fuzzy logic technique is used to formulate a rebel control system for a HMGS [25–27]. Other researchers create new management strategies to minimize the total and operating cost of stand-alone hybrid energy systems [28, 29]. A control strategy consisting of the high-pass filter-based droop controller is realized by [30]. [31] came up with a mathematical formulation of the energy management problem and its implementation in a centralized EMS for isolated microgrid. For the grid connected microgrid systems, the energy management aims at reducing the dependence on the main distribution grid in the microgrid [32–35].

On the other hand, researchers proposed a microgrid power management system (PMS) in real time [36–38]. An advanced real-time EMS for a microgrid is developed to maximize the power of the available RES while minimizing the energy cost and carbon dioxide emissions [39]; also, a multiobjective power management procedure for microgrid is carried out by [36]. [40] developed a technical and economic analysis of home EMS incorporating a small-scale wind turbine and battery energy storage system; the EMS is expressed as a mixed integer nonlinear programming (MINLP) and solved by the cultural algorithm as an effective metaheuristic optimization algorithm.

A new field of research has appeared in recent years that has focused on the management of domestic energy [41, 42]. Novel home EMS using wireless communication technologies for carbon emission reduction within a smart-grid smooth power peak demand and diminish CO₂ emissions is carried out by [43]. In the same way, three approaches are suggested for the rolling optimization by the home EMS, namely, mixed integer linear programming, continuous relaxation, and fuzzy logic controller [44]. ZigBee-based energy measurement modules are used to monitor the energy consumption of home appliances and lights [45]. Likewise, [46] developed a distributed multicontrol-center dynamic power flow algorithm based on an asynchronous iteration scheme.

Most of the articles cited above regarding power management are simulation work and theoretical formulation; few articles present a practical implementation. Experimental evaluation of a PMS for a HRES with hydrogen production presents a PMS based on a fuzzy control system takes into account the uncertainties of the load demand and the power production from renewable energy sources for a HRES [47]. In an EMS implementation in Serbian manufacturing, the Plan-Do-Check-Act cycle approach with the aim to cut energy consumption and CO₂ emissions is proposed by [48]. [49] present the energy box concept in the context of the V2G (vehicle-to-grid) technology to address the energy management needs of a modern residence, considering that the available infrastructure includes microrenewable energy sources in the form of solar and wind power. A real-time load management is developed to control unpredictable residential loads [50]; the developed control is implemented on an ARM Cortex-A9 processor of the ZYNQ device. Likewise, a supervisory PMS for a hybrid microgrid with HESS is presented by [51].

In this article, we consider the case study of a mosque located in a mountain area of Morocco. First, we perform an optimal sizing to identify the best combination of energy sources. Then, we perform a design and modelling using the LabVIEW software. Finally, we carry out an experimental evaluation of the PMS on a real-time platform that is the Raspberry-pi 3 equipped with a microprocessor ARMv8, 1.2 GHz 64-bit quad-core.

The aim of this work is to realize an optimal configuration of a hybrid PV-wind-diesel; a supervision system with the function of ensuring a secure, reliable, and efficient operation of the microgrid; and the implementation of a real-time PMS to verify the effect of the RES variation on the evolution of the system.

The contributions of this article are

- (i) feasibility study of a HMGS based on PV, wind turbine, and diesel generator using the actual solar radiation and the wind speed data to power a mosque located on an isolated site in Morocco
- (ii) modeling of the microgrid and the creation of a supervision dashboard to monitor the evolution of the system under the LabVIEW software
- (iii) implementation of the PMS on an embedded RPI3 platform

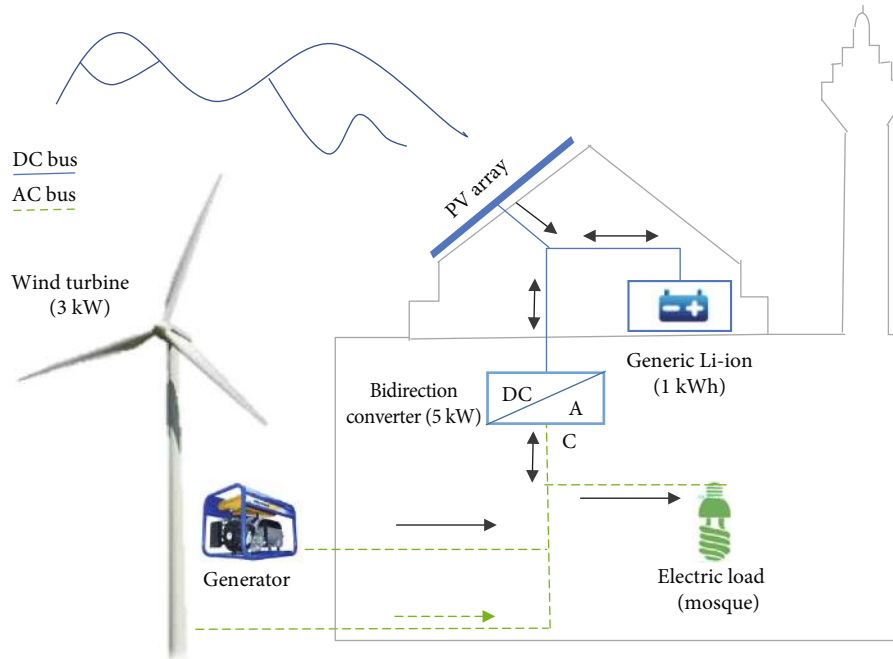


FIGURE 1: Studied hybrid PV-wind-diesel system.

TABLE 1: Infrastructure load analysis.

Load description	Quantity	Power (watt)	On-time (hr/day)	Watt-hr/day
Outside lighting	2	125	11	2750
Garden lighting	3	80	11	2640
Inside lighting	40	100	6–8	24000–32000
Air conditioner	4	1200	6–8	28800–38400
Imam house	—	—	—	3276–5868
Total				73268–81650

2. Studied System

The energy system studied in this paper is a stand-alone hybrid system that contains RES (PV panels and a wind turbine) associated with a standby diesel generator and storage battery. The structure of this AC/DC microgrid is shown in Figure 1. The PV and the battery are connected to the DC bus and the wind turbine; the GD and the loads are connected to the AC bus on the other side.

3. Sizing of the HMGS

In this study, we chose an isolated load under real operating conditions. It is a mosque located in the center of Morocco (33°45'11"N latitude; 04°30'57"W longitude), with a daily load of 77 kWh/day; the detail of the consumption and the description of the major economic input data used in the model to define the optimal size of the different component of the hybrid energy system are given in Table 1 and Table 2, respectively.

The daily profile of the load is shown in Figure 2. In this work, the load is modelled by its demand per power hour.

In order to supply this load, it is necessary to identify the optimum system between the various possible combinations (diesel only, PV-diesel, wind-diesel, and PV-wind-diesel). For this reason, a sizing of the hybrid system was carried out with HOMER-Pro software, for a 25-year project life-time, using actual solar radiation data, wind speed, and economic data of the various components.

4. Modelling of the Proposed System

4.1. Photovoltaic Module. The photovoltaic output power depends on the incident solar radiation, and the hourly output power of the PV panel at any time t is calculated using the following equation:

$$P_{PV} = P_{PV,STC} D_{f,PV} \left(\frac{R_i}{R_{i,STC}} \right), \quad (1)$$

where $P_{PV,STC}$ is the power provided by the PV array under standard test conditions (STC) (kW), $D_{f,PV}$ is the number of the derating factor (%), R_i is the solar radiation incident

TABLE 2: Infrastructure load analysis.

Equipment	Life time (year)	Capital	Replacement	O&M (€/yr)
Generic flat plat PV	30	€1700/kW	€1500/kW	28
Wind turbine	25	€10,000	€10,000	180
Converter (5 kW)	10	€700	€600	50
Generic kWh Li-ion	10	€200	€200	10
Diesel generator	15,000 hours	€500/kW	€500/kW	€0.030/hr

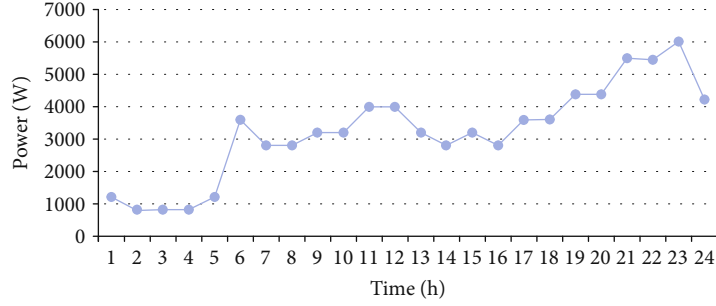


FIGURE 2: Profile load.

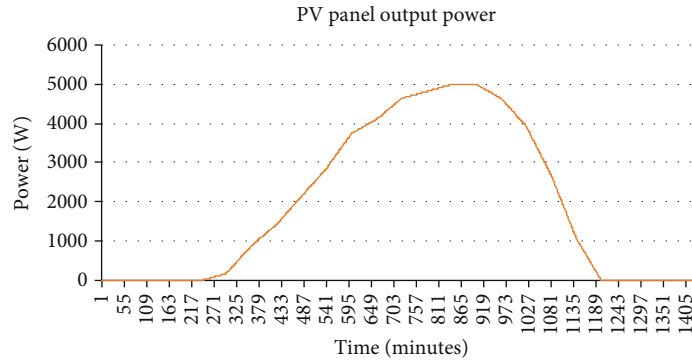


FIGURE 3: PV panel output power.

on the PV array in the current time step (kW/m^2), and $R_{i,STC}$ is the incident radiation at STC ($1 \text{ kW}/\text{m}^2$).

Figure 3 shows the output power profile by the set of photovoltaic panels sized in this study:

4.2. Wind Turbine Modelling. At a specific site, the output power provided by the wind turbine depends on the wind turbine's power curve (WTPC) and wind speed at the hub height W_h . The power curve of the wind turbine used in this work is shown in Figure 4, and the wind speed at the hub height W_h is calculated using the following equation:

$$W_h = W_a \cdot \frac{\ln(H_h/s)}{\ln(A_h/s)}, \quad (2)$$

where W_a is the wind speed at anemometer height (m/s) derived from the wind speed data (Figure 5), $H_h = 30 \text{ m}$ is the hub height of the wind turbine (m), $A_h = 20 \text{ m}$ is

the anemometer height (m), and s is the surface roughness length (m).

Figure 5 shows the wind speed profile and the power supplied by the wind turbine for a typical day.

4.3. Battery Modeling. The optimum system found when dimensioning contains a storage battery to provide the necessary power when the RESs are insufficient to meet the load needs, if, of course, the amount of battery charge is sufficient. It is calculated by the following equation:

$$P_a(t) = P_a(t-1) + ((P_s(t-1) + P_t(t-1) \cdot C_{bat}) \cdot C_{inv}), \quad (3)$$

where $P_a(t)$ is the battery charge at time t , $P_a(t-1)$ is the battery charge at time $t-1$, $P_s(t-1)$ is the charge quantity to be stored at time $t-1$, $P_t(t-1)$ is the total energy to be provided by the battery at time t , C_{bat} is the battery charge efficiency, and C_{inv} is the inverter charge efficiency.

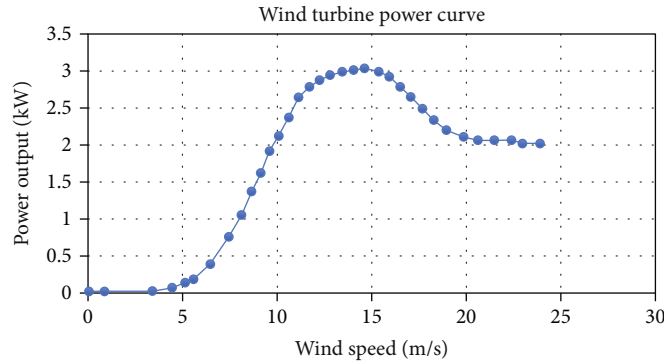


FIGURE 4: Wind turbine's power curve.

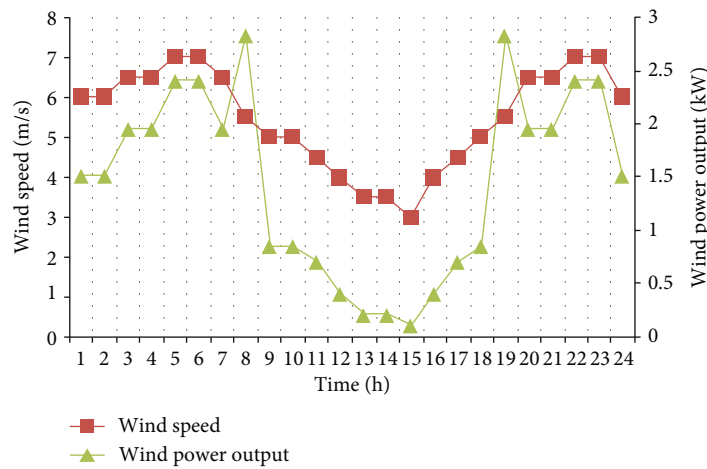


FIGURE 5: Wind speed and wind power output.

State of charge (SOC) of the battery depends on the load requirement and the power provided by the RES, and it is calculated using the following equations:

(i) For the charging mode,

$$\text{SOC}(t) = \text{SOC}(t-1) + \frac{P_{\text{bat}(t)} C_{\text{char}}}{P_N} \cdot 1 \quad (4)$$

(ii) For the discharging mode,

$$\text{SOC}(t) = \text{SOC}(t-1) + \frac{P_{\text{bat}(t)} C_{\text{dis}}}{P_N} \cdot 100, \quad (5)$$

where $\text{SOC}(t)$ is the state of charge of the battery at time t , $P_{\text{bat}(t)}$ is power exchange during the time step Δt , C_{char} is the battery charge efficiency, C_{dis} is the battery discharge efficiency, and P_N is the battery nominal capacity.

4.4. Diesel Generator Modeling. The diesel generator used in this study is of the genset type with a maximum power of 10 kW; its function is to deliver the power difference between the power generated by the RES and the load profile when the

battery is discharged; it always works near its rated power, to increase its lifetime and to minimize emissions and consumption. This consumption is given by the following equation:

$$F_c(t) = \alpha \times P_{\text{nom}} + \beta \times P_{\text{out}}, \quad (6)$$

where α and β are the coefficients of the straight line presented in Figure 6. P_{out} and P_{nom} are the output power and the nominal power of the DG, respectively.

5. Energy Management System

5.1. Proposed Energy Management Scheme Based on Power Flow Control. Energy management in a microgrid is the way to distribute energy between different components and to meet the load requirement in all climatic conditions. In this paper, the microgrid is insulated and consists of several power sources; the control system must ensure the maximum supply of the load by the RES (wind turbine, PV).

The diagram of the EMS proposed in this article is shown in Figure 7. It allows to control the energy flow between the different components and to display the indicators for the user. The main tasks of the control system can be summarized as follows:

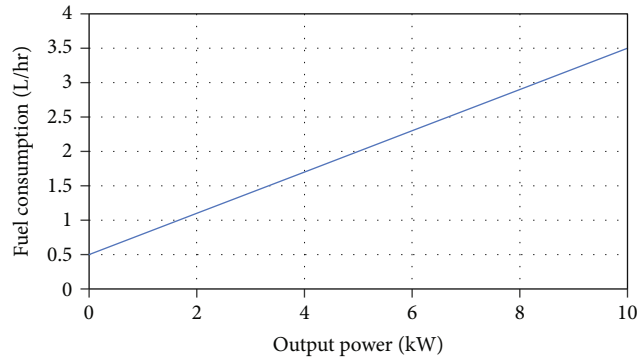


FIGURE 6: Power curve of DG.

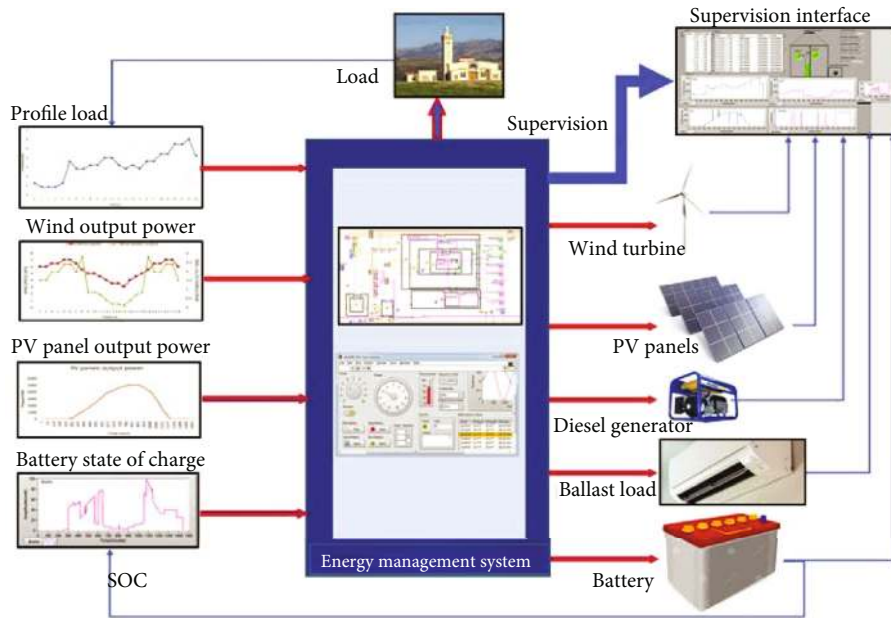


FIGURE 7: General structure of the proposed system.

- (i) Energy flow control
 - (a) Meet the load requirement
 - (b) Avoid interruptions of electrical power supply
 - (c) Protect batteries from deep discharge and overload
 - (d) Automatic start and stop of the diesel generator
 - (e) Connect and disconnect the ballast load automatically in the event of excess energy generated by the RES
- (ii) Supervision
 - (a) Inform the user if the power generated by the PV and the wind turbine is sufficient or not
 - (b) Inform the user if power is supplied to the load and by which energy system
 - (c) Indicate whether the DG is running or stopped
 - (d) Display the SOC of the battery and indicate whether it is plugged in or not
 - (e) Indicate if ballast load is connected or not

5.2. Power Management Algorithm. The purpose of PMS is to ensure the supply of the load. To meet the specifications defined in the previous section the proposed algorithm is shown in Figure 8. It is based on 5 modes:

- (i) *PV mode* ($P_L < P_{PV}$): the power supplied by the PVs is sufficient to supply the load. This mode is the highest priority in our case, if it is activated, the power produced by the PV panels is greater than the requested power by the load; in this case, the load is powered by the PVs and the wind turbine is disconnected if the battery is charged (SOC; SOC_{max}) or charging the battery if $SOC < SOC_{max}$
- (ii) *Wind mode* ($P_{PV} < P_L$ and $P_L < P_W$): the power provided by the wind turbine is sufficient for the

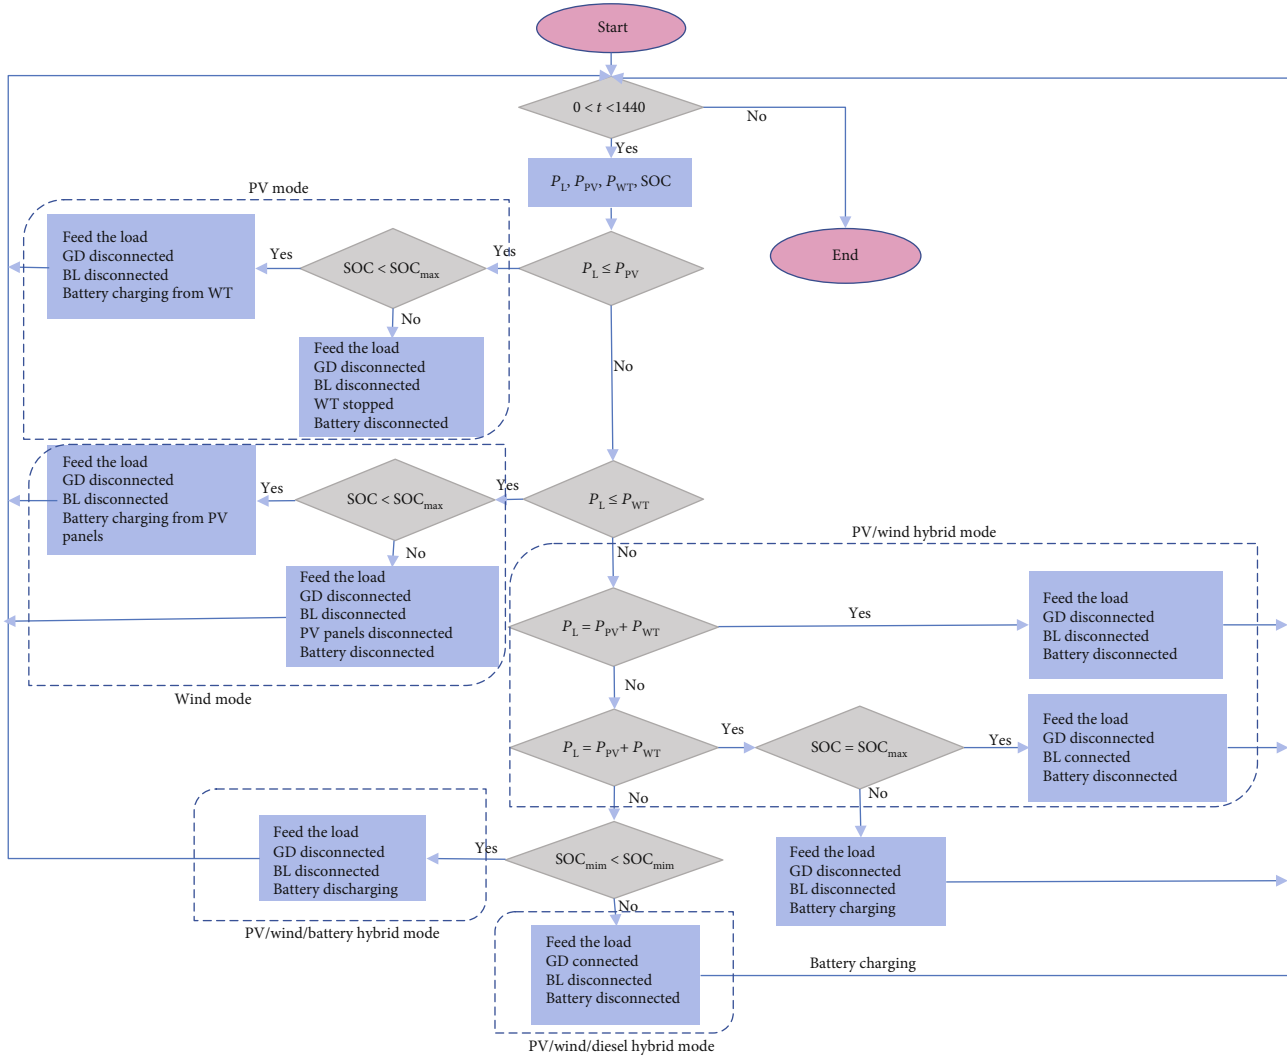


FIGURE 8: Proposed power management algorithm.

power supply. This mode is activated if the power provided by the PVs is not sufficient. The load is fed by the wind turbine. The PVs load the battery if $SOC < SOC_{max}$ and they are disconnected otherwise

- (iii) *PV/wind hybrid mode* ($P_{PV} < P_L$ and $P_L < P_W$ and $P_{PV} + P_W > P_L$): the load is fed by the two RESs (wind and PV). This mode is on if the first two modes are not activated. In this case, the battery is charged by the remaining power if $SOC < SOC_{max}$. Otherwise, the rest of power feeds a ballast load
- (iv) *PV/wind/battery hybrid mode* ($P_{PV} < P_L$ and $P_L < P_W$ and $P_{PV} + P_W < P_L$ and $SOC_{min} < SOC \leq SOC_{max}$): in this case, the RESs are not able to ensure the requirement of the load; the battery ensures the lack of power
- (v) *PV/wind/diesel hybrid mode* ($P_{PV} < P_L$ and $P_L < P_W$ and $P_{PV} + P_W < P_L$ and $SOC \leq SOC_{min}$): the load cannot be fed by the two RESs (wind and PV) and the battery is discharged. This mode is activated if

the preceding modes are not activated; in this mode, the DG is started to complete the lack of energy

5.3. *LabVIEW Code for Controlling the Power Flow of the Microgrid*. Simulation step must be performed prior to implementation. In this study, the operation of the HMGS is tested using the LabVIEW software, for a typical day. Figure 9 shows the power management program, consisting of 3 parts:

- (i) *System inputs*: the load profile (Figure 2), the power generated by the PVs (Figure 3), the power supplied by the wind turbine (Figure 5), and the SOC of the battery for each one-minute time space
- (ii) *Controller*: corresponds to the operation defined by the algorithm shown in Figure 8
- (iii) *System outputs*: corresponds to the actuators and to displays that indicate the status of each source and load (dashboard).

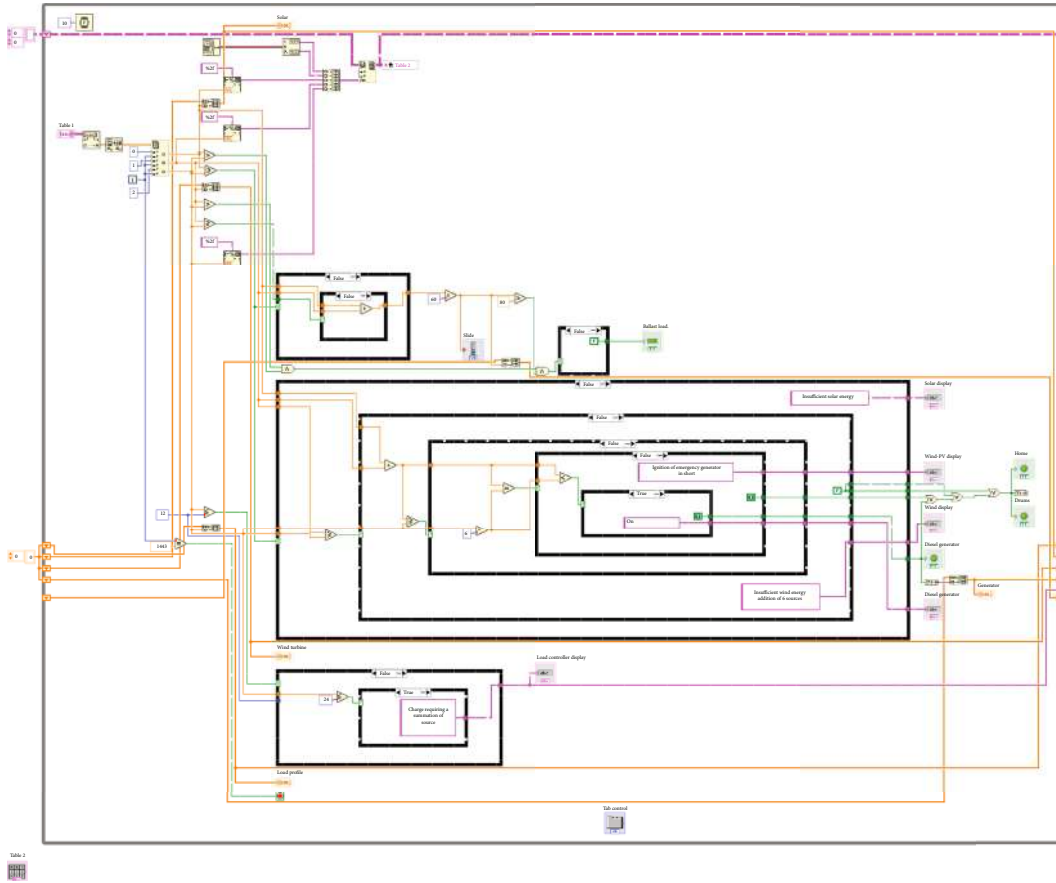


FIGURE 9: LabVIEW code for controlling the power flow of the microgrid.

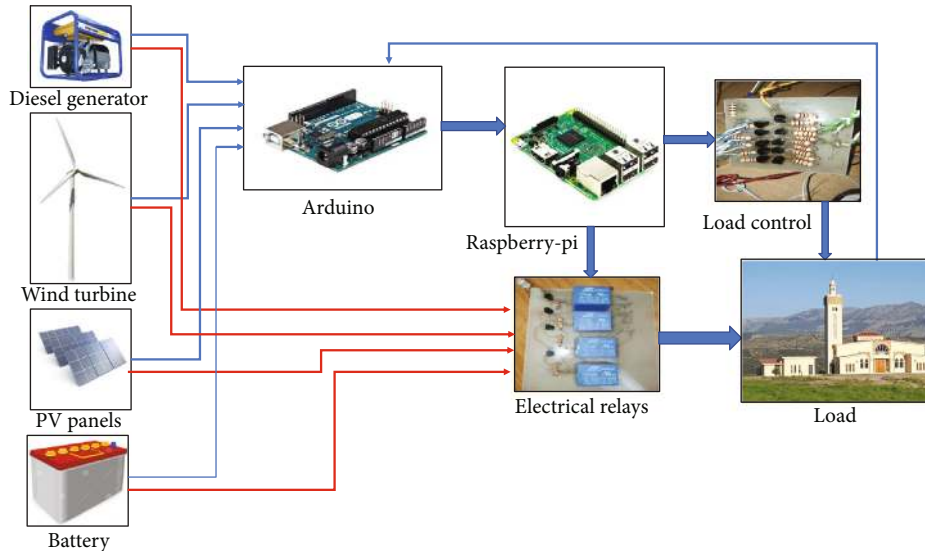


FIGURE 10: General scheme of the hardware implementation.

6. Hardware Implementation

After sizing a HRES to justify the choice of the PV-wind-diesel system, we developed a management algorithm and we carried out a successful simulation on LabVIEW, using

real radiation and wind speed data. The simulations show the feasibility of such a system.

In this section, we implement the energy control system on an embedded platform such as the Raspberry-pi 3. Figure 10 shows the overall electrical scheme. Power sources

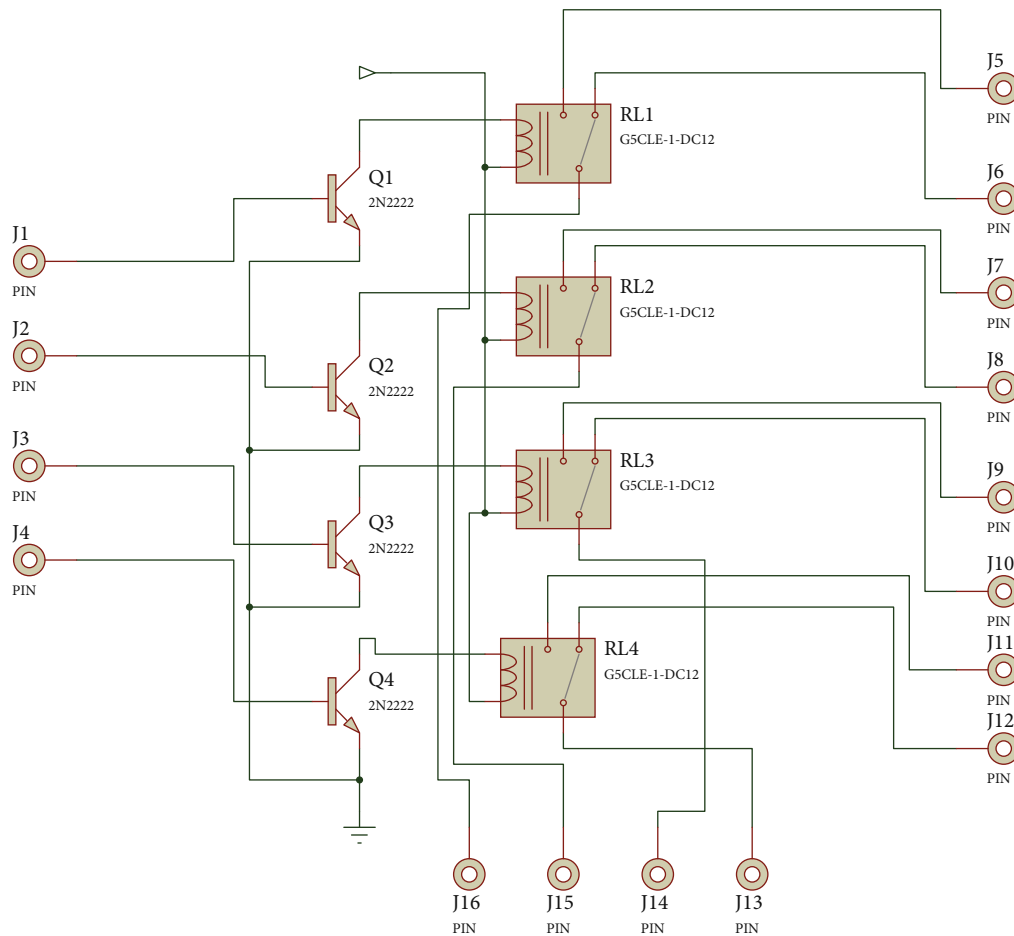


FIGURE 11: ISIS diagram of the relay circuit.

and load are connected to the Raspberry-pi through an Arduino. Part of the Raspberry pins will control the relays, which are wired directly to the sources, and other pins will control the different loads.

6.1. Raspberry-Pi. Raspberry-pi 3 (RPI3) is an open hardware platform and is a low-cost ARM-based palm-size computer, featuring a quad-core 1.2 GHz processor, 1 GB of RAM memory, 4 USB, 10/100 Ethernet, GPIO, HDMI and composite video outputs, and SD card slot. RPI is small in size and it consumes 5 V electricity at 1 A current due to which power consumption of the Raspberry-pi is less.

It allows the execution of several variants of the free GNU/Linux operating system and compatible software. We chose the Raspbian distribution Linux embedded operating system. The programming is done using the Python language which is a structured and object-oriented programming language. It features dynamic typing, automatic memory management, and an exception management system.

6.2. Relays. The relay circuit was designed to be able to switch the different sources, according to the program executed by the Raspberry, which translates the proposed algorithm. For

the realization of this one, we used ISIS software as shown in Figure 11.

Four coils of the relay are powered by 5 V pin of the Rpi and the masses are isolated by transistors 2N2222. Each relay corresponds to a power source and the control is sent by the Rpi. A current passes to the base of the transistor, then the coil of the relay is energized; this will make it possible to use the energy of the chosen source.

After verifying the operation of the circuit on ISIS, we realized the printed circuit using ARES software. Thus, we have obtained the printed circuit indicated in Figure 12.

6.3. Load Control Circuit. To test the management program practically, we took lamps as the system load and a fan as the ballast load. The control circuit that controls these charges is realized. Figure 13 shows its diagram on ISIS and Figure 14 shows its implementation on ARES.

6.4. Arduino. It is a circuit whose main constitution is a microcontroller that can be programmed to perform very different tasks. Its programming is done using the Arduino integrated development environment, which is a free and cross-platform Java Application, which can be used as a code editor and a compiler, and which can transfer the firmware

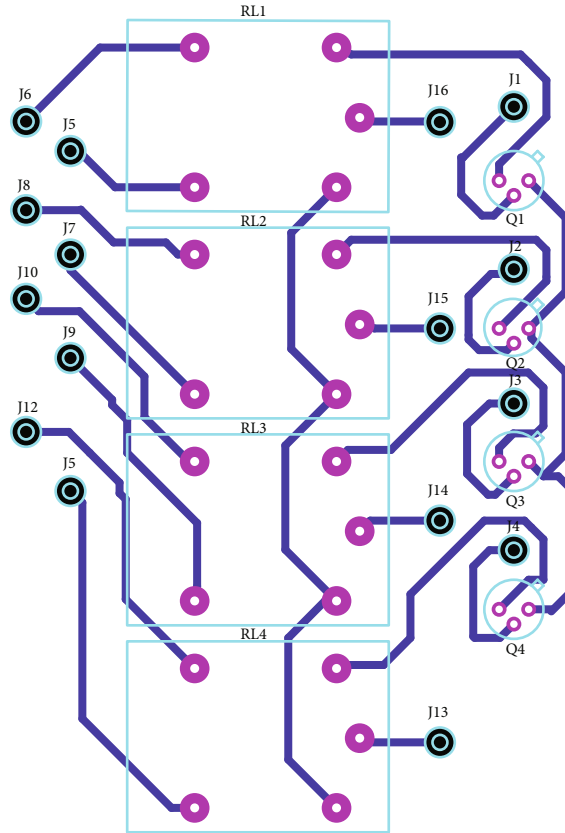


FIGURE 12: ARES diagram of the relay circuit.

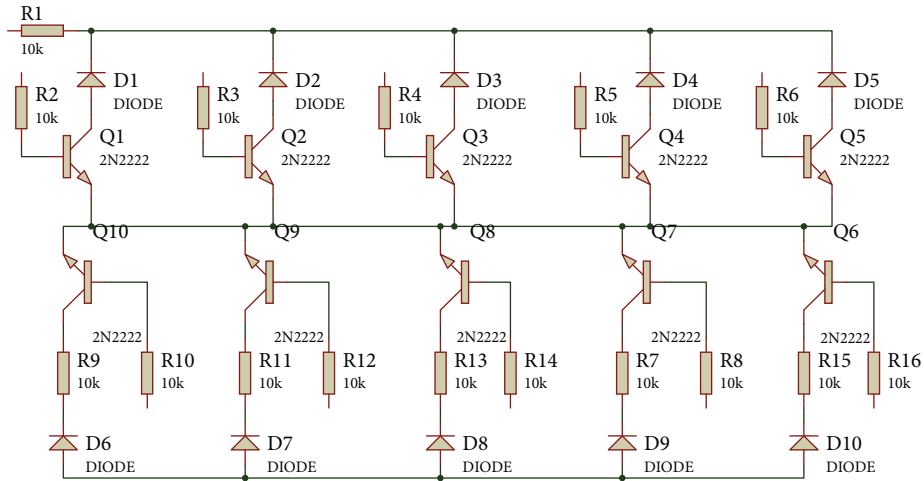


FIGURE 13: ISIS diagram of the load control circuit.

and the program via the serial link (RS-232, Bluetooth, or USB depending on the module).

In our case, the power management program has been implemented on the Raspberry; however, the Rpi does not contain any analog inputs, so we used the Arduino to convert the analog data received from the power sources to digital values. As a result, two programs will be developed, one for

the Raspberry (for management) and one for the Arduino to do the data transfer.

7. Results and Discussion

7.1. Sizing Results. Figure 15 shows the comparison of all possible combinations from an economic and ecological

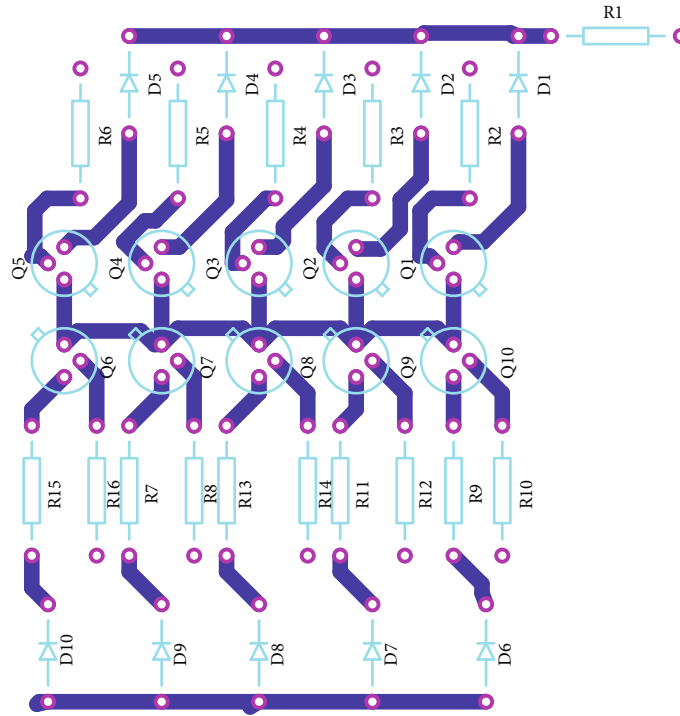


FIGURE 14: ARES diagram of the load control circuit.

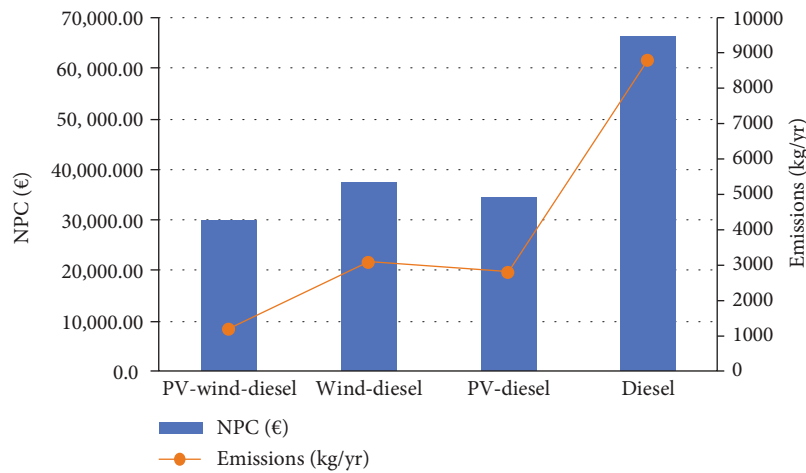


FIGURE 15: NPC and amount of emissions of each combination.

point of view (net present cost and the amount of greenhouse gas emissions). This figure shows the interest of using HMGs compared to the current situation of the diesel generator. Hybrid PV-wind-diesel system (PWDS) produces better results compared to the PV-diesel system (PDS), wind-diesel system (WDS), and diesel-only system (DS).

The sizing result using the Homer-pro software shows that the optimal system is a hybrid system based on 5kW panels, the wind turbine of 3kWp, and a genset of 10kW backup diesel generator, combined with a generic kWh storage battery Li-ion 1kWh and a Leon s219cph 5kW 48Vdc bidirectional converter (BDI 1P).

Further information on the system inputs and other results of this dimensioning can be found in [52].

7.2. Modelling Results. In order to test and monitor microgrid performance under real conditions, a simulation study is done using LabVIEW software. The simulation results consist mainly of 2 components: the user interface realized in the form of a dashboard that allows the user to see the state of the microgrid every minute. As shown in Figure 16, it is composed of

- (i) two tables: Table 1 contains the actual values of the load as well as the powers of the renewable energy

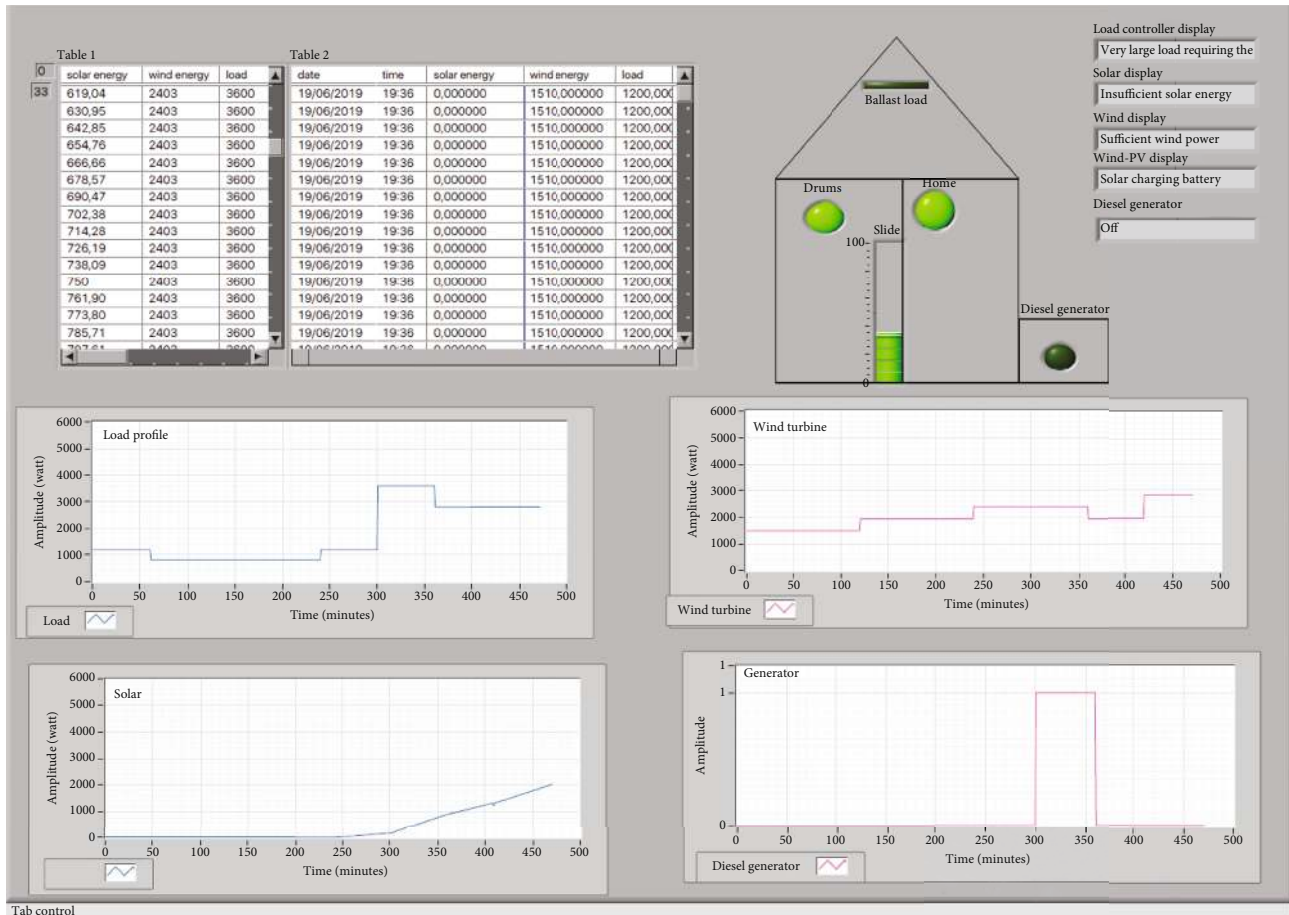


FIGURE 16: LabVIEW user interface of the microgrid.

- and Table 2 displays the results of the simulated values and their execution times as well as the date
- (ii) 4 LEDs indicate whether the load is powered or not, the battery is connected or not, the DG is on or off, and the ballast load is feed or not
- (iii) the SOC level of the battery
- (iv) 5 displays showing the status of each energy source and the need for the load during the execution of the program; the user can see the evolution curves of powers in real time. We used memory oscillators to get the results for 24 h

Figure 17 shows the power supplied by the various energy sources. As can be seen, it corresponds to the required load profile. Figures 18 and 19 represent the power evolution provided by the wind turbine and the PV panels, respectively.

Figure 20 shows the state of the diesel generator; it is started 3 times during the day.

7.3. Experimental Result. Figure 21 shows the first setup of our microgrid; it is a model realized with modest personal means. We have used potentiometers to vary the powers provided by energy sources on purpose to visualize the effect of

this variation in real time. Similarly, for the load, we took 5 lamps and a fan as the ballast load.

Arduino receives the power values provided by the power sources and the battery (potentiometers); it handles the analogue digital conversion and then transfers them to the RPI3, which executes the power management program, and reacts to the loads according to the flow chart of Figure 8.

8. Conclusion and Future Work

This paper presents an implementation of real-time energy management systems (EMS) to maximize the efficiency of the electricity distribution in a microgrid. The grid serves a load with an off-grid hybrid renewable energy system made of photovoltaic modules, a battery energy storage system, a diesel generator, and a wind turbine. Furthermore, a proper power flow control is developed using LabVIEW software and embedded in a suitable platform for the real-time management of the hybrid energy system. The developed EMS is tested and validated through a small-scale application which accurately represents the case study of an isolated mosque located in a remote area of Morocco.

This system can be introduced into a microgrid to monitor its components. The system is realized and is equipped

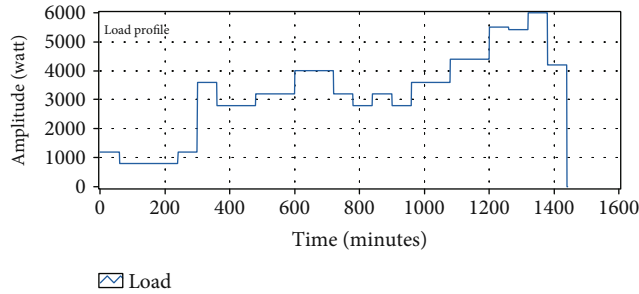


FIGURE 17: Load consumption.

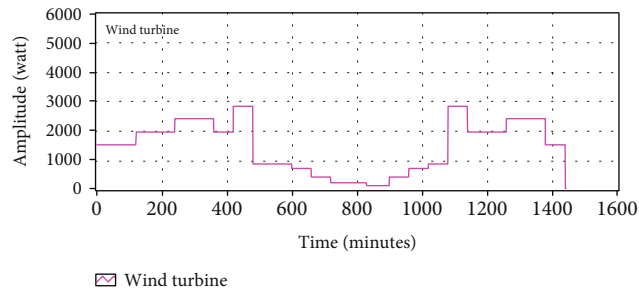


FIGURE 18: The power supplied by the wind turbine.

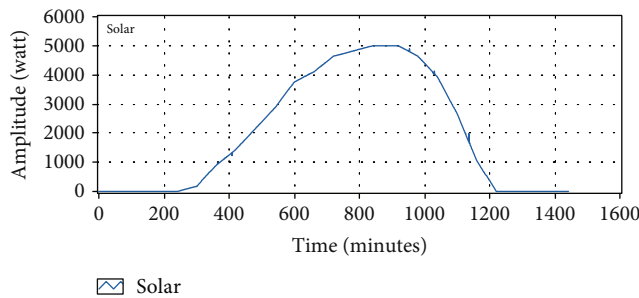


FIGURE 19: PV power production.

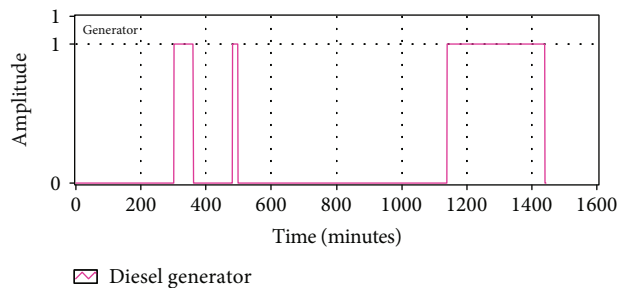


FIGURE 20: DG control.

with a supervision dashboard, allowing the user to monitor the evolution of the hybrid system. In the future, these power systems will be able to take advantage of clean and renewable energy sources.

In the hardware implementation, we used the potentiometers to vary the RES powers and the load profile; in the next

works, we will replace these potentiometers with current and voltage sensors to use the real panels and the wind turbine. Also, monitoring and control technologies must be developed to reduce energy consumption in renewable energy systems. Currently, we are developing a remote monitoring system and a control interface that allows the user to see

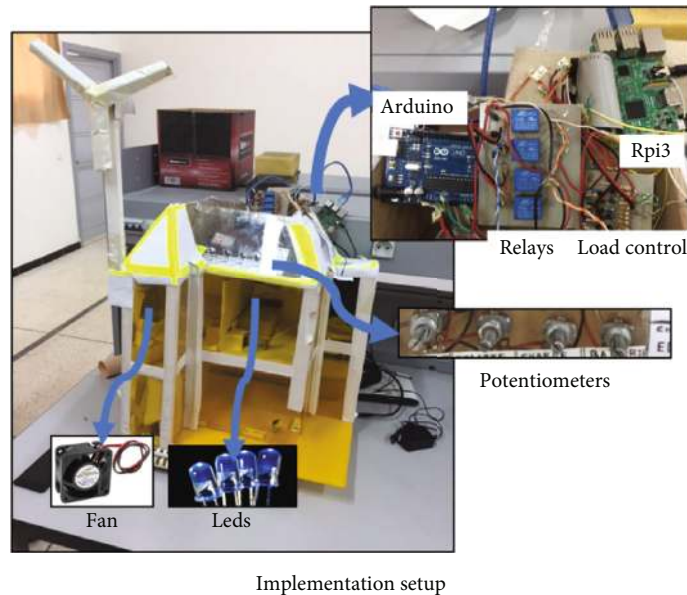


FIGURE 21: Implementation setup.

the power variations and the state of the battery, thus controlling remote power sources. For this reason, we created a hosting server as well as its configuration; thus, we installed the PHP language and a web server named APACHE in order to communicate with the RPI3 using its IP address and to control it from afar.

Data Availability

The data used to support the findings of this study have not been made available because they are confidential.

Conflicts of Interest





The authors declare that there is no conflict of interest regarding the publication of this paper.

References

- [1] United Nations Department of Economic and Social Affairs, *Rapport sur les Objectifs de Développement Durable 2016*, UN, 2018.
- [2] R. Maroc, *Projet de Loi de Finances pour l'année budgétaire 2017*, MINISTÈRE DE L'ÉCONOMIE ET DES FINANCES, Morocco, 2017.
- [3] S. A. Shezan, S. Julai, M. A. Kibria et al., "Performance analysis of an off-grid wind-PV (photovoltaic)-diesel-battery hybrid energy system feasible for remote areas," *Journal of Cleaner Production*, vol. 125, pp. 121–132, 2016.
- [4] S. Goel and R. Sharma, "Performance evaluation of stand alone, grid connected and hybrid renewable energy systems for rural application: a comparative review," *Renewable and Sustainable Energy Reviews*, vol. 78, pp. 1378–1389, 2017.
- [5] Y. Sawle, S. C. Gupta, and A. K. Bohre, "Review of hybrid renewable energy systems with comparative analysis of off-grid hybrid system," *Renewable and Sustainable Energy Reviews*, vol. 81, pp. 2217–2235, 2018.
- [6] J. Jung and M. Villaran, "Optimal planning and design of hybrid renewable energy systems for microgrids," *Renewable and Sustainable Energy Reviews*, vol. 75, pp. 180–191, 2017.
- [7] M. D. A. Al-falahi, S. D. G. Jayasinghe, and H. Enshaei, "A review on recent size optimization methodologies for stand-alone solar and wind hybrid renewable energy system," *Energy Conversion and Management*, vol. 143, pp. 252–274, 2017.
- [8] M. Boussetta, R. El Bachtiri, M. Khanfara, and K. El Hammoui, "Assessing the potential of hybrid PV-Wind systems to cover public facilities loads under different Moroccan climate conditions," *Sustainable Energy Technologies and Assessments*, vol. 22, pp. 74–82, 2017.
- [9] N. Izadyar, H. C. Ong, W. T. Chong, J. C. Mojumder, and K. Y. Leong, "Investigation of potential hybrid renewable energy at various rural areas in Malaysia," *Journal of Cleaner Production*, vol. 139, pp. 61–73, 2016.
- [10] D. Saheb-Koussa, M. Haddadi, and M. Belhamel, "Economic and technical study of a hybrid system (wind-photovoltaic-diesel) for rural electrification in Algeria," *Applied Energy*, vol. 86, no. 7–8, pp. 1024–1030, 2009.
- [11] R. Accorsi, M. Bortolini, M. Gamberi, R. Manzini, and F. Pilati, "Multi-objective warehouse building design to optimize the cycle time, total cost, and carbon footprint," *International Journal of Advanced Manufacturing Technology*, vol. 92, no. 1–4, pp. 839–854, 2017.
- [12] M. Gianni and K. Gotzamani, "Management systems integration: lessons from an abandonment case," *Journal of Cleaner Production*, vol. 86, pp. 265–276, 2015.
- [13] L. Olatomiwa, S. Mekhilef, M. S. Ismail, and M. Moghavvemi, "Energy management strategies in hybrid renewable energy systems: a review," *Renewable and Sustainable Energy Reviews*, vol. 62, pp. 821–835, 2016.
- [14] A. A. Babayo, M. H. Anisi, and I. Ali, "A Review on energy management schemes in energy harvesting wireless sensor networks," *Renewable and Sustainable Energy Reviews*, vol. 76, pp. 1176–1184, 2017.
- [15] A. M. Carreiro, H. M. Jorge, and C. H. Antunes, "Energy management systems aggregators: a literature survey," *Renewable*

- and *Sustainable Energy Reviews*, vol. 73, pp. 1160–1172, 2017.
- [16] P. G. Arul, V. K. Ramachandaramurthy, and R. K. Rajkumar, “Control strategies for a hybrid renewable energy system: a review,” *Renewable and Sustainable Energy Reviews*, vol. 42, pp. 597–608, 2015.
- [17] N. H. Mirjat, M. A. Uqaili, K. Harijan, G. D. Valasai, F. Shaikh, and M. Waris, “A review of energy and power planning and policies of Pakistan,” *Renewable and Sustainable Energy Reviews*, vol. 79, pp. 110–127, 2017.
- [18] O. O. Mengi and I. H. Altas, “A new energy management technique for PV/wind/grid renewable energy system,” *International Journal of Photoenergy*, vol. 2015, Article ID 356930, 19 pages, 2015.
- [19] S. Upadhyay and M. P. Sharma, “Selection of a suitable energy management strategy for a hybrid energy system in a remote rural area of India,” *Energy*, vol. 94, pp. 352–366, 2016.
- [20] A. Maulik and D. Das, “Optimal operation of microgrid using four different optimization techniques,” *Sustainable Energy Technologies and Assessments*, vol. 21, pp. 100–120, 2017.
- [21] W. C. H. Schoonenberg and A. M. Farid, “A dynamic model for the energy management of microgrid-enabled production systems,” *Journal of Cleaner Production*, vol. 164, pp. 816–830, 2017.
- [22] M. R. B. Khan, R. Jidin, and J. Pasupuleti, “Multi-agent based distributed control architecture for microgrid energy management and optimization,” *Energy Conversion and Management*, vol. 112, pp. 288–307, 2016.
- [23] M. Mao, P. Jin, N. D. Hatziaargyriou, and L. Chang, “Multi-agent-based hybrid energy management system for microgrids,” *IEEE Transactions on Sustainable Energy*, vol. 5, no. 3, pp. 1–9, 2014.
- [24] P. Taylor, C. K. Aravind, G. S. Ilango et al., “A control strategy for hybrid autonomous power system with a battery management scheme,” *Electric Power Components and Systems*, vol. 43, no. 8–10, pp. 37–41, 2015.
- [25] F. Valencia, J. Collado, D. Sáez, and L. G. Marin, “Robust energy management system for a microgrid based on a fuzzy prediction interval model,” *IEEE Transactions on Smart Grid*, vol. 7, no. 3, pp. 1486–1494, 2015.
- [26] Z. Roumila, D. Rekioua, and T. Rekioua, “Energy management based fuzzy logic controller of hybrid system wind/photovoltaic/diesel with storage battery,” *International Journal of Hydrogen Energy*, vol. 42, no. 30, pp. 19525–19535, 2017.
- [27] R. J. Wai, S. J. Jhung, J. J. Liaw, and Y. R. Chang, “Intelligent optimal energy management system for hybrid power sources including fuel cell and battery,” *IEEE Transactions on Power Electronics*, vol. 28, no. 7, pp. 3231–3244, 2013.
- [28] P. García, J. P. Torreglosa, L. M. Fernández, F. Jurado, R. Langella, and A. Testa, “Energy management system based on techno-economic optimization for microgrids,” *Electric Power Systems Research*, vol. 131, pp. 49–59, 2016.
- [29] C. Wang, Y. Liu, X. Li, L. Guo, L. Qiao, and H. Lu, “Energy management system for stand-alone diesel-wind-biomass microgrid with energy storage system,” *Energy*, vol. 97, pp. 90–104, 2016.
- [30] Q. Xu, J. Xiao, X. Hu, P. Wang, and M. Y. Lee, “A decentralized power management strategy for hybrid energy storage system with autonomous bus voltage restoration and state-of-charge recovery,” *IEEE Transactions on Industrial Electronics*, vol. 64, no. 9, pp. 7098–7108, 2017.
- [31] D. E. Olivares, C. A. Cañizares, and M. Kazerani, “A centralized energy management system for isolated microgrids,” *IEEE Transactions on Smart Grid*, vol. 5, no. 4, pp. 1864–1875, 2014.
- [32] S. H. C. Cherukuri and B. Saravanan, “A novel energy management algorithm for reduction of main grid dependence in future smart grids using electric springs,” *Sustainable Energy Technologies and Assessments*, vol. 21, pp. 1–12, 2017.
- [33] Z. Yi, W. Dong, and A. H. Etemadi, “A unified control and power management scheme for PV-battery-based hybrid microgrids for both grid-connected and islanded modes,” *IEEE Transactions on Smart Grid*, vol. 9, no. 6, pp. 5975–5985, 2017.
- [34] J. Zhang, L. Huang, J. Shu, H. Wang, and J. Ding, “Energy management of PV-diesel-battery hybrid power system for island stand-alone micro-grid,” *Energy Procedia*, vol. 105, pp. 2201–2206, 2017.
- [35] D. S. Koussa and M. Koussa, “A feasibility and cost benefit prospection of grid connected hybrid power system (wind-photovoltaic) - case study: an Algerian coastal site,” *Renewable and Sustainable Energy Reviews*, vol. 50, pp. 628–642, 2015.
- [36] K. Dehghanpour and H. Nehrir, “Real-time multiobjective microgrid power management using distributed optimization in an agent-based bargaining framework,” *IEEE Transactions on Smart Grid*, vol. 9, no. 6, pp. 6318–6327, 2018.
- [37] W. Shi, N. Li, C. Chu, and R. Gadh, “Real-time energy management in microgrids,” *IEEE Transactions on Smart Grid*, vol. 8, no. 1, pp. 1–11, 2015.
- [38] A. Anvari-Moghaddam, J. M. Guerrero, J. C. Vasquez, H. Monsef, and A. Rahimi-Kian, “Efficient energy management for a grid-tied residential microgrid,” *IET Generation, Transmission & Distribution*, vol. 11, no. 11, pp. 2752–2761, 2017.
- [39] M. Elsieid, A. Oukaour, T. Youssef, H. Gualous, and O. Mohammed, “An advanced real time energy management system for microgrids,” *Energy*, vol. 114, pp. 742–752, 2016.
- [40] R. Hemmati, “Technical and economic analysis of home energy management system incorporating small-scale wind turbine and battery energy storage system,” *Journal of Cleaner Production*, vol. 159, pp. 106–118, 2017.
- [41] A. M. Vega, F. Santamaria, and E. Rivas, “Modeling for home electric energy management: a review,” *Renewable and Sustainable Energy Reviews*, vol. 52, pp. 948–959, 2015.
- [42] B. Zhou, W. Li, K. W. Chan et al., “Smart home energy management systems: concept, configurations, and scheduling strategies,” *Renewable and Sustainable Energy Reviews*, vol. 61, pp. 30–40, 2016.
- [43] H. Elkhorchani and K. Grayaa, “Novel home energy management system using wireless communication technologies for carbon emission reduction within a smart grid,” *Journal of Cleaner Production*, vol. 135, pp. 950–962, 2016.
- [44] Z. Wu, X. P. Zhang, J. Brandt, S. Y. Zhou, and L. I. Jia-Ning, “Three control approaches for optimized energy flow with home energy management system,” *IEEE Power and Energy Technology Systems Journal*, vol. 2, pp. 21–31, 2015.
- [45] J. Han, C. Choi, W. Park, I. Lee, and S. Kim, “Smart home energy management system including renewable energy based on ZigBee and PLC,” *IEEE Transactions on Consumer Electronics*, vol. 60, no. 2, pp. 198–202, 2014.

- [46] H. Zhang, B. Zhang, A. Bose, and H. Sun, "A distributed multi-control-center dynamic power flow algorithm based on asynchronous iteration scheme," *IEEE Transactions on Power Systems*, vol. 33, no. 2, pp. 1716–1724, 2017.
- [47] M. H. Cano, K. Agbossou, S. Kelouwani, and Y. Dubé, "Experimental evaluation of a power management system for a hybrid renewable energy system with hydrogen production," *Renewable Energy*, vol. 113, pp. 1086–1098, 2017.
- [48] B. Jovanović, J. Filipović, and V. Bakić, "Energy management system implementation in Serbian manufacturing - plan-do-check-act cycle approach," *Journal of Cleaner Production*, vol. 162, pp. 1144–1156, 2017.
- [49] C. S. Ioakimidis, L. J. Oliveira, K. N. Genikomsakis, and P. I. Dallas, "Design, architecture and implementation of a residential energy box management tool in a SmartGrid," *Energy*, vol. 75, pp. 167–181, 2014.
- [50] J. Khoury, R. Mbayed, G. Salloum, and E. Monmasson, "Design and implementation of a real time demand side management under intermittent primary energy source conditions with a PV-battery backup system," *Energy and Buildings*, vol. 133, pp. 122–130, 2016.
- [51] S. Kotra and M. K. Mishra, "A supervisory power management system for a hybrid microgrid with HESS," *IEEE Transactions on Industrial Electronics*, vol. 64, no. 5, pp. 3640–3649, 2017.
- [52] M. Boussetta, R. Elbachtiri, M. Khanfara, and K. Elhammoumi, "Performance analysis and power evaluation of hybrid off-grid system," in *Renewable and Sustainable Energy Conference (IRSEC), International*, Marrakech, Morocco, Nov. 2016.

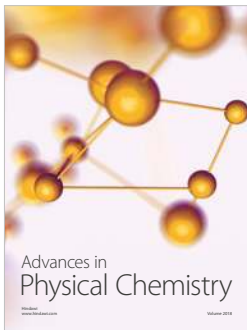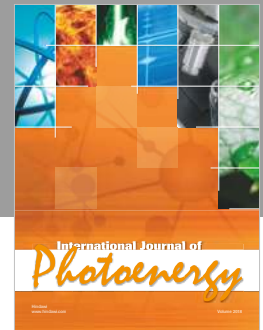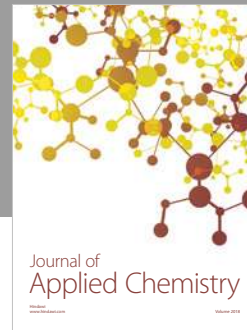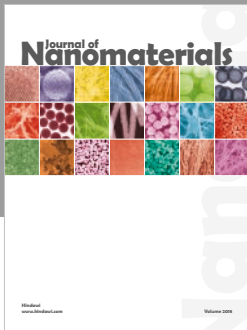

Hindawi

Submit your manuscripts at
www.hindawi.com

