

# Energy management and control for grid connected hybrid energy storage system under different operating modes

Manandhar, Ujjal; Ukil, Abhisek; Gooi, Hoay Beng; Tummuru, Narsa Reddy; Kollimalla, Sathish Kumar; Wang, Benfei; Chaudhari, Kalpesh

2017

Manandhar, U., Ukil, A., Gooi, H. B., Tummuru, N. R., Kollimalla, S. K., Wang, B., & Chaudhari, K. (2019). Energy management and control for grid connected hybrid energy storage system under different operating modes. *IEEE Transactions on Smart Grid*, 10(2), 1626-1636. doi:10.1109/TSG.2017.2773643

<https://hdl.handle.net/10356/144647>

<https://doi.org/10.1109/TSG.2017.2773643>

---

© 2017 IEEE. Personal use of this material is permitted. Permission from IEEE must be obtained for all other uses, in any current or future media, including reprinting/republishing this material for advertising or promotional purposes, creating new collective works, for resale or redistribution to servers or lists, or reuse of any copyrighted component of this work in other works. The published version is available at:  
<https://doi.org/10.1109/TSG.2017.2773643>

*Downloaded on 27 Aug 2022 02:45:58 SGT*

# Energy Management and Control for Grid Connected Hybrid Energy Storage System under Different Operating Modes

Ujjal Manandhar, *Student Member, IEEE*, Abhisek Ukil, *Senior Member, IEEE*, Gooi Hoay Beng, *Senior Member, IEEE*, Narsa Reddy Tummuru, *Member, IEEE*, Sathish Kumar Kollimalla, *Member, IEEE*, Benfei Wang and Kalpesh Chaudhari, *Student Member, IEEE*

**Abstract**—DC-coupled microgrids are simple as they do not require any synchronization when integrating different distributed energy generations. However, the control and energy management strategy between the renewable energy sources and the energy storages under different operating modes is a challenging task. In this paper, a new energy management scheme is proposed for the grid connected hybrid energy storage with the battery and the supercapacitor under different operating modes. The main advantages of the proposed energy management scheme are effective power sharing between the different energy storage systems, faster DC link voltage regulation to generation and load disturbances, dynamic power sharing between the battery and the grid based on the battery state of charge, reduced rate of charge/discharge of battery current during steady state and transient power fluctuations, improved power quality features in AC grid and seamless mode transitions. The effectiveness of the proposed method is validated by both simulation and experimental studies.

**Index Terms**—Battery, energy management, HESS, DC-coupled hybrid microgrid, supercapacitor.

## I. INTRODUCTION

The penetration of the distributed renewable generations like the photovoltaic (PV) and wind in the distribution network has been growing day by day. The PV generation is easily affected by the various environmental conditions. One of the primary countermeasure to solve the intermittent nature of the renewable power generations is to deploy the energy storage system [1]. The battery energy storages are generally used for PV and wind power system. The battery energy storages can deal with the slow power demand. However, it is unable to deal with high power fluctuation and may suffer from ageing problem when stressed to high frequency transient power fluctuations [2]–[4]. The ragone chart for different energy storages with their energy and power densities are presented in Fig. 1.

To deal with the above problem, combinations of energy storages with different characteristics are used. One of the popular combination is of the battery and supercapacitor (SC) system. The performance parameters of the battery and SC are summarized in Table I. The battery energy storages are employed to deal with the slow changing power demand while the SCs deal with the transient power fluctuations. The battery and SC combined hybrid energy storage system (HESS) is popular in renewable distributed generation systems [5]–[9],

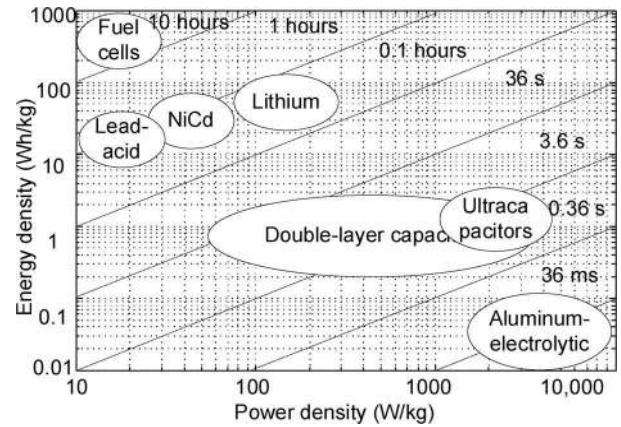


Fig. 1. Ragone chart for different energy storages with their power and energy densities [3].

TABLE I  
PERFORMANCE PARAMETERS FOR BATTERY AND SUPERCAPACITOR [4]

	Lead-acid battery	Supercapacitor
Specific energy density	10-100(Wh/kg)	1-10(W/kg)
Specific power density	< 1000(W/kg)	< 10000(W/kg)
Cycle life	1000	> 500000
Charge/discharge efficiency	70-85%	85-98%
Fast charge time	1-5hr	0.3-30s
Discharge time	0.3-3hr	0.3-30s

uninterruptible power supply applications [10], and in the hybrid electrical vehicle (EV) applications [11]–[13]. The battery and SC based HESS can effectively and efficiently solve the problem of varying power generation and load demand. To extend the life span of battery and SC, they should not be overcharged/overdischarged. To maintain the energy storages in the safe operating region, the energy management scheme (EMS) is imperative, which can effectively utilize the energy storages and also protect them from overcharge/overdischarge problem.

### A. Literature Review

In [14], multi-mode fuzzy logic based power allocator for HESS is proposed. The solution provided in the paper solves the issues in haar wavelet method. In haar wavelet method, impacts of the state of charge (SOC) are generally neglected. But the practical application of the multi-mode fuzzy logic method is still a challenge. Adaptive fuzzy logic based EMS

for HESS in EV application is discussed in [11]. The proposed control scheme uses the multi-agent based approach which is complex to design and requires large computational resources. The fuzzy logic rule based control approach will generate the significant error between the simulated and experimental results as it is sensitive to the change in system parameters.

In [15], the adaptive neural network (ANN) based control for hybrid AC/DC microgrid is presented. In the proposed method the ANN based control is applied to track the maximum power from the renewable source and to exchange power from the grid. The method is based on the online trained neural network controller which is too complex to modelled and requires large computational resources to get the optimal control parameters.

The model predictive control (MPC) based EMS and control for the HESS is presented in [16]. With the given control scheme, it is ensured that the battery and SC operate at predefined SOC limits. As the proposed approach is based on the classical discrete MPC, it requires large computational resources.

A unified EMS for grid-connected HESS is presented in [17]. The results presented show a better performance than the power management algorithm presented in [18], interms of faster DC voltage regulation, execution time and charge/discharge rates of the battery system. However, the power sharing between the grid and the battery during different operating conditions is based on the SOC level of the battery which follows a discrete pattern. This approach creates a sharp increase in the battery charge/discharge rates during transition which can reduce the battery operating lifetime [19].

In [7], [20] sliding mode control technique is used to control the HESS. The proposed methods are supported by detail experimental results. However, the control approach mentioned is complex to design and depend on system parameters. Various power management algorithms for grid connected system are presented in [21], [22]. The studies presented in these literatures follow the discrete power sharing approach between the battery and the grid. The low complexity power management and control strategy for isolated DC microgrid with HESS is presented in [23]. The energy management presented only deal with the isolated DC microgrid and neglect its connection with AC grid. In [24], a unified control and power management for PV-battery hybrid Microgrid for grid connected and islanding operation is presented. In the proposed method, battery balances the DC link and AC link power in all condition which increases the stress in the battery system. This will reduce the lifetime of the battery and also increase the system cost to meet the peak load demand. Xu *et. al* [25] proposed an extended droop control approach to obtain a decentralized power sharing between battery and SC during load and generation variations. The method is based on virtual resistance and virtual capacitance droop controller for reference power generation for battery and SC in DC microgrid application.

### B. Features of Proposed EMS and Control

To solve the aforementioned issues, a new EMS is presented in this paper. The features of the proposed EMS and control

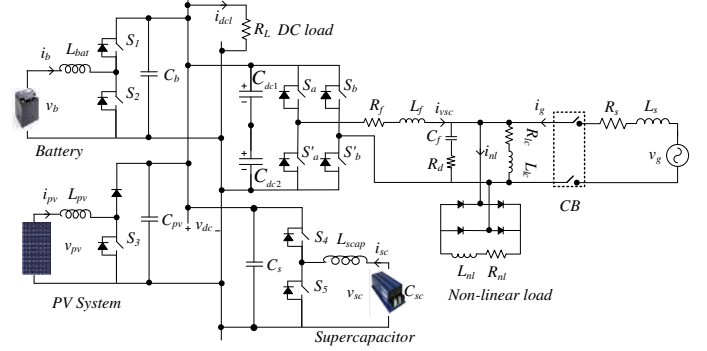


Fig. 2. Overall system architecture.

are: (i) faster DC link voltage restoration, (ii) operation of the battery and SC within their SOC limits, (iii) introduction of a new sharing coefficient for effective power sharing between the battery and the grid which reduces the rate of charge/discharge of the battery during long term operation and (iv) seamless mode transitions. The rest of the paper is organised as follows: The system architecture is described in Section II. The EMS is discussed in Section III. The simulation results are presented in Section IV. Experimental results and comparison between the existing methods are presented in Section V, followed by conclusions in Section VI.

## II. SYSTEM ARCHITECTURE

The overall system architecture studied in this paper is shown in Fig. 2. It consists of emulated PV source, HESS and utility grid. The HESS is connected to the DC link with the half bridge bidirectional DC-DC converter which ensures the bidirectional power flow between the energy storage and the DC link. The DC link is connected to the AC grid with the voltage source converter which acts as a rectifier or an inverter depending upon the current reference. In Fig. 2,  $v_{pv}$ ,  $v_b$ ,  $v_{sc}$ ,  $v_g$  and  $v_{dc}$  are PV, battery, SC, AC grid terminal voltage and DC link voltage respectively.  $L_{pv}$ ,  $L_{bat}$ ,  $L_{scap}$ ,  $L_f$  and  $L_s$  are converter filter inductors for the PV, battery, SC, inverter and grid.  $C_{pv}$ ,  $C_b$  and  $C_s$  are the filter capacitances of PV, battery, SC converters.  $S_1$ ,  $S_2$ ,  $S_3$ ,  $S_4$ ,  $S_5$ ,  $S_a$ ,  $S'_a$ ,  $S_b$  and  $S'_b$  are representation of the control switches used for DC-DC converters and DC-AC inverter.  $i_{pv}$ ,  $i_b$ ,  $i_{sc}$ ,  $i_{dcl}$ ,  $i_{vsc}$ ,  $i_g$  and  $i_{nl}$  represent the PV, battery, SC, DC load, inverter, grid and non-linear load current respectively. The overall DC load is represented by resistance  $R_L$ .

## III. EMS AND CONTROL STRATEGY

### A. Reference Current Generation

The overall power balance should be maintained to make the system stable. The presented configuration and control scheme support the load in all operating conditions. Thus, the overall power balance equation to maintain a constant DC link voltage ( $v_{dc}$ ) is as follows,

$$P_l(t) - P_{ren}(t) = P_b(t) + P_{sc}(t) + P_g(t) = P_{avg}(t) + \hat{P}_{tran}(t), \quad (1)$$

where  $P_{ren}(t)$ ,  $P_b(t)$ ,  $P_{sc}(t)$ ,  $P_g(t)$  and  $P_l(t)$  are the renewable energy source, battery, SC, grid and total load power

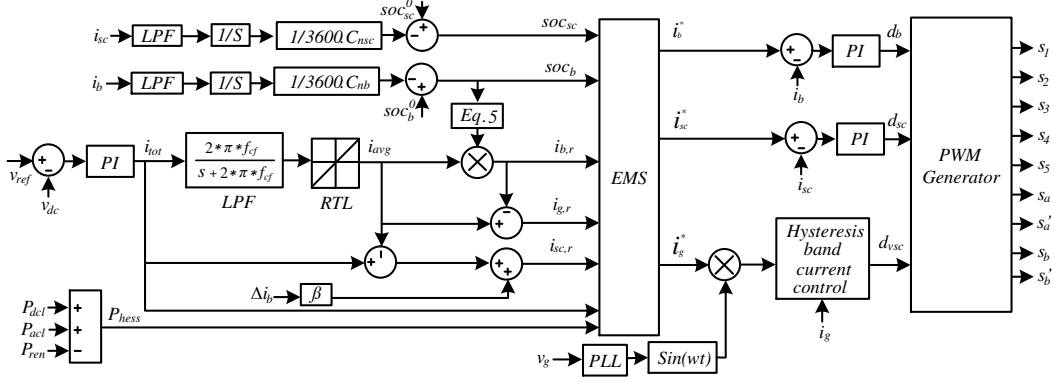


Fig. 4. Overall proposed unified control architecture.

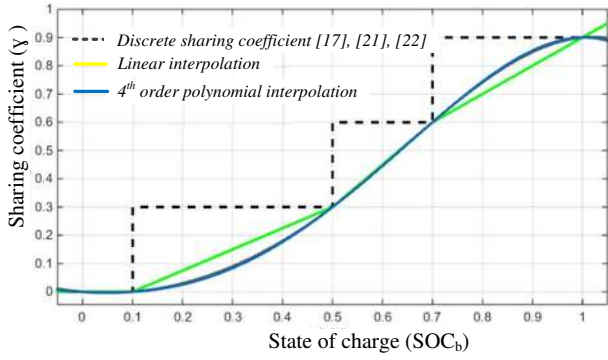


Fig. 3. Sharing coefficient ( $\gamma$ ) for the proposed energy management scheme for deficit power mode.

respectively.  $P_{avg}(t)$  and  $\hat{P}_{tran}(t)$  represents the total average power and transient power demand to be supplied/absorbed from the HESS and the utility grid to maintain the total power balance in the DC link. The DC link voltage is the reflection of the power balance among various sources and sinks [22]. Thus, The total current  $i_{tot}(t)$  to be supplied or absorbed by HESS and grid is obtained from the voltage control loop and it is given in (2),

$$i_{tot}(t) = K_{pdc}(v_{ref} - v_{dc}) + K_{idc} \int (v_{ref} - v_{dc}) dt, \quad (2)$$

where,  $K_{pdc}$  and  $K_{idc}$  are proportional and integral constant for the overall voltage loop proportional integral (PI) controller. In (2),  $v_{ref}$  is the reference DC link voltage. The effective sharing of DC current is essential to achieve a faster DC link voltage restoration and effective performance of the proposed control strategy. In conventional controller approach [18], low pass filter (LPF) is employed to extract an average component of the total effective current. The average current ( $i_{avg}$ ) is given by (3),

$$i_{avg}(s) = \frac{2 * \pi * f_{cf}}{s + 2 * \pi * f_{cf}} i_{tot}(s), \quad (3)$$

$$i_{b,r}(s) = \gamma \cdot i_{avg}(s), \quad i_{g,r}(s) = (1 - \gamma) \cdot i_{avg}(s), \quad (4)$$

where  $f_{cf}$ ,  $i_{b,r}(s)$ ,  $i_{g,r}(s)$  and  $\gamma$  are the cut-off frequency of the LPF, the current reference for the battery converter control and the current reference for the grid and sharing

coefficient. The cut-off frequency is chosen to be 5Hz as presented in [26]. Taking into account the voltage and SOC limit of the battery, it is important to select the appropriate sharing coefficient. As the  $i_{avg}$  is shared between the battery and the grid supply. The discrete power sharing approach is presented in the literature [17], [21], [22]. The discrete power sharing approach creates a sharp rate of change of battery current ( $\frac{di_b}{dt}$ ) during sudden power fluctuation and during normal operation of charge/discharge when reaches to certain SOC limit of battery. The main objectives of the proposed sharing coefficient are to reduce the rate of change of battery current during normal operating condition and sudden power fluctuations and to maintain the SOC limit of battery for longer duration of time. The curve fitting technique from MATLAB is used to obtain a 4th order polynomial equation for sharing coefficient( $\gamma$ ).

$$\gamma = P_1 \cdot (SOC_b)^4 + P_2 \cdot (SOC_b)^3 + P_3 \cdot (SOC_b)^2 + P_4 \cdot SOC_b + P_5 \quad (5)$$

where,  $P_1 = -2.143$ ,  $P_2 = 2.429$ ,  $P_3 = 0.7071$ ,  $P_4 = 0.09286$ , and  $P_5 = 1.832e-16$ . The graphical representation of the sharing coefficient is shown in Fig. 3. The transient and oscillatory component in the total current reference is given by (6),

$$i_{sc,r} = \hat{i}_{tran}(s) = \left(1 - \frac{2 * \pi * f_{cf}}{s + 2 * \pi * f_{cf}}\right) i_{tot} + \beta \Delta i_b, \quad (6)$$

In (6),  $i_{sc,r}$  and  $\Delta i_b$  are the SC reference current and the uncompensated current from the battery system. Here  $\beta = \frac{v_b}{v_{sc}}$ , is the compensation factor. The diversion of the uncompensated current from the battery system to SC system results in faster DC link voltage restoration. The generated battery, SC and grid current references are compared to the actual current. The  $i_b$ ,  $i_{sc}$  and  $i_g$  are the actual battery, SC and grid current respectively. The error is then fed to the PI current control which generates a duty ratio to regulate the current. The rate limiter (RTL) is used with LPF to maintain the rate of charge/discharge of the battery below its maximum value [19]. The overall architecture of the proposed control and EMS is shown in Fig. 4.

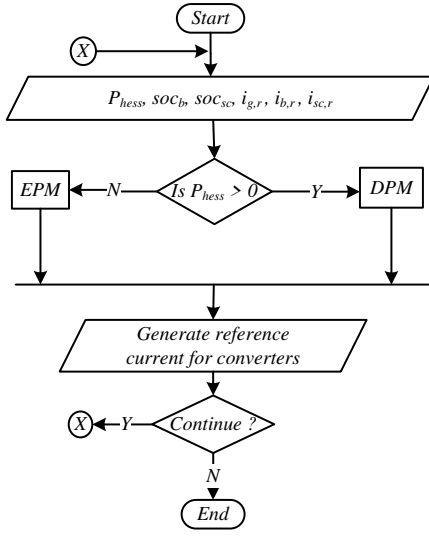


Fig. 5. Flowchart of the proposed EMS.

### B. Proposed EMS

The flow chart of the proposed EMS is presented in Fig. 5. It consists of two different modes, (i) excess power mode (EPM) and (ii) deficit power mode (DPM). The two modes of operation are identified based on the renewable power generation availability and the load demand in the system. They are deficit power mode ( $P_{hess} > 0$ ) and excess power mode ( $P_{hess} \leq 0$ ) where  $P_{hess} = P_b + P_{sc} + P_g = P_{dcl} + P_{acl} - P_{ren}$ . Based on the condition of  $P_{hess}$  the system operates in different modes of operation as shown in flowchart Fig. 5. Under the DPM and EPM modes, four different operating conditions are identified based on the condition of  $SOC_b$  and  $SOC_{sc}$  as shown in Table II and Table III. The  $SOC_b$  and  $SOC_{sc}$  are the SOC of battery and the SC respectively and calculated based on coulomb's counting method presented in [27].

$$SOC_b = SOC_b^0 - \frac{1}{3600 \cdot C_{nb}} \int i_b dt \quad (7)$$

$$SOC_{sc} = SOC_{sc}^0 - \frac{1}{3600 \cdot C_{nsc}} \int i_{sc} dt \quad (8)$$

where  $SOC_b^0$ ,  $SOC_{sc}^0$ ,  $C_{nb}$  and  $C_{nsc}$  are initial SOC of battery and SC, nominal capacity of the battery and SC respectively. The proposed EMS meets the following objectives: (i) always maintains the  $SOC_b$  and  $SOC_{sc}$  within their safe operating region, i.e., higher (H) and lower (L) SOC limits as specified, (ii) limits the rate of charge/discharge of battery and SC, (iii) achieves seamless mode transition between different modes of operation, (iv) reduce stress on the battery and increase lifespan of the battery energy storage system, and (v) computationally less intense.

1) *DPM*: In this mode, the deficit power required to maintain the DC link voltage is supplied by the battery, grid and SC depending upon the SOC conditions of energy storage. In Table II,  $L_b$  and  $L_{sc}$  represent the lowest allowed SOC limits for battery and SC provided by the manufacturer. In the proposed scheme, the real power sharing between the grid and the battery system varies as in (5). The renewable power

TABLE II  
DPM

Conditions	Current setting
$SOC_b > L_b$ & $SOC_{sc} > L_{sc}$	$i_b^* = \gamma \cdot i_{avg}$ , $i_{sc}^* = i_{sc,r}$ $i_g^* = (1 - \gamma) \cdot i_{avg}$
$SOC_b < L_b$ & $SOC_{sc} > L_{sc}$	$i_b^* = 0$ , $i_{sc}^* = i_{sc,r}$ $i_g^* = i_{avg}$
$SOC_b > L_b$ & $SOC_{sc} < L_{sc}$	$i_b^* = \gamma \cdot i_{avg}$ , $i_{sc}^* = 0$ $i_g^* = (1 - \gamma) \cdot i_{avg} + i_{sc,r}$
$SOC_b < L_b$ & $SOC_{sc} < L_{sc}$	$i_b^* = 0$ , $i_{sc}^* = 0$ $i_g^* = i_{avg} + i_{sc,r}$

TABLE III  
EPM

Conditions	Current setting
$SOC_b < H_b$ & $SOC_{sc} < H_{sc}$	$i_b^* = -i_{b,ra}$ , $i_{sc}^* = -i_{sc,ra} + i_{sc,r}$ $i_g^* = i_{tot}$
$SOC_b > H_b$ & $SOC_{sc} < H_{sc}$	$i_b^* = 0$ , $i_{sc}^* = -i_{sc,ra} + i_{sc,r}$ $i_g^* = i_{tot}$
$SOC_b < H_b$ & $SOC_{sc} > H_{sc}$	$i_b^* = -i_{b,ra}$ , $i_{sc}^* = 0$ $i_g^* = i_{tot} + i_{sc,r}$
$SOC_b > H_b$ & $SOC_{sc} > H_{sc}$	$i_b^* = 0$ , $i_{sc}^* = 0$ $i_g^* = i_{tot} + i_{sc,r}$

generation is operated at maximum power point in all four conditions in DPM. The various operations under the DPM are given in Table II and are explained below.

Condition I: If  $SOC_b > L_b$  and  $SOC_{sc} > L_{sc}$  then discharge both battery and SC. The current setting for the battery, SC and grid are as follows.

$$i_b^* = \gamma \cdot i_{avg}, \quad i_{sc}^* = i_{sc,r}, \quad i_g^* = (1 - \gamma) \cdot i_{avg} \quad (9)$$

The value of  $\gamma$  is changed dynamically based on the  $SOC_b$  value calculated based on (5).

Condition II: If  $SOC_b < L_b$  and  $SOC_{sc} > L_{sc}$  then the battery current is set to zero. The transient and oscillatory current is supplied by the SC and the average power demand is supplied by the grid. The current setting for the battery, SC and grid are as follows.

$$i_b^* = 0, \quad i_{sc}^* = i_{sc,r}, \quad i_g^* = i_{avg} \quad (10)$$

Condition III: If  $SOC_b > L_b$  and  $SOC_{sc} < L_{sc}$  then the battery is discharged until  $SOC_b$  reach  $L_b$  to support the average power demand and the SC remains idle. The current setting for the battery, SC and grid are as follows.

$$i_b^* = \gamma \cdot i_{avg}, \quad i_{sc}^* = 0, \quad i_g^* = (1 - \gamma) \cdot i_{avg} + i_{sc,r} \quad (11)$$

Condition IV: If  $SOC_b < L_b$  and  $SOC_{sc} < L_{sc}$  then both the battery and the SC remain idle. The grid supports the total power mismatch between the generation and load. The current setting for the battery, SC and grid are as follows.

$$i_b^* = 0, \quad i_{sc}^* = 0, \quad i_g^* = i_{avg} + i_{sc,r} \quad (12)$$

In this condition, the average power as well as transient power demand is supplied from the grid.

TABLE IV  
SYSTEM PARAMETERS FOR SIMULATION STUDY

PV array parameters @ STC	Values
Open circuit voltage ( $v_{pv}$ )	40 V
Short circuit current ( $i_{pv}$ )	20 A
Battery specifications	Values
Type	Lead Acid
Ah capacity	12 Ah
Terminal Voltage ( $v_b$ )	12 V
No of batteries in series	4
SC specifications	Values
Terminal voltage ( $v_{sc}$ )	15V
Capacitance ( $C_{sc}$ )	58F
No of SCs in series	4
Maximum continuous current	20A
Maximum current in 1sec	80A
Converters parameters	$L_{pv} = 10$ mH, $C_{pv} = 440$ $\mu$ F $L_{bat} = 1.63$ mH, $C_b = 440$ $\mu$ F $L_{scap} = 2$ mH, $C_s = 440$ $\mu$ F $C_{dc1} = 1600$ $\mu$ F, $C_{dc2} = 1600$ $\mu$ F $L_f = 5$ mH, $C_f = 15$ $\mu$ F $L_s = 5$ mH
Controller parameters	$k_{pv} = 0.1$ , $k_{ipv} = 1$ $k_{pb} = 0.1$ , $k_{ib} = 100$ $k_{psc} = 0.4$ , $k_{isc} = 150$ $k_{pdc} = 1$ , $k_{idc} = 100$ $\beta = 0.85$
Load parameters	$R_L = 50$ $\Omega$ , $R_{lc} = 20$ $\Omega$ $R_{nl} = 30$ $\Omega$ , $L_{nl} = 50$ mH
DC and AC grid parameters	$v_{dc} = 80$ V, $v_g = 50$ V, 50Hz

2) *EPM*: In this mode, the excess power from the renewable energy sources is stored into the battery and SC until  $SOC_b$  and  $SOC_{sc}$  reach their highest limits. In Table III,  $H_b$  and  $H_{sc}$  represent the highest safe operating SOC limit for battery and SC provided by the manufacturer. Once the ESS reaches its highest SOC limit, the excess energy is fed to the grid using DC-AC inverter. The operating conditions in EPM are given in Table III. In Table III,  $i_{b,ra}$  and  $i_{sc,ra}$  are the battery and SC rated charging current.

#### IV. SIMULATION RESULTS

The nominal system parameters used during simulation are listed in Table IV. In Table IV,  $k_{pv}$ ,  $k_{pb}$ ,  $k_{psc}$  are the proportional constants of PV, battery and SC current loop PI controller.  $k_{ipv}$ ,  $k_{ib}$ ,  $k_{isc}$  are the integral constants of PV, battery and SC current loop PI controller. The  $SOC_b$  and  $SOC_{sc}$  limits are varied intentionally to observe the extreme operation conditions in different operating modes during both simulation and experimental studies.

##### A. Performance under DPM Operation

The performance of the proposed EMS for DPM operation is shown in Fig. 6. In this mode, the PV generation is kept constant.  $SOC_b$  and  $SOC_{sc}$  limits are varied to study the behaviour of the system in extreme conditions. The purpose to do so is to study the behaviour of the controller and proposed energy management algorithm during extreme operating conditions.

At time  $t_1$ ,  $SOC_b$  and  $SOC_{sc}$  are above lower SOC limit. At the same time instant, the DC load is changed from  $R = 50\Omega$  to  $R = 25\Omega$ , which creates a voltage deviation in the DC link. In Fig. 6 (c) it can be observed that the SC responds to

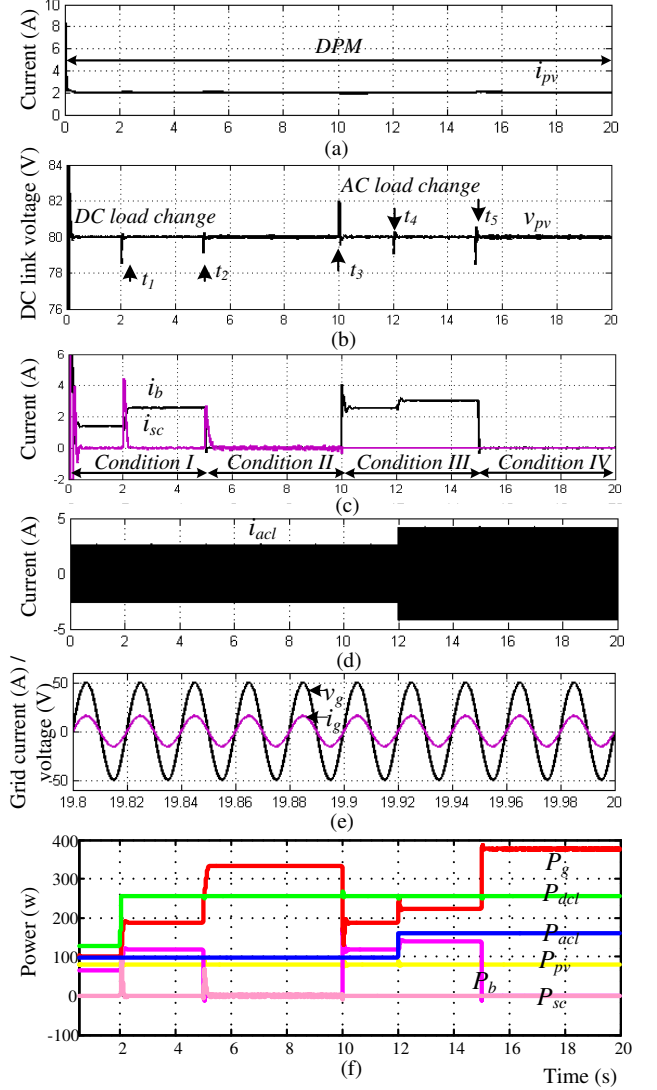


Fig. 6. Performance under DPM operation: (a) PV current, (b) DC link voltage, (c) SC and battery current, (d) AC load current, (e) grid current and voltage and (f) Powers.

deal with the fast changing transient power demand and the battery current slowly increases.

At time  $t_2$ ,  $SOC_b$  is decreased below  $L_b$  while the  $SOC_{sc}$  is still above  $L_{sc}$ . In this condition, the transient power is absorbed by the SC and the active power demand is dealt by the grid supply.

At time  $t_3$ ,  $SOC_b$  is higher than  $L_b$  and  $SOC_{sc}$  is below  $L_{sc}$ . In this instant, the transient power is dealt by the grid supply and the average power is shared based on the sharing coefficient in (5).

At time  $t_4$ , the AC load is increased by decreasing the linear load resistance. At this time,  $SOC_{sc}$  is below  $L_{sc}$ . So, the  $i_{sc}$  is zero. The  $i_b$  slowly rises as the grid participates to compensate the deficit of SC in the system.

At time  $t_5$ ,  $SOC_b$  is below  $L_b$ , and  $SOC_{sc}$  is below  $L_{sc}$ . In this condition, the grid supplies the required power to stabilise the DC link voltage. In this condition, if the grid is not available we should consider the load shedding control techniques to maintain the power balance in the system.

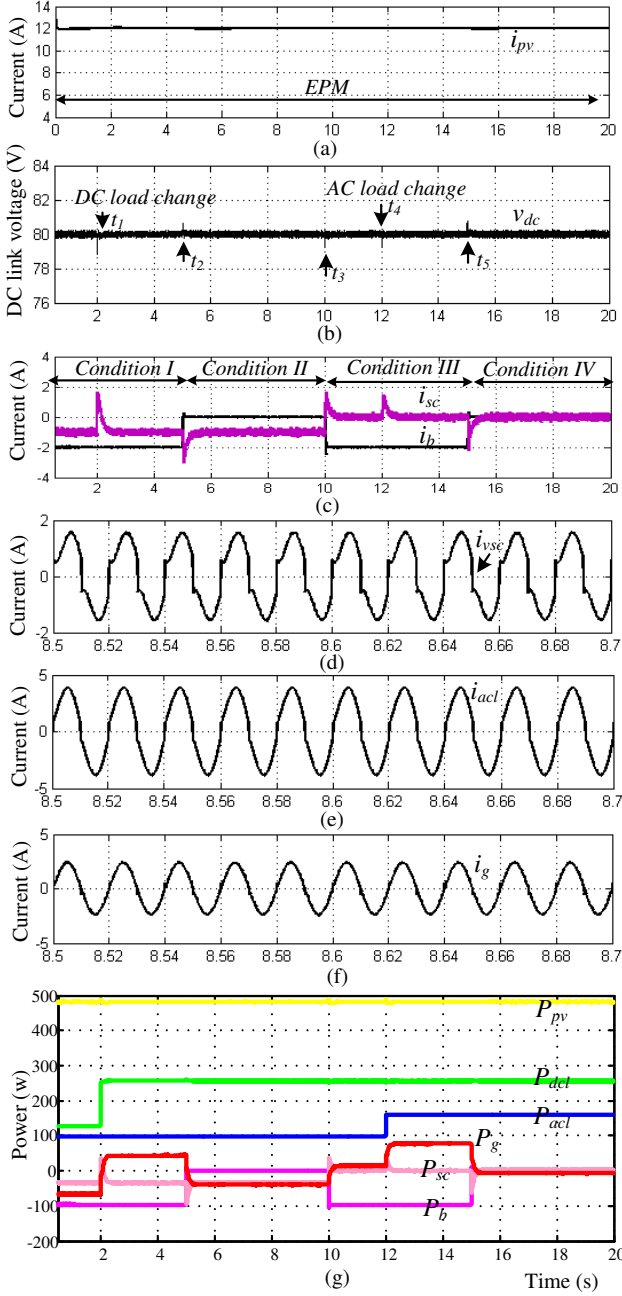


Fig. 7. Performance under EPM operation: (a) PV current, (b) DC link voltage, (c) SC and battery current, (d) inverter current, (e) AC load current, (f) grid current and (g) Powers.

### B. Performance under EPM Operation

The performance of the proposed EMS for EPM operation is shown in Fig. 7. In this mode the generation is made higher than the load demand. At time  $t_1$ ,  $SOC_b$  and  $SOC_{sc}$  are below  $H$ . At time  $t_1 = 2s$ , the DC load is changed from  $R = 50\Omega$  to  $R = 25\Omega$ , which creates a voltage deviation in the DC link. In this condition the battery and SC are charged with their rated charging capacity until the highest SOC limit is achieved. The required average power to maintain the constant DC link voltage in this condition is maintained by the grid. The transient power is supplied by the SC system.

At time  $t_2$ ,  $SOC_b$  reaches to  $H_b$  so the battery charging current is zero. In this condition the SC is charged with the

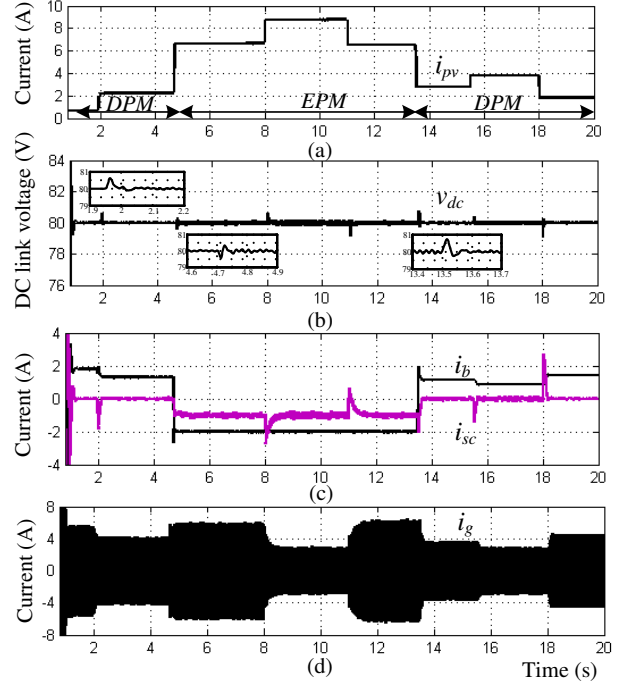


Fig. 8. Performance under change in various operating modes: (a) PV current, (b) DC link voltage, (c) SC and battery current and (d) grid current.

rated charging current as the  $SOC_{sc}$  is still below  $H_{sc}$ . The remaining excess power is fed to the grid as shown in Fig. 7 (g). The grid power is negative from time  $t_2$  to  $t_3$ , as the excess power is fed to the grid.

At time  $t_3$ ,  $SOC_{sc}$  reaches to  $H_{sc}$  so that the SC charging current is zero. In this condition, the battery is charged with rated charging current until  $H_b$  is achieved. And the grid takes the transient and average power to maintain the constant DC link voltage.

At time instant  $t_4$ , the AC load is increased by decreasing the linear load resistance. During this time period,  $SOC_{sc}$  is at  $H_{sc}$  and  $SOC_b$  is below  $H_b$ . The  $i_b$  charging current remains unchanged while  $i_{sc}$  supplies the transient power demand.

At time  $t_5$ ,  $SOC_b$  and  $SOC_{sc}$  are made above the  $H$  SOC limit. In this condition, the grid takes all the power to stabilise the DC voltage. All the load is supplied by the generation, and the excess power is fed to the grid. In all the operating conditions, the grid current and voltage are operating in unity power factor in all conditions. The inverter, AC load and grid currents are shown in Fig. 7 (d)-(f) respectively.

### C. Seamless Mode Transition

The transition from one mode to another is shown in Fig. 8. The PV generation is changed by changing the current reference value for the PV converter control. During this study, the  $SOC_b$  and  $SOC_{sc}$  are maintained between  $L$  and  $H$ . The transient power is controlled by the SC system as shown in the Fig. 8 (c) and slow changing power demand is shared by the grid current and the battery system as shown in the Fig. 8 (c) and Fig. 8 (d). The smooth restoration of the DC link

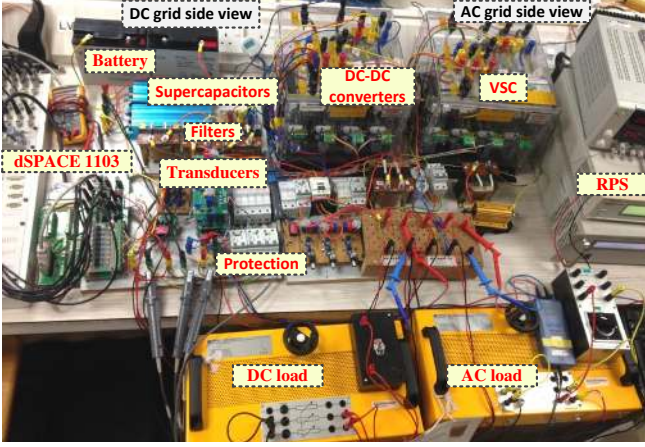


Fig. 9. Hardware setup.

voltage is observed in all operating conditions with varying PV generation.

## V. EXPERIMENTAL RESULTS

The hardware prototype for a grid connected DC microgrid with HESS is built, as shown in Fig. 9. The Semikron SKM 75GB12T4 control switches are used to build DC-DC converters and a single phase DC-AC inverter. The LEM current and voltage transducers are used to measure the current and the voltage. The chroma programmable DC power supply 62012P-600-8 is used as a renewable power source (RPS) in the experiment. The RPS is connected to the DC link using a DC-DC boost converter. The current from the RPS is controlled by changing the current reference for the DC-DC boost converter current controller. The different current references are fed to the current controller to generate different PV current profiles during the experimental study. The two series combinations of 17Ah capacity lead acid battery with terminal voltage of 12V are used as a battery system. The two series combinations of Maxwell BMOD0058 E015 B01 SC with capacity of 58F at 15V are used as a SC system. The maximum discharge current for SC in 1sec is 80A. The dSPACE 1103 real-time controller is used as a control platform. The DC link voltage ( $v_{dc} = 48V$ ) and AC grid voltage ( $v_{ac} = 20V$  (rms)) are chosen for the experimental study. It is highlight that the experimental setup is the scaled down version of the system used during the simulation study.

### A. Performance under Different Modes of Operation

The experimental results for the DPM and EPM operations are shown in Fig. 10 and Fig. 11 respectively.

The possible operating conditions during the DPM are shown in Fig. 10. The average deficit power is shared between the grid and the battery according to the sharing coefficient mentioned in (5). This approach reduces stress in the battery, as the sharing coefficient varies with respect to  $SOC_b$ . The four conditions are analysed where  $SOC_b$  and  $SOC_{sc}$  limits are changed intentionally to observe the extreme conditions. It is observed that the energy storages participate to maintain the

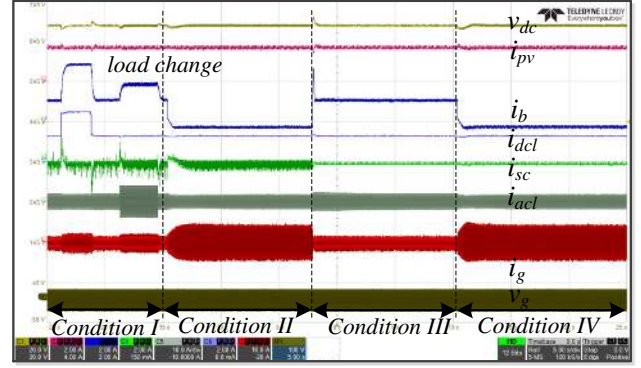


Fig. 10. Experimental result for DPM operation.  $v_{dc} \sim 20V/div$ ,  $i_{pv}$ ,  $i_b$ ,  $i_{sc}$ ,  $i_{dcl} \sim 2A/div$ ,  $i_g$ ,  $i_{acl} \sim 10A/div$ ,  $v_g \sim 100V/div$ ,  $time \sim 5s/div$ .

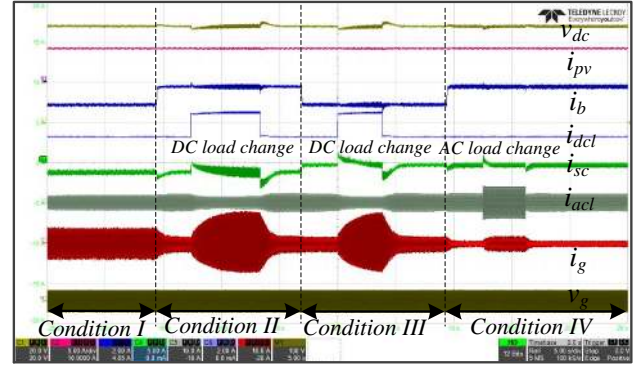


Fig. 11. Experimental result for EPM operation.  $v_{dc} \sim 20V/div$ ,  $i_{pv}$ ,  $i_{sc} \sim 5A/div$ ,  $i_b$ ,  $i_{dcl} \sim 2A/div$ ,  $i_g$ ,  $i_{acl} \sim 10A/div$ ,  $v_g \sim 100V/div$ ,  $time \sim 5s/div$ .

system balance until their SOC limit is less than their lower SOC limit in DPM.

In Fig. 11, four operating conditions during EPM are studied. In condition I, the battery and SC are charged with the excess power with its rated charging current ( $i_{b,ra}$  and  $i_{sc,ra}$ ) until  $H_b$  and  $H_{sc}$  are achieved. In this case, the DC link is maintained by the grid power supply. In condition II, the battery charging current is set to zero as  $SOC_b$  reaches to  $H_b$ . In condition III,  $i_{sc}$  is zero as  $SOC_{sc}$  reaches the  $H_{sc}$ . The soft change in the grid current is observed during transition and load change as SC supports the transient power demand. In condition IV,  $i_b$  and  $i_{sc}$  are made zero as they reached their maximum storage limits and the excess power is fed to the grid. During the load change conditions in different modes, the transient power is supported by SC and average power is shared between battery and grid.

### B. Long-term Performance Analysis

Fig. 12 illustrates the operation of proposed controller under a general operational case when the PV generation changes in random manners. The PV irradiation data is recorded every one minute from 10:00 am to 16:30 pm. The irradiation pattern obtained is shown in Fig. 12 (a). In this experiment,  $SOC_b$  and  $SOC_{sc}$  are maintained under safe operating regions.

The respective  $i_{pv}$  pattern is generated as per the irradiation pattern, shown in Fig. 12 (b). It is observed from the experiment that the proposed controller is effective in managing



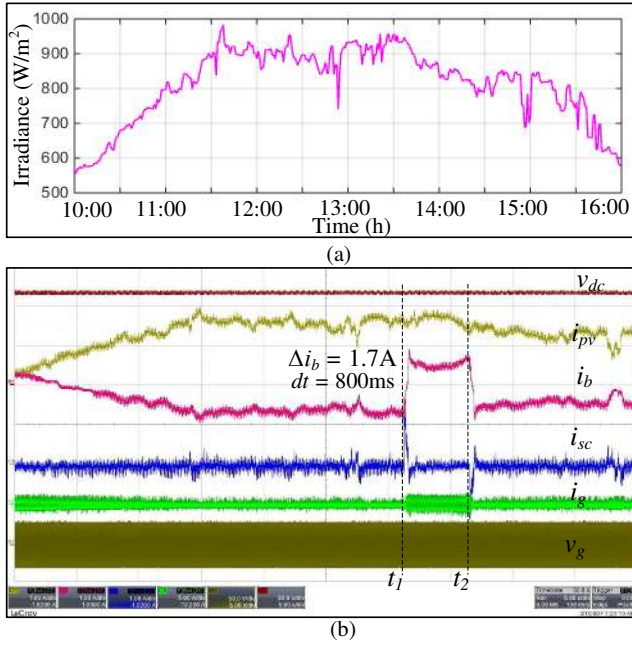


Fig. 12. Experimental result for long-term PV change. (a) Irradiance pattern from 10:00 am - 16:30 pm. (b)  $v_{dc} \sim 20V/div$ ,  $i_{pv}$ ,  $i_b$ ,  $i_{sc} \sim 1A/div$ ,  $i_g \sim 5A/div$ ,  $v_g \sim 50V/div$ ,  $time \sim 5s/div$ .

the intermittent PV power (represented by  $i_{pv}$ ), by effectively controlling the slow base power fluctuations from the battery (represented by  $i_b$ ), and the faster transient power fluctuations from the SC system. The DC link voltage is maintained at the constant value.

The AC grid voltage and current through grid are in phase. The DC-AC inverter compensates the harmonics components for the non-linear part of the AC load. Thus, the grid voltage and current are operated at unity power factor. In Fig. 12 (b), the step change in the DC load is done at time  $t_1$  and  $t_2$  along with PV generation variation. At time  $t_1$ , the battery changes its modes from charging current of  $-0.8A$  to discharging current of  $0.9A$  to meet the varying load demand. During the step change in load demand the SC absorbs the transient power due to load as well as variation due to PV which reduces the stress in the battery system. The battery current slowly increases to compensate the low frequency power demand. This ensures less stress in the battery system during the long-term operation and stable DC grid operation.

### C. Short-term Performance Analysis

The operation of the conventional control strategy [17], [18] and proposed EMS during step change in load demand is presented in Fig. 13 (a) and (b) respectively.  $v_{dc}$ ,  $v_{ac}$  are constant during the step increase and decrease in the load demand.  $i_b$  and  $i_g$  interact with each other to support the average power demand. The transient current fluctuation caused by the step load change is taken care by the SC system. During this condition, the grid operates at unity power factor. The  $\frac{di_b}{dt}$  of the battery is maintained below its maximum rate of charge/discharge. The zoomed view of the the step decrease in load demand at point  $t_4$  is shown in Fig. 13 (c). The results shows average power shared between the battery and grid. It

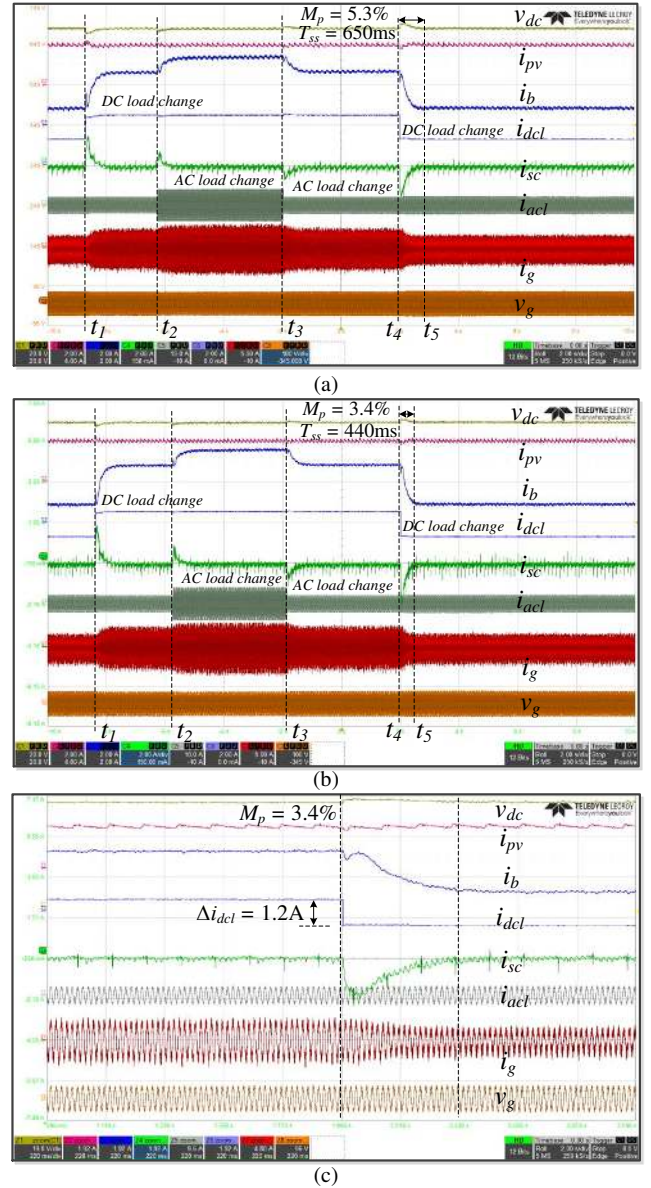


Fig. 13. Experimental result for step change in load demand. (a) Results for control scheme [17], [18]. (b) Results for proposed controller. (c) zoomed view of Fig. 12 (b) at point  $t_4$ .  $v_{dc} \sim 20V/div$ ,  $i_{pv}$ ,  $i_b$ ,  $i_{sc}$ ,  $i_{dcl} \sim 2A/div$ ,  $i_{acl} \sim 10A/div$ ,  $i_g \sim 5A/div$ ,  $v_g \sim 100V/div$ ,  $time \sim 2s/div$ .

is also observed that the grid current and voltage are in phase which ensures the unity power factor operation. The measured total harmonic distortion in the grid current in Fig. 13 (c) is less than 7%.

The high-frequency ripples contents in the DC link voltage are handled by the SC system. This provides a smooth DC link voltage in the system. The zoomed version of the DC link voltage and SC current are shown in Fig. 13 (c).

### D. Performance Comparison of Proposed Controller with the Existing Method

Fig. 14 shows the comparison of the performance of the proposed controller with the existing methods [17], [18], for smoothing the battery power fluctuations. In the experiment

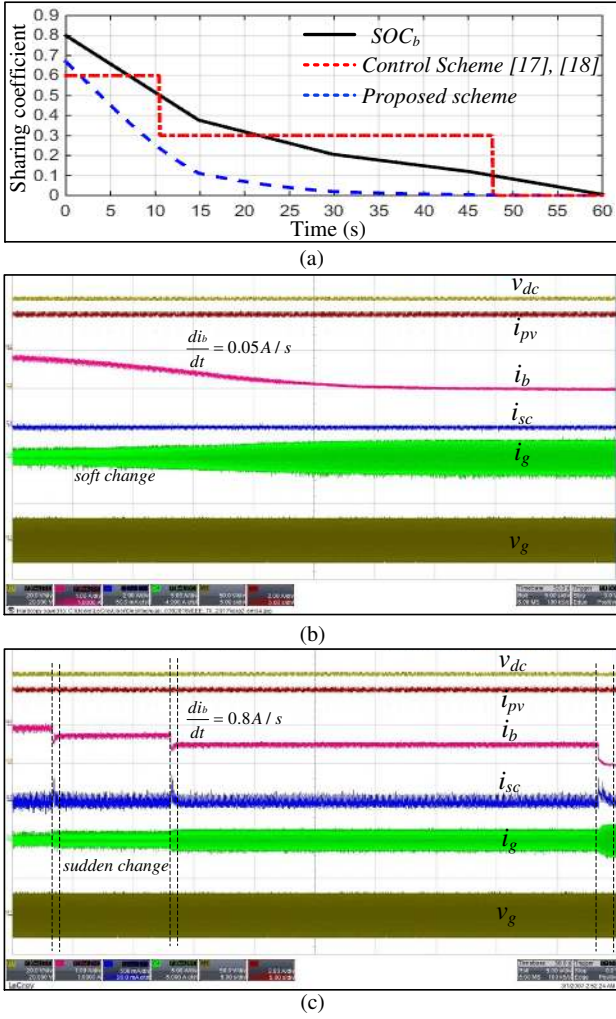


Fig. 14. Experimental result for dynamic  $SOC_b$  change. (a)  $SOC_b$  change and sharing coefficient. (b) Results for proposed controller and (c) Results for control scheme [17], [18].  $v_{dc} \sim 20V/div$ ,  $i_{pv} \sim 2A/div$ ,  $i_b \sim 1A/div$ ,  $i_{sc} \sim 0.5A/div$ ,  $i_g \sim 5A/div$ ,  $time \sim 5s/div$ .

TABLE V  
PERFORMANCE COMPARISONS WITH VARIOUS CONTROL SCHEMES

Performance index	[16]	[17], [18]	Proposed
Peak overshoot ( $M_p$ )	-	5.3%	3.4%
Settling time ( $T_{ss}$ )	-	650ms	440ms
$\frac{di_b}{dt}$ ratio (A/s)	-	0.8	0.05
Execution time ( $T_s$ )	0.01s	75 $\mu$ s	30 $\mu$ s

the  $SOC_b$  is changed as shown in the Fig. 14 (a). As the control schemes in [17], [18] follow the discrete pattern to change the current sharing reference, the sharp changes in the battery current are observed in Fig. 14 (c). Taking into account the voltage and SOC limit, it is important to select the appropriate smoothing sharing coefficient. The battery current reference is varied dynamically in the proposed scheme, so the  $\frac{di_b}{dt}$  for proposed method is lower compared to the existing methods [17], [18]. The grid provides more power in the proposed control to reduce stress in the battery from large average power demand. Thus, in Fig. 14 (b), the current from the grid is higher compared to the Fig. 14 (c) at the same time instants.

The voltage overshoot ( $M_p = \frac{\Delta v_{dc}}{v_{dc}} * 100\%$ ) and settling

time ( $T_{ss}$ ) during step decrease in load demand is studied based on the experimental results shown in Fig. 13 (a) and (b) at time  $t_4$ . The rate of change of the battery current  $\frac{di_b}{dt}$  is compared based on the experimental result presented in Fig. 14. The comparisons are presented in Table V. The result obtained shows the better performance of the proposed controller in terms of faster DC link voltage restoration with less peak overshoot during step change in load demand.

## VI. CONCLUSION

The new energy management scheme and control for grid connected HESS are presented in this paper. The main features of the proposed energy management scheme are less stress in the battery system, dynamic power sharing between the battery and grid, faster DC link voltage restoration and maintain the SOC limits of energy storage within the safe operating region. The proposed energy management scheme and control is effective in seamless mode transition between various modes of operation. The performance of the proposed control approach to reduce the stress in the battery during the normal operation and sudden changes in load and generation is also studied. The effectiveness of the proposed controller over the existing controller is also presented in the paper.

## REFERENCES

- [1] C. Wang, X. Yang, Z. Wu, Y. Che, L. Guo, S. Zhang, and Y. Liu, "A highly integrated and reconfigurable microgrid testbed with hybrid distributed energy sources," *IEEE Trans. Smart. Grid*, vol. 7, no. 1, pp. 451–459, Jan. 2016.
- [2] J. Xiao, P. Wang, and L. Setyawan, "Multilevel energy management system for hybridization of energy storages in dc microgrids," *IEEE Trans. Smart. Grid*, vol. 7, no. 2, pp. 847–856, Mar. 2016.
- [3] H. Zhou, T. Bhattacharya, D. Tran, T. S. T. Siew, and A. M. Khambadkone, "Composite energy storage system involving battery and ultracapacitor with dynamic energy management in microgrid applications," *IEEE Trans. Power. Electron.*, vol. 26, no. 3, pp. 923–930, Mar. 2011.
- [4] M. E. Glavin, P. K. W. Chan, S. Armstrong, and W. G. Hurley, "A stand-alone photovoltaic supercapacitor battery hybrid energy storage system," in *13th International Power Electron. and Motion Control Conf.*, Sept. 2008, pp. 1688–1695.
- [5] J. Pegueroles-Queralt, F. D. Bianchi, and O. Gomis-Bellmunt, "A power smoothing system based on supercapacitors for renewable distributed generation," *IEEE Trans. Ind. Electron.*, vol. 62, no. 1, pp. 343–350, Jan. 2015.
- [6] B. Hredzak, V. G. Agelidis, and G. D. Demetriades, "A low complexity control system for a hybrid dc power source based on ultracapacitor," *IEEE Trans. Power. Electron.*, vol. 29, no. 6, pp. 2882–2891, Jun. 2014.
- [7] D. B. W. Abeywardana, B. Hredzak, and V. G. Agelidis, "A fixed-frequency sliding mode controller for a boost-inverter-based battery-supercapacitor hybrid energy storage system," *IEEE Trans. Power. Electron.*, vol. 32, no. 1, pp. 668–680, Jan. 2017.
- [8] B. V. Solanki, K. Bhattacharya, and C. A. Cañizares, "A sustainable energy management system for isolated microgrids," *IEEE Trans. Sust. Ene.*, vol. 8, no. 4, pp. 1507–1517, Oct. 2017.
- [9] J. Tan and Y. Zhang, "Coordinated control strategy of a battery energy storage system to support a wind power plant providing multi-timescale frequency ancillary services," *IEEE Trans. Sust. Ene.*, vol. 8, no. 3, pp. 1140–1153, Jul. 2017.
- [10] A. Lahyani, P. Venet, A. Guermazi, and A. Troudi, "Battery/supercapacitors combination in uninterruptible power supply (ups)," *IEEE Trans. Power. Electron.*, vol. 28, no. 4, pp. 1509–1522, Apr. 2013.
- [11] H. Yin, W. Zhou, M. Li, C. Ma, and C. Zhao, "An adaptive fuzzy logic-based energy management strategy on battery/ultracapacitor hybrid electric vehicles," *IEEE Trans. Trans. Electri.*, vol. 2, no. 3, pp. 300–311, Sept. 2016.
- [12] L. Sun, K. Feng, C. Chapman, and N. Zhang, "An adaptive power-split strategy for battery, supercapacitor powertrain, design, simulation, and experiment," *IEEE Trans. Power. Electron.*, vol. 32, no. 12, pp. 9364–9375, Dec. 2017.

- [13] Z. Amjadi and S. S. Williamson, "Prototype design and controller implementation for a battery-ultracapacitor hybrid electric vehicle energy storage system," *IEEE Trans. Smart. Grid*, vol. 3, no. 1, pp. 332–340, Mar. 2012.
- [14] X. Feng, H. B. Gooi, and S. X. Chen, "Hybrid energy storage with multimode fuzzy power allocator for pv systems," *IEEE Trans. Sust. Ene.*, vol. 5, no. 2, pp. 389–397, Apr. 2014.
- [15] N. Chettibi, A. Mellit, G. Sulligoi, and A. M. Pavan, "Adaptive neural network-based control of a hybrid ac/dc microgrid," *IEEE Trans. Smart. Grid*, vol. PP, no. 99, pp. 1–13, 2016.
- [16] B. Hredzak, V. G. Agelidis, and M. Jang, "A model predictive control system for a hybrid battery-ultracapacitor power source," *IEEE Trans. Power. Electron.*, vol. 29, no. 3, pp. 1469–1479, Mar. 2014.
- [17] N. R. Tummuru, M. K. Mishra, and S. Srinivas, "Dynamic energy management of renewable grid integrated hybrid energy storage system," *IEEE Trans. Ind. Electron.*, vol. 62, no. 12, pp. 7728–7737, Dec. 2015.
- [18] R. Sathishkumar, S. K. Kollimalla, and M. K. Mishra, "Dynamic energy management of micro grids using battery super capacitor combined storage," in *Annual IEEE India Conf. (INDICON)*, Dec. 2012, pp. 1078–1083.
- [19] S. K. Kollimalla, A. Ukil, H. B. Gooi, U. Manandhar, and N. R. Tummuru, "Optimization of charge/discharge rates of a battery using a two-stage rate-limit control," *IEEE Trans. Sust. Ene.*, vol. 8, no. 2, pp. 516–529, Apr. 2017.
- [20] B. Wang, J. Xu, R. J. Wai, and B. Cao, "Adaptive sliding-mode with hysteresis control strategy for simple multimode hybrid energy storage system in electric vehicles," *IEEE Trans. Ind. Electron.*, vol. 64, no. 2, pp. 1404–1414, Feb. 2017.
- [21] S. Kotra and M. K. Mishra, "A supervisory power management system for a hybrid microgrid with hess," *IEEE Trans. Ind. Electron.*, vol. 64, no. 5, pp. 3640–3649, May. 2017.
- [22] N. Korada and M. K. Mishra, "Grid adaptive power management strategy for an integrated microgrid with hybrid energy storage," *IEEE Trans. Ind. Electron.*, vol. 64, no. 4, pp. 2884–2892, Apr. 2017.
- [23] S. K. Kollimalla, M. K. Mishra, A. Ukil, and H. B. Gooi, "Dc grid voltage regulation using new hess control strategy," *IEEE Trans. Sust. Ene.*, vol. 8, no. 2, pp. 772–781, Apr. 2017.
- [24] Z. Yi, W. Dong, and A. H. Etamadi, "A unified control and power management scheme for pv-battery-based hybrid microgrids for both grid-connected and islanded modes," *IEEE Trans. Smart. Grid*, vol. PP, no. 99, pp. 1–1, 2017.
- [25] Q. Xu, X. Hu, P. Wang, J. Xiao, P. Tu, C. Wen, and M. Y. Lee, "A decentralized dynamic power sharing strategy for hybrid energy storage system in autonomous dc microgrid," *IEEE Trans. Ind. Electron.*, vol. 64, no. 7, pp. 5930–5941, Jul. 2017.
- [26] M. Hamzeh, A. Ghazanfari, Y. A. R. I. Mohamed, and Y. Karimi, "Modeling and design of an oscillatory current-sharing control strategy in dc microgrids," *IEEE Trans. Ind. Electron.*, vol. 62, no. 11, pp. 6647–6657, Nov. 2015.
- [27] H. Mahmood, D. Michaelson, and J. Jiang, "A power management strategy for pv/battery hybrid systems in islanded microgrids," *IEEE Jour. Emerg. and Sel. Topics in Power Electron.*, vol. 2, no. 4, pp. 870–882, Dec. 2014.



**Ujjal Manandhar** (S'15) received the B.E. degree in Electrical and Electronics Engineering from Kathmandu University, Nepal in 2013. His main study includes control strategies in DC and AC grid system with hybrid energy storage system.

He is currently working toward Ph.D degree in Electrical Engineering at the School of Electrical and Electronic Engineering, Nanyang Technological University, Singapore. His research interest includes control strategies in DC grid, hybrid energy storage system and power electronics control.



**Abhisek Ukil** (S'05-M'06-SM'10) received the B.E. degree in electrical engineering from the Jadavpur Univ., Kolkata, India, in 2000 and the M.Sc. degree in electronic systems and engineering management from the Univ. of Bolton, Bolton, UK in 2004. He received the Ph.D. degree from the Pretoria (Tshwane) University of Technology, Pretoria, South Africa in 2006, working on automated disturbance analysis in power systems.

From 2006-2013, he was Principal Scientist at the ABB Corporate Research Center, Baden-Daettwil, Switzerland, where he led several projects on smart grid, protection, control, condition monitoring, including first worldwide prototype of directional protection relay using only current for smart grid applications. From 2013-2017, he was Assistant Professor in the School of EEE, Nanyang Technological University, Singapore, where he led a group of 20 researchers with several industrial collaborations. He is inventor of 10 patents, and author of more than 125 refereed papers, a monograph, 2 chapters. His research interests include smart grid, DC grid, protection & control, renewable energy & integration, energy storage, condition monitoring.



**Gooi Hoay Beng** (SM'95) received the B.S. degree in EE from National Taiwan University in 1978; the M.S. degree in EE from University of New Brunswick in 1980; and the Ph.D. degree in EE from Ohio State University in 1983. From 1983 to 1985, he was an Assistant Professor with Lafayette College, Easton. From 1985 to 1991, he was a Senior Engineer with Empros (now Siemens), Minneapolis, where he was responsible for the design and testing coordination of domestic and international energy management system projects. In 1991, he joined

the School of Electrical and Electronic Engineering, Nanyang Technological University, Singapore, as a Senior Lecturer. Since 1999, he has been an Associate Professor. He was the Deputy Head of Power Engineering Division during 2008-2014. He has been an Editor of IEEE Transactions on Power Systems since 2016. His current research interests include microgrid energy management systems dealing with storage, renewable energy sources, electricity market and spinning reserve.



**Narsa Reddy Tummuru** (S'12-M'15) received his Bachelor's degree in Electrical and Electronics Engineering from Jawaharlal Nehru Technological University, Hyderabad, India, in 2002 and the Master of Technology degree in Power Electronics, Electrical Machines and Drives from the Indian Institute of Technology Delhi, New Delhi, India, in 2006 and Narsa Reddy Tummuru received the Ph.D. degree in Electrical Engineering from Indian Institute of Technology Madras, Chennai, India, in 2015. He was a post-doctoral fellow at Nanyang Technological

University, Singapore during 2015-2016. He received Keshav-Rangnath Excellence and POSOCO Research Awards in year 2015 and 2016 respectively for his research work. He is currently Assistant professor with School of Computing and Electrical Engineering, Indian Institute of Technology Mandi, Kamand, India.

His research interests are Hybrid Energy Storage Applications in Smart grids, power electronic converter applications in renewable-energy systems, power quality, and control of switch-mode power converters.



**Benfei Wang** (S'12-M'17) received the B.Sc. degree in Electronic Information Science and Technology from University of Science and Technology of China, China, in 2011 and the Ph.D. degree in Power Engineering from Nanyang Technological University (NTU), Singapore, in 2017.

He is currently a Research Fellow in Energy Research Institute at NTU, Singapore. His research interests include model predictive control, multi-port DC-DC converter, hybrid energy storage system, hybrid renewable energy system and microgrid.



**Kalpesh Chaudhari** (S'15) received his B.E. in electrical engineering from Sardar Patel College of Engineering, Mumbai, India, in 2013. He worked as a Design Engineer with Jacobs Engineering, Mumbai, India between 2013 and 2014 specializing in substation and distribution grid designing for petrochemical refineries.

He is currently working toward the Ph.D. degree in Electrical Engineering at the School of Electrical and Electronic Engineering, Nanyang Technological University, Singapore. His research interests include

Modelling and Optimization for Electric Vehicles, Energy Storage Systems.



**Sathish Kumar Kollimalla** (S'12-M'15) received the Bachelor's degree in electrical engineering from the Viswanadha Institute of Technology and Management College of Engineering, Visakhapatnam, India, in 2003, and the Master degree in engineering from Andhra University, Visakhapatnam, in 2006. He received Ph.D. degree in electrical engineering from Indian Institute of Technology Madras, Chennai, India in 2015. He has worked as senior research fellow in Central Power Research Institute, Bangalore, India during 2008 to 2010. Currently he

is holding a position of Post Doctoral Research Fellow in Nanyang Technological University, Singapore. His research interests include power electronics applications in power systems, microgrid, renewable energy systems, hybrid energy storage system and power quality, dc grid and power electronics control.