
Load flow solution of the Tanzanian power network using Newton-Raphson method and MATLAB software

Mashauri Adam Kusekwa

Electrical Engineering Department, Dar es Salaam Institute of Technology (DIT), Dar es Salaam, Tanzania

Email address:

kusekwa_adam@yahoo.com, kusekwa_adam@dit.ac.tz

To cite this article:

Mashauri Adam Kusekwa. Load Flow Solution of the Tanzanian Power Network Using Newton-Raphson Method and MATLAB Software. *International Journal of Energy and Power Engineering*. Vol. 3, No. 6, 2014, pp. 277-286. doi: 10.11648/j.ijepe.20140306.11

Abstract: Load flow studies are the backbone of power system analysis and design. They are necessary for planning, operation, optimal power flow and economic scheduling and power exchange between utilities. This paper describes modelling procedure and present models of system components used in performing load flow analysis. The developed models are joined together to form a system network representing an approximate Tanzanian power network model. A load flow problem is formulated using the model and a MATLAB program developed using Newton-Raphson algorithm is applied in solving the problem. Simulation results are presented and analysed. The results indicate that the voltage magnitude and voltage phase angle profiles are within the operating limits of the system; it means that the selection of system components and modelling process is appropriate and accurate. The results will form the basis of other critical power system studies of the network in the future such as power system state estimation, optimal power flow and security constrained optimal power flow studies.

Keywords: System Component Modelling, Power System, Load Flow Analysis, Newton-Raphson Method, MATLAB Software

1. Introduction

The aim of load flow analysis program [1-5] is to determine the steady-state operating condition of the power system for a given load distribution. The steady-state of a power system may be determined by finding out of real and reactive power throughout the system network and the voltage magnitude and voltage angle at all buses of the network.

The planning and day-to-day operation of modern power systems call for numerous load flow analysis. Information obtained from the analysis is useful in finding component or circuit loadings, bus voltages, real and reactive power flows, transformer tap settings, system losses, exciter voltage set points, and performance under emergency conditions. The load flow model also forms the basis for other types of analysis such as short circuit, angle and voltage stability, motor starting and harmonic studies.

Load flow problem is basically involves the solution of a set of non-linear equations for real and reactive powers at each bus. Several methods have been developed and successfully applied in solving the problem [6-9]. Methods [8-9] are derived from the Newton-Raphson method given in

[6]. Method [6] is applied in this paper. The problem to be solved is that of computing the steady-state load flow through different transmission components i.e. computing the voltage magnitude and voltage angle at all buses, real and reactive power flows and losses in the system. In this way a simplified modelling through which the whole generation-transmission-consumption system can be rapidly simulated is adopted.

The first simplification is by considering only the electrical variables with angular frequency corresponding to fundamental frequency which will vary only slightly from the nominal frequency. Fast transient phenomena happening in the system are not considered, the time constants in the transmission lines, in the transformers and generators are so low, such that are neglected. Hence, no component of the system is modelled using differential equations. Voltage, currents, power, and impedance are expressed as complex variables in polar coordinates. The second simplification is by limiting the modelling to equivalent single-phase circuit, which corresponds either to the balanced states of a three-phase network or to positive, negative or zero sequence components of the unbalanced states. The second assumption is adopted in order to avoid a detailed modelling.


In this paper, system components from the Tanzanian power network are used in the modelling process. Load flow analysis is implemented under MATLAB environment using Newton-Raphson algorithm. The objective of the study is to develop alternative load flow software to PSS/E, which is used by the Tanzania Electric Supply Company Limited (TANESCO) at the moment.

The structure of the paper is as follows. Section 2 presents a brief account of Tanzanian power network status (generation and high voltage transmission). Section 3 presents material and method that include system component modelling procedures and developed models for load flow analysis is given. Section 4 presents overall system network modelling. Formulation of load flow problem using Newton-Raphson method and its solution algorithm is given in section 5. Section 6 presents input data, algorithm, simulation procedures and results. Section 7 discusses the obtained results, and section 8 concludes the paper.

2. Tanzanian Power Network

2.1. Generation

The Tanzanian power network comprises of hydro, thermal and gas plants [10]. The hydro system is comprised of 6 plants with a total nameplate of 561MW (see Table 1). The installed capacity of thermal generating plants totals 453.6MW (see Table 2). The installed capacity of isolated thermal generating plants totals 33.80MW. Currently, the total nameplate capacity is 1,053.05 MW. Coal power generation is between 4 to 6 MW; import of power is about 5 and 10 MW of bulk power from Uganda and 3 MW from Zambia. The demand of electricity in Tanzania which is a large country (950,000 square kilometres) is however growing at a relatively fast rate. While the annual average growth rate between 1990 and 1998 was 4.45 percent, the average load growth rate between 2003 and 2006 has been above 8 percent [11]

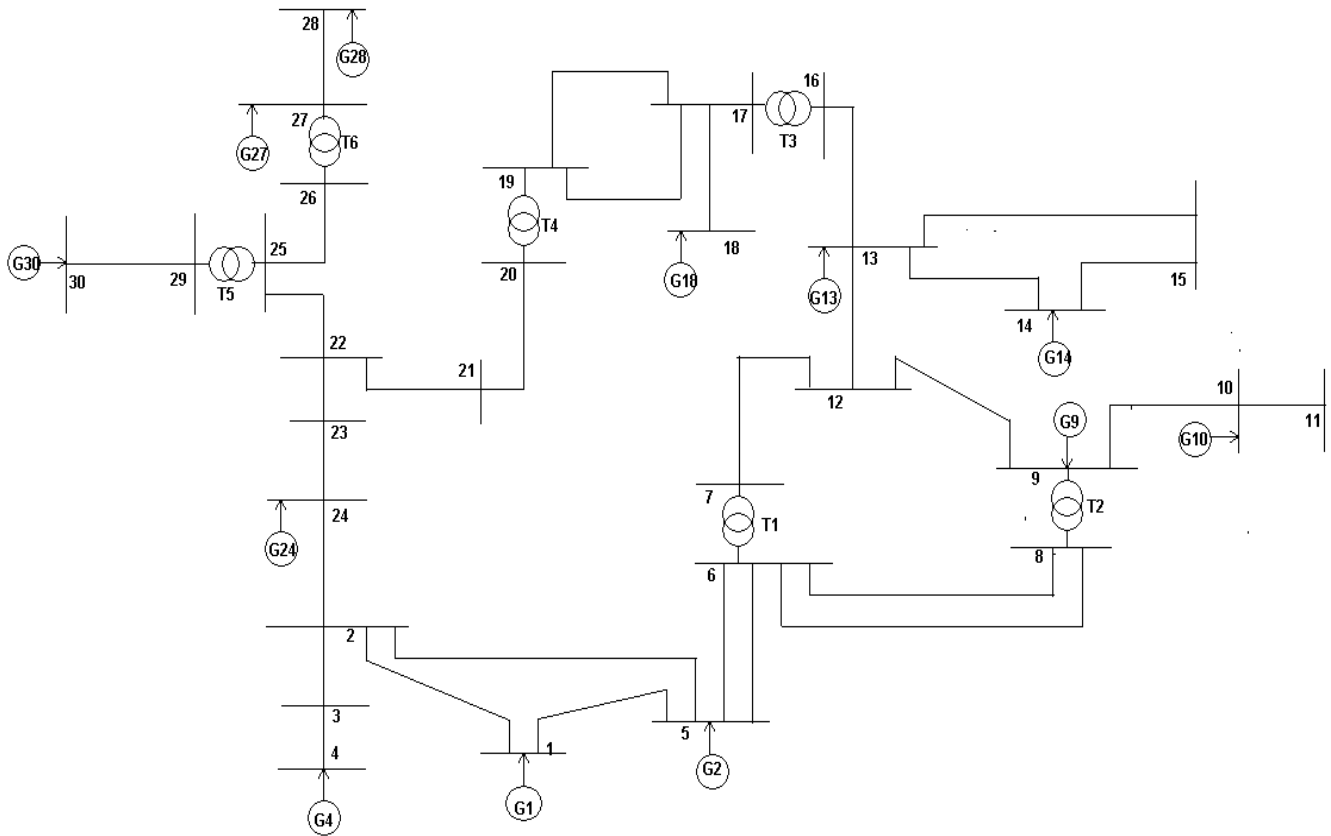

KEY: G-Generating plant, T-Two winding transformer

Figure 1. One-line diagram-Tanzanian Power Network (not to scale)

Table 1. Installed hydro grid generation capacity

Plant Name	Fuel Type	Installed Capacity [MW]	Ownership
Kihansi	Hydro	180.00	TANESCO
Kidatu	Hydro	204.00	TANESCO
Mtera	Hydro	80.00	TANESCO
NPF	Hydro	68.00	TANESCO
Hale	Hydro	21.00	TANESCO
NYM	Hydro	08.00	TANESCO
TOTAL		561.00	

Tanzania Electric Supply Company Limited (TANESCO) owns all of the hydro generating plants in the country and some of the thermal generating plants, although there are some independent power producers (IPPs) owned by private operators. Tables 1 and 2 show the installed grid connected generation capacities for the country. The system presently consists of an interconnected grid and several isolated systems. The model of the interconnected grid is shown in

Figure 1. The interconnected system consists of hydro and thermal generating plants providing power to cities, Municipals and townships.

2.2. High Voltage Transmission Network

TANESCO owns high voltage and low voltage transmission and distribution lines of different voltage levels scattered all over the country. The high voltage transmission lines are estimated to comprise of 2,624.36 km of system voltage 220 kV; 1,441.50 km of 132 kV and 486.00 km of 66 kV, totalling to 4,551.86 km by the end of December 2006 [12]. High voltage transmission lines use pylons made of steel. Almost of all HV transmission lines are radial single circuit lines. The country power system is alternating current (AC) and the system frequency is 50 Hz. The TANESCO grid comprises of: South-West grid, North-West grid and North-East grid. South-East grid is still under planning stage.

South-West grid mostly of 220 kV connects: Ubungo-Morogoro-Kidatu-Kihansi-Iringa-Mufindi-Mbeya.

North-West grid connects: Ubungo-Morogoro-Kidatu-Kihansi-Iringa-Mtera-Dodoma-Singida-Shinyanga-Mwanza (220 kV); Mwanza- Musoma (132 kV)-Shinyanga- Tabora (132 kV)

North-East grid connects: Ubungo-Tegeta-Zanzibar (132 kV); Ubungo-Chalinze- Hale-NPF-Tanga (132 kV); Chalinze – Moshi – Arusha (132 kV); NYM – Moshi (66 kV); Arusha-Babati-Singida (220 kV).

Table 2. Installed thermal grid generation capacity

Plant Name	Fuel Type	Installed Capacity [MW]	Ownership
Songas	Natural gas	202.00	Private
Ubungo	Natural gas	102.00	TANESCO
IPTL	HFO	103.00	Private
Dodoma	IDO	07.44	TANESCO
Mbeya	IDO	13.90	TANESCO
Mwanza	IDO	12.50	TANESCO
Musoma	IDO	02.56	TANESCO
Tabora	IDO	10.20	TANESCO
TOTAL		453.60	

Source: Economic Survey Report: 2007 and 2009

IDO – Industrial Diesel Oil

HFO- Heavy Fuel Oil

3. Materials and Methods

The data used for this study were obtained from TANESCO, Ubungo power station. Computer software programmed using MATLAB 2013 were used in conducting the simulation.

3.1. Modelling of System Components

A state of a power system is defined by its topology i.e. by the list of components in operation at the time of analysis and by the connections between these components. In the load-flow analysis, the system is represented in the nodal topology. The nodal topology can be defined by a graph, the buses of which are electrical buses and branches of which are the transmission system components (lines, cables, transformers).

Models of these components are presented in the following subsections.

3.2. AC synchronous Generator

Two approaches are possible for modelling AC synchronous generators: representing in detail the excitation control system or using approximate models. In system studies where system alternatives must be explored in detail, or when developing protection schemes and operating criteria to maintain the power system stability, accurate modelling is necessary and requires detailed generator models. But in the initial stages of a planning study or in operating studies such as load-flow, simplified models may be adequate for real-time determination of operating limits and for some contingency analysis studies [13]. Thus, the AC synchronous generator is modelled as a voltage-controlled bus with constant real power and voltage.

3.3. Transmission Lines

A transmission line or a cable connecting two buses (Figure 1) i and j is modelled by a π - circuit with series impedance:

$$\bar{z}_{ij} = z_{ij} e^{j\delta_{ij}} = r_{ij} + jx_{ij} \quad (1)$$

And a shunt admittance on the side i

$$\bar{y}_{ij} = g_{ij} + jb_{ij} \quad (2)$$

The π -circuit is symmetrical, thus:

$$g_{ij} = g_{ji} = 0 \quad (3)$$

and

$$b_{ij} = b_{ji} = \frac{C_{ij}\omega}{2} \quad (4)$$

Where

$C_{ij}\omega$ denotes the susceptance

ω is the angular frequency corresponding to the fundamental frequency

C_{ij} is the capacitance

3.4. Regulating Transformer (RT)

Regulating transformers can be used to control real and reactive power flows in a circuit [14]. Regulating transformers (RT) can also be used for control of voltage magnitude as well as phase angle. Thus, it is necessary to develop bus admittance equations that can be included in load flow analysis from regulating transformers. Figure 2 shows a detailed representation of a practical regulating transformer.

Figure 2 shows currents I_i and I_j entering the two buses, and the voltage at these buses are V_i and V_j referred to the reference bus. The complex expression for power into the ideal transformer with turns ratio $l: t$ from bus i and bus j are,

respectively

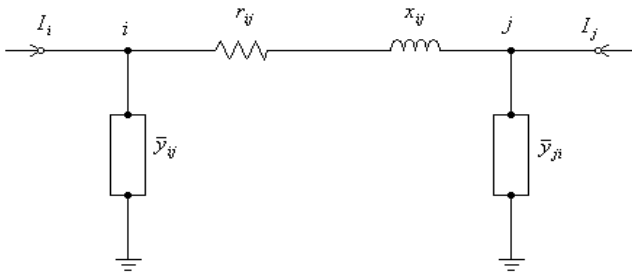


Figure 2. Transmission line representation

$$S_i = V_i I_i^* \tag{5}$$

$$S_j = t V_i I_j^* \tag{6}$$

Assuming the ideal transformer has no losses, the power S_i into the ideal transformer from bus i must equal the power $-S_j$ out of the ideal transformer on the bus j side, so from (5) and (6)

$$\begin{aligned} S_i &= -S_j \\ V_i I_i^* &= -t V_i I_j^* \\ I_i &= -t I_j^* \end{aligned} \tag{7}$$

The current I_j can be expressed by

$$\begin{aligned} I_j &= (V_j - t V_i) Y \\ &= -t Y V_i + V_j Y \end{aligned} \tag{8}$$

Multiplying (8) by $-t^*$ and substituting I_i for $-t^* I_j$ yield:

$$I_i = t t^* Y V_i - t^* Y V_j \tag{9}$$

Setting $t t^* = |t|^2$ and re-arranging (8) and (9) into Ybus admittance matrix form, gives

$$\begin{bmatrix} I_i \\ I_j \end{bmatrix} = \begin{bmatrix} |t|^2 Y & -t^* Y \\ -t Y & Y \end{bmatrix} \begin{bmatrix} V_i \\ V_j \end{bmatrix} \tag{10}$$

The π -equivalent model corresponding to (10) is presented in Figure 3.

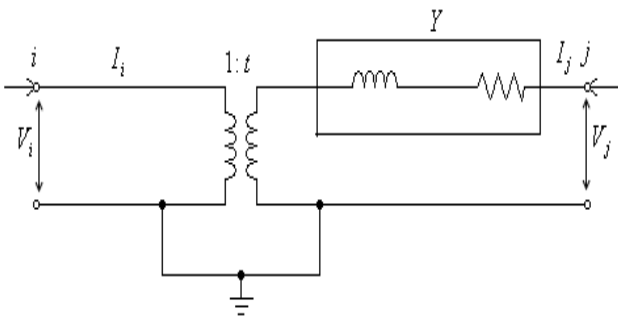


Figure 3. Detailed representation of RT

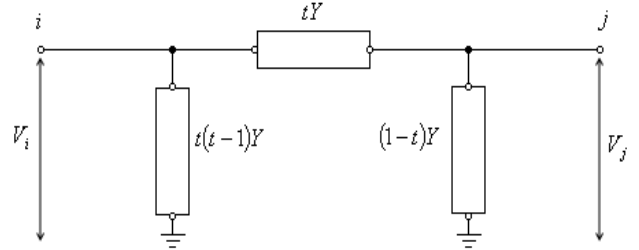


Figure 4. π -equivalent model of RT

3.5. Loads

It has been suggested [15] that the actual load be modelled as linear combination of constant load, constant current and constant impedance. This approach would require considerable knowledge of load composition or knowledge of real and reactive power variation with voltage magnitude. In real power system, load models are categorized as static models or dynamic models. Static models normally express the characteristic of the load at any instant of time as algebraic function of the bus voltage magnitude and frequency at that instant time. In this way the real power component P and the reactive power component Q are considered separately. The load characteristic in terms of voltage for static loads is represented by exponential model:

$$P = P_0 \left(\frac{V}{V_0} \right)^a \tag{11}$$

$$Q = Q_0 \left(\frac{V}{V_0} \right)^b \tag{12}$$

Where

P and Q are real and reactive components of the load when the load voltage magnitude is V . Subscript “0” identifies the values of the respective variables at the initial operating conditions

The parameters for static load the exponents “ a ” and “ b ”. When these exponents are equal to 0, 1, 2 [15] the static load model represents constant power, constant current or constant impedance characteristic, respectively. In case of composite load, their parameter values depend on the aggregate characteristics of load components. In this study static model type of loads is adopted.

4. System Network Modelling

Given a bus load and specified voltage magnitudes/power injections at generation buses, usually conventional load flow analysis determines the steady-state operating condition of a power system based on the bus/branch network model. Such a network model is produced by merging adjacent substation buses present at the actual bus-section level topology.

The basic power flow equations are obtained by applying the Kirchhoff’s laws to the network represented by the bus/branch model. The results can be grouped as either nodal

or branch equations. The nodal equations for an N-bus network are the real and reactive power injections at each bus, given by [16-17].

$$P_i = V_i \sum_{j=1}^N V_j (G_{ij} \cos \delta_{ij} + B_{ij} \sin \delta_{ij}) \quad (13)$$

$$i = \overline{1, N}$$

$$Q_i = V_i \sum_{j=1}^N V_j (G_{ij} \sin \delta_{ij} - B_{ij} \cos \delta_{ij}) \quad (14)$$

$$i = \overline{1, N}$$

where

$$\delta_{ij} \triangleq \delta_i - \delta_j$$

V_i, V_j : voltage magnitudes at buses i and j

δ_i, δ_j : bus voltage angles at buses i and j

P_i : real power injection at bus i

Q_i : reactive power injection at bus i

$G_{ij} + B_{ij}$: entry (i, j) of the nodal admittance matrix

The branch equations provide the real and reactive power flows through the branches of the network, which are respectively, given by [17]

$$P_{ij} = V_i V_j (G_{ij} \cos \delta_{ij} + B_{ij} \sin \delta_{ij}) - V_i^2 G_{ij} \quad (15)$$

$$Q_{ij} = V_i V_j (G_{ij} \sin \delta_{ij} - B_{ij} \cos \delta_{ij}) + V_i^2 (B_{ij} - b_{ij}^{shunt}) \quad (16)$$

where

P_{ij} : real power flow through branch $i - j$

Q_{ij} : reactive power flow through branch $i - j$

b_{ij}^{shunt} : shunt susceptance of branch $i - j$

Equations (15) and (16) can be extended to represent the power flow through tap-changing and phase-shifting transformers as given in [15]. Power injections given by (13) and (14) can also be written as the sum of the real power flow through the branches incident to bus p that is given in [15]

$$P_i = \sum_{j \in \Omega_i} P_{ij}(V_i, V_j, \delta_i, \delta_j) \quad (17)$$

$$i = \overline{1, N}, j \neq i$$

$$Q_i = -b_i^{shunt} V_i^2 + \sum_{j \in \Omega_i} Q_{ij}(V_i, V_j, \delta_i, \delta_j) \quad (18)$$

$$i = \overline{1, N}, j \neq i$$

where Ω_i : Set of buses adjacent to bus i (bus i not included)

b_i^{shunt} : Shunt susceptance at bus i

5. Load Flow Problem Formulation

The load flow problem is formulated as a set of non-linear algebraic equations, normally represented by (13) and (14) and a set of inequality relationship to take into account operating limits such as reactive power injections/voltage magnitudes at generation buses. The problem solvability is guaranteed by the classical bus classifications: Slack/reference bus (V- δ), voltage-controlled/regulated buses (P-V) and load buses (P-Q) [16] and [18]. Load flow usually defines a single bus i.e. reference bus, which plays a double function: it provides the phase reference angle, and since the transmission losses are unknown in advance, this bus is used to balance generation losses and load [15] and [18].

Consider an electrical power system (the Tanzanian system) comprising of n_L buses, n_{PV} generation buses and one reference bus. The vector of state variables i.e. voltage magnitudes and phase angles determined by the load flow formulation is given by:

$$x = [V^T, \delta^T] \quad (19)$$

where

$\delta = (n_L, n_{PV})$ Vector of phase angles

$V = n_L$ Vector of voltage magnitudes

The set of equality equations, which represents the system of power flow problem, is given by [18-19]

$$f(x) = \begin{bmatrix} \Delta P \\ \Delta Q \end{bmatrix} = \begin{bmatrix} P_{Sche} & -P(V, \delta) \\ Q_{Sche} & -Q(V, \delta) \end{bmatrix} = 0 \quad (20)$$

where

ΔP and ΔQ is the real and reactive vector of power mismatches, respectively

P_{sche} and Q_{sche} the vectors of scheduled values of real and reactive power injections, respectively

P and Q are vectors of non-linear equations of real and reactive power injections, represented in equations (15) and (16), respectively

5.1. Load Flow Solution Using Newton-Raphson Method

The following linear system is generated when applying Newton-Raphson method to solve eqn (20) [5], [14], [18], [19] and [20-21]:

$$\begin{bmatrix} \Delta P \\ \Delta Q \end{bmatrix}^k = J(x^k) \begin{bmatrix} \Delta \delta \\ \Delta V \end{bmatrix}^k \quad (21)$$

where

k : the iteration counter

$J(x^k)$: the problem's Jacobian matrix given by

$$J(x^k) = \begin{bmatrix} J_1 & J_2 \\ J_3 & J_4 \end{bmatrix}^k = \begin{bmatrix} \frac{\partial P}{\partial \delta} & \frac{\partial P}{\partial V} \\ \frac{\partial Q}{\partial \delta} & \frac{\partial Q}{\partial V} \end{bmatrix}^k \quad (22)$$

If m buses of the system are PV, m equations involving ΔQ and ΔV and the corresponding column of the Jacobian matrix are eliminated because for PV buses, the voltage magnitudes are known. Accordingly, there are $n-1$ real power constraints and $(n-1-m)$ reactive power constraints, and the Jacobian matrix is of order $(2n-2-m) \times (2n-2-m)$.

J_1 is of the order $(n-1) \times (n-1)$

J_2 is of the order $(n-1) \times (n-1-m)$

J_3 is of order the $(n-1-m) \times (n-1)$

J_4 is of the order $(n-1-m) \times (n-1-m)$

The load flow solution can be iteratively obtained by solving the linear system represented in Eqn (21). The voltage magnitudes and phase angles are updated as:

$$\begin{aligned} \delta^{k+1} &= \delta^k + \Delta\delta \\ V^{k+1} &= V^k + \Delta V \end{aligned} \tag{23}$$

Until convergence is obtained

The procedure for load flow solution by the Newton-Raphson method is given in flow chart of Figure 5.

6. Results

6.1. Input Data

Input data for load flow simulation are given in Tables 3 and 4. Table 3 gives the transmission lines of the Tanzanian Network while Table 4 provides power generation and demand of all buses in the system.

6.2. Simulation

Table 3. Linedata 30-Bus Tanzania System Network

From	To	Impedance	Half of line charging	Tap ratio setting
1	2	0.012+j0.081	0.00+j0.065	1.00
2	3	0.020+j0.111	0.00+j0.085	1.00
1	5	0.039+j0.154	0.00+j0.122	1.00
2	5	0.025+j0.136	0.00+j0.010	1.00
2	24	0.016+j0.090	0.00+j0.068	1.00
3	4	0.034+j0.019	0.00+j0.143	1.00
5	6	0.014+j0.011	0.00+j0.087	1.00
6	7	0.00+j0.274	0.00+j0.00	1.00
6	8	0.018+j0.015	0.00+j0.117	1.00
7	12	0.086+j0.196	0.00+j0.020	1.00
8	9	0.00+j0.062	0.00+j0.00	1.00
9	10	0.043+j0.098	0.00+j0.00	1.00
9	12	0.010+j0.232	0.00+j0.024	1.00
10	11	0.052+j0.030	0.00+j0.00	1.00
12	13	0.018+j0.418	0.00+j0.043	1.00
13	14	0.009+j0.027	0.00+j0.00	1.00
13	15	0.063+j0.014	0.00+j0.00	1.00
14	15	0.049+j0.014	0.00+j0.00	1.00
13	16	0.026+j0.597	0.00+j0.062	1.00
16	17	0.00+j0.7373	0.00+j0.00	1.00
17	19	0.036+j0.716	0.00+j0.00	1.00
18	17	0.018+j0.037	0.00+j0.00	1.00
20	19	0.00+j0.1416	0.00+j0.00	1.00
20	21	0.023+j0.014	0.00+j0.111	1.00

From	To	Impedance	Half of line charging	Tap ratio setting
21	22	0.021+j0.131	0.00+j0.100	1.00
22	23	0.033+j0.017	0.00+j0.137	1.00
23	24	0.021+j0.012	0.00+0.081	1.00
22	25	0.034+j0.188	0.00+j0.143	1.00
25	26	0.022+j0.118	0.00+j0.095	1.00
25	29	0.00+j0.160	0.00+j0.00	1.00
26	27	0.00+j0.160	0.00+j0.00	1.00
27	28	0.263+j0.597	0.00+j0.061	1.00
29	30	0.021+j0.485	0.00+j0.041	1.00

Table 4. Busdata 30-Bus Tanzania System Network

Bus No.	Load demand		Generation	
	MW	MVAr	MW	MVAr
1	-	-	-	-
2	06.20	01.60	-	-
3	20.00	07.00	-	-
4	27.00	07.80	14	-
5	-	-	142.00	-
6	18.00	09.10	-	-
7	00.00	00.00	-	-
8	233.10	45.10	-	-
9	-	-	259.00	-
10	-	-	100.00	-
11	17.60	09.00	-	-
12	12.00	02.50	-	-
13	-	-	10.50	-
14	-	-	68.00	-
15	21.00	08.30	-	-
16	23.10	09.00	-	-
17	00.00	00.00	-	-
18	-	-	03.60	-
19	22.00	05.00	-	-
20	00.00	00.00	-	-
21	06.50	01.20	-	-
22	05.00	01.40	-	-
23	06.20	01.60	-	-
24	-	-	74.00	-
25	21.70	09.00	-	-
26	29.70	09.60	-	-
27	-	-	13.00	-
28	11.50	05.00	-	-
29	00.00	00.00	-	-
30	05.40	01.50	-	-

A computer program has been developed in MATLAB environment to implement the load flow described in section 5. MATLAB software development is based on [22]. The MATLAB software comprises of 7 files namely: LF30.m, this file runs the software. Other files include: LD30, BD30, Lfybus.m, Lfnewton.m, Lineflow.m and Busout.m. LD30 and BD 30 are excel files describe arrangement of transmission line data given in Table 3 and bus data of the system of Table 4. LD and BD files were prepared according to IEEE Data Format from [23]. These MATLAB and Excel files must be in the same current directory in order to implement the load flow analysis. The files are used in sequence to calculate and display load flow solution in the MATLAB command

window. The summary of the MATLAB software can be found in Table 5. Algorithm used in developing the MATLAB software is given in Figures 7a and 7b.

The MATLAB computer software was test using a PC with CPU Pentium IV, 3.33 GHz and 0.99 GB of RAM. The efficiency of the software was demonstrated by IEEE standard bus test systems IEEE14, IEEE30 and later on the 30-bus system of the Tanzanian network. The approximate one-line diagram model of the Tanzanian network shown in Figure 1 comprises of 12 generating plants (hydro and thermal), 6 power transformers, and 17 load centres. All power transformers of the system are assumed to be two-winding transformers. Voltage magnitudes for voltage controlled buses were not set at

6.3. Computational Results

Table 5. MATLAB files for computation of load flow

File	Description
LF30	M-file to run the software
LD30	Excel-file giving transmission line parameters
BD30	Excel-file giving bus data
Lfybus.m	M-file which calculates bus admittance matrix
Lfnewton.m	M-file which calculates load flow using Newton-Raphson algorithm
Lineflow.m	M-file which calculates line-flow and losses of the system
Busout.m	M-file which prints the output on the computer screen in tabular form

VOLTAGE MAGNITUDE PROFILE-TANZANIAN NETWORK

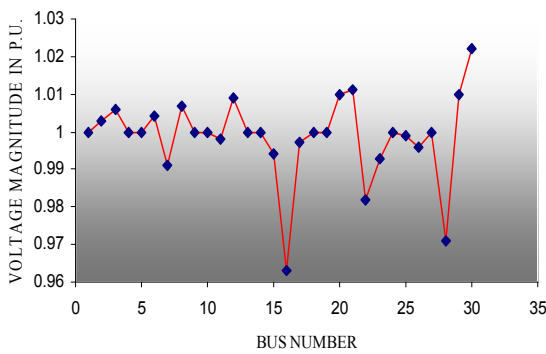


Figure 5. Voltage magnitude profile-Tanzanian Network

VOLTAGE ANGLE PROFILE-TANZANIAN NETWORK

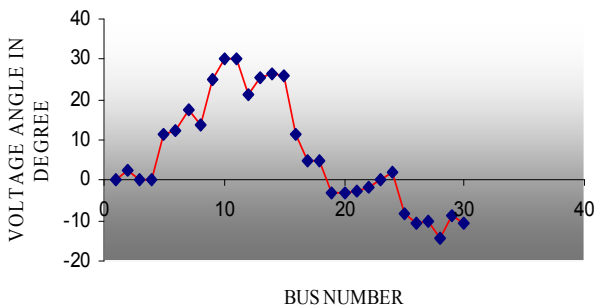


Figure 6. Voltage angle profile-Tanzanian Network

Table 6. Voltage magnitude and Voltage angle profiles: Tanzania network

Bus No.	Volt. Mag. [p.u.]	Volt. Angle [Deg.]	Bus No.	Volt. Mag. [p.u.]	Volt. Angle [Deg.]
1	1.000	00.000	16	0.963	11.595
2	1.003	02.559	17	0.997	04.743
3	1.006	00.373	18	1.000	04.761
4	1.000	00.370	19	1.000	-03.155
5	1.000	11.197	20	1.010	-02.913
6	1.004	12.328	21	1.011	-02.843
7	0.991	17.351	22	0.982	-01.932
8	1.007	13.749	23	0.993	00.330
9	1.000	24.783	24	1.000	02.016
10	1.000	30.183	25	0.999	-08.438
11	0.998	30.148	26	0.996	-10.413
12	1.009	21.2000	27	1.000	-10.309
13	1.000	25.460	28	0.971	-14.481
14	1.000	26.367	29	1.010	-08.929
15	0.994	26.013	30	1.022	-10.415

Computational results are divided into A and B parts. Part A refers to results from IEEE 14 and IEEE 30 bus test systems. These results are presented to check the convergence characteristics of the developed MATLAB software. Part B presents result from the Tanzanian network model; computational result from this system are used to validate the one-line diagram model as well as validity of input data collected from Tanzania Electric Supply Company Limited (TANESCO). The computational results obtained after simulation are presented in both tabular and graphical form. Table 6 shows the corresponding voltage magnitude and voltage angle profile of the Tanzanian network. Table 7 presents a summary of load flow results of other IEEE standard bus test systems including the Tanzanian network. The aim of presenting this summary is to make comparison of/observe iteration counts for different IEEE bus test systems, maximum power mismatch; CPU time elapsed till convergence, total system loss, total MVAR system loss, and accuracy of the MATLAB software if it remains within pre-defined tolerance for all test systems. Figures 5 shows voltage magnitude profile and Figure 6 presents voltage angle profile of the Tanzania network.

Table 7. Summary of load flow results

Test System	IEEE 14	IEEE 30	Tanzanian Network
Number of Lines	20	41	33
Transformer Tap setting	FIXED	FIXED	FIXED
Max. Power Mismatch	1.15E-008	1.20E-008	7.17E-007
No. of Iterations	10	9	4
Comp. Accuracy	0.0001	0.0001	0.0001
CPU time [Seconds]	2.270	3.191	3.088
Injected MVAR	00.00	00.00	00.00
Total MVAR Loss	31.618	23.611	-171.028
Total System Loss	13.483	17.730	28.041

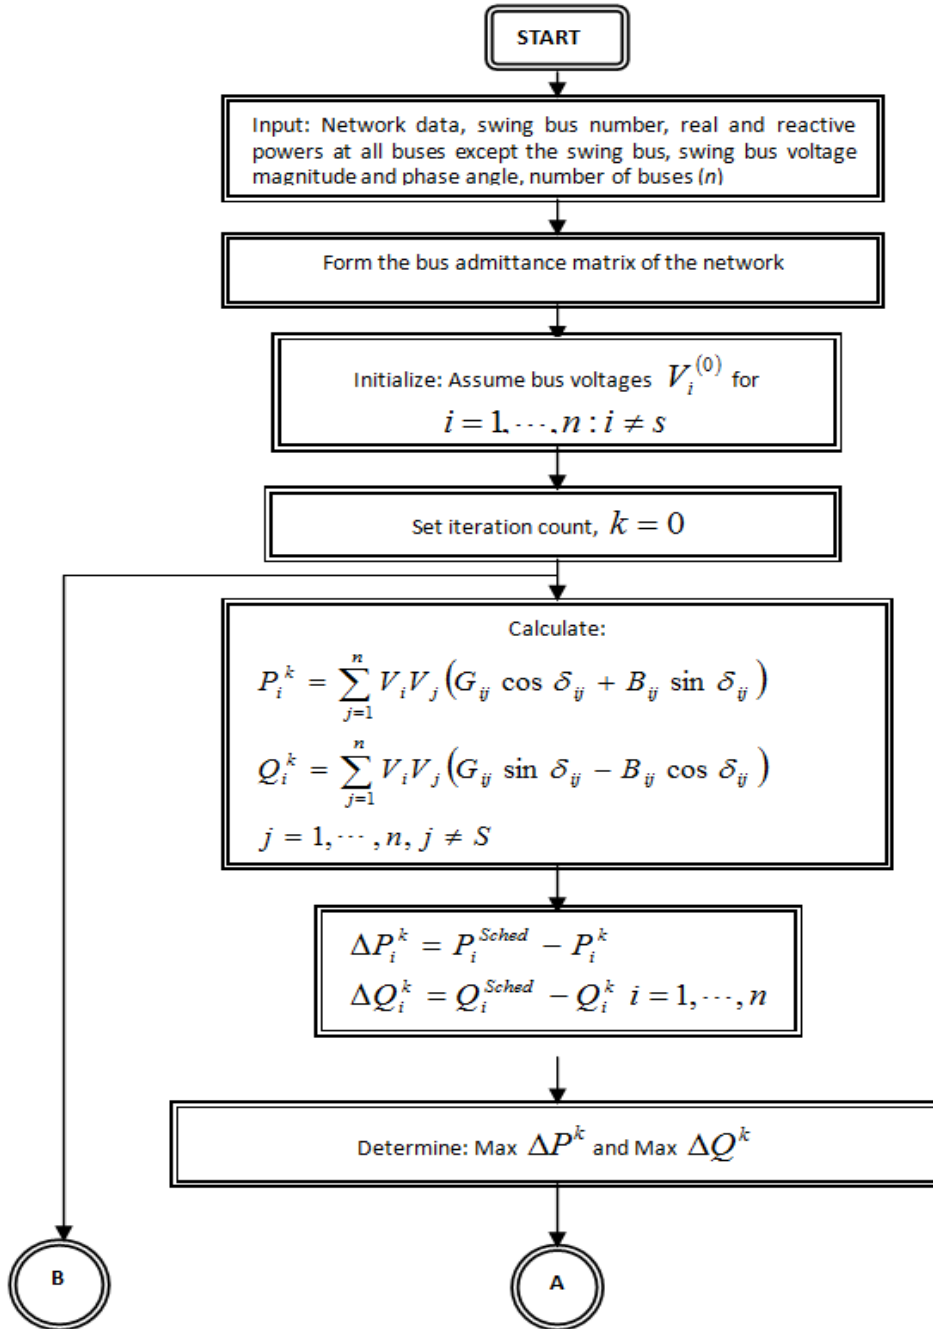


Figure 7a. Newton-Raphson Algorithm in Flowchart Format

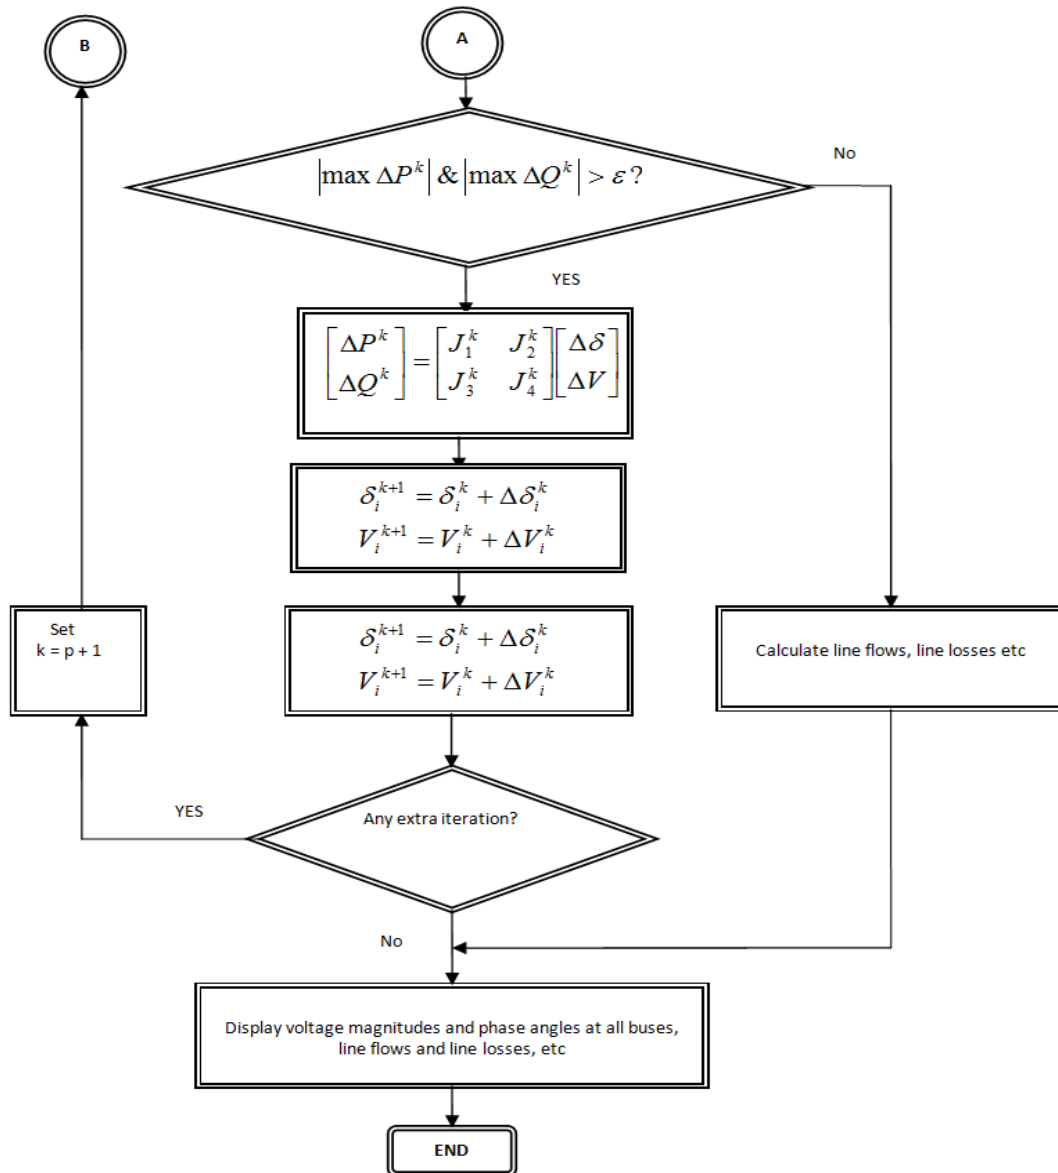


Figure 7b. Newton-Raphson Algorithm in Flowchart Format

7. Discussion

The following observations from simulation results can be made. The load flow solution for the Tanzanian network has a maximum power mismatch of about 7.17×10^{-7} ; and converged after 4 numbers of iterations. The total real and reactive power losses in the system during this particular scenario were 20.041 MW and -171.028 MVar. The voltage magnitude and voltage angle profiles of the Tanzanian power network are within acceptable limits i.e. 0.95-1.10 per unit for voltage magnitude and -35° - $+35^{\circ}$ degree for voltage angle. The power factor (pf) of the system is around 0.868 ($+30^{\circ}$ degree) which is the operating value required by TANESCO. It means that the selection of system components and modelling procedure was successful. Also, it means that the high voltage transmission system has the required nominal capacity to meet the current power demand.

8. Conclusion

This paper has presented an overview of the Tanzanian power network structure. Modelling procedure of critical system components for load flow analysis and their corresponding models have been developed and presented. An approximate model of the Tanzanian power network model is built from the developed models and used in load flow analysis. The load flow problem, which involves in determining voltage, and line flow in an electrical network is discussed and then formulated using Newton-Raphson algorithm. Algorithm formulation in form of flowchart and MATLAB software for simulation as well as results from simulation are developed and presented.

The load flow solution presented in this paper forms the basis for future investigation and development of MATLAB software as an alternative to PSS/E software. In addition, the

results can be used in other critical studies such as power system state estimation (PSSE), optimal power flow (OPF), security constrained optimal power flow (SCOPF) etc of the Tanzanian power network.

Acknowledgement

I would like to thank the Tanzania Electric Supply Company Limited (TANESCO) for its cooperation and readiness to supply most of the needed data and information to make this work possible. Their support is gratefully acknowledged.

References

- [1] W.F. Tinney & C.E. Hart, Power flow solution by Newton's method, *IEEE Transactions on Power Apparatus and Systems*, Vol. PAS-86, November 1967: 1447-1460
- [2] A.O. Ekwue, & J.F. Macqueen, Comparison of Load Flow Solution Methods, *Electric power System Research* 22 (1991): 213-222
- [3] L. Srivastava, S.C. Srivastava & L.P. Singh, Fast decoupled load flow methods in rectangular coordinates, *Electrical Power and Energy Systems* (1991): 160-166
- [4] A.E. Guile & W.D. Paterson, *Electrical Power Systems*, Vol.2,(Pergamon Press, 2nd Edition, 1977)
- [5] W.D. Stevenson Jr, *Elements of Power System Analysis* (McGraw-Hill, 4th Edition, 1982)
- [6] B. Stott, Effective starting process for Newton-Raphson load flows, *IEE Proceeding*, 118, No. 8, August 1971: 983-987
- [7] W.F. Tinney & W.L. Powel, Notes on Newton-Raphson method for solution of AC power flow problem, *IEEE Short course*, Power System Planning, 1971
- [8] B. Stott, Fast decoupled Newton Load flow, *IEEE Transactions on Power Apparatus and Systems*, Vol. PAS-91, October 1972: 1955-1959
- [9] B. Stott & O. Alsac, Fast decoupled load flow, *IEEE Transactions on Power Apparatus and Systems*, Vol. PAS-83, 1974: 859-869
- [10] <http://www.tanESCO.com/national.html>
- [11] <http://www.tanESCO.com/generation.html>
- [12] <http://www.tanESCO.com/trans.html>
- [13] S.S. Vadhera, *Power System Analysis and Stability* (Khanna Publishers, 1st Edition, 1981)
- [14] J.J.Grainger & W.D. Stevenson Jr. *Power System Analysis* (McGraw-Hill, Inc. Singapore, 1994)
- [15] J.A. Momoh, *Electric Power System Application of Optimization* (CRC Press, 2nd Edition, 2009)
- [16] A. Monticelli, *State Estimation in Electric Power Systems: A Generalized Approach*. (Norwell, MA: Kluwer, 1999)
- [17] J. Arrilaga, C.P.Arnold & B.J. Harker, *Computer Modelling of Electrical Power Systems*. (New York: Wiley, 1983)
- [18] A.G. Exposito, *Analisis y operacion de sistemas de energia Electrica-Madrid Spain* (McGraw-Hill/Interamerican de Espana, 2002)
- [19] H.Saadat, *Power System Analysis. International Edition* (McGraw-Hill, Singapore, 2nd Edition, 2004)
- [20] A.R. Bergen & V.Vittal, *Power System Analysis, International Edition* (Pearson Prentice Hall, 2nd Edition, 2000)
- [21] L. Powel, *Power System Load Flow Analysis*. (McGraw-Hill, New York, 2004)
- [22] F.L. Alvarado, Solving Power flow Systems with MATLAB implementation of the Power System Application Data Dictionary, *Proceedings of the 32nd Hawaii International Conference on System Science* , Hawaii, USA , 1999, 1-7
- [23] <http://www.ee.washington.edu/research/pstca>