



Online Short-term Solar Power Forecasting

Bacher, Peder; Madsen, Henrik; Nielsen, Henrik Aalborg

Publication date:
2011

Document Version
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

Citation (APA):
Bacher, P., Madsen, H., & Nielsen, H. A. (2011). *Online Short-term Solar Power Forecasting*. Poster session presented at 1st International Workshop on Integration of Solar Power into Power Systems, Aarhus, Denmark. <http://www.solarintegrationworkshop.org/>

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Online Short-term Solar Power Forecasting

Peder Bacher, Henrik Madsen, and Henrik A. Nielsen


This poster presents two approaches to online forecasting of power production from PV systems. The methods are suited for online forecasting in many applications and here they are used to predict hourly values of solar power for horizons up to 32 hours.

Observed solar power and numerical weather predictions


The data used is hourly observations of solar power from a single 4 kW-peak PV-system located on a rooftop in a small village in Denmark. The entire year of 2006 is covered. The numerical weather predictions (NWP) are provided by the Danish Meteorological Institute (DMI) using the HIRLAM mesoscale NWP model. The NWP have a calculation time of 4 hours and a time resolution of 3 hours.

Two-stage approach using a clear-sky model

One approach is to use a two-stage method in which a statistical normalization of the solar power is obtained using a clear sky model. The clear sky model is found using statistical smoothing techniques, which ensure that local phenomena are directly modelled from data, as opposed to applying a deterministically derived clear sky model. In the second stage forecasts of the normalized solar power are calculated using adaptive linear time series models.

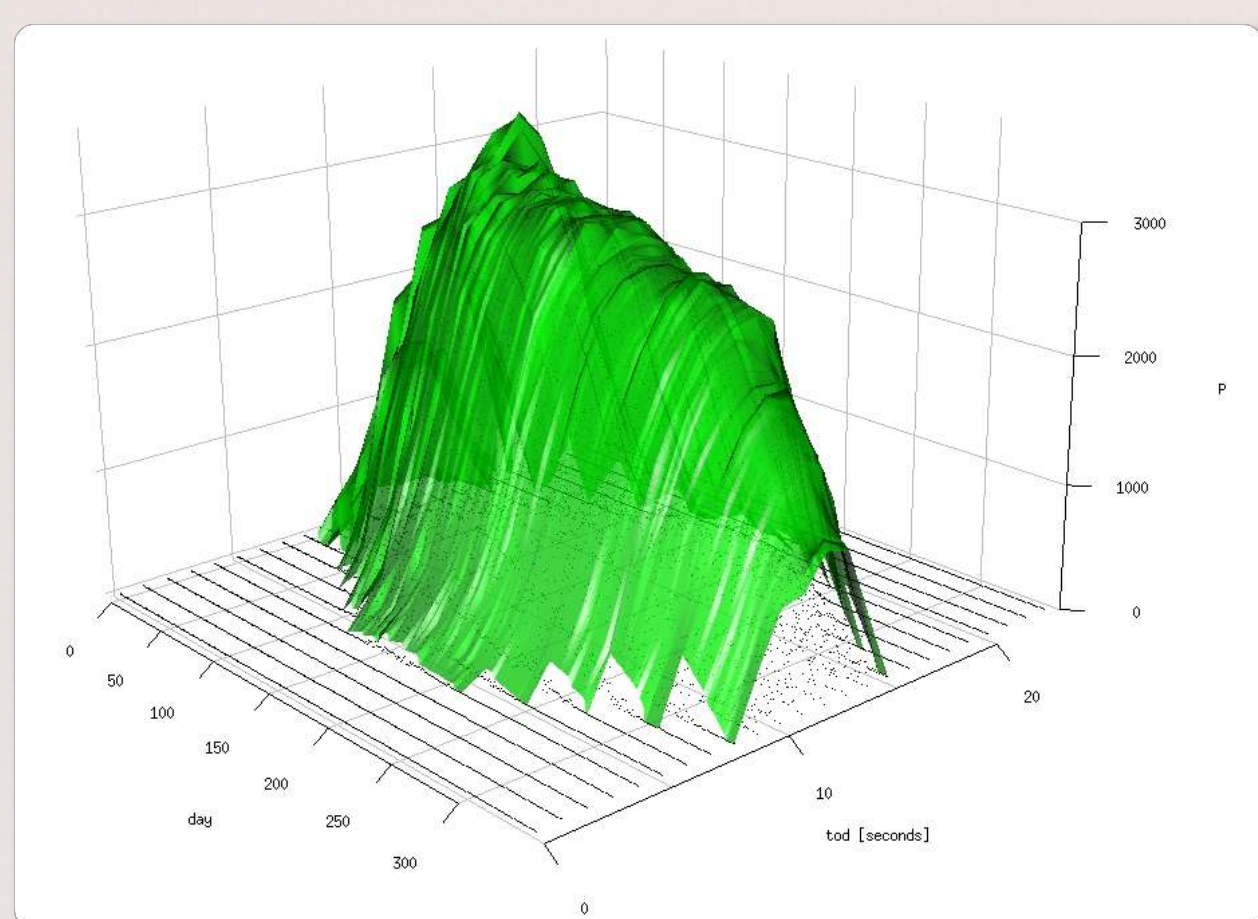

The estimated clear sky solar power.

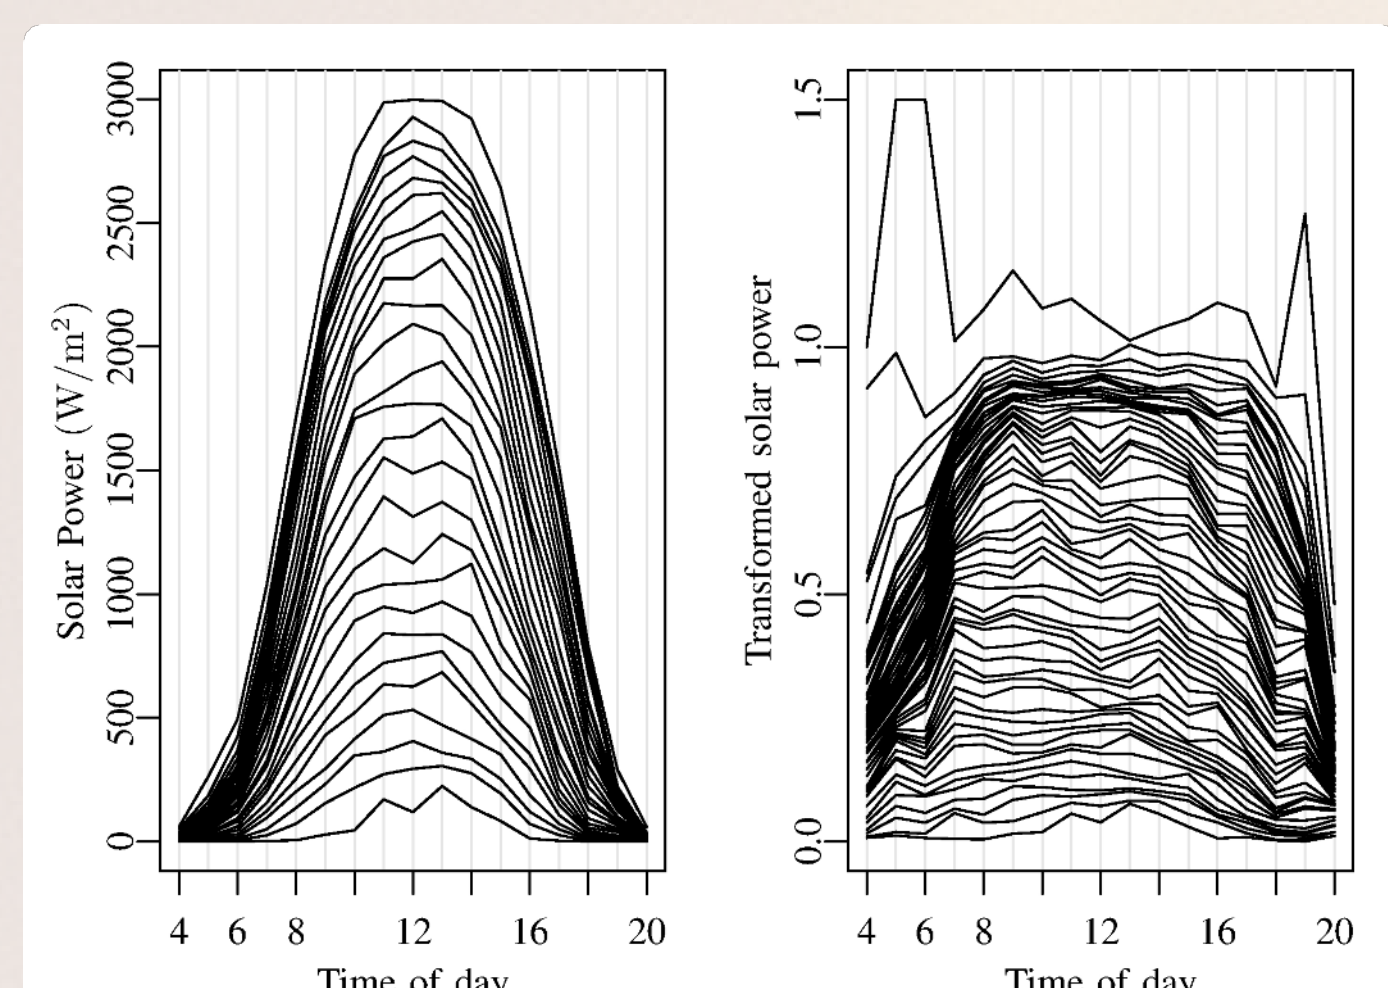


The 0%, 4%, ..., 100% quantiles of the distribution of the solar power and the normalized solar power conditioned on the time of day. Values above 1.5 has been clipped, which was the case for 6 values.

Direct approach using conditional parametric models

A second approach is to use conditional parametric models with both autoregressive input and NWP's exogenous input. The coefficients are conditional on the time of day and time of year. The models are applied with both past solar power observations and NWP's as inputs. Plots of the fitted forecasting function for $k=24$ hours are shown in the figure below.

It is seen how the slope of the function is lower in the morning, than in the middle of the day. This is naturally caused by the higher angle of incidence in the morning, which cause less horizontal radiation to be absorbed due to reflection. Likewise for the afternoon. Finally, non-linearity in the fitted function is seen.

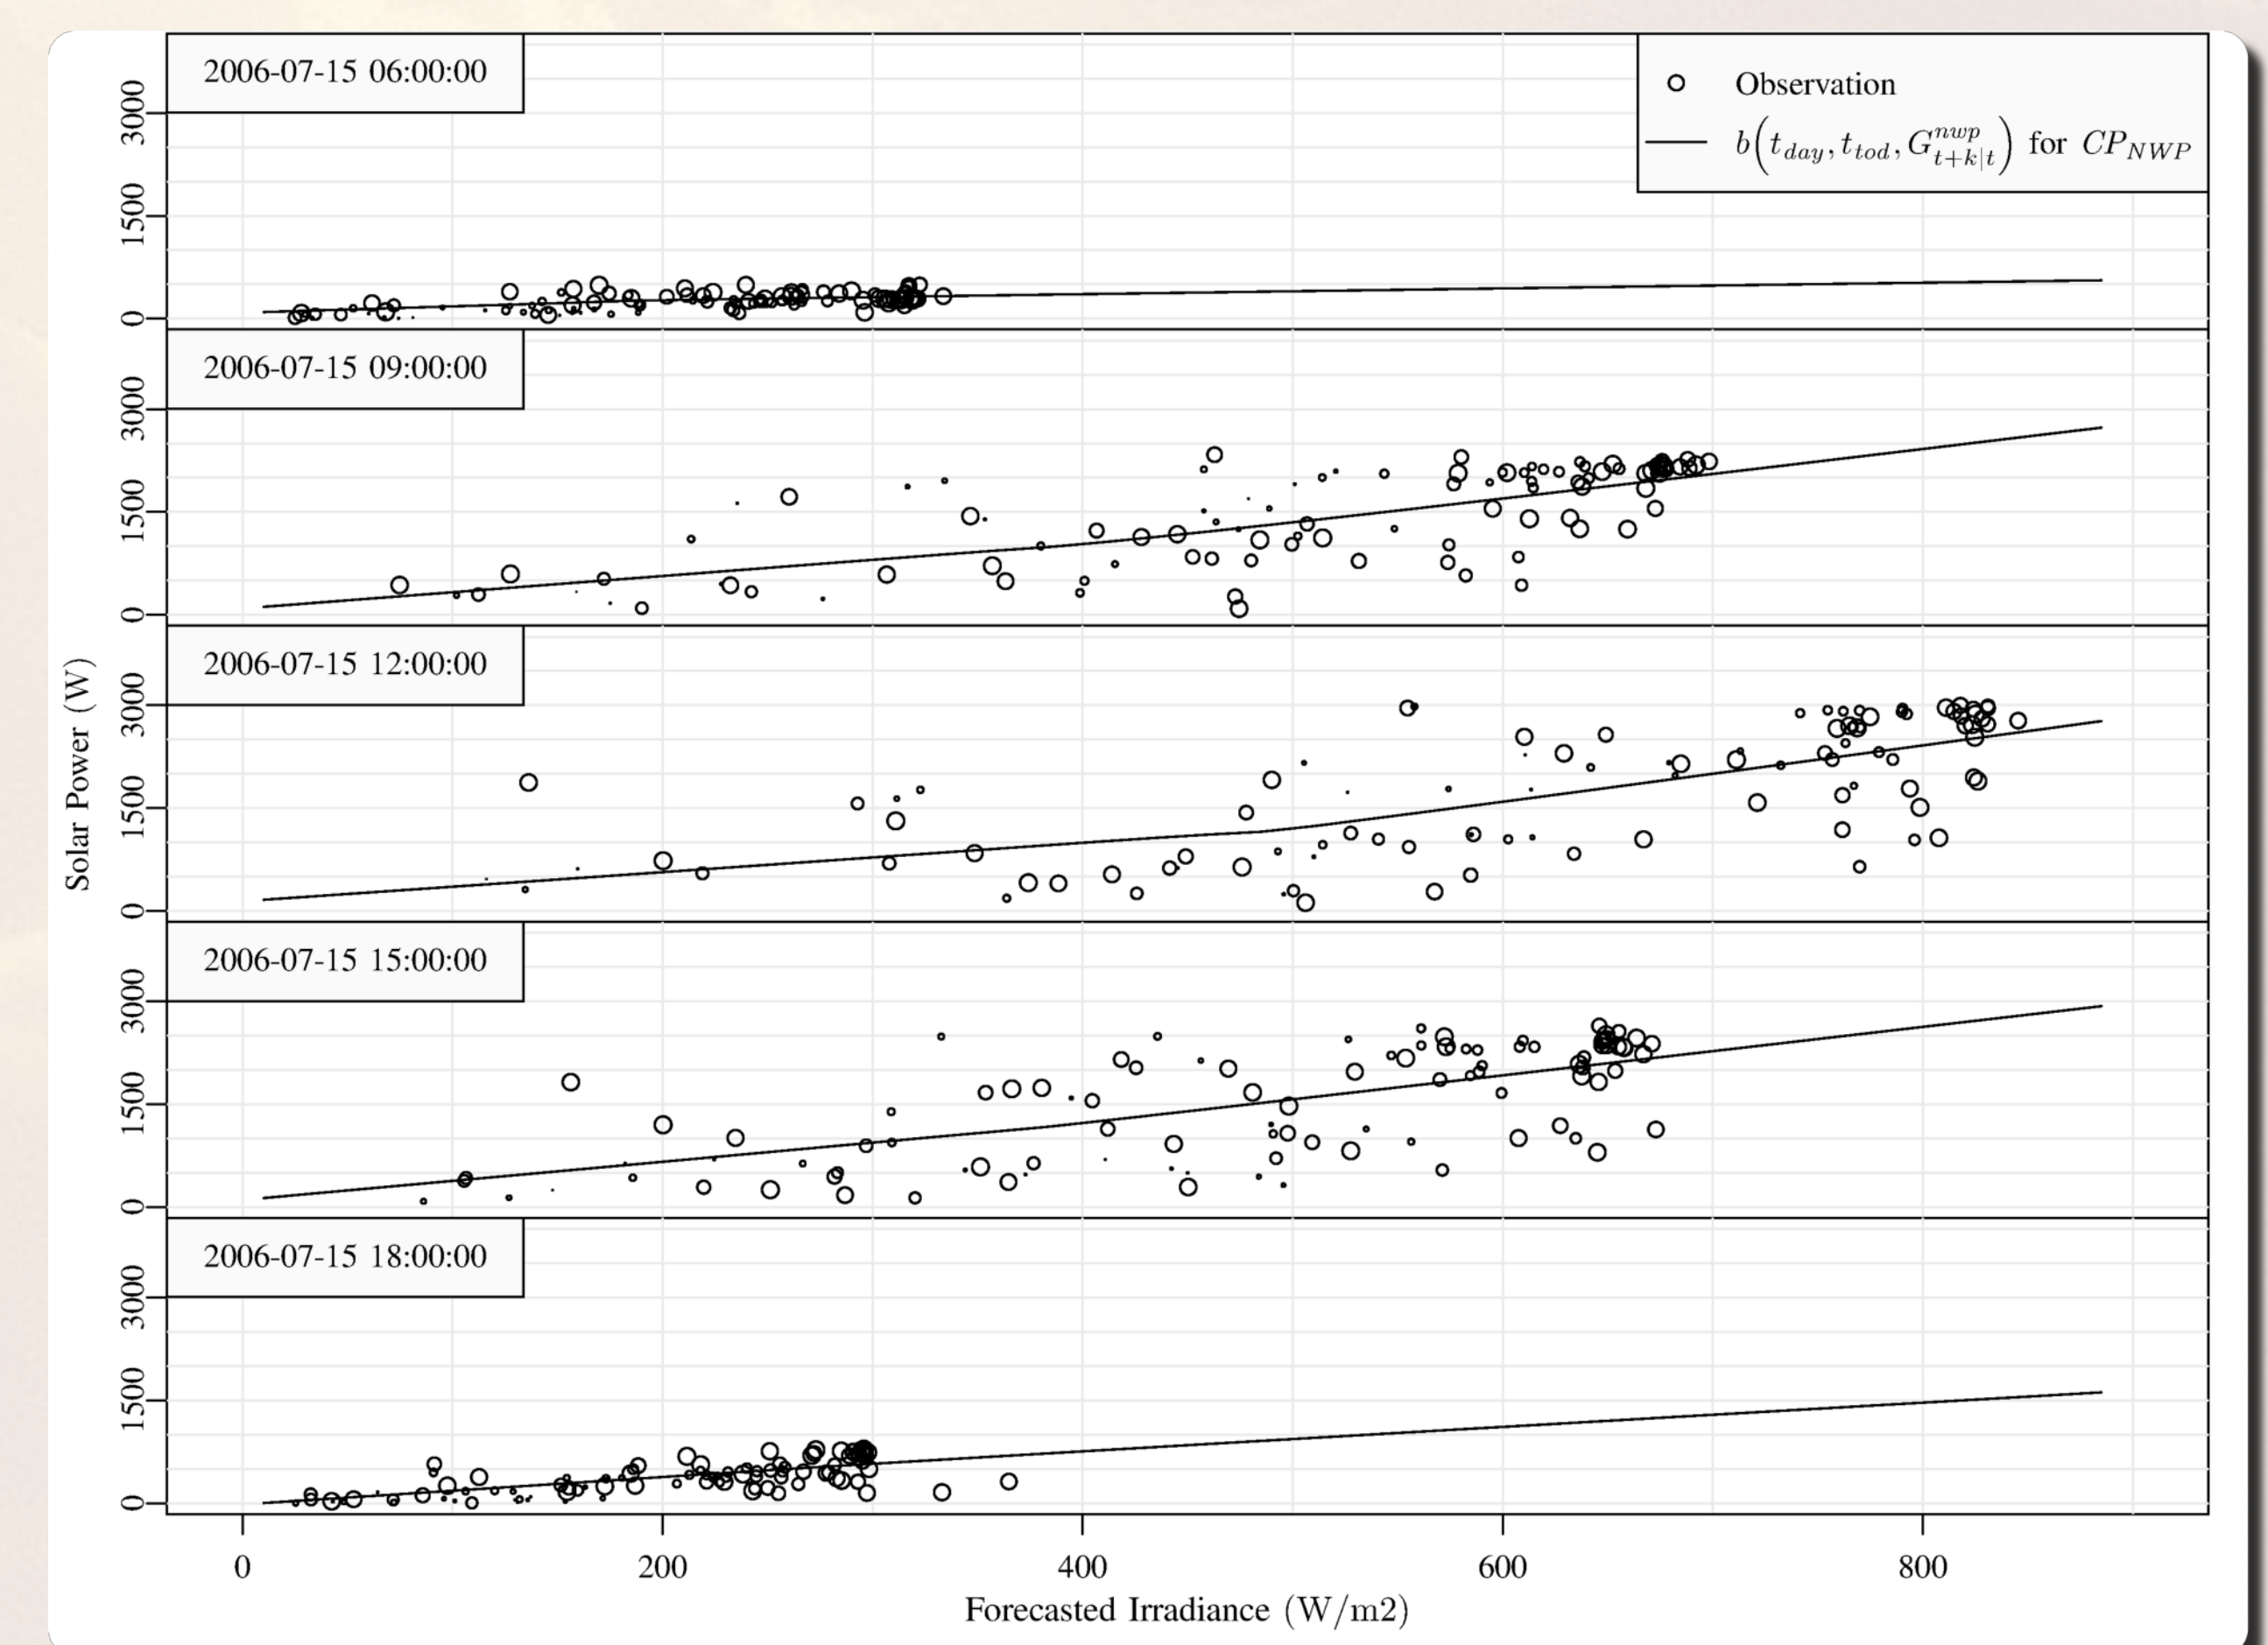


Examples of the function fitted for $k=24$ hours forecasting with the NWP's of global radiation at different times of the day on the 15th of July 2010 for the conditional model with NWP's as input. For each observation the size of circle indicates the weighting of the observation. Thus observations with a larger circle have more influence on the fitted function.

Results

The performance is evaluated for each k hours horizon with the root mean square error (RMSE) and the completeness, the latter is the ratio of the total sum of solar power and the summed solar power for time points where the forecasts are not missing.

The following models are evaluated:

- **Ref** A reference persistence model
- **AR** Auto-regressive model forecasting the normalized solar power
- **CP_P** Conditional parametric model with solar power input
- **CP_{NWP}** Conditional parametric model with NWP's
- **$CP_{NWP,P}$** Conditional parametric model with NWP's and solar power
- **ARX** Auto-regressive including NWP's as input

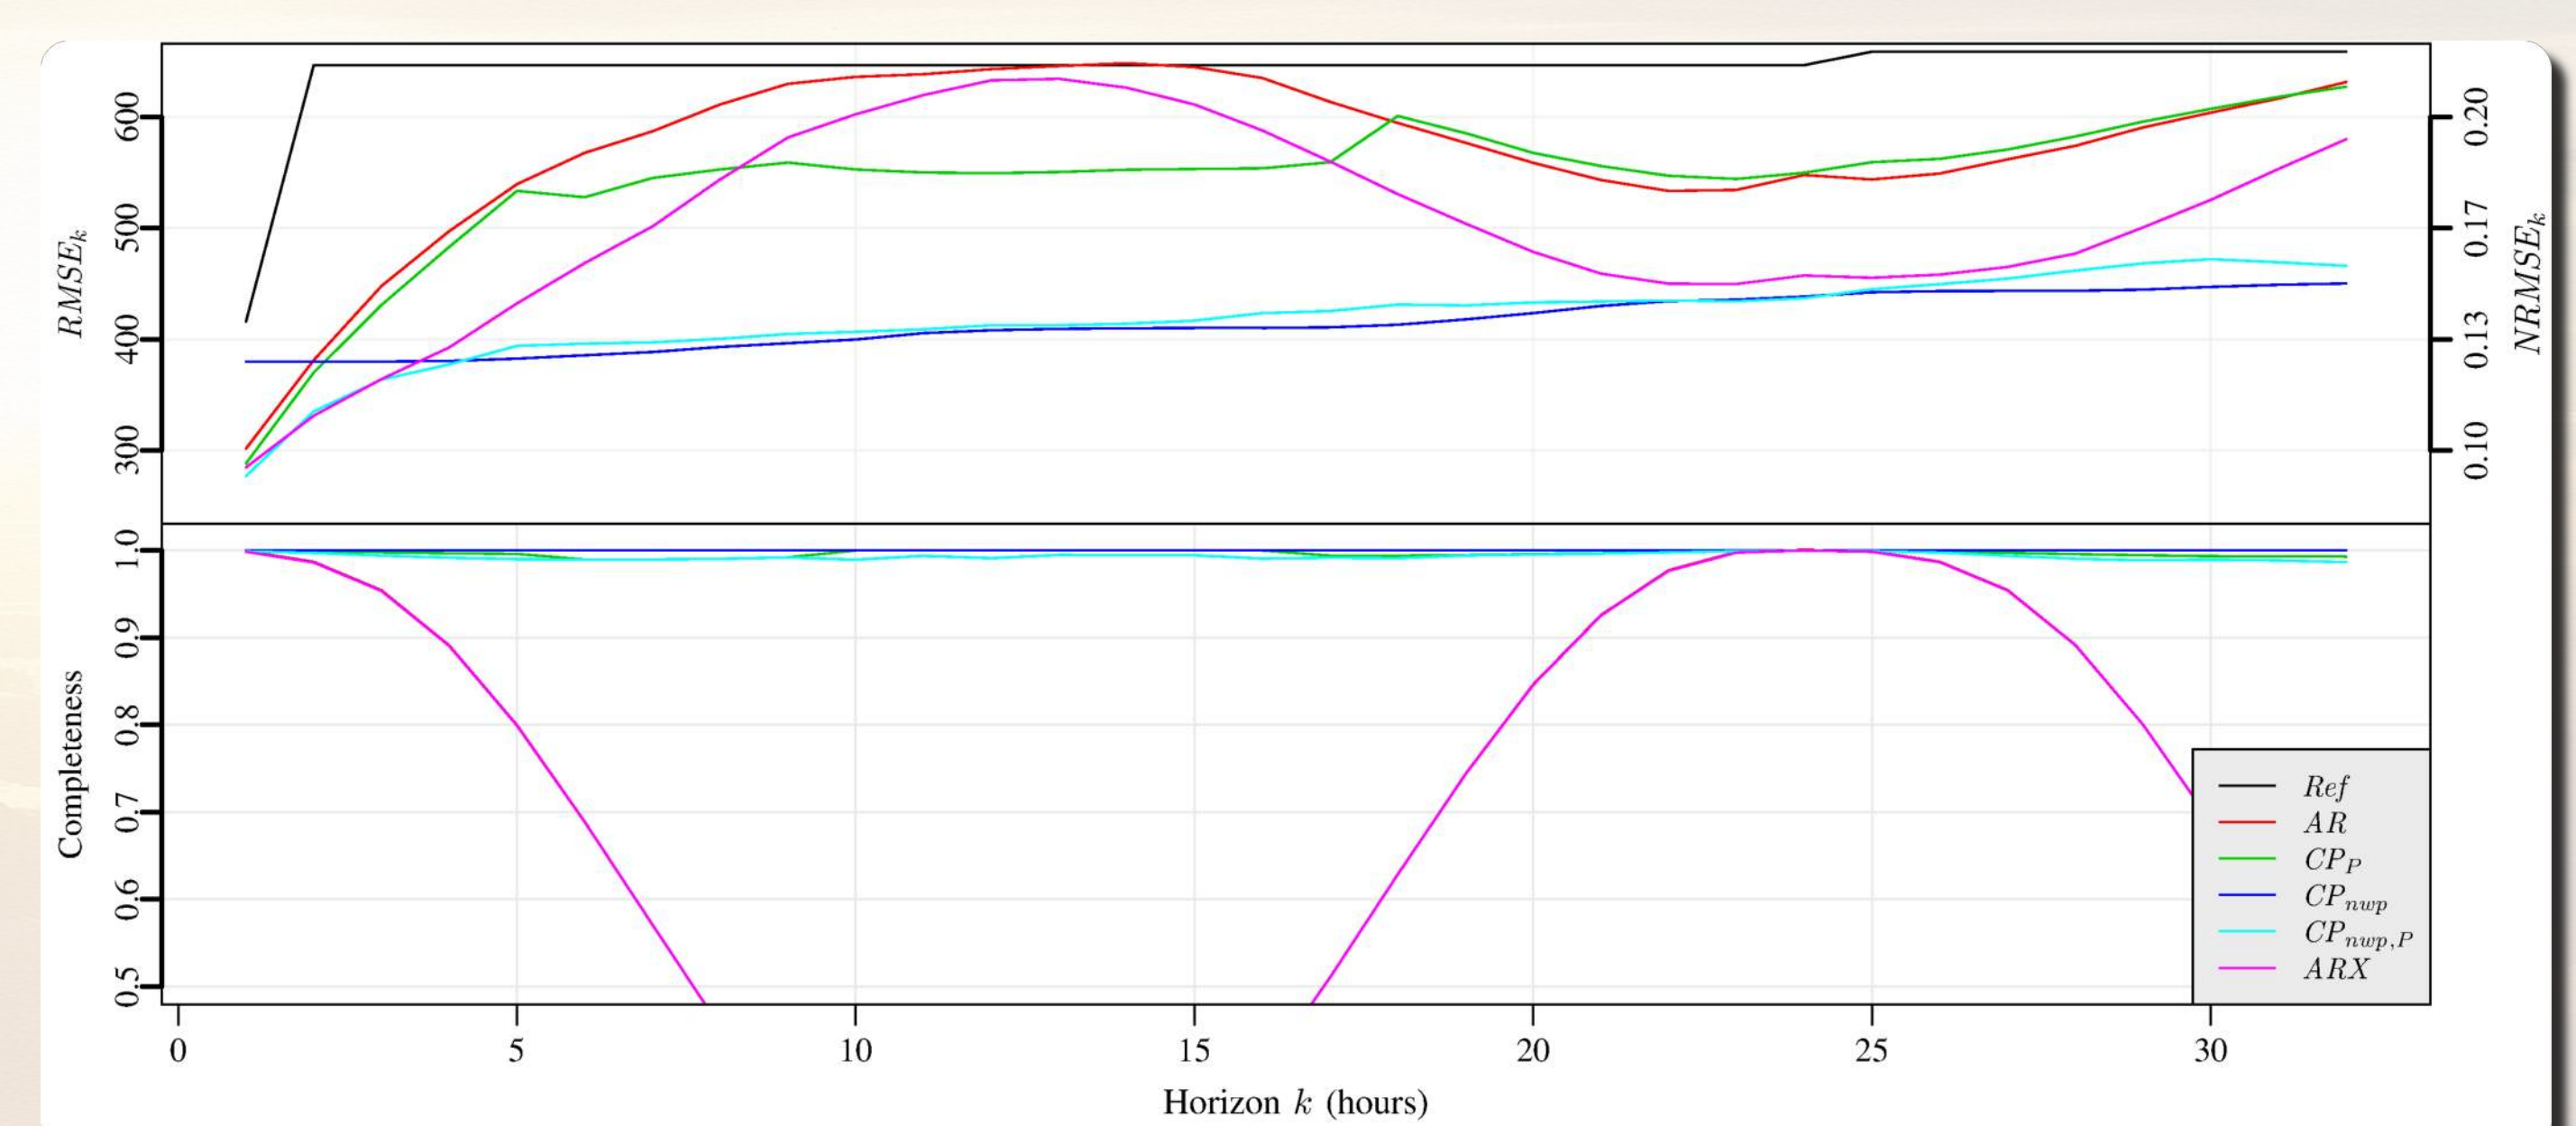

The upper plot is the RMSE for each horizon k for the forecasting models. The lower plot is the completeness for each horizon k .