

Received August 5, 2020, accepted August 9, 2020, date of publication August 12, 2020, date of current version August 21, 2020.

Digital Object Identifier 10.1109/ACCESS.2020.3015973

# Partial Discharge Localization Using Electromagnetic Time Reversal: A Performance Analysis

MOHAMMAD AZADIFAR<sup>1</sup>, (Member, IEEE), HAMIDREZA KARAMI<sup>2,3</sup>,  
ZHAOYANG WANG<sup>2</sup>, (Member, IEEE), MARCOS RUBINSTEIN<sup>1</sup>, (Fellow, IEEE),  
FARHAD RACHIDI<sup>2</sup>, (Fellow, IEEE), HOSSEIN KARAMI<sup>4</sup>, ALI GHASEMI<sup>5</sup>,  
AND GEVORK B. GHAREHPETIAN<sup>6</sup>, (Senior Member, IEEE)

<sup>1</sup>Institute for Information and Communication Technologies (IICT), University of Applied Sciences of Western Switzerland (HES-SO), 1401 Yverdon-les-Bains, Switzerland

<sup>2</sup>Electromagnetic Compatibility Laboratory, Swiss Federal Institute of Technology (EPFL), 1015 Lausanne, Switzerland

<sup>3</sup>Department of Electrical Engineering, Bu-Ali Sina University, Hamedan 65178, Iran

<sup>4</sup>High-Voltage Research Group, Niroo Research Institute, Tehran 1996836111, Iran

<sup>5</sup>Department of Electrical Engineering, Shahed University, Tehran 3319118651, Iran

<sup>6</sup>Department of Electrical Engineering, Amirkabir University of Technology (Tehran Polytechnic), Tehran 15914, Iran

Corresponding author: Mohammad Azadifar (mohammad.azadifar@heig-vd.ch)

**ABSTRACT** In this study, first, a comparison on the application of electromagnetic time reversal (EMTR) and time difference of arrival (TDoA) in partial discharge localization in power transformers is presented. A two-dimensional finite-difference time-domain simulation is used to calculate the signal recorded by the sensors. Results show that, in a transformer tank excluding its windings, both methods yield similar results in terms of location accuracy, although the EMTR method only needs one sensor to localize the partial discharge (PD) source while the TDoA method needs at least three sensors in the 2D localization problem. However, the presence of transformer windings leads to a degradation of the performance of the TDoA method if the line of sight from the source to the sensor is blocked by any of the winding blocks. On the other hand, the presence of the transformer windings has an effect on the localization of PD sources that occur between two adjacent phase windings when the distance between the outer winding distances is shorter than the minimum wavelength,  $\lambda_{\min}$ . The degradation is directly caused by the diffraction limit. It is shown that, if the distance between two adjacent phase windings is greater than  $\lambda_{\min}$ , the EMTR process can locate PD sources occurring between two adjacent phase windings with acceptable accuracy. A case of occurrence of PDs in close proximity (less than  $\lambda_{\min}/2$ ) to a single metallic object is analyzed both numerically and experimentally. The analysis reveals that although a degradation in the accuracy of the localization is observed compared to the case of longer distances between the PD source and the metallic object, a reasonable localization error of 10 mm (corresponding to  $\lambda_{\min}/10$ ) is obtained.

**INDEX TERMS** Experimental analysis, partial discharge localization, time difference of arrival, electromagnetic time reversal process, transformer tank.

## I. INTRODUCTION

Power transformers are one of the key components of power systems. Partial discharges (PDs), which are due to abnormal local enhancements in the electric field within the transformer tank are the main cause of damage to the insulation system of power transformers. Measurement methods based on electrical, chemical, acoustic and electromagnetic techniques have

The associate editor coordinating the review of this manuscript and approving it for publication was Xiaodong Liang<sup>id</sup>.

been deployed to study this phenomenon in power transformers [1]–[7]. Electromagnetic based techniques have received more attention recently due to their robustness against external noise and their ability to detect weak PDs.

PDs produce electromagnetic waves in the range of 300 MHz up to 3 GHz [8], [9]. As a result, electromagnetic source detection methods are applied to locate PDs in the ultra-high-frequency (UHF) band. Electromagnetic methods use generally the time difference of arrival (TDoA) to localize PDs [10], [11]. In a three-dimensional problem, this method

needs at least four synchronized sensors to provide source localization. Even with four sensors, an accurate location of the PD source cannot be achieved in the presence of transformer windings since the line of sight assumption of the TDoA method is no longer guaranteed. The effect of the presence of the transformer windings on the arrival time of the signal is investigated in [12]. In this regard, the effect of the sensor positioning on the amplitude of the recorded signal is discussed by Du *et al.* [13]. Simulations in the presence of transformer windings have been validated against measurements in [14].

In order to improve the performance of TDOA-based PD location methods, a new algorithm using the binary swarm optimization technique was used in [15] and tested on a relatively complex model of a transformer tank which includes reflection, refraction and diffraction of the electromagnetic waves taking into account the transformer's equipment, including the walls of the transformer tank. The proposed algorithm was able to locate the PD source with location accuracies of about 15 cm [15].

More recently, the electromagnetic time reversal (EMTR) technique was proposed to locate PD sources in power transformers [16], demonstrating the ability of the method for source localization in complex and heterogeneous media [17], [18]. The metallic enclosure that forms the transformer tank is a cavity. The power transformer windings make the interior of the tank a rich scattering environment for the time reversal localization process, whose performance has been shown to improve in the presence of scatterers [19]. The focusing property of electromagnetic time reversal cavities has been proven both experimentally and theoretically [20]–[22]. Recently, the application of electromagnetic time reversal cavities has been exploited to locate EMI sources [23], [24]. It has been shown that using a single sensor within a cavity is equivalent to the use of an infinite number of sensors in free space.

In this paper, first, the time reversal method and the TDoA method in terms of their performance for PD source localization in power transformers are compared. The efficiency of both methods for various source locations and geometries is studied. Furthermore, the EMTR performance to localize PD sources using only one sensor is investigated. Also, case studies are investigated in which the EMTR's ability to localize the PD accurately breaks down when electrical distances between two adjacent phase windings fall below a threshold equal to the PD minimum radiated wavelength.

This paper is organized as follows. Section II briefly summarizes the EMTR and TDoA methodologies to locate PD sources, as well as the considered 2D model for the transformer used in this study. Section III presents a comparison between the EMTR and the TDoA techniques. Section IV presents different case studies in which the performance of the single-sensor EMTR technique to locate PD sources is evaluated. Section V presents experimental data aimed at analyzing the performance of the EMTR technique in locating

PDs occurring near a metallic surface. Finally, concluding remarks are given in Section VI.

## II. METHODOLOGY AND SIMULATION SCHEME

### A. TIME DIFFERENCE OF ARRIVAL

The principle of PD source localization using TDoA includes obtaining electromagnetic fields by at least three separated sensors in a 2D problem. The differences in the times of arrival of the signals at the sensor locations are used to form a system of nonlinear equations given in (1) [12].

$$\sqrt{(x - x_i)^2 + (y - y_i)^2} + \sqrt{(x - x_j)^2 + (y - y_j)^2} = \Delta t \quad (1)$$

in which  $\Delta t$  is the difference in arrival of the signal to two sensors  $i$  and  $j$  with coordinates  $(x_i, y_i)$  and  $(x_j, y_j)$ .

By solving the resulting set of equations, the location of the PD source can be obtained. Various algorithms have been applied to improve the TDoA-based PD source localization (e.g. [14]).

### B. ELECTROMAGNETIC TIME REVERSAL

Maxwell's equations in lossless media are known to be invariant under the time reversal operator [25]. As a result of the time reversal invariance, the waves from the source that originally diverged from it, can be made to converge back to it, as if time were running backwards. As explained in the three steps to be presented below, electromagnetic field signals measured at a distance from the source need only be time-reversed and back-injected into the original medium to produce waves that propagate back and eventually concentrate at the source location, creating a diffraction limited focal spot [26]. To apply the time reversal process to the PD source localization problem, one needs to follow the following three steps [16]:


(i) The electromagnetic waves from the PD source are measured at one or multiple locations (forward-time). This step, called the forward-time step, can be done either numerically or experimentally.

(ii) The recorded waveforms are time-reversed and back-injected into the solution space in a simulation environment (backward-time step).

(iii) A criterion to locate focal points created by constructive interference is used to determine the position of the original PD source. To identify the focal spot of the back-injected waves, several criteria can be used (e.g., maximum field, minimum entropy, cross correlation [24], [27], [28]). Further discussion on the maximum field criterion can be found in [24]. In this paper, the maximum electric field power intensity criterion is used.

### C. CONSIDERED 2D TRANSFORMER MODEL

Figure 1 shows the overall geometry of a transformer tank that will be used in the analysis. The size of the tank is  $1000 \times 500 \text{ mm}^2$ . The walls of the transformer tank are considered to be metallic, perfect electric conductors (PEC). Three metallic

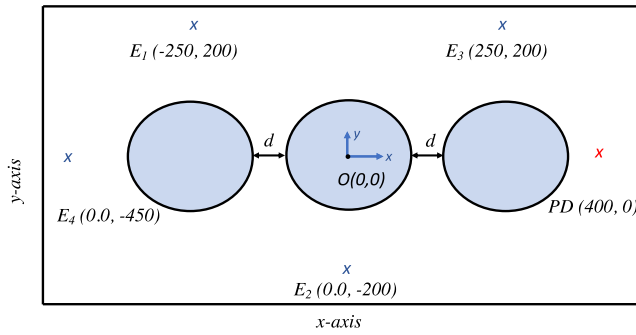

**FIGURE 1. Two-dimensional geometry of the transformer tank including the windings. All the values are in millimeters.  $E_1$ ,  $E_2$ ,  $E_3$ , and  $E_4$  correspond to the locations of the sensors. PD corresponds to the location of the partial discharge (red cross).**

circles with a 100 mm radius are used to represent the solid-shell cylindrical windings of the transformer. Apart from the three considered windings, the transformer tank is considered to be empty. Four sensor locations provided in Table 1 are used in this study. The subset used for each case study is given in its associated description. Four points, denoted  $E_1$ ,  $E_2$ ,  $E_3$  and  $E_4$  show the locations of the sensors. The location of the partial discharge source will be identified as PD in the figures. One such partial discharge source is shown in Figure 1 (red cross). An infinitesimal dipole source is considered as a PD source. The dipole source is excited with a 3-GHz bandwidth Gaussian pulse.

**TABLE 1. Considered locations of the sensors.**

Sensor	Location (m)
$E_1$	(-250, 200)
$E_2$	(0, -200)
$E_3$	(250, 200)
$E_4$	(-450, 0)

### III. COMPARISON BETWEEN EMTR AND TDOA

A two-dimensional finite-difference time-domain (FDTD) numerical code will be used to calculate the electric field within the transformer tank in the forward and backward time steps. Considering the axis of symmetry of a two-dimensional transformer tank, the numerical code solves the transverse magnetic modes ( $TM_z$ ) of Maxwell's equation given in (2),

$$\begin{cases} \frac{\partial E_z}{\partial t} = \frac{1}{\epsilon} \left( \frac{\partial H_y}{\partial x} - \frac{\partial H_x}{\partial y} - \sigma E_z - J \right) \\ \frac{\partial H_x}{\partial t} = \frac{1}{\mu} \left( -\frac{\partial E_z}{\partial y} - \sigma H_x \right) \\ \frac{\partial H_y}{\partial t} = \frac{1}{\mu} \left( \frac{\partial E_z}{\partial x} - \sigma H_y \right) \end{cases} \quad (2)$$


in which  $\epsilon$ ,  $\mu$  and  $\sigma$  are, respectively, the permittivity, permeability and conductivity of the medium.

Identical scenarios will be considered to investigate the performance of the time reversal and TDoA techniques.

The computational domain is meshed using an equally-spaced square mesh with a cell length of 2.5 mm. In the presented simulations, the time step and number of time steps are 5.3 ps and 4000, respectively.

#### A. CASE STUDY ONE: TRANSFORMER WITHOUT WINDING

Here, the simplest case study is assumed, in which an empty tank is considered as a transformer. The location of the used sensors and the PD source are given in Figure 1. Figure 2 provides the comparative analysis of the obtained results using both, the EMTR and the TDoA techniques.

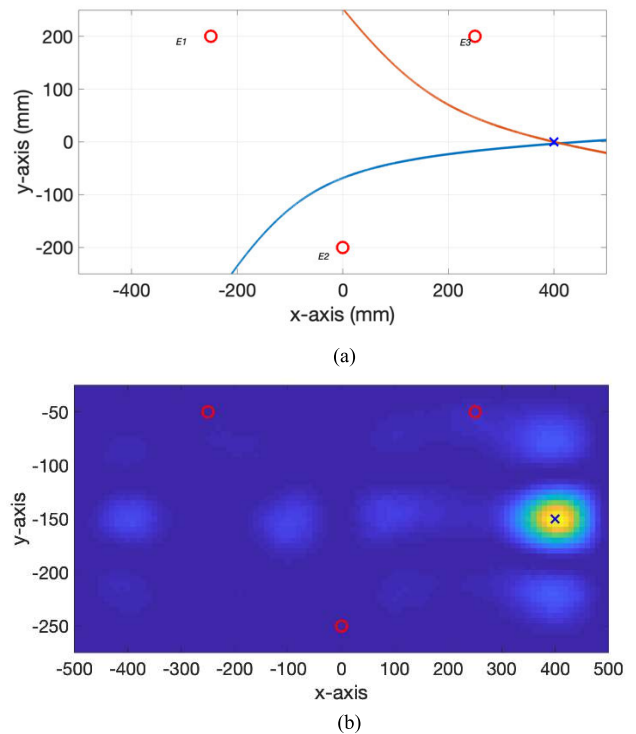

**FIGURE 2. PD source localization in a Transformer model without winding. a) TDOA: hyperbolic branches corresponding to the propagation times from the PD to the sensors  $E_2$  and  $E_3$ . The hyperbolic branch defined by the time difference of arrival between sensors 2 and 3 is presented in red. The hyperbolic branch defined by the time difference of arrival between sensors 1 and 2 is represented in blue. b) TR: Normalized distribution of the maximum electric field power intensity at each location over all time steps. Red circles show the locations of the sensors and the blue cross shows the estimated location of the PD source.**

The results presented for the TDoA method can be understood as follows. For line-of-sight conditions, the time difference of arrival of the radiation of the PD source to two spatially separated sensors is proportional to the difference between the distances. The time difference of arrival can therefore be used to draw a hyperbolic branch that is the set of possible source locations.

Two pairs of sensors define two different hyperbolic branches whose intersection is the location of the source. The blue and red lines in Figures 2a and 3a are the hyperbolic branches for two different pairs of sensors. Only the

hyperbolic branches that correspond to a shorter propagation time from the PD source to sensors  $E_2$  and  $E_3$  are shown in Figure 2a (TDoA). Figure 2b shows the normalized distribution of the maximum electric field power intensity at each location over all time steps used for the EMTR method. The EMTR location error is less than a mesh cell, while the TDoA location error is 11 mm. It should be noted that an electric field threshold of  $10^{-9}$  (V/m) is used to determine the onset time of each signal in the TDoA method. Once the onset times are obtained, their time difference is used to draw the two hyperbolas. The intersection of the two hyperbolas yields the estimated location of the PD source.

**B. CASE STUDY TWO: TRANSFORMER WITH WINDINGS**


In this case study, the windings of the transformer are included as presented in Figure 1. Figure 3 provides the result of the PD source localization for both the TDoA and the EMTR methods. Only the hyperbolic branches that correspond to a shorter propagation time from the PD source to sensors  $E_2$  and  $E_3$  are shown in Figure 3a. It can be observed that the TDoA method estimates the location of the source (the point where the hyperbolas cross) to be outside of the tank, which is shown as a dashed line rectangle in the figure. The localization error is about 489 mm. On the other hand, the EMTR method (Figure 3b) can still provide accurate results, similar to the first case study. A discussion here is in order on the reason for the failure of the TDoA in this case. As can be seen in Figure 1, there is no line-of-sight view from the PD source to the sensors  $E_1$  and  $E_2$ . From the hyperbolic branches drawn in Fig. 3a, it can be inferred that the first arriving wave is coming from the second hop reflection from the right wall of the cavity. Since the arrival time of the wave does not correspond to that of the direct wave, the TDoA method does not work properly. Further discussion on the performance of the TDoA technique for the localization of PD sources is provided in the supplementary material.

**IV. SINGLE-SENSOR ELECTROMAGNETIC TIME REVERSAL PD LOCALIZATION**


In this section, it is shown that the EMTR technique can yield the location of the PD source using only one sensor. The TDoA technique fails to provide any information on the PD location when one sensor is used.

**A. CASE STUDY 1: NO LINE OF SIGHT**

The position of the sensor in this case study is shown with a red circle in Figure 4. The position, which is different from the positions of the sensors in the previously considered cases, was set in such a way that the line of sight to the PD source goes through all three windings, making the localization seemingly difficult. Figure 4 presents the results of the source localization by the EMTR technique using the single sensor. As can be seen, the EMTR method can provide the accurate position of the PD source even for the selected location.

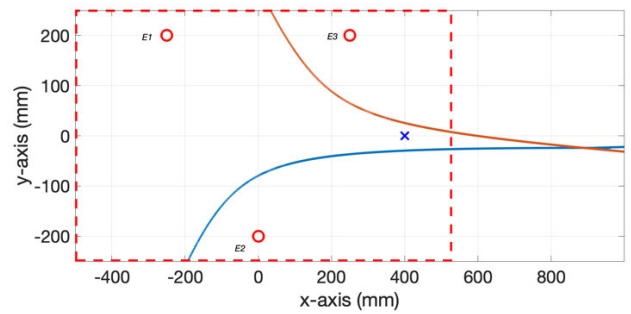


(a)

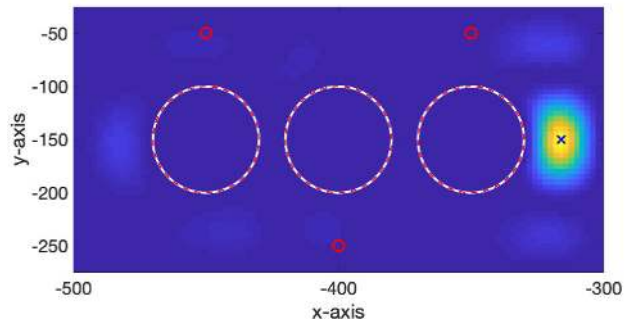

(b)


**FIGURE 3. PD source localization in a Transformer with windings.** a) TDOA: hyperbolic branches corresponding to the propagation times from the PD to the sensors  $E_2$  and  $E_3$ . The hyperbolic branch defined by the time difference of arrival between sensors 2 and 3 is represented in red. The hyperbolic branch defined by the time difference of arrival between sensors 1 and 2 is represented in blue. b) EMTR: Normalized distribution of the maximum electric field power intensity at each location over all time steps. Red solid circles show the locations of the sensors and the blue cross shows the estimated location of the PD source. The dashed circles show the location of the windings.

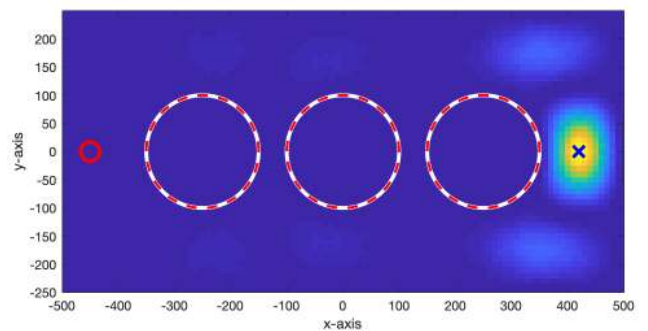

**FIGURE 4. PD source localization by the EMTR technique using a single sensor.** Normalized distribution of the maximum electric field power intensity at each location over all time steps. The red solid circle shows the location of the sensor and the blue cross shows the estimated location of the PD source. The dashed circles show the location of the windings.

**B. CASE STUDY 2: PD LOCATED BETWEEN TWO ADJACENT PHASE WINDINGS**

In this section, a study is performed of the ability of the EMTR technique to localize a PD produced between two adjacent phase windings of the transformer, which is a critical location for electromagnetic based detection methods. A PD source location is defined as “critical” if the line of sight

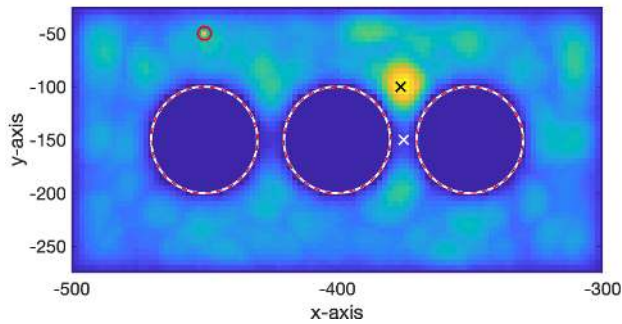


**FIGURE 5.** PD source localization by the EMTR technique using a single sensor when the PD source is between two adjacent phase windings and the spacing between the two adjacent phase windings is equal to 50 mm: Normalized distribution of the maximum electric field power intensity at each location over all time steps. The red circle, black cross, and white cross indicate the location of the sensor, the estimated location of the PD source, and the actual location of the PD source, respectively. The dashed circles show the location of the windings.

is obstructed and/or if the source is close to a conducting surface. Figure 1 shows the geometry of the problem with spacing  $d$  between two adjacent phase windings. First, the EMTR procedure is applied when the spacing between two adjacent phase windings is 50 mm (corresponding to one half of the shortest wavelength of the source  $\lambda_{min}/2$ ) and the distance between the PD source and the metallic winding is 25 mm ( $\lambda_{min}/4$ ). Figure 5 shows the result of the PD source localization for the considered geometry and position of the PD source. The red circle shows the location of the sensor and white and black crosses indicate the actual and the estimated locations of the PD source, respectively. As it can be observed, the calculated location of the PD source exhibits a localization error of about 112 mm. The reason behind this large error lies in the distance between the PD and the winding, which is less than  $\lambda_{min}/2$ . To further investigate the localization skill of the EMTR method, the EMTR procedure is applied to the geometry of Figure 1 with a spacing between two adjacent phase windings equal to 150 mm. In this case, the distance between the PD source and the winding is 75 mm. Figure 6 shows the result of the PD source localization using EMTR for this case. As it can be seen, the localization is much improved compared to the case with the shorter 50 mm spacing, with a localization error of 21 mm.

### C. MONTE CARLO SIMULATION

In order to study the influence of the location of the source in the performance of the EMTR technique for the location of PD sources, a Monte-Carlo simulation on 145 source locations is performed. The aim here is to examine if the method could work for various possible PD locations and to have an estimate on the statistical parameters of the localization error.

The nature of the time reversal solution procedure does not allow the use of analytical formulas. The Monte Carlo method was therefore used as a way of obtaining statistical information on the error through a random sampling of the possible PD locations.

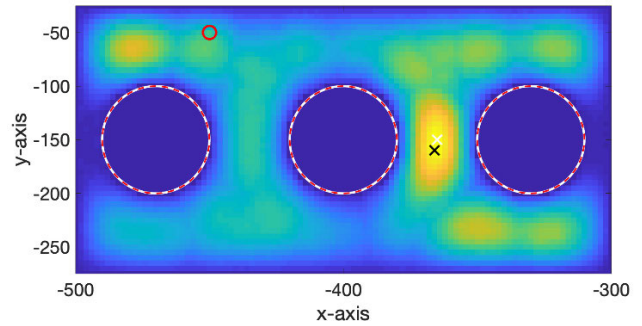

**FIGURE 6.** PD source localization by the EMTR technique using a single sensor when the PD source is between the two adjacent phase windings and the spacing between them is equal to 150 mm: Normalized distribution of the maximum electric field power intensity at each location over all time steps. The red circle, black cross, and white cross indicate the location of the sensor, the estimated location of the PD source, and the actual location of the PD source, respectively. The dashed circles show the location of the windings.

The geometry of the problem is shown in Figure 1 of the paper with a winding spacing of 150 mm. Only sensor E1 was used. The  $x$  and  $y$  coordinates of the different locations of the PD sources in the Monte Carlo simulation were chosen randomly based on a uniform probability distribution within the tank.

It should be noted that the locations with distances less than  $\lambda_{min}/2$  from metallic barriers were removed from the considered locations. Figures 7a and 7b provide the localization error along the  $x$  and  $y$  axes, respectively. In this case, the minimum, maximum, and mean values of the error are 2 mm, 108 mm, and 19 mm, respectively. These are based on the Euclidian distance between the estimated and the real locations obtained from the errors along the  $x$  and  $y$  axes.


### D. INFLUENCE OF THE NUMBER OF SENSORS

In this subsection, the localization error in a scenario similar to the single sensor described above is investigated, the only difference being that two sensors are used:  $E_1$  and  $E_2$ . The minimum, maximum, and mean values of the error in this case are, respectively, 2 mm, 34 mm, and 15 mm. Figures 8a and 8b provide the localization error along the  $x$  and the  $y$  axes, respectively. It can be seen that, by adding the second sensor, the maximum localization error was significantly reduced.


## V. EXPERIMENTAL VALIDATION

In this section, an experimental analysis of the ability of the EMTR process is presented for PD sources that are close to metallic objects. The EMTR process can be applied both in the time and in the frequency domains, in the latter case using the inverse Fourier transform to obtain the time signals. Here, an HP-8753D Vector Network Analyzer (VNA) is used to perform the experimental part of the time reversal process in the frequency domain.

A metallic box with dimensions of  $101 \times 73 \times 73$  cm<sup>3</sup> was used to represent the transformer tank. A monopole antenna with length 5.3 mm was used to emulate the PD source and another monopole antenna with length 8.3 mm was used as

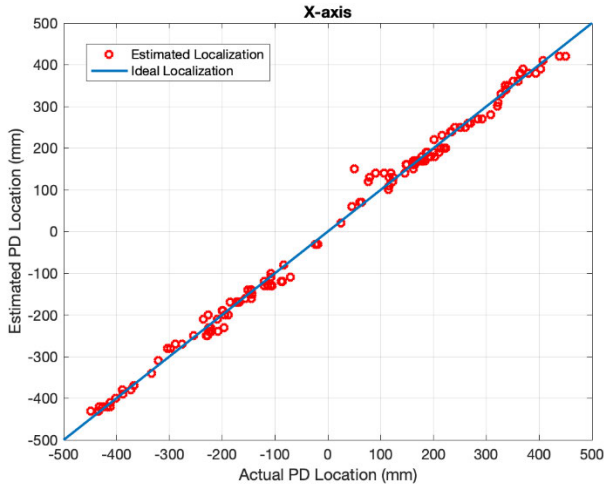

(a)

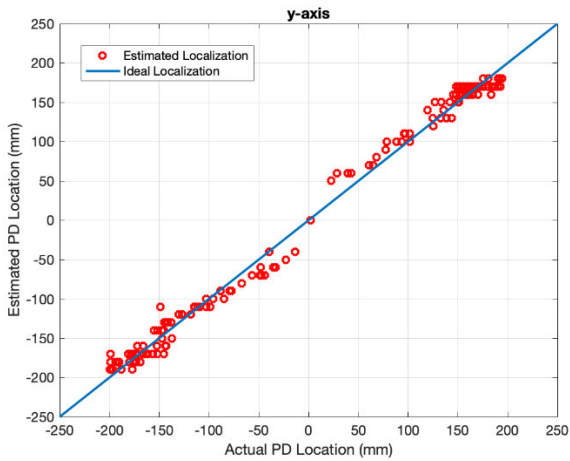

(b)

**FIGURE 7.** PD source localization using a single sensor. (a) Error along the x-axis. (b) Error along the y-axis.

a sensor. The transformer tank, monopole antennas and a metallic object used to represent a transformer winding are shown in Figure 9.


The three-step procedure described in Section II is applied to locate the PD source: 1) Obtain forward time domain signal, 2) time reverse the signal and back inject it into the medium, 3) use the maximum field criterion to locate the PD source. To apply the procedure in the frequency domain:

- A Gaussian pulse with a bandwidth of 3000-MHz is considered and its Fourier transform is found. The time and frequency domain waveforms will be denoted as  $x(t)$  and  $X(\omega)$ , respectively. The  $S_{21}(\omega)$  response between the PD source and the sensor is measured using the VNA. Hence, the time domain field recorded by the sensor can be written as


$$r(t) = F^{-1}(X(\omega)S_{21}(\omega)),$$

where the  $F^{-1}$  operator is the inverse Fourier transform.

- In the time reversed step,  $S_{12}(\omega)$  between the sensor and the test points is measured. Hence, the time reversed

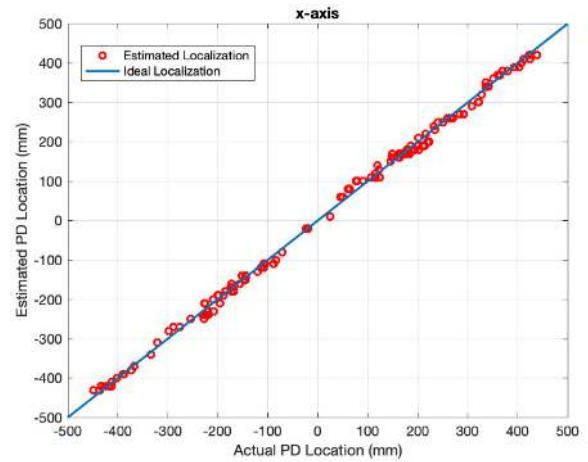

(a)

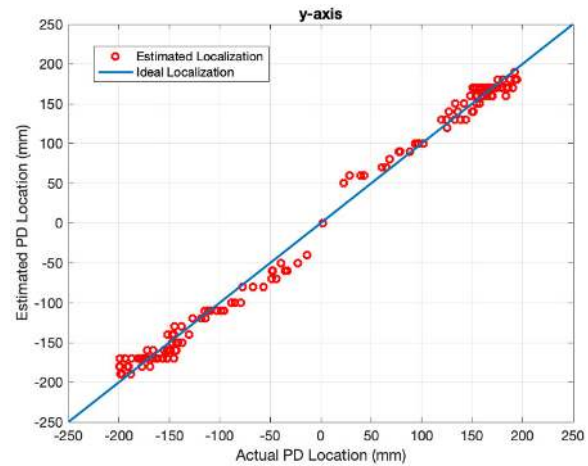

(b)

**FIGURE 8.** PD source localization using two sensors. (a) Error along the x-axis. (b) Error along the y-axis.



**FIGURE 9.** Metallic box representing a transformer tank, monopole antennas and metallic object.

field in the time domain can be obtained as  $E^{TR}(t) = F^{-1}(S_{12}(\omega))*r(-t)$ , where  $*$  is the convolution operator.

- In the third step,  $E^{TR}(t)$  is calculated at each one of the test points to find the point with the maximum electric field.

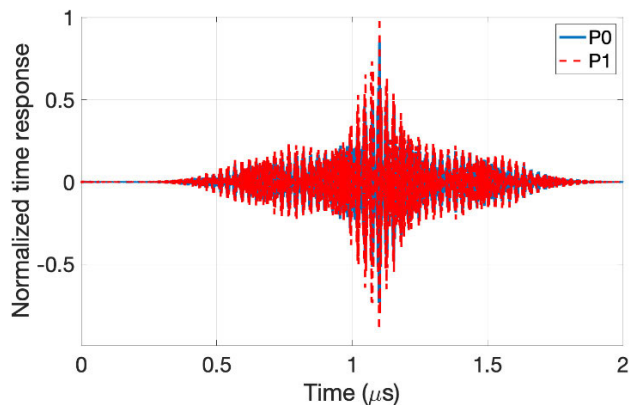


FIGURE 10. Time reversed field at locations  $P_0$  and  $P_1$ .

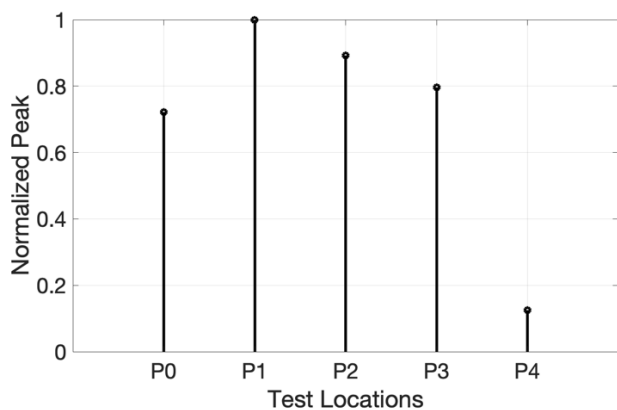


FIGURE 11. Normalized distribution of the peak time-reversed field at the test locations (source located at  $P_0$ ).

It is worth mentioning that a limited number of test points is used in the third step due to practical limitations. It is indeed impossible to measure at all possible locations in space. Similar test procedures have been used by Fink and coworkers [26] to show the imaging ability of the TR process experimentally.

To investigate the effect of the vicinity to a metallic object, the PD source is considered to be at location  $P_0$  (see Figure 9) and the test points  $P_0$  to  $P_4$ , which are equally spaced at 1.5 cm to 5.5 cm distance from the metallic object, are considered. Note that the distance between  $P_0$  and the metallic object (1.5 cm) corresponds to about  $1/7$  of the shortest wavelength of the source. Figure 10 shows the fields  $E^{TR}(t)$  measured at  $P_0$  and  $P_1$ . It can be observed that the peak field is higher at  $P_1$  than at  $P_0$ . Therefore, the proposed method predicts that the location of the PD (which actually occurred at  $P_0$ ) occurs at  $P_1$ , which represents a localization error of 1 cm. Figure 11 shows the normalized peak field of the time reversed field at all five test points.

To show that the method works when farther from the metallic object, the PD source location at  $P_2$  (3.5 cm away from the object, corresponding to  $\lambda_{min}/3$ ) is considered now. Figure 12 shows the normalized peak electric field distribution of the time reversed field at all five test points. As it

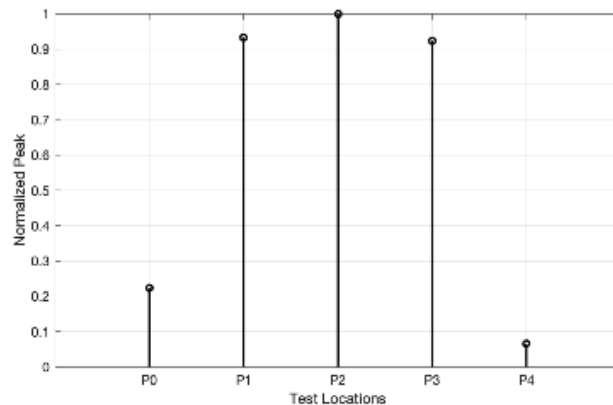


FIGURE 12. Normalized distribution of the peak time-reversed field at the test locations (source located at  $P_2$ ).

can be seen, the maximum normalized peak field value corresponds to  $P_2$ , which is the actual source location.

It must be noted that the provided experimental results are a proof of concept for the applicability of the time reversal method to PD localization. Indeed, more thorough experimental validation is needed by considering a more realistic transformer, including an oil-filled tank and windings.

## VI. CONCLUDING REMARKS

In this paper, first, a theoretical comparison of the TDoA and electromagnetic time reversal techniques is performed when used for PD source localization. It is observed that, by using three sensors, the TDoA technique cannot provide accurate results when the line of sight is blocked by the presence of transformer windings. On the other hand, the electromagnetic time reversal technique can provide reasonable source localization results using only one sensor, even if the line-of-sight condition is not satisfied, barring the case where the PD source is closer to a metallic object than half of the minimum wavelength of the radiated field signal.

The skill of the proposed method to localize PD sources in the vicinity of metallic objects is analyzed both numerically and experimentally. It is observed that, although a degradation in the accuracy of the localization is observed compared to the case of longer distances between the PD source and the metallic object, a reasonable localization error of 10 mm (corresponding to  $\lambda_{min}/10$ ) is obtained.

In summary, the presented numerical simulations supported by experimental results suggest that the electromagnetic time reversal method is capable of providing accurate localization of PD sources occurring at distances further than the diffraction limit ( $\lambda_{min}/2$ ) to metallic objects such as the surface of the power transformer tank or the windings.

2D configurations were used in this paper to demonstrate the ability of the time reversal technique to perform non-line-of-sight localization of PD sources. Future work is underway to investigate the performance of the time reversal technique to locate PD sources in realistic (3D) transformers.

## REFERENCES

- [1] *Partial Discharges in Transformers*, W.D1.29, CIGRE, Paris, France, 2017.
- [2] M. Duval, "A review of faults detectable by gas-in-oil analysis in transformers," *IEEE Elect. Insul. Mag.*, vol. 18, no. 3, pp. 8–17, May 2002.
- [3] N. H. Nik Ali, M. Giannakou, R. D. Nimmo, P. L. Lewin, and P. Rapisarda, "Classification and localisation of multiple partial discharge sources within a high voltage transformer winding," in *Proc. IEEE Electr. Insul. Conf. (EIC)*, Jun. 2016, pp. 519–522.
- [4] L. E. Lundgaard, "Partial discharge. XIV. Acoustic partial discharge detection-practical application," *IEEE Elect. Insul. Mag.*, vol. 8, no. 5, pp. 34–43, Sep. 1992.
- [5] S. Markalous, S. Tenbohlen, and K. Feser, "Detection and location of partial discharges in power transformers using acoustic and electromagnetic signals," *IEEE Trans. Dielectr. Electr. Insul.*, vol. 15, no. 6, pp. 1576–1583, Dec. 2008.
- [6] S. Tenbohlen, D. Denissov, S. Hoek, and S. M. Markalous, "Partial discharge measurement in the ultra high frequency (UHF) range," *IEEE Trans. Dielectr. Electr. Insul.*, vol. 15, no. 6, pp. 1544–1552, Dec. 2008.
- [7] M. D. Judd, L. Yang, and I. B. B. Hunter, "Partial discharge monitoring of power transformers using UHF sensors. Part I: Sensors and signal interpretation," *IEEE Elect. Insul. Mag.*, vol. 21, no. 2, pp. 5–14, Mar. 2005.
- [8] R. Albarracín, J. Ardila-Rey, and A. Mas'ud, "On the use of monopole antennas for determining the effect of the enclosure of a power transformer tank in partial discharges electromagnetic propagation," *Sensors*, vol. 16, no. 2, p. 148, Jan. 2016.
- [9] X. Zhang, G. Zhang, Y. Li, J. Zhang, and R. Huang, "On the feasibility of gap detection of power transformer partial discharge UHF signals: Gap propagation characteristics of electromagnetic waves," *Energies*, vol. 10, no. 10, p. 1531, Oct. 2017.
- [10] Z. Tang, C. Li, X. Cheng, W. Wang, J. Li, and J. Li, "Partial discharge location in power transformers using wideband RF detection," *IEEE Trans. Dielectr. Electr. Insul.*, vol. 13, no. 6, pp. 1193–1199, Dec. 2006.
- [11] H. Mirzaei, A. Akbari, E. Gockenbach, and K. Miralikhani, "Advancing new techniques for UHF PD detection and localization in the power transformers in the factory tests," *IEEE Trans. Dielectr. Electr. Insul.*, vol. 22, no. 1, pp. 448–455, Feb. 2015.
- [12] H. R. Mirzaei, A. Akbari, E. Gockenbach, M. Zanjani, and K. Miralikhani, "A novel method for ultra-high-frequency partial discharge localization in power transformers using the particle swarm optimization algorithm," *IEEE Elect. Insul. Mag.*, vol. 29, no. 2, pp. 26–39, Mar. 2013.
- [13] J. Du, W. Chen, and B. Xie, "Simulation analysis on the propagation characteristics of electromagnetic wave generated by partial discharges in the power transformer," in *Proc. IEEE Conf. Electr. Insul. Dielectr. Phenomena (CEIDP)*, Oct. 2016, pp. 179–182.
- [14] T. Umemoto and S. Tenbohlen, "Novel simulation technique of electromagnetic wave propagation in the ultra high frequency range within power transformers," *Sensors*, vol. 18, no. 12, p. 4236, Dec. 2018.
- [15] L. Nobrega, E. Costa, A. Serres, G. Xavier, and M. Aquino, "UHF partial discharge location in power transformers via solution of the Maxwell equations in a computational environment," *Sensors*, vol. 19, no. 15, p. 3435, Aug. 2019.
- [16] H. Karami, M. Azadifar, A. Mostajabi, M. Rubinstein, H. Karami, G. B. Gharehpetian, and F. Rachidi, "Partial discharge localization using time reversal: Application to power transformers," *Sensors*, vol. 20, no. 5, p. 1419, Mar. 2020.
- [17] M. Fink, "Time reversed acoustics," *Phys. Today*, vol. 50, no. 3, pp. 34–40, Mar. 1997.
- [18] M. Fink, D. Cassereau, and A. Derode, "Time-reversed mirrors," *J. Phys. D. Appl. Phys.*, vol. 26, p. 1333, Sep. 1993.
- [19] A. Derode, A. Tourin, J. de Rosny, M. Tanter, S. Yon, and M. Fink, "Taking advantage of multiple scattering to communicate with time-reversal antennas," *Phys. Rev. Lett.*, vol. 90, no. 1, pp. 014301-1–014301-4, Jan. 2003.
- [20] G. Lerosey, J. de Rosny, A. Tourin, A. Derode, G. Montaldo, and M. Fink, "Time reversal of electromagnetic waves," *Phys. Rev. Lett.*, vol. 92, no. 19, p. 193904, May 2004.
- [21] R. Carminati, R. Pierrat, J. D. Rosny, and M. Fink, "Theory of the time reversal cavity for electromagnetic fields," *Opt. Lett.*, vol. 32, no. 21, p. 3107, Nov. 2007.
- [22] Z. Wang, F. Rachidi, M. Paolone, M. Rubinstein, and R. Razzaghi, "A closed time-reversal cavity for electromagnetic waves in transmission line networks," *IEEE Trans. Antennas Propag.*, to be published.
- [23] H. Karami, M. Azadifar, A. Mostajabi, P. Favrat, M. Rubinstein, and F. Rachidi, "Localization of electromagnetic interference sources using a time reversal cavity," *IEEE Trans. Ind. Electron.*, early access, Jan. 1, 2020, doi: 10.1109/TIE.2019.2962460.
- [24] H. Karami, M. Azadifar, A. Mostajabi, M. Rubinstein, and F. Rachidi, "Localization of electromagnetic interference source using a time reversal cavity: Application of the maximum power criterion," in *Proc. IEEE Int. EMC+SIPI*, to be published.
- [25] F. Rachidi, M. Rubinstein, and M. Paolone, *Electromagnetic Time Reversal: Application to EMC and Power Systems*. Hoboken, NJ, USA: Wiley, 2017.
- [26] G. Lerosey, J. De Rosny, A. Tourin, A. Derode, G. Montaldo, and M. Fink, "Time reversal of electromagnetic waves," *Phys. Rev. Lett.*, vol. 92, no. 19, May 2004, Art. no. 193904.
- [27] P. Kosmas and C. M. Rappaport, "Time reversal with the FDTD method for microwave breast cancer detection," *IEEE Trans. Microw. Theory Techn.*, vol. 53, no. 7, pp. 2317–2323, Jul. 2005.
- [28] Z. Wang, R. Razzaghi, M. Paolone, and F. Rachidi, "Electromagnetic time reversal similarity characteristics and its application to locating faults in power networks," *IEEE Trans. Power Del.*, vol. 35, no. 4, pp. 1735–1748, Aug. 2020.



**MOHAMMAD AZADIFAR** (Member, IEEE) received the B.S. and M.S. degrees (Hons.) in electrical engineering from the Amirkabir University of Technology (Tehran Polytechnic), Tehran, Iran, in 2005 and 2009, respectively, and the Ph.D. degree in electrical engineering from the Swiss Federal Institute of Technology, Lausanne, Switzerland, in 2018. In 2018, he joined the University of Applied Sciences of Western Switzerland, Yverdon-les-Bains, Switzerland, where he is currently a Researcher with the Information and Communication Technologies Institute Team. He has authored or coauthored more than 50 scientific journal and conference papers. His research interests include computational electromagnetic, electromagnetic compatibility, high power electromagnetic, time reversal, and lightning. He was a recipient of the 2017 Richard B. Shultz Best Transaction Paper Award of the IEEE TRANSACTIONS ON ELECTROMAGNETIC COMPATIBILITY (EMC). He is also the Chair of Switzerland IEEE Chapter on EMC/AP/MTT.



**HAMIDREZA KARAMI** received the B.S. degree in electrical engineering from Bu-Ali Sina University, Hamedan, Iran, in 2004, and the M.S. and Ph.D. degrees in telecommunications from the Amirkabir University of Technology, Tehran, Iran, in 2008 and 2013, respectively. He was with the École Polytechnique, Fédérale de Lausanne (EPFL), Lausanne, Switzerland, in June 2013, as a Visiting Scientist. He has been the Visiting Scientist with EPFL, since 2019. He is currently an Assistant Professor of electrical engineering with Bu-Ali Sina University. His research interests include electromagnetic compatibility (EMC), computational methods in electromagnetics, microwave nondestructive testing techniques, and time reversal.



**ZHAOYANG WANG** (Member, IEEE) received the M.Sc. degree in electrical engineering from Xi'an Jiaotong University, Xi'an, China, in 2015. He is currently pursuing the Ph.D. degree in electrical engineering with the Electromagnetic Compatibility Laboratory, and the Distributed Electrical Systems Laboratory, Swiss Federal Institute of Technology (EPFL), Lausanne, Switzerland.

His research interests include electromagnetic transients, power system fault location and protection, and electromagnetic time reversal. He was a recipient of the 2018 Richard B. Shultz Best Transaction Paper Award of the IEEE TRANSACTIONS ON ELECTROMAGNETIC COMPATIBILITY (EMC).





**MARCOS RUBINSTEIN** (Fellow, IEEE) received the master's and Ph.D. degrees in electrical engineering from the University of Florida, Gainesville, FL, USA.

After a postdoctoral fellowship at the Swiss Federal Institute of Technology in Lausanne, where he worked in the fields of electromagnetic compatibility and lightning, he moved to Swisscom as a Project Engineer, and then the Program Manager in charge of projects in lightning, numerical electromagnetics, and EMC. In 2001, he moved to the University of Applied Sciences and Arts of Western Switzerland HES-SO, Yverdon-les-Bains, where he is currently a Full Professor, the Head of the Advanced Communication Technologies Group, and a member of the IICT Institute Team. He is the author or coauthor of more than 300 scientific publications in reviewed journals and international conferences. He is also the coauthor of seven book chapters and one of the editors of a book on *Electromagnetic Time Reversal*. He is a Fellow of the SUMMA Foundation, and a member of the Swiss Academy of Sciences and the International Union of Radio Science. He received the best Master's Thesis Award from the University of Florida, and the IEEE Achievement Award. He was a co-recipient of the NASA's Recognition for Innovative Technological Work Award, and the ICLP Karl Berger Award. He has served as the Editor-in-Chief for *The Open Atmospheric Science Journal*. He also serves as an Associate Editor for the IEEE TRANSACTIONS ON ELECTROMAGNETIC COMPATIBILITY.



**FARHAD RACHIDI** (Fellow, IEEE) received the M.S. degree in electrical engineering and the Ph.D. degree from the Swiss Federal Institute of Technology, Lausanne, Switzerland, in 1986 and 1991, respectively.

He was with the Power Systems Laboratory, Swiss Federal Institute of Technology, until 1996. In 1997, he joined the Lightning Research Laboratory, University of Toronto, Toronto, ON, Canada. From 1998 to 1999, he was with Montena EMC, Rossens, Switzerland. He is currently a Titular Professor and the Head of the EMC Laboratory, Swiss Federal Institute of Technology. He has authored or coauthored over 200 scientific articles published in peer-reviewed journals and over 400 papers presented at international conferences. He is also a member of the Advisory Board of the IEEE TRANSACTIONS ON ELECTROMAGNETIC COMPATIBILITY and the President of the Swiss National Committee of the International Union of Radio Science. He is a Fellow of the SUMMA Foundation, and a member of the Swiss Academy of Natural Sciences. He received numerous awards, including the 2005 IEEE EMC Technical Achievement Award, the 2005 CIGRE Technical Committee Award, the 2006 Blondel Medal from the French Association of Electrical Engineering, Electronics, Information Technology and Communication (SEE), the 2016 Berger Award from the International Conference on Lightning Protection, the Best Paper Award of the IEEE TRANSACTIONS ON ELECTROMAGNETIC COMPATIBILITY (EMC), in 2016 and 2018, and the Motohisa Kanda Award for the most cited paper of the IEEE TRANSACTIONS ON ELECTROMAGNETIC COMPATIBILITY (EMC), in 2012 and 2016, and in 2014 and 2018. In 2014, he was conferred the title of Honorary Professor of the Xi'an Jiaotong University in China. He has served as the Vice-Chair of the European COST Action on the Physics of Lightning Flash and its Effects, from 2005 to 2009, the Chairman of the 2008 European Electromagnetics International Symposium, the President of the International Conference on Lightning Protection, from 2008 to 2014, and the Editor-in-Chief of *The Open Atmospheric Science Journal*, from 2010 to 2012, and the IEEE TRANSACTIONS ON ELECTROMAGNETIC COMPATIBILITY, from 2013 to 2015.

**HOSSEIN KARAMI** received the B.S., M.S., and Ph.D. degrees in high voltage electrical engineering from the Department of Electrical Engineering, Amirkabir University of Technology (AUT), Tehran, Iran, in 2010, 2012, and 2017, respectively. His Ph.D. thesis was about the feasibility of combination partial discharge localization and synthetic-aperture radar imaging of power transformer windings using electromagnetic antennas. He was a Postdoctoral Researcher with AUT worked on the development and optimization of methods for objective interpretation of frequency response analysis (FRA) test results. He is the author of one U.S. patent, one book, and more than 50 journal and conference papers. His research interests include online monitoring, power transformers, partial discharge, FRA test results interpretation, energy management, and optimal scheduling.

**ALI GHASEMI** was born in Sari, Iran. He received the B.Sc. degree in electrical engineering from the Faculty of Electrical and Computer Engineering, Babol University of Technology, Babol, Iran, in 2015, and the M.Sc. degree in electrical engineering from the Faculty of Engineering, Shahed University, Tehran, Iran, in 2019. His research interests include partial discharge, condition monitoring of electrical equipment, HVDC technology, power electronics applications in power systems, and integration of renewable energy into power grids.

**GEVORK B. GHAREHPETIAN** (Senior Member, IEEE) received the Ph.D. degree (Hons.) in electrical engineering from Tehran University, Tehran, Iran, in 1996, with a scholarship from DAAD (German Academic Exchange Service), from 1993 to 1996.

He was with the High Voltage Institute, RWTH Aachen University, Aachen, Germany. He has been holding an Assistant Professor position with AUT, from 1997 to 2003, an Associate Professor position, from 2004 to 2007, and has been a Professor, since 2007. He is the author of more than 1200 journal and conference papers. His teaching and research interests include smart grid, microgrids, FACTS and HVDC systems, and monitoring of power transformers and its transients. He was selected by the Ministry of Science Research and Technology (MSRT) as the Distinguished Professor of Iran, by the Iranian Association of Electrical and Electronics Engineers (IAEEE) as the Distinguished Researcher of Iran, by the Iran Energy Association (IEA) as the Best Researcher of Iran in the field of energy, by the MSRT as the Distinguished Researcher of Iran, by the Academy of Science of the Islamic Republic of Iran as the Distinguished Professor of electrical engineering, and by National Elites Foundation as the laureates of Alameh Tabatabaei Award, and was awarded the National Prize, in 2008, 2010, 2018, and 2019, respectively. Based on the Web of Science database (2005–2019), he is among world's top 1% elite scientists according to ESI (Essential Science Indicators) ranking system.

...