

Solar Power Tower
Design Basis Document

Revision 0



Prepared by
Alexis B. Zavoico
Nexant
San Francisco, CA 94104

Prepared by
Sandia National Laboratories
Albuquerque, New Mexico 87185 and Livermore, California 94550

Sandia is a multiprogram laboratory operated by Sandia Corporation,
a Lockheed Martin Company, for the United States Department of Energy
under contract DE-AC04-94AL85000.

Approved for public release; further dissemination unlimited.

SAND2001-2100
Unlimited Release
Printed July 2001



Issued by Sandia National Laboratories, operated for the United States Department of Energy by Sandia Corporation.

NOTICE: This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government, nor any agency thereof, nor any of their employees, nor any of their contractors, subcontractors, or their employees, make any warranty, express or implied, or assume any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represent that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government, any agency thereof, or any of their contractors or subcontractors. The views and opinions expressed herein do not necessarily state or reflect those of the United States Government, any agency thereof, or any of their contractors.



SAND2001-2100
Unlimited Release
Printed July 2001

Solar Power Tower Design Basis Document Revision 0

Prepared by Alexis B. Zavoico
Nexant
San Francisco, CA 94104

Abstract

This report contains the design basis for a generic molten-salt solar power tower. A solar power tower uses a field of tracking mirrors (heliostats) that redirect sunlight on to a centrally located receiver mounted on top a tower, which absorbs the concentrated sunlight. Molten nitrate salt, pumped from a tank at ground level, absorbs the sunlight, heating it up to 565°C. The heated salt flows back to ground level into another tank where it is stored, then pumped through a steam generator to produce steam and make electricity. This report establishes a set of criteria upon which the next generation of solar power towers will be designed. The report contains detailed criteria for each of the major systems: Collector System, Receiver System, Thermal Storage System, Steam Generator System, Master Control System, and Electric Heat Tracing System. The Electric Power Generation System and Balance of Plant discussions are limited to interface requirements. This design basis builds on the extensive experience gained from the Solar Two project and includes potential design innovations that will improve reliability and lower technical risk. This design basis document is a living document and contains several areas that require trade-studies and design analysis to fully complete the design basis. Project- and site-specific conditions and requirements will also resolve open To Be Determined issues.

Contents

1. Design Standards, Material Properties, System Functional Descriptions, General Design Requirements, and Design Data	13
1.1 Introduction and Purpose	13
1.1.1 Introduction.....	13
1.1.2 Purpose.....	13
1.2 Reference Documents	14
1.2.1 Design Codes and Standards.....	14
1.3 Solar Power Tower Plant Functional Descriptions.....	15
1.3.1 Solar Power Tower System Elements.....	15
1.4 General Design Requirements	18
1.4.1 Solar Power Tower Plant Sizing Criteria.....	18
1.4.2 American Society of Mechanical Engineers Boiler and Pressure Vessel Codes.....	20
1.4.3 Plant Design Life	20
1.5 Site Selection Characteristics.....	21
1.6 Nitrate Salt Basic Data.....	21
1.6.1 Nitrate Salt Properties.....	21
1.6.2 Salt Specification	22
1.6.3 Fluid Nitrate Salt Property Formulas.....	23
1.6.4 Solid Salt Properties.....	23
1.7 Trade Studies and Evaluations.....	24
2. Operating States and Transitions	25
2.1 Introduction.....	25
2.2 State and Transition Definitions – Energy Collection Section.....	25
2.2.1 States.....	25
2.2.2 Transitions Between States.....	25
2.3 State and Transition Definitions – Energy Conversion Section	28
2.3.1 States.....	28
2.3.2 Transition Between States	32
3. System Descriptions, Scope of Study, and Design Bases.....	35
3.1 Introduction.....	35
3.1.1 Process Flow Diagrams.....	35
3.2 Collector System.....	35
3.2.1 System Description	35
3.2.2 Scope of Supply	35
3.2.3 Field Communication Link Design Basis.....	55
3.2.4 Emergency Heliostat Defocus Design Basis	55
3.3 Receiver System.....	55
3.3.1 System Description	55
3.3.2 Scope of Supply	56
3.3.3 Design Innovation.....	56
3.3.4 Receiver Design Basis	57
3.3.5 Receiver System Materials	66

3.3.6	Receiver Inlet Vessel Design Basis	67
3.3.7	Receiver Outlet Vessel Design Basis.....	68
3.3.8	Receiver Circulation Pump Design Basis.....	69
3.3.9	Receiver Control System	70
3.3.10	Typical Sequence of Operations	71
3.4	Thermal Storage System.....	73
3.4.1	System Description	73
3.4.2	Scope of Supply	74
3.4.3	Thermal Storage System Design Basis.....	75
3.4.4	Design Temperatures, Heating Rates, and Tank Thermal Cycles	80
3.4.5	Thermal Storage System Tank Materials.....	83
3.4.6	Tank Insulation	83
3.4.7	Thermal Storage System Foundations	85
3.5	Steam Generation System.....	87
3.5.1	System Description	87
3.5.2	Scope of Supply	87
3.5.3	Steam Generation System Design Basis	88
3.5.4	Steam Generation System Shell and Tube Heat Exchanger Design Requirements	94
3.5.5	Steam Drum Design Requirements.....	95
3.5.6	Steam Generation System Circulation Pump and Steam Generation System Attenuation Pump Design Requirements.....	96
3.5.7	Steam Generation System Preheater Feedwater Pump(s) and Steam Generation System Evaporator Feedwater Pump(s) Design Basis.....	97
3.5.8	Steam Generation System Material Selection	99
3.5.9	Steam Generation System Fill Process	101
3.5.10	Steam Generation System Sequence of Operation	102
3.6	Electric Heat Tracing System	104
3.6.1	System Description	104
3.6.2	Scope of Supply	104
3.6.3	Electric Heat Tracing System Design Basis	105
3.6.4	Equipment Thermal Conditioning and Freeze Protection	109
3.7	Master Control System	111
3.7.1	System Description	111
3.7.2	Preliminary System Block Diagram	112
3.7.3	Scope of Supply	112
3.7.4	General Distributed Control System Design and Functional Requirements	114
3.8	Major Process to BOP Interfaces.....	116
3.8.1	General.....	116
3.8.2	Balance of Plant to Collector System Interface Requirements.....	116
3.8.3	Balance of Plant to Receiver System Interface Requirements	116
3.8.4	Balance of Plant to Thermal Storage System Interface Requirements	117
3.8.5	Balance of Plant to Steam Generation System Interface Requirements	118
3.8.6	Balance of Plant to Electric Heat Tracing System Interface Requirements	118

3.8.7	Balance of Plant to Master Control System Interface Requirements	118
3.8.8	Balance of Plant to Electric Power Generation System Interface Requirements	119
4.	General Layout, Materials, and Processes	120
4.1	Plant Layout	120
4.1.1	Layout for Access and Egress – Personnel Safety	120
4.1.2	Maintenance Access	120
4.2	Mechanical and Electrical Equipment Maintenance Automation	121
4.2.1	Solar Power Tower Mechanical and Electrical Equipment	121
4.2.2	Component Failure Diagnostics	121
4.3	Material Selection General	121
4.3.1	Material Requirements	121
4.4	Piping, Fitting, and Pipe Support Requirements	122
4.4.1	Pipe	122
4.4.2	Flanges	123
4.4.3	Fittings	123
4.4.4	Pipe Supports	123
4.4.5	Stud Bolts	124
4.5	Valves	124
4.5.1	Gate Valves and Globe Valves	124
4.5.2	Bonnet Gaskets and Split Body Gaskets	125
4.5.3	Extended Bonnet Valves	125
4.6	Solar Power Tower and Nitrate Salt Service Instrumentation	125
4.6.1	Flow Instruments	125
4.6.2	Temperature Instruments	126
4.6.3	Pressure Instruments	126
4.6.4	Direct Normal Insolation, Total Insolation, and RS Flux Instrumentation	127
4.6.5	Photometers	129
4.6.6	Level Instruments	130
4.6.7	Receiver Infra Red Cameras	130
4.7	Electrical Component Requirements	131
4.7.1	General Layout Issues	131
4.7.2	Cable and Raceway Materials	132
4.7.3	Enclosures, Junction Boxes, Panels, Cabinets, Motors, and Motor Housings	132
4.7.4	Power System Reliability	133
4.8	Equipment and Piping Thermal Insulation	133
4.8.1	Economic Insulation Thickness	133
4.8.2	General Insulation System Design	133
4.9	Nitrate Salt Handling and Melting	135
4.9.1	Nitrate Salt Handling and Melting Equipment	135
4.9.2	Off-Gassing NOX	136
4.9.3	Safety	136
5.	Trade Studies	138
5.1	Elimination of the Receiver Inlet Vessel	138

5.2	Receiver Protection.....	138
5.2.1	Primary Objective	138
5.2.2	Secondary Objective	139
5.2.3	Receiver Protection Requirement Basis	139
5.2.4	Protection System Reliability	139
5.2.5	Receiver Protection Options	139
5.3	Elimination of the Receiver Outlet Vessel	140
6.	References	142

Figures

Figure 2-1.	Energy Collection Section: Operating States and Transitions.....	27
Figure 2-2.	Energy Conversion Section: Operating States and Transitions.....	31
Figure 3-1.	Nitrate Salt Systems PFD.	36
Figure 3-2.	SGS Feedwater/Steam System PFD.	37
Figure 3-3.	Design Solution Using Line Orifice.	61
Figure 3-4.	Conceptual Sectional View of Oven Box Assembly.	62
Figure 3-5.	Configuration of passive vent.	101
Figure 3-6.	Piping System EHT Zones.....	107
Figure 3-7.	Typical Valve EHT Zone Definition.	108
Figure 3-8.	Distributed Control System	113
Figure 4-1.	Typical Installation of Pressure Transducer	128

Tables

Table 1-1.	Properties of Nitrate Salt.....	22
Table 2-1.	Plant States; Equipment and System Status.....	26
Table 2-2.	Plant States: Equipment and System Status.....	29
Table 3-1.	Wind Definitions for Heliostat Structural Design.	40
Table 3-2.	Typical Error Stack-Ups for Tracking and Beam Quality in Calm Winds.....	42
Table 3-3.	Typical Error Stack-Ups for Tracking and for Beam Quality in Windy Conditions.....	43
Table 3-4.	Receiver Maximum Design Temperatures	65
Table 3-5.	Receiver Materials Specification	66
Table 3-6.	Design Temperatures and Heating Rates	81
Table 3-7.	TSS Tank Material Selection.....	84
Table 3-8.	Nominal Full Load SGS Equipment Design Temperature and Pressure Conditions	88
Table 3-9.	SGS Material Selection.....	99
Table 4-1.	Material Requirements for Piping in Nitrate Salt Service and Structural Steel	121

Acronyms/Abbreviations

ADAS	Administrative and Data Analysis System
API	American Petroleum Institute
ASME	American Society of Mechanical Engineers
ASTM	American Society for Testing and Materials
bar	Bars, pressure
BCS	beam characterization system
BOP	Balance of Plant
BTU	British Thermal Unit
CPU	Central Processing Unit
CS	Collector System
D	diameter (ft)
DAPS	Dynamic Aim Processing System
DCS	Distributed Control system
EHT	electric heat tracing
EHTS	Electric Heat Tracing System
EPGS	Electric Power Generation System
f	friction factor (dimensionless)
ft	feet
ft/s	feet per second
g	gravitational constant (ft/sec ²)
HAC	heliostat array controller
HC	heliostat controller
h _l	head loss (feet)
HLL	high liquid level
HMI	Human Machine Interface
hr	hour
I/O	input/output
in	inch
IR	infrared
KNO ₃	potassium nitrate
kPa	Pascals x1000, Pressure
kW/m ²	kilowatts per square meter
kWh	kilowatt hours
L	length (ft)
lb _m	pound mass
LLL	low liquid level
m	meter
m/s	meters per second
MCMS	Material Control and Maintenance System
MCS	Master Control System
MI	Mineral Insulated (Magnesium Oxide)
MIS	Management Information System
mm	millimeter
mph	miles per hour

mrad	milliradian
MW/m ²	megawatts per square meter
MW _e	megawatt - electric
MWh	megawatt hour
MW _t	megawatt – thermal
N	number of moles of gas (N = M (molecular Weight)/mass
N/A	Not Applicable
NaK	sodium potassium
NaNO ₃	sodium nitrate
NC	normally closed
NDE	nondestructive examination
NEC	National Electric Code
NEMA	National Electric Manufacturers Association
NFPA	National Fire Protection Association
NLL	normal liquid level
NO	normally open
NOX	nitrous oxides
°C	temperature – degrees centigrade
°F	temperature - degrees Fahrenheit
°F/hr	°F/hour, temperature rate of change
p	pressure (pounds per square inch)
Pa	Pascal, pressure
PCN	personal computer network
PFD	process flow diagram
PLC	programmable logic controller
psia	pressure, pounds per square inch - absolute
psig	pressure, pounds per square inch - gauge
PSV	pressure safety valve
R	universal gas constant 8.3144 Joule / mol °K (1.987 Btu/lb mol °R)
RS	receiver system
RTJ	ring type joint, flanged fitting
SAPS	Static Aim Processing System
SAPS	static aim point
sec	second
SGS	steam generation system
SNL	Sandia National Laboratories
SPT	solar power tower
T	temperature (degrees Fahrenheit (°F), Centigrade (°C), Kelvin (°K), or Rankine (°R)
TBD	To Be Determined (Design Issue)
TEMA	Tubular Exchanger Manufacturers Association
TSS	thermal storage system
UPS	uninterruptible power supply
V	volt
V	volume
V	velocity (ft/sec)

VSD Variable Speed Drive

1. Design Standards, Material Properties, System Functional Descriptions, General Design Requirements, and Design Data

1.1 Introduction and Purpose

1.1.1 Introduction

The next generation Solar Power Tower (SPT) will build upon the experience gained from designing, constructing, and operating the 10 MW_e Solar Two central receiver project at Daggett, California. The design basis will draw in a large part from:

- A Bechtel Solar Two report entitled “Topical Report on the Lessons Learned, Project History, and Operating Experience, Solar Two, Daggett, California - Revision 1, dated 5 Nov 1999.”
- A Bechtel Solar Two criteria document entitled “Design Basis Document for the Solar Two Project, Daggett, California – Revision 2, dated 25 Feb 1994.”

Potential design innovations are also discussed. These are recommended innovations to Solar Two baseline that will improve the overall system reliability and lower risk; however, additional preliminary design and analysis will have to be completed before these implemented. Trade Studies and concept design analyses will be completed and, based upon recommendation, will be incorporated into a revised baseline.

1.1.2 Purpose

The purpose of this document is to establish a set of criteria upon which the next generation SPT project will be designed. The SPT Design Basis Document (DBD) will be generic in nature and not for a specific plant rating. The DBD will focus on the following Solar SPT elements:

- Collector System (CS)
- Receiver System (RS)
- Steam Generation System (SGS)
- Thermal Storage System (TSS)
- Master Control System (MCS)
- Electric Heat Tracing System (EHTS)
- Electric Power Generation System (EPGS)*
- BOP*

* EPGS, BOP, and their related subsystems discussions will be limited to interface requirements. The EPGS uses conventional turbine-generator hardware and technology that is not unique to SPT technology. There are many turbine-generator systems available. The appropriate EPGS will be selected based upon SPT system thermal performance. BOP systems will also be discussed as interface requirements and, if necessary, in greater detail when the BOP subsystem is unique to the SPT system e.g., heliostat emergency power.

1 **1.2 Reference Documents**

2 **1.2.1 Design Codes and Standards**

3 Reference codes and standards are keyed to the United States of America (USA) market. Should
4 an SPT facility be constructed outside the USA, an equivalency matrix will have to be prepared
5 to reflect the specific requirements for the host country.

6	No. Designation	Title
7	ASME	B31.1, Power Piping
8	ASME	Section I, Rules for the Construction of Power Boilers
9	ASME	Section III, Division 1, Subsection NH, Class 1 Components in Elevated
10		Temperature Service
11	ASME	Section V, Non Destructive Examination
12	ASME	Section VIII, Division 1, Rules for the Construction of Pressure Vessels
13	ASME	Section VIII, Division 2, Alternative Rules for the Construction of Pres-
14		sure Vessels
15	ASTM	A105, Specification for Forgings, Carbon Steel, for Piping Components
16	ASTM	A181, Specification for Forgings, Carbon Steel for General Service
17	ASTM	A182, Specification for Forged or Rolled Alloy-Steel Pipe Flanges,
18		Forged Fittings, and Valves and Parts for High-Temperature Service
19	ASTM	A192, Specification for Seamless Carbon Steel Boiler Tubes for High-
20		Pressure Service
21	ASTM	A193, Specification for Alloy-Steel and Stainless Steel Bolting Materials
22		for High-Temperature Service
23	ASTM	A194, Specification for Carbon and Alloy Steel Nuts for Bolts for High-
24		Pressure and High-Temperature Service
25	ASTM	A213, Specification for Seamless Ferritic and Austenitic Alloy-Steel
26		Boiler, Superheater, and Heat Exchanger Tubing
27	ASTM	A216, Specification for steel Castings, Carbon, Suitable for Fusion
28		Welding, for High-Temperature Service
29	ASTM	A240, Specification for Heat-Resisting Chromium and Chromium-Nickel
30		Stainless Steel Plate, Sheet, and Strip for Pressure Vessels
31	ASTM	A249, Specification for Welded Austenitic Steel Boiler, Superheater, Heat
32		Exchanger, and Condenser Tubes
33	ASTM	A312, Specification for Seamless and Welded Austenitic Stainless Steel
34		Pipe
35	ASTM	A325, Specification for Structural Steel Bolts, Steel, Heat Treated,
36		120/125 ksi Minimum Tensile Strength
37	ASTM	A351, Specification for Castings Austenitic Austenitic-Ferritic (Duplex)
38		for Pressure-Containing Parts
39	ASTM	A36, Specification for Carbon Structural Steel
40	ASTM	A387, Specification for Pressure Vessel Plates, Alloy Steel, Chromium-
41		Molybdenum
42	ASTM	A403, Specification for Wrought Austenitic Stainless Steel Piping Fittings

1	ASTM	A500, Specification for Cold-Formed Welded and Seamless Carbon Steel
2		Structural Tubing in Rounds and Shapes
3	ASTM	A506, Specification for Steel, Sheet and Strip, Alloy, Hot-Rolled and
4		Cold-Rolled, Regular Quality and Structural Quality
5	ASTM	A516, Specification for Pressure Vessel Plates, Carbon Steel, for Moder-
6		ate- and Lower-Temperature Service
7	ASTM	A53, Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated
8		Welded and Seamless
9	ASTM	A556, Specification for Seamless Cold-Drawn Carbon Steel Feedwater
10		Heater Tubes
11	NEC	National Electric Code
12	NEMA	National Electrical Manufacturers Association
13	NFPA	National Electric Code (NEC), National Fire Protection Association
14		(NFPA)
15	TEMA	Tubular Exchanger Manufacturers Association, 8th Edition TEMA Stan-
16		dards
17	UBC	Uniform Building Code

18 **1.3 Solar Power Tower Plant Functional Descriptions**

19 **1.3.1 Solar Power Tower System Elements**

20 The following are the major SPT system elements.

21 **1.3.1.1 Collector System**

22 The collector system (CS) contains the collector field and heliostats that redirect and focuses
 23 sunlight on the receiver. The major system elements are two-axis tracking mirrors (heliostats),
 24 heliostat controllers (HCs), a heliostat array controller (HAC), and a communications link be-
 25 tween the HCs and the HAC. The number of heliostats will vary for a particular receiver thermal
 26 duty and a specific heliostat design.

- 27 • The heliostat and HC consist of a foundation, pedestal, drive, support structure, mirrors,
 28 drive units, control sensors, HC and firmware/software, and associated heliostat wiring for
 29 power, control, and grounding.
- 30 • The HAC resident in the control center maintains master control over the entire CS and in-
 31 cludes the Beam Characterization System (BCS), static aim processing system, and Dynamic
 32 Aim Processing System (DAPS) software. The operator interface and interaction will be
 33 through the Distributed Control System (DCS).
- 34 • BCS consists of BCS target, cameras, and automatic software resident on the HAC.
- 35 • The communication link should be a redundant network (copper path or fiber) between the
 36 HAC and the HCs

1 **1.3.1.2 Receiver System**

2 The RS converts the redirected solar flux into thermal energy. The receiver is a cylindrical tube
3 wall heat exchanger that heats molten nitrate salt from 290°C (550°F) to 565°C (1050°F) and
4 includes the associated piping, valves and controls, and unique RS control system software inter-
5 face requirements. The control system software resides in the MCS. The system components of
6 the RS are: the receiver, receiver pumps, receiver inlet vessel, and outlet vessel.

7 The RS is installed on top of a tower structure. The tower structure is a BOP subsystem. The
8 interfaces between the RS and the tower will be discussed.

9 The cold salt pump is installed on a structure on top of the thermal storage system (TSS) cold
10 tank. The structural support frame is a BOP subsystem.

11 **1.3.1.3 Thermal Storage System**

12 The TSS stores high temperature nitrate salt 565°C (1050°F) from the receiver for use by the
13 steam generator, and stores low temperature nitrate salt 290°C (550°F) from the steam generator
14 for use by the receiver. The TSS system components are the: cold nitrate salt tank; hot nitrate
15 salt tank; pressure relief valves (over- and under-pressure relief); tank foundations; nitrate salt
16 inventory; tank immersion heaters; and tank insulation system.

17 **1.3.1.4 Steam Generation System**

18 The Steam Generation System (SGS) uses thermal energy from the hot nitrate salt to produce
19 superheated steam at the conditions required by the turbine-generator and auxiliary steam sys-
20 tems. The SGS system components are: shell and tube exchangers including superheater, reheater,
21 evaporator, preheater, and startup feedwater heater; a steam drum; steam drum mixer; steam
22 generator evaporator feedwater pump; and steam generator preheater feedwater circulation
23 pump. A hot nitrate salt delivery system consists of the SGS circulation pump and SGS attem-
24 peration pump.

25 The SGS circulation pump is installed on a structure on top of the hot salt tank and the SGS at-
26 temperature pump is installed on a structure on top of the cold salt tank. The structural support
27 frames are BOP subsystems.

28 **1.3.1.5 Master Control System**

29 The MCS controls and monitors all SPT process functions for all system equipment through all
30 states and transitions in response to operator commands. The MCS is comprised of the follow-
31 ing major subsystems: a DCS, HAC, and ADAS. MCS functions tie all plant systems together
32 into a common database encompassing the CS, RS, TSS, SGS, electric heat tracing system
33 (EHTS), EPGS, and BOP.

34 The DCS consists of the Human Machine Interface (HMI)—operator consoles, redundant Per-
35 sonal Computer Network (PCN) servers, network server, redundant Programmable Logic Con

1 trollers (PLCs), PLC remote input/output (I/O) devices and cabinets, data historian and network
2 communications, peripherals, and software

3 The HAC consists of redundant HAC Processors (PCs), data historian, BCS hardware and soft-
4 ware, DAPS hardware and software, Static Aim Processing System (SAPS) software, special in-
5 struments, associated network ties, and peripherals. The HAC controls and monitors the CS and
6 individual HCs. The HAC HMI interface is through the DCS. HCs are *not* part of the HAC.

7 The Administrative and Data Analysis Systems (ADAS) are linked to the DCS and HAC with
8 read-only access and consist of the Management Information System (MIS), Material Control
9 and Maintenance Systems (MCMS), and SPT administrative systems, peripherals, and software.
10 ADAS will not be defined in the Design Basis Document other than its interfaces with the DCS
11 and HAC.

12 **1.3.1.6 Electric Heat Tracing System**

13 The EHTS provides nitrate salt freeze protection to all process equipment and components;
14 thermal conditioning of all process equipment and components for plant startup; and protects
15 equipment from extreme thermal gradients and excessive thermal stresses. The EHTS encom-
16 passes all STP equipment, component thermal conditioning, and nitrate salt freeze protection
17 systems. The EHTS consists of the following components:

- 18 • All electric heat tracing (EHT) circuits/zones,
- 19 • Installation hardware—cold leads, termination kits,
- 20 • Temperature elements either thermocouples or resistant temperature detectors (RTDs),
- 21 • Temperature signal conditioning instrumentation and transmitters, and
- 22 • Power conditioning equipment including a solid state contactors.

23 EHTS system control will be through the PLCs and the DCS. The EHTS is a process critical
24 system and is an integral part of the MCS. EHT is required on equipment, piping, instruments,
25 valves, vents, drains, pressure relief valves, tank immersion heaters, and RS ovens.

26 Thermal Insulation. Thermal Insulation is part of the system on which it is installed. However,
27 the design and installation details are an integral part of the EHTS and must be developed as part
28 of an integrated system design package.

29 **1.3.1.7 Electric Power Generation System**

30 The Electric Power Generation System (EPGS) converts the energy in the main steam into elec-
31 tric power for delivery to the electric grid. The EPGS consists of the turbine-generator, deaera-
32 tor, condenser, condensate system, feedwater system, circulating water system including the
33 cooling tower, water sampling system, turbine lubrication oil system, and associated pumps and
34 rotating equipment.

1 **1.3.1.8 Balance of Plant**

2 The Balance of Plant (BOP) supports all other plant systems and includes:

- 3 • Switch yard/main power distribution system including main power transformers and secondary power transformers
- 4 • Emergency and uninterruptible power supply (UPS) system
- 5 • RS tower cranes providing RS receiver panel access, RS and SGS pump access, SGS exchanger tube bundle access
- 6 • Fire protection and detection systems
- 7 • Plant security system
- 8 • Compressed air system
- 9 • Potable water system
- 10 • Cooling water system
- 11 • Service water system
- 12 • Nitrogen supply system
- 13 • Water treatment system
- 14 • Deionized water system
- 15 • Sanitary waste and industrial waste systems
- 16 • Oil/water separator

19 The BOP includes the power distribution system feeding the individual process system Motor Control Centers (MCCs), grounding, lightning protection, lighting with associated raceway, conduit, and wire. The MCCs and associated power distribution supplying equipment, instruments, and components are part of the system element and are *not* BOP.

23 The BOP includes all site civil (grading, drainage, fencing), buildings, receiver tower structure, and bridging structures over the TSS. The BCS target is included in the BOP.

25 **1.4 General Design Requirements**

26 **1.4.1 Solar Power Tower Plant Sizing Criteria**

27 SPT plant sizing criteria are discussed below. This is an iterative design process lead by the project integrator with support from the collector field technical specialists, receiver engineer/designer, and the turbine-generator manufacturer.

- 30 • Establish the required net annualized MWh_{electric} delivered to power grid.
- 31 • Establish the annual direct normal insolation MWh_{thermal}/m^2 available to the plant based upon insolation models for the area (Climatic factors that affect the annual solar radiation, e.g., dust, haze, wind outages, weather, etc.) should be taken into account, if available.)
- 34 • Determine collector field/mirror area (m^2) required based upon annualized power delivered to grid, the annual solar radiation, annual collector field efficiency, annual receiver efficiency, and annual net turbine cycle efficiency.

- 1 – The annual collector field efficiency (%) adjusts annual direct normal insolation to the
2 collector field for heliostat losses as a function of time, the sum of cosine factors, shading
3 losses, blocking losses, heliostat cleanliness, losses, etc. This efficiency is developed by
4 the collector field designer.
- 5 – The annual receiver efficiency (%) adjusts annual receiver output (MWh) as a function of
6 time considering varying receiver loads (startup and shut down cycles) and the sum of
7 conduction, convection, and radiation losses. This efficiency is developed by the re-
8 ceiver designer.
- 9 – The annual net turbine cycle efficiency (%) adjusts the turbine output (MWe) as a func-
10 tion of time for partial loads (startup and shut down cycles), etc. This efficiency is de-
11 veloped by the turbine manufacturer and the plant operations models.
- 12 • Determine the maximum daily insolation (MWh/m²) for the “best day,” summer solstice.
- 13 • Determine the maximum amount of solar energy collected (MWh) for the “best day” from
14 the maximum daily insolation, mirror area, collector field efficiency, and daily receiver effi-
15 ciency.
- 16 – Determine the daily collector field efficiency (%) for the “best day” e.g., cosine factor,
17 shading losses, and blocking losses.
- 18 – The daily receiver efficiency (%) is similar to the annual receiver efficiency but adjust
19 the receiver output (MWt) for partial loads considering conduction, convection, and ra-
20 diation losses. This efficiency is developed by the receiver designer.
- 21 • Establish the hours per day (hrs) that the plant is expected to deliver energy to the grid.
- 22 • Determine the gross amount of energy delivered to the SGS (MW) from the maximum
23 amount of energy collected and the hours of operation.
- 24 • Establish turbine size based upon gross amount of energy delivered to the SGS times the tur-
25 bine efficiency (%).
- 26 • Establish a target SPT annual plant availability (%) based upon the annual direct normal in-
27 solation MWh_{thermal}/m^2 that could produce power with a corresponding theoretical maximum
28 power generated and compare this value to a target theoretical annual SPT operation by re-
29 ducing the maximum as a function of time considering:
- 30 – Time for planned maintenance outages that impact power generation
31 – Time that insolation levels are below the minimum to allow the heliostats to track the re-
32 ceiver
33 – Time durations for RS warm-up
34 – Time durations for SGS/EPGS startup/warm-up
- 35 A target SPT annual plant availability of 90% should be a design objective.

1 • TSS Sizing

2 – Minimum storage capacity for daytime operation. The steam generator and turbine gen-
3 erator are sized to accept the peak thermal output from the receiver with a nominal stor-
4 age capacity of one hour provided to simplify the daily turbine startup.

5 – Storage Capacity for 24 hr/day operation. A storage capacity of 12 to 16 hours allows
6 continuous turbine operation at full load on the “best day.”

7 • RS Sizing (MW_t)

8 – Establish the peak reflected power from the collector field at noon of the “best day.”

9 – Estimate receiver spillage losses, reflection losses, and heat losses due to convection,
10 conduction, and radiation.

11 – Receiver rating (MW_t) is the reflected power from the collector field minus the sum of
12 the receiver losses.

13 **1.4.2 American Society of Mechanical Engineers Boiler and Pressure Vessel Codes**

14 It is recommended that:

15 • Salt piping systems and steam piping systems be designed and manufactured to American
16 Society of Mechanical Engineers (ASME) B31.1.

17 • All pressure vessels and heat exchangers in salt service be designed and manufactured to
18 ASME Section VIII with the exception of the receiver.

19 • National, state, and local jurisdictional authorities may have special requirements that could
20 override this recommendation. For example, ASME Section I was required for Solar Two
21 SGS Exchangers by the State of California—any steam generator, regardless whether it was
22 fired or unfired.

23 • Solar Two Receiver design and manufacturing requirements were driven by metallurgy and
24 operating temperatures. These resulted in application of ASME Section I and Code Case N-
25 47. Refer to page 57, line 17 for a discussion on Code Case N 47.

26 **1.4.3 Plant Design Life**

27 Plant and equipment will be designed for a 30-year design life.

1 **1.5 Site Selection Characteristics**

2 Site selection characteristics for an SPT are similar to any industrial facility, but for an SPT fa-
3 cility, the following apply:

- 4 • Annual mean direct beam solar insolation ranging from 5.6 to 7.5 kWh/m²/day.
- 5 • Site altitude and weather conditions both macro- and micro-level should not have high inci-
6 dences of atmospheric water, smoke, fogs, haze, and airborne particulates (dust, tilled farm
7 land, evaporation pond residues, etc). Periodic rain and snow assist in keeping the heliostats
8 clean.
- 9 • Not subject the high winds or wind amplification due to terrain features.
- 10 • Land area sufficient to site the SPT, heliostat field, and provide a clear safety zone for he-
11 liostat and plant operations e.g., glint, cooling tower fog.
- 12 • Water availability requirements are the same as any power plant with an additional require-
13 ment for deionized water for heliostat washing.
- 14 • Close proximity to power grid tie-in point.
- 15 • Not in the vicinity of local airports, particularly airport low-altitude approach paths.
- 16 • Relatively low seismic risk.
- 17 • While not critical, isolated away from major inhabited areas, but close enough for construc-
18 tion and operations labor pool.

19 **1.6 Nitrate Salt Basic Data**

20 **1.6.1 Nitrate Salt Properties**

21 **1.6.1.1 Nitrate Salt-General**

22 The nitrate salt is a mixture of 60% by weight sodium nitrate (NaNO₃) and 40% by weight po-
23 tassium nitrate (KNO₃). It is stable in air and has a low vapor pressure.

24 **1.6.1.2 Phase Change Nitrate Salt Properties**

- 25 • Melted salt can be used over a temperature range of 260°C (500°F) to approximately 621°C
26 (1150°F).
- 27 • As temperature decreases, it solidifies at 221°C (430°F) and starts to crystallize at 238°C
28 (460°F).

- 1 • Isotropic compressibility (NaNO₃) at the melting point: 2×10^{-10} (m²/N)
- 2 • Heat of fusion (based on the average of heat of fusion of each component): $h_{sl} = 161$ kJ/kg
- 3 • Change in density upon melting: $\Delta V/V_{solid} = 4.6\% \Rightarrow V_{liquid} = 1.046 V_{solid}$

4 **1.6.1.3 Thermal and Fluid Properties**

5 The properties for the mixture, 60% NaNO₃ and 40% KNO₃, as a function of temperature are
 6 given in Table 1-1.

7 **Table 1-1. Properties of Nitrate Salt**

Temperature Fahrenheit	Density lb _m /ft ³	Specific Heat Btu/lb _m F	Absolute Vis- cosity lb _m /ft-hr	Thermal Con- ductivity Btu/hr-ft-F
500	120.10	0.356	10.5058	0.284557
550	118.98	0.358	8.6073	0.287692
600	117.87	0.359	7.0853	0.290827
650	116.76	0.360	5.8940	0.293962
700	115.65	0.361	4.9873	0.297097
750	114.54	0.362	4.3196	0.300232
800	113.43	0.363	3.8450	0.303367
850	112.32	0.364	3.5175	0.306502
900	111.21	0.366	3.2913	0.309637
950	110.10	0.367	3.1206	0.312771
1,000	108.99	0.368	2.9596	0.315906
1,050	107.88	0.369	2.7623	0.319041
1,100	106.77	0.370	2.4830	0.322176

Note: Bold type denotes design points for the nitrate salt systems

8
 9 **1.6.2 Salt Specification**

10 Industrial grade salt with a nominal composition of 60% by weight NaNO₃ and 40% by weight
 11 KNO₃ should be specified. The composition could vary from this 60/40 requirement but prop-
 12 erty tables and relationships must be developed in order for process design to commence.
 13 Therefore, it is recommended that the 60/40 composition be used as the design basis unless there
 14 are other issues driving the requirement. A minimum nitrate salt concentration will be specified
 15 as 98% by weight with the following requirements:

- 16 • Maximum chloride ion concentration from all sources will be 0.6% by weight

17 Maximum contamination from all sources will be:

- 1 • Nitrite: $\leq 1.00\%$ by weight
- 2 • Carbonate: $\leq 0.10\%$ by weight
- 3 • Sulfate: $\leq 0.75\%$ by weight
- 4 • Hydroxyl alkalinity: $\leq 0.20\%$ by weight
- 5 • Perchlorate: $\leq 0.25\%$ by weight
- 6 • Magnesium: $\leq 0.05\%$ by weight

7 Specification will include requirement for detailed chemical analysis and notification to the proj-
8 ect for any contaminants not listed above that exceed a concentration of 0.04% by weight.

9 1.6.3 Fluid Nitrate Salt Property Formulas

10 Fluid nitrate salt property formulas as a function of temperature between 300 to 600°C (570 to
11 1110°F) are as follows:

12 Density as a function of temperature:

$$13 \rho \text{ (lb}_m\text{/ft}^3\text{)} = 131.2 - 0.02221 \times T \text{ (}^\circ\text{F)}$$

$$14 \rho \text{ (kg/m}^3\text{)} = 2090 - 0.636 \times T \text{ (}^\circ\text{C)}$$

15 Specific heat as a function of temperature:

$$16 c_p \text{ (Btu/lb}_m\text{-}^\circ\text{F)} = 0.345 + (2.28 \times 10^{-5}) * T \text{ (}^\circ\text{F)}$$

$$17 c_p \text{ (J/kg - }^\circ\text{C)} = 1443 + 0.172 \times T \text{ (}^\circ\text{C)}$$

18 Absolute viscosity as a function of temperature:

$$19 \mu \text{ (lbm/ft-hr)} = 60.28440 - 0.17236 \times T \text{ (}^\circ\text{F)} + (1.76176 \times 10^{-4}) \times (T \text{ (}^\circ\text{F)})^2 - (6.11408 \times 10^{-8}) \times$$

$$20 (T \text{ (}^\circ\text{F)})^3$$

$$21 \mu \text{ (mPa-sec)} = 22.714 - 0.120 \times T \text{ (}^\circ\text{C)} + 2.281 \times 10^{-4} \times (T \text{ (}^\circ\text{C)})^2 - 1.474 \times 10^{-7} \times (T \text{ (}^\circ\text{C)})^3$$

22

23 Thermal conductivity as a function of temperature:

$$24 k \text{ (Btu/hr-ft- }^\circ\text{F)} = 0.253208 + 6.26984 \times 10^{-5} \times T \text{ (}^\circ\text{F)}$$

$$25 k \text{ (W/m - }^\circ\text{C)} = 0.443 + 1.9 \times 10^{-4} \times T \text{ (}^\circ\text{C)}$$

26 1.6.4 Solid Salt Properties

27 Solid salt properties are as follows:

28 Density, ρ

29 NaNO_3 : 2260 kg/m^3 at ambient temperature

30 KNO_3 : 2190 kg/m^3 at ambient temperature

31 Heat Capacitance c_p

32 NaNO_3 $37.0 \text{ cal/}^\circ\text{C-mol} = 1820 \text{ J/kg - }^\circ\text{C}$ near the melting point

1	KNO ₃	28.0 cal/°C-mol = 1160 J/kg – °C near the melting point
2	Thermal Conductivity	
3	KNO ₃	2.1 W/m °C

4 **1.7 Trade Studies and Evaluations**

5 There were elements of the Solar Two design that, while the technical solution worked, the sys-
6 tems were problematic. Based upon Solar Two “Lessons Learned,” follow-on evaluations and
7 trades studies are required to completely resolve the issue. Major trade studies will be discussed
8 in Section 5.0.

2. Operating States and Transitions

2.1 Introduction

For the purposes of the states and transitions, the SPT can be divided into the following sections: (1) energy collection section, consisting of the CS and the RS; and (2) energy conversion section, consisting of the steam generator system and the EPGS.

2.2 State and Transition Definitions – Energy Collection Section

2.2.1 States

The energy collection section operates in one of the following five states (Refer to Table 2-1 and Figure 2-1):

- Long Term Hold/Overnight Hold. The heliostats are in the stow position, the receiver is drained, and the electric heat trace circuits are inactive.
- Standby. The heliostats are focused on the standby aim points, and the receiver pump is in operation. Salt is flowing in the riser, the receiver bypass line, and the downcomer.
- Preheat. The receiver electric heat trace circuits are active, the preheat heliostats are focused on the receiver, and the receiver pump is in operation. Salt is flowing in the riser, the receiver bypass line, and the downcomer.
- Normal Operation. All of the available heliostats are focused on the receiver, the receiver flow rate is controlled to achieve an outlet temperature of 565°C (1,050°F), and the electric heat trace circuits are de-energized at normal operation temperature set points.
- Cloud Standby. All of the available heliostats are focused on the receiver, the receiver flow rate is controlled to achieve an outlet temperature of 510°C (950°F) under theoretical clear sky conditions, and the electric heat trace circuits are de-energized at the normal operation temperature set points.


2.2.2 Transitions Between States

The nine transitions between the states are as follows:

- Long Term Hold to Standby. The operator moves the heliostats from the stow positions to tracking the standby aim points. The temperatures of the riser, the receiver bypass line, and the downcomer are raised to 260°C (500°F). The receiver pump is started, and a flow is established in the riser, the bypass line, and the downcomer.

Table 2-1. Plant States; Equipment and System Status

Receiver System, Collector Field & Thermal Storage	Collector Field	Receiver			Riser & Downcomer	Receiver Pump	Thermal Storage		Downcomer Flow	Thermal Conditioning	
		Inlet Vessel	Panels	Outlet Vessel			Cold Tank	Hot Tank		Immersion Heaters	Electric Heat Tracing
Long Term Hold / Overnight	Heliostats Stowed	Empty	Empty	Empty	Empty	Off	Filled Max Level	Heel Level	None	Tank Systems Energized with controllers at Long Term Hold temperature set points	Salt wetted Systems Activated, Most Systems Inactive
Standby	Heliostats Tracking Standby Imaginary Aim Points	Level Control Operating at Partial Pressure	Empty	Empty	Filled with flow through Crossover	Re-circulation	Level Control– Level Variable	Level Control– Level Variable	Flow routed to Cold Tank	De-energized with controllers at Normal Operation temperature set points	Salt wetted Systems Activated, Flowing systems standby
Preheat	Heliostats assigned to preheat focused on the receiver	Level Control Operating at partial Pressure	Empty	Empty	Filled with flow through Crossover	Re-circulation	Level Control– Level Variable	Level Control– Level Variable	Flow routed to Cold Tank	De-energized with controllers at Normal Operation temperature set points	Receiver EHT and Ovens Active
Normal Operation	Heliostats Tracking Receiver Aim Points	Pressure Control Design Flow	Filled and Design Flow Established	Filled Under Level Control	Filled and Design Flow	On	Level Control - Draw-down to Heel Level	Level Control– Filling to Max Level	Flow routed to Hot Tank	De-energized with controllers at Normal Operation temperature set points	Salt wetted Systems Activated, Flowing systems standby
Cloud Standby	Heliostats Tracking Receiver Aim Points	Pressures Control, Under Reduced Pressure	Receiver flow controlled to maintain outlet temperature of 510°C (950°F) under theoretical clear sky conditions	Filled	Filled	On	Level Control– Level Variable	Level Control– Level Variable	Flow routed to Cold Tank	De-energized with controllers at Normal Operation temperature set points	Salt wetted Systems Activated, Flowing systems standby

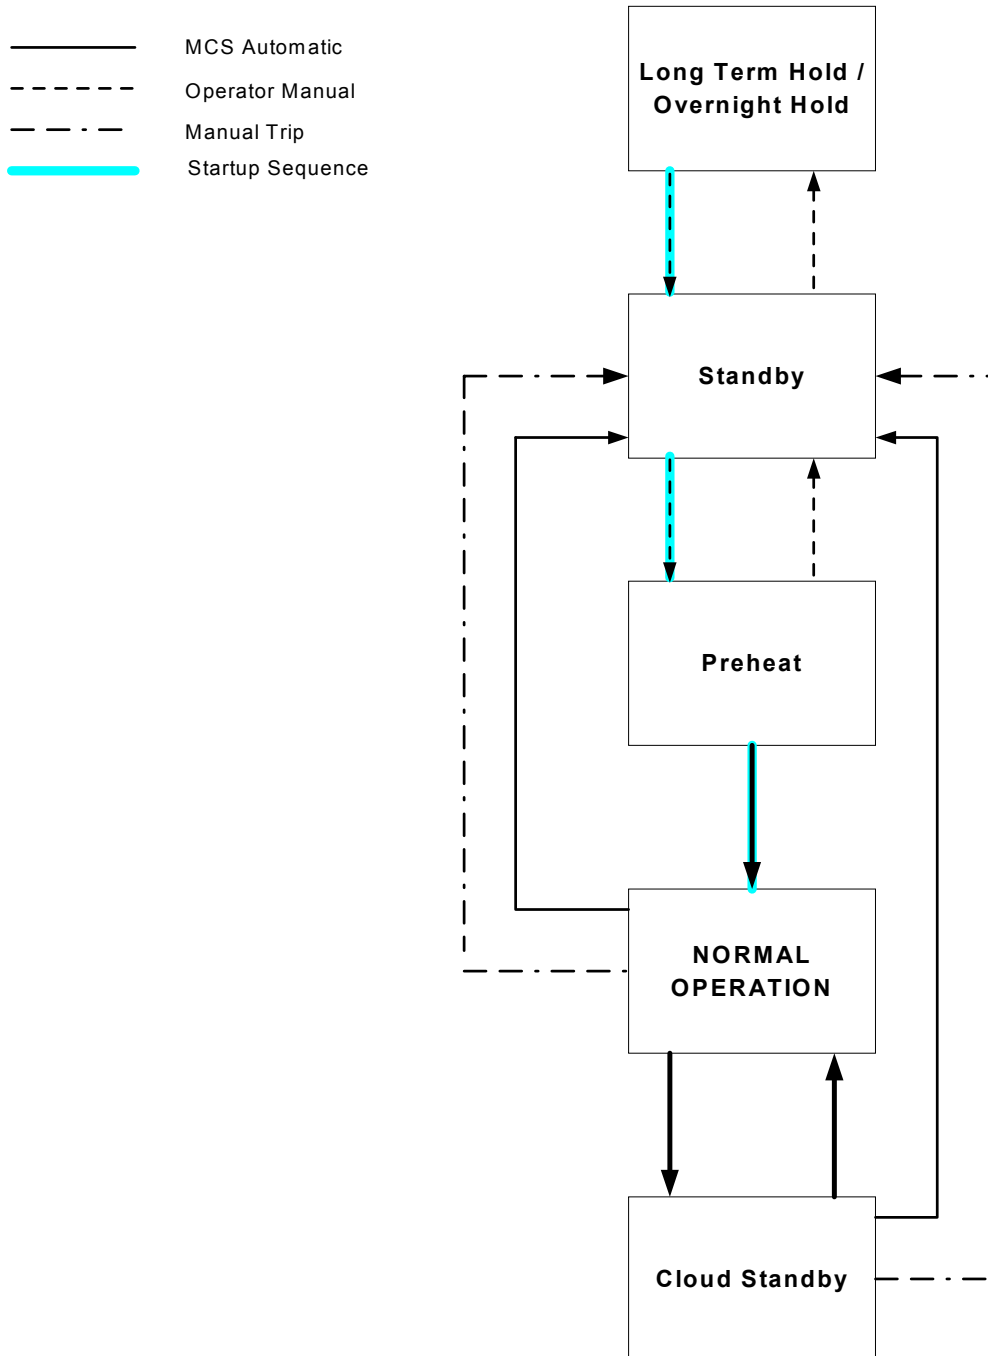

1

2

Figure 2-1. Energy Collection Section: Operating States and Transitions

3

- Standby to Preheat. The temperatures of the receiver ovens and interpanel piping are raised to 315°C (600°F). The preheat heliostats, selected by the DAPS, are moved from the standby aim points to the preheat aim points.

4

5

6

- Preheat to Standby. The preheat heliostats are moved from the preheat aim points to the standby aim points.

7

- 1 • Preheat to Normal Operation. The transition consists of the following steps: (1) the receiver
2 is filled by flooding, (2) serpentine flow is established, (3) a flow rate corresponding to clear
3 sky conditions is established, (4) the heliostats are moved from the standby (or preheat) aim
4 points to the normal aim points, and (5) the flow rate is controlled to achieve a nominal outlet
5 temperature of 565°C (1,050°F).
- 6 • Normal Operation to Cloud Standby. Automatic temperature control is suspended, and the
7 flow rate is controlled to achieve an outlet temperature of 510°C (950°F) under theoretical
8 clear sky conditions.
- 9 • Cloud Standby to Normal Operation. Automatic temperature control is resumed, and the
10 flow rate is controlled to achieve a nominal outlet temperature of 565°C (1,050°F).
- 11 • Normal Operation to Standby. The heliostats are moved from the normal aim points to the
12 standby aim points, the inlet vessel is vented to the atmosphere, and the receiver is drained.
- 13 • Cloud Standby to Standby. The heliostats are moved from the normal aim points to the
14 standby aim points, the inlet vessel is vented to the atmosphere, and the receiver is drained.
- 15 • Standby to Long Term Hold. The heliostats are moved from tracking the standby aim points
16 to the stow position, the receiver pump is stopped, and the electric heat trace circuits are in-
17 active.

18 **2.3 State and Transition Definitions – Energy Conversion Section**

19 **2.3.1 States**

20 The energy conversion section operates in one of the following five states (Refer to Table 2-2
21 and Figure 2-2):

- 22 • Long Term Hold. The steam generator is drained, and the electric heat trace circuits and
23 steam drum immersion heater are inactive.
- 24 • Overnight Hold. The attemperation pump supplies cold salt to the steam generator to keep
25 the steam drum hot, but with steam production the rate is 0 kg/hr (0 lb/hr). The steam turbine
26 is rotated by the turning gear. Steam drum immersion heaters de-energized at overnight hold
27 temperature set points.
- 28 • Auxiliary Steam. A nominal saturated steam flow rate of TBD kg/hr (TBD lb/hr) is estab-
29 lished by the auxiliary (electric) steam generator. Sealing steam is delivered to the turbine
30 shaft seals, and a vacuum is established in the condenser using the auxiliary steam generator
31 electric boiler and steam drum immersion heater set at auxiliary steam generator temperature
32 set points. Auxiliary steam demand to preheat piping systems and other equipment will be
33 supplied by the SGS.

34

Table 2-2. Plant States: Equipment and System Status

Steam Generator, Turbine Generator, Thermal Storage	Long Term Hold	Overnight Hold	Auxiliary Steam	Turbine Synchronization	Normal Operation
Steam - Generator					
Salt Side	Empty	Filled – Attemperation Pumps provide cold salt to maintain system minimum temperature	Filled	Filled	Filled
Water Side	Empty	Filled No Steam generation	Filled	Filled	Filled
Startup Feed Water Preheater	Empty	Filled	Filled	Filled	Filled
Thermal Storage					
Cold Tank	Filled	Level	Level	Level	Level
Hot Tank	Heel	Level	Level	Level	Level
Salt Pumps					
SGS Circulation Pump	Off	Off	On	On	On
SGS attemperation Pump	Off	Periodic Operation to maintain SGS minimum temperatures	On	Salt Attemperation As required	Salt Attemperation As required
Water Pumps					
Condensate	Off	Off	On	On	On
Feedwater	Off	Off	On	On	On
Recirculation (Evaporator and Preheater)	Off	Off	On	On	On
Auxiliary Steam					
Electric Boiler	Off	Off	Initial demand for turbine seals	Off	Off
SGS Aux. Steam	Off	Off	Condenser Vacuum and main steam dump valve	On	On


Table 2-2. Plant States: Equipment and System Status (continued)

Steam Generator, Turbine Generator, Thermal Storage	Long Term Hold	Overnight Hold	Auxiliary Steam	Turbine Synchronization	Normal Operation
Turbine – Generator					
Turbine	Turning Gear	Turning Gear	Turning Gear	On –Part Load	On – Full Load
Condenser	Empty	Nitrogen	Nitrogen	Vacuum	Vacuum
Generator	Off	Off	On	On - Part Load	On – Full Load
Balance-of-Plant	As Required to support sustaining Operation	As Required to support sustaining Operation	As required top support startup	On	On
Thermal Conditioning					
Immersion Heaters	Tank Systems Energized	Tanks Systems Intermittent	Tanks Systems Activated as required to Support Aux Steam Generation	Off	Off
Electric Heat Tracing	Off - all systems drained	Activated as required for preheating and protection of equipment from salt freezing. Steam systems activated for preheat as required	Non-flowing salt wetted Systems Activated, Flowing systems standby. Steam systems activated for preheat as required	Non-flowing Salt wetted Systems Activated, Flowing systems standby. Steam System Off	Non-flowing Salt wetted Systems Activated, Flowing systems standby. Steam System Off
Tank Air Volume Heating	Activated as required to prevent storage tank temperature stratification	Off	Off	Off	Off

1

30

2

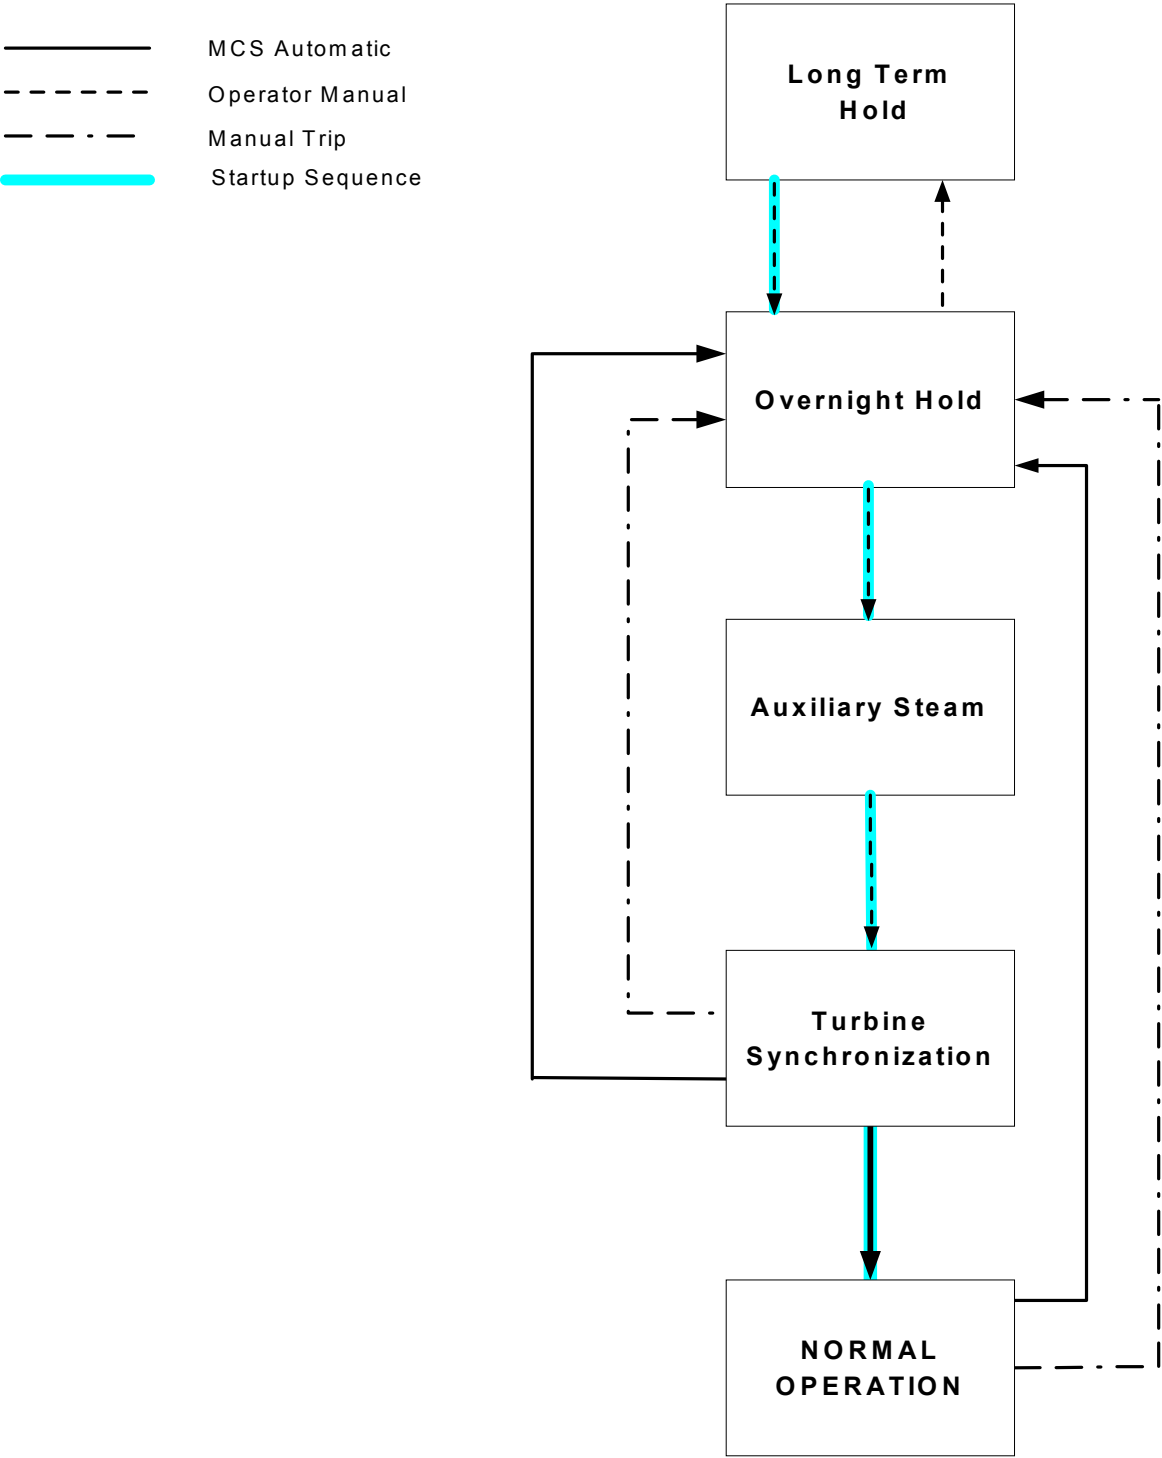

1
2

Figure 2-2. Energy Conversion Section: Operating States and Transitions.

3
4
5

- Turbine Synchronization. A live steam flow rate of TBD kg/hr (TBD lb/hr), with a temperature and pressure of 400°C (750°F) and 80 bar, pressure (bar) (1,200 lb/in²), respectively, are established. The turbine-generator is synchronized with the grid, and a minimum

1 turbine output of TBD MWe is established. Steam drum immersion heaters are de-energized
2 at normal operation temperature set points.

- 3 • Normal Operation. The extraction feedwater heaters are placed in service. A live steam flow
4 rate of TBD kg/hr, with a temperature and pressure of 550°C (1,022°F) and 125 bar
5 (1,815 lb/in²), respectively, are established. Turbine-generator output at rated MWe turbine-
6 generator load is established. Steam drum immersion heaters are de-energized at normal op-
7 eration temperature set points.

8 **2.3.2 Transition Between States**

9 The seven transitions between the states are as follows:

- 10 • Long Term Hold to Overnight Hold. The temperatures of the steam generator heat exchang-
11 ers and intervessel piping are raised to 260°C (500°F) by the EHTS. The SGS attemperation
12 pump is started, and a flow of cold salt is established through the heat exchangers.
- 13 • Overnight Hold to Auxiliary Steam. The auxiliary (electric) steam generator is started, a
14 flow of saturated steam is established to the turbine shaft seals, and a vacuum is drawn in the
15 condenser. Makeup water for the auxiliary steam generator is provided by a variable speed,
16 positive displacement auxiliary feedwater pump.
- 17 • Auxiliary Steam to Turbine Synchronization. The SGS circulation pump is started, and the
18 speed of the pump is increased so that the temperature of the mixed salt at the inlet to the su-
19 perheater increases at a rate of 500°C (1,000°F/hr). The live steam is throttled and sent to the
20 condenser. As soon as the live steam achieves a superheat of 60°C (100°F), the turbine is
21 accelerated to TBD rev/min and synchronized with the grid. The live steam throttle valve to
22 the condenser is closed, and a minimum turbine output of TBD MWe is established.
- 23 • Turbine Synchronization to Normal Operation. The turbine is transferred from evaporator
24 pressure control to speed control, the extraction feedwater heaters are placed in service, the
25 reheater is placed in service, the attemperation flow of cold salt is reduced consistent with an
26 allowable rate of temperature change in the heat exchangers of 500°C (1,000°F/hr), and the
27 flow rate of hot salt is increased to the design value.
- 28 • Normal Operation to Overnight Hold. The attemperation cold salt is started, and temperature
29 of the mixed salt at the inlet to the superheater is reduced consistent with an allowable rate of
30 temperature change of 500°C (1,000°F/hr). The output of the turbine is reduced to TBD
31 MWe, the live steam throttle valve to the condenser is placed in operation, the turbine is
32 tripped, live steam is throttled to the condenser, and the temperatures of the heat exchangers
33 are reduced to 285°C (550°F). Steam for the turbine shaft seals is provided by the auxiliary
34 (electric) boiler.
- 35 • Turbine Synchronization to Overnight Hold. The output of the turbine is reduced to TBD
36 MWe, the live steam throttle valve to the condenser is placed in operation, the turbine is
37 tripped, live steam is throttled to the condenser, and the temperatures of the heat exchangers

- 1 are reduced to 285°C (550°F). Steam for the turbine shaft seals is provided by the auxiliary
2 (electric) boiler.
- 3 • Overnight Hold to Long Term Hold. The attemperation pump is stopped, and the electric
4 heat trace system is turned off.

3. System Descriptions, Scope of Study, and Design Bases

3.1 Introduction

3.1.1 Process Flow Diagrams

Two SPT Process Flow Diagrams (PFDs) depict a baseline SPT configuration described in Section 3.2. Instruments and valves for the primary process control functions are shown. The Nitrate Salt Systems PFD, Figure 3-1, shows the primary nitrate salt flow paths for the RS, TSS, and SGS. Minor lines, drains, and vents are not indicated. SGS feedwater/steam system PFD, Figure 3-2, covers the SGS feedwater and steam generation side of the process. PFDs for the EPGS and BOP are not included since these systems use proven conventional equipment and process technology.

3.2 Collector System

3.2.1 System Description

The collector System (CS) baseline consists of the following elements:

- Pedestal mounted heliostats, including glass mirror modules, a heliostat controller (HC), all structural support elements and drives, and a foundation.
- Heliostat Array Controller (HAC), including the software and hardware used to control the CS. It also includes a time base, a beam characterization system (BCS), static aim processing system (SAPS), and dynamic aim processing system (DAPS).
 - The BCS is used to automatically calibrate/recalibrate each heliostat by setting its aim point on the receiver and the BCS target.
 - The SAPS shifts the heliostat image up or down from the receiver equator to establish a uniform flux on the receiver. This aim point varies by time of year, time of day, and ambient temperature and is used for active control of the CS.
 - The DAPS is used to automatically preheat and postheat the receiver on a daily basis.
- Redundant communications link, including all power and communications links (a) between the HAC and each HC and (b) between the power distribution motor control centers and each heliostat.

3.2.2 Scope of Supply

The CS package design and design integration package includes the overall system integration effort between the collector field technical specialists, heliostat designer and manufacturer, the

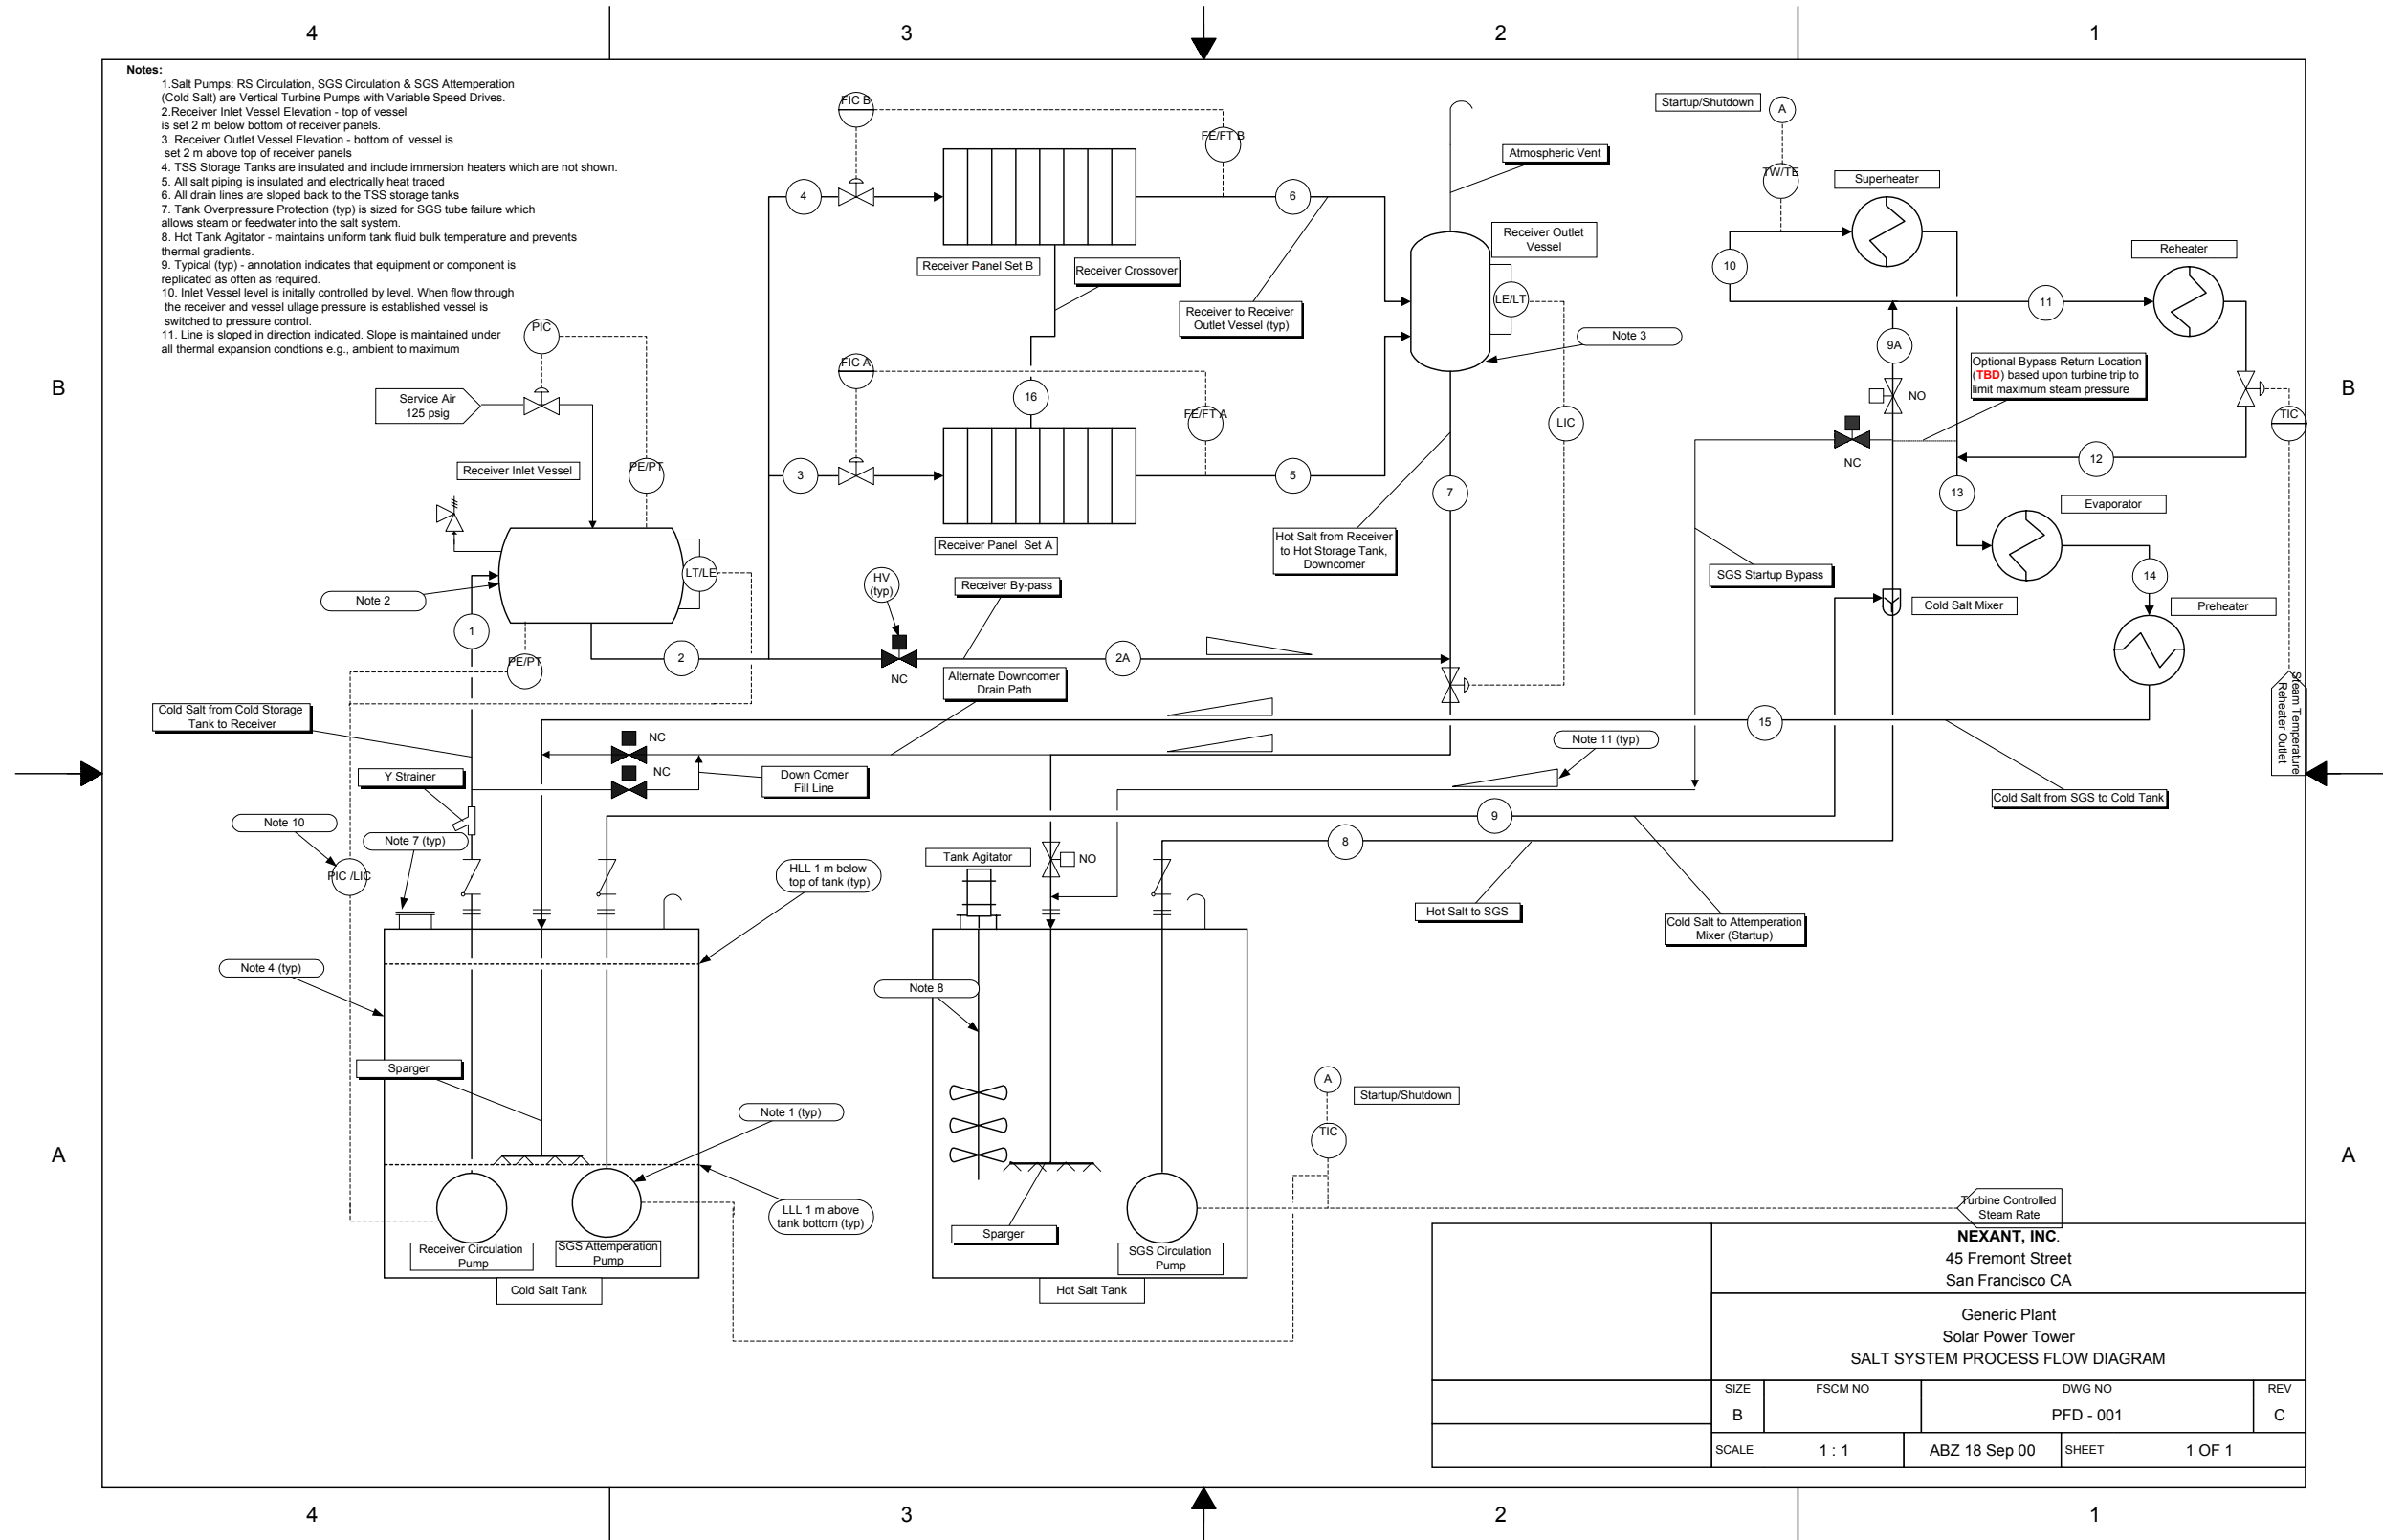


Figure 3-1. Nitrate Salt Systems PFD.

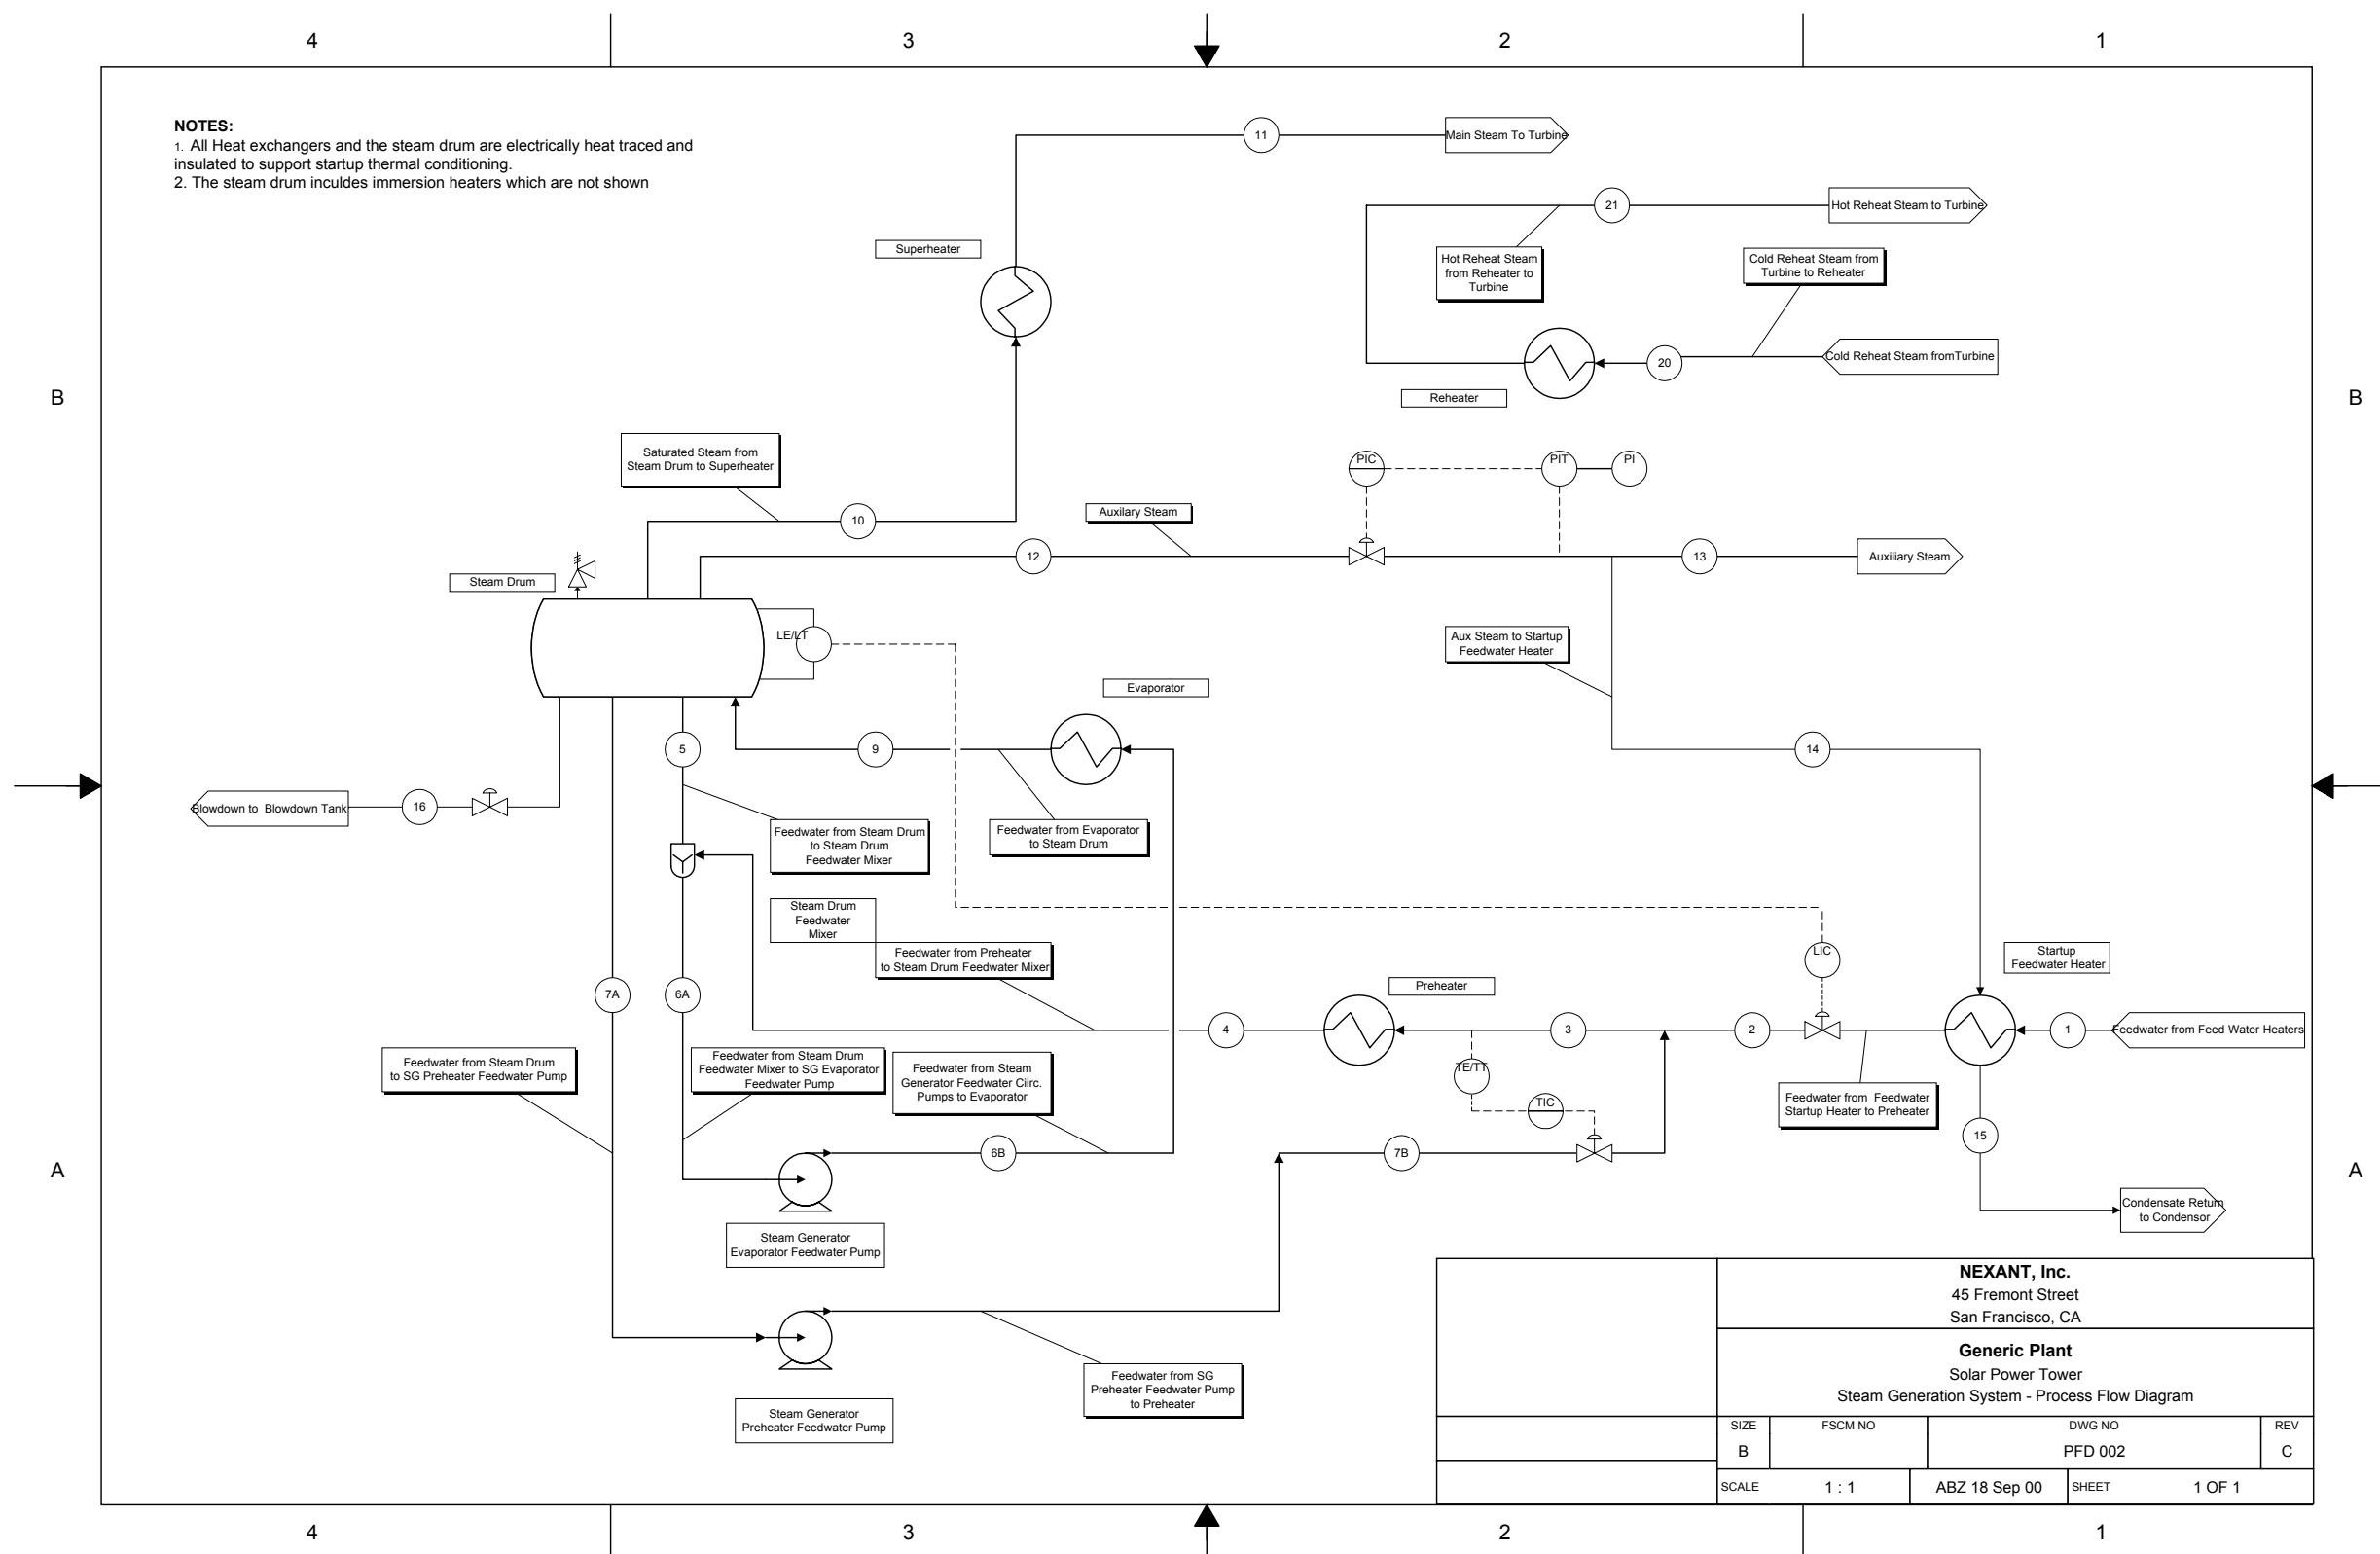


Figure 3-2. SGS Feedwater/Steam System PFD.

1
2
3

1 HAC hardware and software developer(s), the receiver absorber panel designer and manufac-
2 turer, the field installation subcontractor, etc. In addition, it includes heliostat foundation design,
3 power, grounding and communications link cabling, routing, and design.

4 The heliostats design and manufacturing package includes the heliostat hardware (mirror mod-
5 ules, structural supports, drives systems, and the HC hardware and software) design, component
6 manufacturing, fabrication, quality assurance, oversight of installation and installation testing,
7 field heliostat canting, and performance of startup and activation testing. Heliostat equipment
8 self-diagnosis (hardware and component error reporting) and coordinates input into the mainte-
9 nance database. It also includes developing the heliostat error correction algorithms and the de-
10 sign and supply of heliostat mirror washing equipment.

11 The heliostat array controller software/hardware development package includes:

- 12 • All HAC hardware including controls and computers
- 13 • Industrial standard interface hardware and protocol to the plant Master Control System
14 (MCS).
- 15 • HAC, BCS, DAPS, and SAPS software
- 16 • CS field control software and interface requirements with MCS
- 17 • HC interface hardware and protocols
- 18 • Heliostat point error software
- 19 • Hardware redundancy with hot stand-by
- 20 • Secondary equipment associated with the BCS
- 21 • All software simulation laboratory development and testing
- 22 • Field installation and testing; activation and activation support
- 23 • All documentation (hardware and software manuals, source code)

24 The HAC package and heliostat package may be procured from the same source.

25 The collector field technical specialist package includes all technical analysis and computations
26 required to:

- 27 • Size the collector field (both area and quantity) using site insolation, terrain, and weather
28 data,
- 29 • Determine the height of the receiver tower,
- 30 • Develop the receiver flux maps based upon a maximum allowable flux,

- 1 • Develop algorithms for aiming and for SAPS, DAPS, and HAC,
- 2 • Support software development.

3 This is an iterative procedure and must be followed closely with the receiver and heliostat de-
4 signer/manufacturer.

5 The heliostat installation subcontract package is part of the overall site facilities construction
6 package and includes foundation construction, heliostat assembly, heliostat installation, support
7 for heliostat canting, installation of all interconnecting cabling and wiring, continuity checking,
8 and support testing through initial startup through system activation. The heliostat manufacturer
9 will provide assembly and installation support oversight.

10 Heliostat Design Basis The proposed methodology discussed below is applicable with the cur-
11 rent state-of-the-art of heliostat technology for 50 m² (540 ft²) to 150 m² (1615 ft²) heliostats.
12 Heliostat unit cost, structural strength requirements, and optical performance requirements drive
13 heliostat design. Experience in the design of heliostats has determined that if the structural
14 strength requirements are satisfied, the optical performance requirements with respect to struc-
15 tural rigidity and stiffness will likely be achieved. The issue then becomes how to trade heliostat
16 unit cost with structural strength. Wind loads drive the design load cases.

17 **3.2.2.1 Wind Loading Conditions**

18 The wind definitions for heliostat structural design are given in Table 3-1.

19 Heliostat Design Structural Performance Heliostats must be able to take wind loads without
20 suffering permanent damage that causes excessive performance losses. For example, the pedes-
21 tal and foundation must not break free and rotate under wind loads. Since it is not possible to
22 control the wind, simulated static wind moments should be used. Simulated wind mo-
23 ments should be applied individually to each axis of rotation of the heliostat. Force will be ap-
24 plied at one or two locations on the heliostat, providing a more extreme condition than wind
25 loading for some parts of the heliostat structure. However, the application of static moments is
26 less severe than dynamic wind moments that can be higher due to resonance with the heliostat
27 structure. The heliostat will be designed for W3 level azimuth and elevation wind moments in
28 the worst case operational orientation, and W4 level azimuth and elevation moments in the high
29 wind stow orientation.

30 Static wind load definition The basic design wind pressures and moments should be computed
31 using Peterka and Derickson (1992) for a solitary heliostat using the wind velocities in Table 3-
32 1. If newer, more accurate data is available based upon modeling with turbulent wind conditions,
33 then that methodology may be used to establish the peak equivalent static wind load. Note that
34 the peak wind pressures over small areas will exceed the mean pressures determined by Peterka
35 and Derickson (1992); therefore, heliostat components, such as the mirrors and mirror fasteners,
36 should use appropriate load increases similar to those in ASCE 7-98 for roofs or wall cladding.

1

Table 3-1. Wind Definitions for Heliostat Structural Design

Wind Level	Condition	Wind Speed m/s (mph) @10m
W1	Operational performance requirements.	12 m/s (27 mph) Gust 8 m/s (18 mph) Mean
W2	Stowage limit (Heliostat moving from an operating mode to either normal stow or high wind stow position. Refer to Section 3.2.2.3).	16 m/s (35 mph) Gust 10 m/s (22 mph) Mean
W3	Survival in any orientation. Survival wind speed in any orientation may be adjusted to reflect site specific requirements.	22 m/s (50 mph) Gust 14 m/s (31 mph) Mean
W4	Survival in high-wind stow orientation (Based upon ASCE 7 -98 - Western United States). Survival wind speed may be adjusted to reflect site specific requirements.	40 m/s (90 mph) Gust 25 m/s (56 mph) Mean

2

3 The structural analyses outlined below in combination with a rigorous a shop and field-test program should be applied to qualify a heliostat design for production. The design process is iterative and the heliostat development must allow sufficient schedule duration for testing and retesting.

7 *Heliostat Failures* Historically, heliostat drive failures occur more predominately than structural failures or facet failures. Structural members like torque tubes, trusses, pedestal, etc., should use the “Peterka Generated Loads.” This may add a small additional cost for the additional structure, but the structural cost is small when compared to drive cost and the overall system cost.

11 The majority of the wind’s energy is below a frequency of 1–2 Hz (the typical range of first natural frequency of heliostats in this size range). Low frequency structural resonance/cyclic loading is the mechanism that has most likely resulted in previous failures.

14 The cost buildup of a heliostat from past experience is as follows:

- 15 • Drive 40–50 % (of the overall heliostat system cost)
- 16 • Structure 15–20%
- 17 • Facets 15–25 %
- 18 • Foundation 2%
- 19 • Field wiring 6%
- 20 • HC and controls 7%

1 Drive Components. These include azimuth and elevation gear, motor drives, and all linkages.
 2 Based upon the historical structural performance and costs for a heliostat system, the drive unit is
 3 both the main cost driver, as well as the most likely component to fail. In order to validate the
 4 design and derive a consistent and cost effective unit, the drive should be tested to the criteria in
 5 “Heliostats Design Optical Performance,” below. The drive system rated capacity should be
 6 based upon test rather than the manufacturer’s nominal catalog ratings.

7 Heliostat Structural Components. These include all mirrors support, the mirror attachment
 8 screws, the frames, the torque tubes, and the foundations, but exclude the drive mechanism.
 9 These items should be designed using loads from Peterka and Derickson (1992) and the standard
 10 building code factors of safety. Note that wind force levels W1, W2, and W3 are considered op-
 11 erating load cases so no increases in allowable stresses should be included. For the W4 wind
 12 loads, allowable stresses may be increased as permitted by the codes for short-term loads.

13 *Heliostat Unit Cost* Achieving the lowest heliostat unit cost is a major project objective consid-
 14 ering that 30–50% of an SPT’s capital cost is tied to the collector field and the thousands of he-
 15 liostats. The design objective should be to optimize heliostat structure/component designs so that
 16 heliostats may fail over the life of the plant under severe wind conditions and are not designed to
 17 preclude failure.

18 Field Testing A rigorous test program (shop and field) is required to qualify the heliostat struc-
 19 turally, as well as optically. This issue is discussed in more detail in “Heliostats Design Optical
 20 Performance,” below. Test planning must accommodate heliostat failures during testing, repairs,
 21 and retesting. The test program must allow sufficient time to perform redesign and make design
 22 modifications to the test article. One of the objectives is to optimize heliostat design by removing
 23 structure, reducing structural weight and component strength to reduce cost.

24 Heliostats Design Optical Performance Optical performance is not a driving requirement of the
 25 initial structural support design. Heliostat stiffness and deflection are important, as they affect
 26 optical performance, but the connection between optical performance requirements and heliostat
 27 deflections is complicated and difficult to model. For example, a finite element model of a he-
 28 liostat may neglect the deflections where the torque tube is bolted to the drive. Validation that a
 29 heliostat is stiff enough must be determined through a rigorous optical performance test of an
 30 installed heliostat under the range of conditions expected in service. Heliostat optical perform-
 31 ance varies substantially with orientation, location in the field, and weather.


- 32 • Wind impacts both heliostat tracking and beam quality.
- 33 • North field heliostats generally have smaller reflection angles between the sun and target,
 34 thus less beam aberration, than do heliostats located elsewhere. This effect is typically mod-
 35 eled on the computer simulations, but second-order effects can make real heliostat perform-
 36 ance worse than predicted.
- 37 • Structural sag due to gravity affects performance as a function of heliostat elevation angle.
 38 These effects are not typically computer-modeled. For a given orientation, aiming the mirror
 39 modules appropriately can compensate for gravity sag. However, heliostat orientation must
 40 change as the sun moves, and the further the elevation angle departs from where it was cor

1 rected, the worse the problem. North field heliostats must travel through a smaller range of
 2 elevation motion than other heliostats, so these effects are less pronounced.

- 3 • Table 3-2 shows typical error stack-ups for tracking and beam quality in calm winds that a
 4 heliostat designer needs to establish as part of the design process. The error categories and
 5 values indicated are representative and will vary as a function of the actual design.
- 6 • Table 3-3 shows typical error stack-ups for tracking and for beam quality in windy condi-
 7 tions that a heliostat designer needs to establish as part of the design process. The error cate-
 8 gories and values indicated are representative and will vary as a function of the actual design.

9 An error, α , in the mirror-normal or pointing vector causes an error of twice the magnitude, 2α ,
 10 in the reflected beam. The conversion between the pointing and beam error types is accom-
 11 plished with the relation.

12
$$\text{Beam Error} = 2 * \text{Pointing Error.}$$

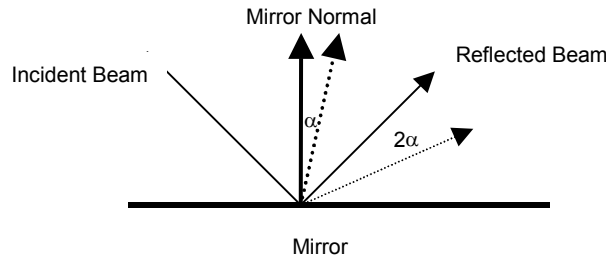

14
 15
 16 The typical error stack-ups have errors listed in two coordinate systems (mirror normal and re-
 17 flected beam) for reference.

18 **Table 3-2. Typical Error Stack-Ups for Tracking and Beam Quality in Calm Winds**

Tracking Errors	Error Stack-up Mirror-Normal Coordinates (mrad, RMS)		Error Stack-up Beam Coordinates (mrad, RMS)	
	Azimuth	Elevation	Azimuth	Elevation
Encoder resolution/drive backlash	0.6	0.4	1.2	0.8
Sun position prediction	0.15	0.15	0.3	0.3
Light refraction	0.05	0.05	0.1	0.1
Error corrected tracking*	0.4	0.4	0.8	0.8
Total error (RSS, mrad)	0.74	0.59	1.48	1.17
Total Error Req. (mrad, RMS)	0.75	0.75	1.5	1.5
Beam Quality Error Source	X	Y	X	Y
Slope error	1.0	1.0	2.0	2.0

1 **Table 3-2. Typical Error Stack-Ups for Tracking and Beam Quality in Calm Winds (con-**
 2 **tinued)**

Tracking Errors	Error Stack-up Mirror-Normal Coordinates (mrad, RMS)		Error Stack-up Beam Coordinates (mrad, RMS)	
	Azimuth	Elevation	Azimuth	Elevation
Mirror specularity	0.25	0.25	0.5	0.5
Mirror alignment error	0.25	0.25	0.5	0.5
Structural deflections from gravity	0.8	0.8	1.6	1.6
Focal change with temperature	0.5	0.5	1	1
Total error (RSS, mrad)	1.33	1.33	2.66	2.66
Total Error Req. (mrad, RMS)	1.8	1.8	3.6	3.6

* software to correct for pedestal tilt, drive non-orthogonality, etc.

3
 4 **Table 3-3. Typical Error Stack-Ups for Tracking and for Beam Quality in Windy**
 5 **Conditions**

Tracking Errors	Error Stack-Up Mirror-Normal Coordinates (mrad, RMS)		Error Stack-up Beam Coordinates (mrad, RMS)	
	Azimuth	Elevation	Azimuth	Elevation
Wind structural deflections	0.75	0.75	1.5	1.5
Encoder resolution/drive backlash	1	0.6	2	1.2
Sun position prediction	0.15	0.15	0.3	0.3
Light refraction	0.05	0.05	0.1	0.1
Error corrected tracking*	0.4	0.4	0.8	0.8
Total error (RSS, mrad)	1.32	1.05	2.64	2.10
Total Error Req. (mrad, RMS)	1.25	1.25	2.5	2.5
Beam Quality Error Source	X	Y	X	Y
Wind structural deflections	1.4	1.4	2.8	2.8
Slope error	1.5	1.5	3	3
Mirror specularity	0.25	0.25	0.5	0.5
Mirror alignment error	0.25	0.25	0.5	0.5
Structural deflections from gravity	0.8	0.8	1.6	1.6
Focal change with temperature	0.5	0.5	1	1
Total error (RSS, mrad)	2.29	2.29	4.57	4.57
Total Error Req. (mrad, RMS)	2.3	2.3	4.6	4.6

* software to correct for pedestal tilt, drive non-orthogonality, etc.

1 **3.2.2.2 Tracking Performance Requirements**

2 Calm Winds The heliostat tracking error should be less than 0.75 mrad RMS in both of its axes
3 of rotation (azimuth and elevation). At least 20 measurements (field qualification test program),
4 spread over the course of a solar day (from sun elevations of 15 degrees after sunrise to 15 de-
5 grees before sunset) are required for the daily RMS calculation. Heliostat tracking accuracy will
6 be calculated by measuring the difference between the measured beam centroid and the desired
7 aim point and performing a coordinate conversion using knowledge of the heliostat orientation
8 and geometry. The 0.75 mrad daily RMS heliostat tracking errors must be demonstrated on every
9 day tested (minimum two days), over a minimum of three months that includes an equinox,
10 without additional corrections or alterations to the control system parameters (initial configura-
11 tion is permitted). These requirements apply under the following conditions:

- 12 • Heliostat Orientation: Tracking accuracy *must* be demonstrated across the full range eleva-
13 tion angles expected in the field (typically pointing from 15 degrees above horizon to face-up
14 for a surround field). Care must be exercised in selecting the heliostat installation location to
15 achieve this requirement. Tracking errors during the resolution of singularity are not counted
16 in this requirement.
- 17 • Wind: Calm winds with gusts less than 3 m/s (7 mph) at 10 m elevation within 30 seconds of
18 measurement
- 19 • Temperatures: 0° to 50°C (32° to 122°F).

20 Windy Conditions Since wind conditions are uncontrollable, it is not possible to ensure a limited
21 test regime will represent the full spectrum of winds encountered in practice. Heliostat tracking
22 error must be less than 1.25 mrad RMS for each azimuth and elevation axis in W1 level winds.
23 Heliostat tracking error must be less than 1.5 mrad RMS for each azimuth and elevation axis in
24 W2 level winds. At least 60 measurements are required over a period of no less than 30 seconds
25 to establish the RMS values and winds must be within $\pm 20\%$ of the W1 levels for the duration of
26 each measurement period. Multiple tests under different wind speeds and directions are re-
27 quired. These requirements must be met when temperatures are from 0° to 50°C (32° to 122°F).

28 Singularity occurs when a heliostat's position must change in order to properly track the sun's
29 image on the desired aim point more rapidly than it is capable of doing. This occurs for azi-
30 muth/elevation drive heliostats when the heliostat is tracking nearly face up and must rotate 180
31 degrees in azimuth (or "bend over backwards") to continue tracking. A heliostat's inability to
32 move quickly typically causes tracking errors for a short period while this singularity position is
33 resolved. The heliostat must resolve singularity in 15 minutes or less.

34 **3.2.2.3 Beam Quality**

35 Calm Winds Beam quality refers to the distribution of light intensity in the heliostat beam when
36 it strikes a target, also referred to as the flux distribution or, in a simplified sense, the beam
37 shape. The beam shape can vary significantly depending upon the geometry of the sun, heliostat,
38 and target, so a fixed reference is meaningless. Rather, the heliostat must perform as predicted

1 by optical modeling codes for the given conditions. Under calm winds, the beam quality shall be
 2 such that a minimum of 90% of the reflected energy shall fall within the area defined by a com-
 3 puter model predicted beam shape. The predicted beam shape shall be evaluated with the
 4 HELIOS model or another suitable substitute. The computer model predictions will include all
 5 the information available about the heliostat, including: the size and orientation of the mirror
 6 modules; the focal length (in x- and y-directions) of the mirror modules, ideally as a function of
 7 temperature; the mirror module alignment, or canting, configuration; and measured mirror re-
 8 flectivity. A measured or conservative estimate of the sun intensity (sunshape) distribution
 9 should be used in predicting the ideal beam shape. To this information the computer model
 10 should add ‘slope’ errors of 1.8 mrad in heliostat mirror-normal coordinates or errors of 3.6 mrad
 11 in reflected beam coordinates. This criteria must be demonstrated on at least two days and ap-
 12 plies under the following conditions:

- 13 • Heliostat Orientation: Beam quality must be demonstrated across the full range of elevation
 14 angles expected in the field (typically pointing from 15 degrees above horizon to face-up for
 15 a surround field). Care must be exercised in selecting the heliostat installation location to
 16 achieve this requirement.
- 17 • Wind: Calm winds with gusts less than 3 m/s (7 mph) at 10 m elevation within 30 seconds of
 18 measurement
- 19 • Temperatures: 0° to 50°C (32° to 122°F)

20 Windy Conditions The beam quality should be measured under as many wind conditions as pos-
 21 sible as there is no valid way to simulate the effects of winds on beam quality. Beam quality
 22 shall be such that a minimum of 90% of the reflected energy falls within the area defined by a
 23 computer model predicted beam shape including ‘slope’ errors of 2.3 mrad (or 4.6 mrad in re-
 24 flected beam errors) in W1 level winds. These criteria must be met at all times of the day and
 25 demonstrated on at least two days. This criteria applies under the following conditions:

- 26 • Heliostat Orientation: Beam quality should be demonstrated over the full range of elevation
 27 angles expected in the field (typically pointing from 15 degrees above horizon to face-up for
 28 a surround field). Uncontrollable winds may prevent this from occurring.
- 29 • Temperatures: 0° to 50°C (32° to 122°F).

30 The heliostat drive system must:

- 31 • Have the capability of positioning a heliostat to a stow, cleaning, or directed maintenance
 32 position in TBD minutes from any operational orientation.
- 33 • Not drift in elevation or azimuth from the last commanded position due to environmental
 34 loading or component wear.
- 35 • Have the capability for local emergency HC override and to stow heliostats using the drive
 36 motors

- 1 • Have a sealed drive system, including drive motors, thus protected from rain, mirror washing
2 detergents/agents (type TBD), wind-blown dust, UV, etc.

3 Materials for cable harness(es) from HC to drive motors, position sensors, etc., will be selected
4 to provide a 30-year design life considering UV and exposure to heliostat mirror washing agents.
5 External coatings on drive systems, including the motors, must be specified for a 30-year service
6 life. Manufactures standard coating will typically not withstand the multiple heliostat wash cy-
7 cles.

8 Internally lubricated vented drive systems (gear drives) must be designed to prevent lubricant
9 leaks from contaminating either the drive motors or the environment. Oils/lubricants must be
10 suitable over the entire operating temperature range and specifically address thermal expansion
11 lubricant corrosiveness, maintenance, etc. It is recommended that, if the drive motors are directly
12 coupled to the drive, they do not share a common seal.

13 Drive motors should be DC-capable of reverse operation with environmentally sealed, Totally
14 Enclosed Nonventilated (TENV) housings.

15 *Hail* The heliostat, in any orientation, must survive TBD mm (TBD in) diameter, TBD specific
16 gravity, hail impacting at TBD m/s (TBD ft/s). Temperature of simulated hail will be TBD °C
17 (TBD °F). These requirement are site-specific. The typical US Military Standard requirement is
18 as follows:

- 19 • Diameter: 25 mm (1 in.)
- 20 • Specific Gravity 0.9
- 21 • Terminal Velocity 23 m/s (75 ft/sec)
- 22 • Temperature -6.7°C (20°F)

23 Lightning Protection will be provided in accordance with NEC requirements under the following
24 guidelines:

- 25 • Total destruction of a heliostat/HC from a direct hit is acceptable.
- 26 • Repairable damage of heliostats and HCs adjacent to a direct hit.
- 27 • The HAC and adjacent communication links shall be protected from a direct hit.

28 Mirror Canting is performed in conjunction with the initial heliostat assembly/installation and
29 when mirror modules are replaced. The frequency of periodic maintenance mirror recanting will
30 depend upon the specific heliostat design and is a TBD issue. The orientation of each mirror
31 module on the heliostat requires adjustment so that the image from the mirror module overlaps at
32 a distance equal to that from the heliostat to the receiver. This adjustment is defined as a cant,
33 and the distance from the heliostat to the receiver is defined as the slant range.

1 Each Heliostat will be provided with:

- 2 • TBD mirror module adjustment setscrews near the corners of each module, typically at each
3 connection point with the structure.
- 4 • TBD fixed reference marks near the corners on each mirror module. The reference marks
5 may be at either the top or bottom of the module with the bottom being preferred since the
6 canting operation will be performed with heliostat in a horizontal, level position (stowed po-
7 sition). This will allow the canting operation to be performed from underneath the heliostat.
- 8 • A data package that establishes the slant angle setting for each heliostat as a function of its
9 location in the heliostat field and position of each mirror module on the heliostat. The
10 setscrew elevation adjustment table will be developed as part of the design process and is
11 calculated for each mirror module reference mark with respect to a reference plane parallel to
12 the heliostat. The adjustment is made with the heliostat in a horizontal, level position.

13 Two canting procedures for individual mirror modules are discussed below:

14 Manual Process The first procedure is a manual operation that uses a laser survey instrument
15 and TBD scaled rulers mounted perpendicularly to a mirror module at predetermined reference
16 marks. The laser survey instrument is positioned so that it can see all four corners of the mirror
17 module and the scaled rulers and establish the parallel heliostat structural reference plane.
18 Setscrews are then adjusted so that the laser beam intersects the scale at the required setscrew
19 elevation adjustment table value for that mirror module.

20 Automated Process The second process uses a dual axis clinometer or inclinometer(s) mounted
21 to a support frame (calibration device) that, in turn, is attached to a mirror module at predeter-
22 mined reference points to measure angle/tilt from the horizontal plane and a portable PC. This
23 procedure will require development and integration of supplier algorithms/software into a HAC
24 software module that will link the amount of tilt from the horizontal to the setscrew elevation
25 adjustment tables. The linking software will allow table values to be compared with the instru-
26 ment readout and, by adjusting the setscrews to the equivalent tilt value, establish the proper cant
27 setting.

28 Suggested Clinometer Source:

29 Schaevitz™ Sensors

30 1000 Lucas Way

31 Hampton, Virginia 23666

32 Phone: (757) 766-1500

33 Facsimile: (757) 7664297

34 Internet: www.schaevitz.com

35 Suggested Inclinometer Source

36 US Digital Corporation™

37 11100 NE 34th Circle

38 Vancouver, WA 98682 USA

39 Phone: (360) 260-2468

- 1 Facsimile: (360) 260-2469
- 2 Internet: www.usdigital.com

3 Mirror Cleaning Mirror cleaning should be performed on a continuous basis using two methods.
4 The primary method will be a semi-automated high-pressure deionized water wash spray without
5 scrubbing. The objective should be to wash the entire heliostat field on a two-week interval. A
6 secondary method will be performed periodically using deionized water, a mild biodegradable
7 detergent, and manual scrubbing. The frequency of the secondary manual scrubbing method is
8 part of the heliostat design and is based upon site-specific, unique environmental conditions.
9 The semi-automated high-pressure wash process requires a unique vehicle and wash mechanism
10 design. Its concept must be developed early in the collector field design to establish (a) the hori-
11 zontal clearances between heliostat rows and vertical clearances underneath heliostats for wash
12 vehicle access, and (b) to establish the wash position of the heliostats. The wash hardware de-
13 sign and process must be optimized to minimize labor, assure quality and repeatability of the
14 wash process, and maximize the wash rate.

15 HAC Design Basis The HAC resides in the MCS and provides primary control and monitoring
16 of the CS. Its primary function is to control the heliostats through the communication link to the
17 HCs. The HAC control functions to the HCs and its operating modes are described below in
18 “HAC Control Functions” and “Heliostat Operating Modes.” The functions of the SAPS, DAPS
19 and BCS are discussed in sequence starting in Section 3.2.2.4.

20 HAC Control Functions The HAC shall function as appropriate for all steady-state modes (refer
21 to “Heliostat Operating Modes,” below) of plant operation. This shall include the capability of
22 controlling all heliostats in tracking mode so that the incident flux on the receiver is removed
23 within TBD seconds as determined by the Receiver Protection Trade Study. The primary HAC
24 functions are to:

- 25 1. Receive operating mode commands from either an operator through the MCS - Distributed
26 Control System (DCS) interface or from the HAC software.
- 27 2. Store the geographic location, drive characteristics, limit switch positions, pedestal tilt char-
28 acteristics, gravitational correction factors, etc., for each heliostat.
- 29 3. Receive wind speed data from the local anemometer.
- 30 4. Automatically (or with operator intervention) initiate a command to stow the heliostats when
31 the wind exceeds the operating wind design condition.
- 32 5. Monitor and maintain clock time for calculation of sun positions using an accurate time stan-
33 dard.
- 34 6. Send CS status data to the DCS.
- 35 7. Record system alarms.

- 1 8. Receive, acknowledge, and act upon individual heliostat operating mode commands from
2 DCS.
- 3 9. Send operating mode commands to the HCs.
- 4 10. Calculate and send sun position data to the HCs. HC CPU capability and cost will determine
5 where the sun position pointing vector algorithm resides and where the computation is per-
6 formed. The objectives are to minimize HC unit cost and distribute the computational proc-
7 essing as far down in the CS system as possible to limit communications traffic between the
8 HAC and the HCs.
- 9 11. Calculate a new target once each second during the transition from standby mode to stow and
10 transmit the target data to the HC. This computation may be performed in either in the HC or
11 HAC (TBD). The location depends upon the complexity of the computation and the capabil-
12 ity of the HC. The preference would be to have the HC perform this operation.
- 13 12. Receive heliostat status and acknowledgement data from the HCs.

14 Beam Safety Move groups of heliostats from the normal stow position or high wind stow posi-
15 tion to a standby tracking point along imaginary lines to prevent concentrating the image from
16 more than one heliostat outside the plant boundaries. The process is reversed from the standby
17 tracking point to either stow position. These paths will vary by season. The paths are site-
18 dependent and the effort is a major heliostat and HAC software design task.

- 19 • Maintain individual heliostat reflectivity database and calculate overall collector field clean-
20 liness for HAC software and DAPS.
- 21 • Transmit heliostat status to the maintenance database and report overall collector field
22 status/readiness to the DCS interface. Provide input data to SAPS and DAPS for active or
23 inactive status.
- 24 • Provide data for graphic displays of heliostat operating and functional status, which will be
25 displayed on the CS DCS workstation interface.

26 The commercial software supplied with the Normal Incident Pyrheliometers and Total Radiation
27 Pranameter (rotating shade) will reside on the HAC hardware and communicate with the HAC.

28 Heliostat Operating Modes The principal operating modes include:

29 *High Wind Stow* The heliostats are placed in the face-up position for high wind stow and for
30 long-term plant outages.

31 *Normal Stow and Wash Position* The heliostat is pointed at the horizon with an elevation angle
32 of TBD degrees and azimuth position perpendicular to a radial line originating at the receiver
33 tower and terminating at the heliostat pedestal for mirror module cleaning and normal overnight
34 stow.

1 *Off-line* The heliostat does not respond to commands from the HAC; a manual command is re-
2 quired to return to active status. The heliostat may be down requiring maintenance or repair.

3 *Track* The heliostats are tracking the designated receiver aim points.

4 *Standby* The heliostats are tracking the designated standby aim points.

5 *BCS* An individual heliostat is tracking the beam characterization system target.

6 *Directed Position* A heliostat has been moved to a given position for maintenance or testing.

7 *Initialization* The heliostat initialization task executes automatically upon operating system start-
8 up.

9 *Mark* This is the position of the heliostat for calibrating the relative position signals from the
10 azimuth and elevation motor encoders.

11 **3.2.2.4 Static Aim Processing System Design Basis**

12 Each heliostat is aimed at the vertical centerline of the receiver. However, the image of each he-
13 liostat is shifted up or down with respect to the receiver equator to establish as uniform flux as
14 possible over the length of a receiver panel. The number of aim points will vary as a function of
15 receiver panel length and shall be determined during HAC system design. Image shifts will be
16 determined as follows.

17 The heliostats with smallest image are assigned the largest shifts to illuminate the ends of the
18 panel without causing excessive spillage losses. The heliostats with largest image are assigned a
19 shift from zero that will reduce spillage losses.

20 The optimum length of each shift will vary with the relative position of the sun, heliostat, and
21 receiver, and therefore varies with time of day and time of year. Ambient temperature also
22 changes heliostat focal length and therefore the amount of shift.

23 SAPS will compute shift lengths every 5-6 minutes when the sun is less than 10° above the hori-
24 zon and every 30 minutes during the balance of the day.

25 **3.2.2.5 Dynamic Aim Processing System Design Basis**

26 The DAPS function is for receiver preheat prior to filling and postheat prior to emptying to pre-
27 vent freezing salt or exceeding receiver tube strain levels. The thermal efficiency of the receiver
28 is such that a very small flux is necessary to establish a preheat/postheat panel temperature of
29 232°C (450°F).

- 30 • At wind speeds less than 2.3 m/s (5 mph), a flux of approximately 10 to 20 kW/m² is re-
31 quired to preheat the panels.

- 1 • At wind speeds approaching 11.2 m/s (25 mph), a flux of approximately 30–40 kW/m²
2 (windward side) is required to preheat the panels.

3 A group of heliostats will be selected from the total field to provide the preheat flux. Aim points,
4 different from the static aim points, will be established that extend well past the ends of the re-
5 ceiver to prevent cold zones at the header box interface. This will be a select group, but will
6 vary by time of year (summer/winter) and potentially by time of day. For example, Solar Two
7 identified 400 heliostats for the DAPS use out of a total of 2000 heliostats. The criteria for se-
8 lecting preheat/postheat heliostats is as follows:

- 9 • Inner rows (small image),
10 • Uniformly distributed around the field,
11 • Preheat/postheat operations may occur at any time during the day.

12 DAPS calculates a theoretical incident flux on the receiver from the point in time that startup op-
13 erations commence using the following information for each heliostat.

- 14 1. direct normal radiation
15 2. shading losses
16 3. cosine efficiency
17 4. mirror reflectivity
18 5. blocking losses
19 6. receiver back tube temperatures
20 7. atmospheric attenuation
21 8. static aim point position

22 The input variables are as follows:

- 23 • Direct normal radiation input will be obtained from HAC/DCS and by taking the largest val-
24 ues from redundant pyrliometers measurements.
- 25 • The computation for heliostat shading losses, cosine efficiency, and blocking losses shall be
26 calculated for intervals of one minute. The calculation will cover an entire day since a pre-
27 heat/postheat operation may occur at any time.
- 28 • Receiver back tube temperatures will be obtained from the DCS through network link RS
29 Panel thermocouples. A software algorithm will be developed to recognize inoperable or
30 suspect thermocouples.

- 1 • Mirror reflectivity shall be computed for each section of the collector field from the mirror
2 cleanliness database records through periodic measurements of mirror cleanliness/reflectivity
3 and input from the mirror washing maintenance program.
- 4 • Atmospheric attenuation will be based upon measurements of daily visual range.
- 5 • Wind velocity is used to determine a theoretical convection heat loss.

6 Preheat Sequence The preheat process, from start to finish (salt flow and receiver full power)
7 takes up to one hour. DAPS applies a proper number of heliostats from standby to track required
8 to provide an initial preheat theoretical flux of 20 kW/m². DAPS updates this calculation during
9 the warm up sequence and assigns/reassigns heliostats as needed from track to standby. The aim
10 points shall include edge heating to assure even preheating over the entire length of the receiver.
11 As the panel temperature approaches 650°F, the allowable flux will be reduced to 12 kW/m².
12 Additional flux will be applied to panels on the windward side of the receiver, where the tem-
13 perature will be less than 650°F. The postheat process will prevent salt freezing in the windward
14 panels on windy days and is similar to the preheat process.

15 **3.2.2.6 Beam Characterization System Design Basis**

16 Each heliostat accumulates errors in pointing over time due to electromechanical system wear,
17 pedestal movements, errors in drive motor revolution counts, canting alignment errors, etc. The
18 Beam Characterization System (BCS) provides correction offsets to the HAC to compensate for
19 these errors. The BCS is comprised of the BCS software, conventional imaging software, BCS
20 target, and BCS camera system (four conventional charge coupled device cameras). It is required
21 during heliostat installation and during normal operations. While automated, this operation takes
22 time during initial heliostat installation and must be completed prior to RS startup. Sufficient
23 time must be incorporated into the construction schedule to accommodate this activity.

24 The function of the BCS is to automatically instruct a heliostat to tack the center of the BCS tar-
25 get just below the receiver and then determine the distance between the center of the target and
26 the centroid of the heliostat image and provide point correction factors to the HAC to compen-
27 sate for the offsets errors.

28 A BCS array correction algorithm compensates for the net effect of the errors in canting align-
29 ment, electromechanical system ware, pedestal tilt, encoder reference position, and gravity de-
30 flections. The correction factors are developed by tracking a heliostat on the BCS target and
31 measuring the difference between the center of target and the beam centroid TBD (at least 25)
32 times during the day. The tracking errors are used in a curve fit program to develop pointing er-
33 ror correction factors to limit vertical and horizontal pointing errors to 1 mrad rms or less per
34 year. Each heliostat will be aligned using this process and the algorithm at installation and at
35 least once per year.

36 The BCS target is part of the BOP receiver tower structure. The target is located immediately
37 below the receiver and consists of four flat white surfaces facing north, south, east, and west.
38 The target surface is canted towards the field so that the surface of the target is perpendicular to a

1 line drawn from the midpoint of the heliostat field to the midpoint of the target (TBD). The size
 2 of each target surface is determined so that the heliostat furthest from the target in each quadrant
 3 can place an image on the target with margin in area of 300–400% and afford protection to per-
 4 sonnel working on the receiver. The target will prevent an incident heliostat beam from entering
 5 the tower structure from just below the receiver elevation to approximately three deck levels be-
 6 low the receiver. A 0.6 m (2 ft) by 0.6 m (2 ft) cutout will be provided in the center (approx-
 7 imate) of each target accessible by personnel at the inside the receiver structure from the platform
 8 deck level.

9 The architectural panels comprising the target surface will be coated with a heat-resistant white
 10 paint. The interior surface will insulated for personnel protection.

11 As a point of reference, on Solar Two each target face (trapezoidal shape) extended horizontally
 12 along the entire face of the tower structure and vertically for approximately three deck levels.

13 **3.2.2.7 Heliostat Controller Design Basis**

14 HCs require self-contained modularized controller housing, and electrical and electronic hard-
 15 ware (controller, CPU, batteries, power suppliers, inverters, motor contactor/controller, commu-
 16 nications cards, etc.) to control all heliostat functions. “Modularized” means that any board
 17 within the HC can removed and replaced using plug-in-type connections. Hardwired terminal
 18 strip interfaces should be avoided. HC functions are to:

- 19 • Acquire time from the HAC.
- 20 • Point the heliostat.
- 21 • Continually calculate sun position or receive sun position data from the HAC. HC CPU ca-
 22 pability and cost will determine whether sun position pointing vector algorithm resides in the
 23 HAC or HC. The preference is for the HC to minimize communications traffic between the
 24 HAC and the HCs.
- 25 • Continually calculate and update pointing vectors using correction algorithm and correction
 26 factors for corridor walks and for tracking and standby modes (refer to page 49, line 4 and
 27 page 53, line 28).
- 28 • Provide the power and signal to control drive system azimuth and elevation motors.
- 29 • Receive limit switch signals (drive motors exceeding limits of drive system travel), shut
 30 down drive system motors, and alarm the error to the HAC.
- 31 • Retain last known vector point position in case of a power outage and be able to recover
 32 without having to reinitialize from a reference position.

- 1 • Provide an internal error checking diagnostic that informs the HAC that a heliostat compo-
2 nent–position encoder, limit switches, drive motor, motor controller, power supply and HC
3 (if possible)–is failing or has failed.
- 4 • Provide communication status updates to the HAC that data transfers and commands have
5 been received, if the communication loop protocol does not perform the function).
- 6 • Confirm that commands have been successfully executed.

7 **3.2.2.8 HC Hardware Requirements**

8 The maximum operating internal service temperature is 55°C (131°F)

9 During extended long term holds, the collector field power will be shut down at the CS motor
10 control centers to reduce parasitic losses. The HC hardware and firmware will be designed to
11 reinitialize without having to reload software from the HAC.

12 Electronic/electrical cooling systems will be passive.

13 CPU reboot cycle time will be established by the receiver protection trade study (TBD < 30 sec-
14 onds). Refer to Section 3.2.4 for emergency power requirements.

15 Exterior connections will consist of:

- 16 • Power Supply to a HC isolation breaker, consisting of a single power source to a he-
17 liostat/HC that powers all electronics, communications, instruments, and heliostat motors and
18 provides a convenience 120 V AC outlet for heliostat maintenance. Refer to Section 3.2.4 for
19 emergency power requirements.
- 20 • Communications link to the HAC – Refer to Section 3.2.3.
- 21 • Grounding/lightning protection tie-in to a facility common grid.

22 The HC enclosure will be segmented to protect electronic components from internal power com-
23 ponent noise/interference and external noise sources, e.g., drive system DC motors. Line filters
24 may be required.

25 Ideally, the HC housing should consist of an industrial standard metallic housing suitable for
26 dirty wet exterior applications (NEMA 4/4X or equal).

27 The selection of the HC processor is driven by cost, the amount of processing that must take
28 place in HC versus the HAC, high system reliability, and the volume/rate of communications
29 traffic between the HAC and all the HCs. As part of the preliminary design, prepare a design
30 analysis to select the HC and HAC hardware configuration that addresses the above issues. The
31 HC processor memory shall be nonvolatile so that a short-term loss of power will not require a
32 re-initialization of the memory. The processor shall include internal error checking diagnostics

1 and fault detection/isolation on all electromechanical subsystems, i.e., azimuth and elevation
2 motor drives and limit switches.

3 **3.2.3 Field Communication Link Design Basis**

4 Communications between each HC and the HAC in the facility control center must be highly re-
5 liable and be comprised of industrial standard network components and hardware. It should in-
6 corporate communication error detection and correction protocols. A communications rate must
7 be selected that supports 2000-3000 heliostats. A defocus command must be acted upon by the
8 entire collector field within an extremely short time duration. The response rate will established
9 by Receiver Protection Trade Study and the HAC and HC hardware design analysis/selection
10 process (refer to page 54, line 9). Include redundant paths from the HAC to each HC. The path
11 may be either direct-buried, armored-twisted-shield-pair-copper or fiber-optic with a 30-year de-
12 sign life. The communications link shall be protected from electrical transients, both power and
13 from lightning, and shall be designed so that it is not affected by power distribution paths that
14 may parallel its path.

15 **3.2.4 Emergency Heliostat Defocus Design Basis**

16 A trade study is required to determine emergency backup power systems and solutions for defo-
17 cusing the heliostats from the receiver in a loss of cold nitrate flow emergency, e.g., loss of the
18 cold salt pump or power failure. This study is part of the Receiver Protection Trade Study dis-
19 cussed in Section 5.2.

20 **3.3 Receiver System**

21 **3.3.1 System Description**

22 The RS baseline system elements are comprised of:

- 23 • Receiver circulation pump—a variable speed drive (VSD) vertical turbine pump mounted on
24 top of the TSS cold salt storage tank supplying cold salt to the receiver inlet vessel.
- 25 • Receiver inlet vessel—an ASME Section VIII pressure vessel with air pressure blanket and a
26 capacity for providing 60 seconds of uninterrupted flow to the receiver in the event of pump
27 or power loss. Receiver inlet vessel is controlled initially by level and, once full, operation is
28 established, it is switched to pressure control.
- 29 • Two-receiver flow loops that start on the North from the inlet vessel, flow through the re-
30 ceiver with serpentine flow, and exit from the receiver on the South in the outlet vessel. Pip-
31 ing includes interconnecting receiver piping to the receiver panel headers, crossovers, fill and
32 drain lines, and inline instrumentation flow, pressure, temperature, and externally mounted
33 flux photometers.

- 1 • Receiver absorber panels designed and fabricated in accordance with either ASME Section
2 VIII or I from a high nickel alloy including tubes, tube clips, and headers.
- 3 • Receiver outlet vessel—an ASME Section VIII pressure vessel leveled controlled via down
4 comer throttling valve controlling flow returning hot salt to TSS hot salt storage tank.
- 5 • Receiver structural elements interfacing with the receiver panel support frame, receiver oven
6 boxes, and providing support to all piping ladders, platforms, vessels, etc.
- 7 • A receiver tower crane to allow access to receiver panels for installation and replacement.

8 **3.3.2 Scope of Supply**

9 The RS design, physical and system integration, and procurement package includes all PFDs and
10 process and instrument diagrams for the RS, receiver hardware and other equipment specifica-
11 tions, system hydraulic calculations, and hardware and services procurement for the receiver
12 hardware (panels). In addition, it includes developing design, specifications, and procurement
13 packages for the following hardware elements: RS circulation pump, receiver inlet and outlet
14 vessels, interconnecting piping (riser, downcomer, crossovers, fill and drain lines, intrareceiver
15 piping), pipe supports, thermal insulation, instrumentation/controls, interface with MCS, all
16 valves, electrical power, and primary and secondary support structures, including the receiver
17 tower crane. The system design also requires minimizing parasitic electrical power loads and
18 thermal heat losses from piping and equipment in all states and through all transitions.

19 The receiver panel design package includes the receiver panels with tubes, headers, nozzles, tube
20 clips, receiver panel support frames, receiver panel oven boxes, and design of all controls and
21 instrumentation associated with the receiver. The receiver design package also includes the
22 thermal fatigue and stress analysis to determine maximum life cycles for absorber tubes.

23 The receiver fabrication package includes the receiver panels with tubes, headers, nozzles, tube
24 clips, receiver panel support frames, receiver panel oven boxes, and all controls and instrumen-
25 tation hardware installation associated with the receiver.

26 The RS installation package includes receiver and receiver subsystem component installation,
27 installation testing, and activation support. This work will be included in the overall site con-
28 struction subcontract. Both the receiver panel designer and fabricator will be on contract to pro-
29 vide oversight during installation and all testing.

30 **3.3.3 Design Innovation**

31 There are three major receiver design innovation trade studies required. The scope and require-
32 ments for these studies is discussed in detail in Section 5.0.

3.3.4 Receiver Design Basis

3.3.4.1 Receiver Physical Configuration

General Configuration. The nitrate salt receiver is configured to approximate an external cylinder with vertical panels arranged on the surface to provide two parallel salt flow paths. Inlet flow is introduced on the north side of the receiver and exits on the south side. One or more cross-overs in the flow path are provided to keep energy capture of the two paths in balance over the complete range of operating conditions, including startup. The receiver is comprised of individual panel sections and includes an inlet header, inlet nozzles, tubes, outlet nozzles, outlet header, tube clips, and panel support structure. The panels are supported at the top and allowed to grow freely in the downward direction. The design allows the receiver panels to be filled uniformly using either a serpentine or flood fill technique.

Receiver Tubes and Headers. Receiver tubes are thin-walled, approximately 0.05 in. (1.25 mm), and are welded to thick walled inlet and outlet header/nozzles. The nozzle-to-header interfaces are the location of highest thermal stresses, which result from rapid temperature changes due to cloud transients and the difference in wall thickness. The rate of temperature change for the 30-year SPT commercial plant is 2.8°C/sec (5°F/sec) and 36,000 cycles.

ASME Code Case N 47 and ASME Section III, Subsection NH. The incident solar flux on the receiver produces temperature gradients through the tube wall large enough to develop plastic strains. Plastic strains are cumulative and the tubes will eventually fail through low cycle fatigue. ASME Code Case N 47 provided the Solar Two basis for calculating tube strains and fatigue life for a molten nitrate salt receiver operating at temperature ranges from 427°C to 760°C (800°F to 1400°F). Material property data (fatigue and creep) in N 47 exists for Type 304 and 316 Stainless Steels, 2 1/4 Cr-1Mo steel, and Alloy 800 Nickel Steel. After Solar Two, Code Case N-47 was superceded by Subsection NH of ASME Section III. Subsection NH is identical to Code Case N-47.

The next generation SPT will use a high nickel alloy and may require the application of the rules in Subsection NH of ASME Section III. Plastic strain may not be an issue with this material. However, if this is a requirement, then material fatigue and creep data will have to be developed for the high nickel alloy prior to receiver design. This metallurgy will permit higher strains for a given fatigue life and will allow a simplified tube to header nozzle interface. The design flux level with nickel alloy metallurgy and tube wall thickness of approximately 1.25 mm (0.05 in.) is a nominal 1 MW/m² with local adjustments for salt velocity and temperature. Flux levels shall be confirmed through fatigue-creep analysis for the final material selected.

The design, fabrication, and welding of these assemblies is critical, and is affected by a requirement to have 360-degree access clearance around the tubes for fabrication welding and field replacement. A typical header will have in excess of 30 tube-to-header interface welds and 30 tube-to-nozzle welds. The header interface to the receiver intrareceiver piping is welded. The interface plane between the header and the intrareceiver piping is a zero stress load interface. Clearance to gain access to weld the tubes to header nozzle requires five to six different three-dimensional tube bend configurations.

1 Header Nozzles. Solar Two required three different nozzle configurations.

- 2 • All of the connections on the bottom header used a thermal sleeve on the outside of the tube;
3 salt trapped in the annular space between the tube and the sleeve moderated the thermal trans-
4 sitions at the welded joints.
- 5 • The connections at the ends of the upper header used a re-entrant nozzle. The tube extended
6 into the header about 2.54 cm (1 in.), and a sleeve between the end of the tube and the wall of
7 the header formed the pressure boundary. The differential expansion between the tube and
8 the header was accommodated by flexure in the curved portions of the sleeve.
- 9 • The connections at the center of the upper header used flared, long radius nozzles. The fluid
10 velocities were higher near the center of the header, and the corresponding increase in the
11 heat transfer coefficients reduced the transient stresses to levels that did not require a re-
12 entrant nozzle. In addition, the flared nozzles did not extend into the header, which allowed
13 the upper headers to drain completely.

14 Subsequent to the Solar Two manufacturing process, Research, Development, Test and Evalua-
15 tion has demonstrated that header nozzles can be pulled directly from a header billet avoiding
16 nozzle-to-header welding.

17 Tube and Header Weld nondestructive examination (NDE). All tube weld and header welds re-
18 quire NDE to verify weld quality and integrity. Each panel will be hydrotested to 1.5 times the
19 operating pressures in accordance with ASME code requirements. In addition, each panel will
20 be pressurized with helium to TBD bar (TBD psig) and the panel assembly helium leak tested in
21 accordance with ASME Section V. Molten nitrate salt is an excellent wetting agent and will
22 penetrate porous surfaces and minute cracks that will not be apparent with a hydrotest.

23 Tube clips. Each tube is supported at the top by a receiver panel support frame and periodically
24 guided over their entire length by tube clips. These clips are individually welded to each tube.
25 The attachment of the tube clips to the tubes will be designed and tested to assure that the ap-
26 plied weld procedure limits the penetration of the tube wall to the minimum amount necessary to
27 assure complete fusion. Full penetration, pinholes, and burn-through will not be permitted.

28 The location of the tube clip (startup and warm up condition) on the tube relative to the oven box
29 structural interface is critical. The tube clip acts as a heat sink. If the tube clip location coin-
30 cides with the oven box structure, there will be no physical space available to add heat and salt
31 freezing may ensue. Tube clips must be located outside the oven box envelope from the mini-
32 mum to maximum thermal expansion condition.

33 Receiver Panel Support Frame. The receiver panel support frame is a close tolerance structural
34 element that supports the tube header assembly at the top and guides, which allow free expansion
35 of the tubes/bottom headers in the downward direction without binding. The following will be
36 accommodated in the design of the receiver panel and panel support frame:

- 37 • The tube support frame will be designed to accommodate unlimited thermal growth of the
38 tubes. “Unlimited” is defined as the point at which the tubes will melt.

- 1 • The tube clip is required to slide freely in the tube guide and therefore tube guide material
2 must be selected that will prevent gauling and binding.
- 3 • The frame restrains the tubes from bowing outwards and to sides, and prevents gaps from
4 opening between tubes to the backside of the receiver.
- 5 • The structure accommodates oven boxes, oven box insulation system, oven box electric heat-
6 ers, oven box power feeds, thermocouple (back of tube) tube clip guides, tube supports, EHT,
7 panel insulation, etc.
- 8 • Stainless steel-jacketed thermal insulation (mineral wool) panels will be attached to the
9 backside of each receiver panel sealing the backside of the tubes. The design must accom-
10 modate the daily panel thermal expansion and contraction cycles. The jacketing is intended
11 to protect the mineral wool insulation and its binder from moisture.
- 12 • All back of panel instrumentation, e.g., thermocouples, must be allowed free movement with
13 the panel over the maximum range of movement.
- 14 • The frame interfaces with the receiver secondary support steel and is designed to accommo-
15 date dead loads, thermal loads, wind loads, etc.
- 16 • Individual panel tubes must be designed to be replaced during an eight-hour nighttime
17 maintenance shift. The cutting and welding operations are performed from inside the re-
18 ceiver. Tube removal and new tube fit-up occur from the outside. The receiver design must
19 encompass field welding equipment, work access stands, lighting, and environmental
20 shielding. Environmental shielding must permit the welding operations to be conducted with
21 a 22 m/s (50 mph) wind.
- 22 • The receiver structural frame and panel will be designed for removal and replacement within
23 a 40-hour period (long-term hold).

24 **3.3.4.2 Receiver Vent and Drain System**

25 A receiver vent and drain system is required to fill the receiver during daily startup and drain the
26 receiver during shutdown. The function of vent and drain system is to:

- 27 • Uniformly fill the receiver.
- 28 • Assure that no air is trapped in the receiver panels during the fill process resulting in receiver
29 damage.
- 30 • Allow for rapid receiver a shut down and draining in ≤ 1 min to preclude freezing salt in the
31 panels.

32 There are two methods to fill the receiver – a flood fill method from bottom to top, and serpen-
33 tine fill method from receiver inlet to outlet. The preferred method is the flood fill, which allows

1 the fastest uniform fill rate and the highest probability that all air will be vented as the receiver is
2 filled. However, both methods need to be allowed in the design in order to provide operational
3 flexibility.

4 There are a number of design options available for the vent and drain systems. Each option has
5 pluses and minuses. The state-of-the-technology of molten nitrate salt system components, spe-
6 cifically valves, will dictate the lowest risk and lowest cost solution. As part of the design de-
7 velopment, an industrial survey should be conducted relative to improvements in valve
8 technology. Sandia National Laboratories (SNL) - Sun Lab should also be contacted as a techni-
9 cal source to determine which option should be implemented. The following is a discussion of
10 these options.

11 Vent orifices. If vent system orifices are used, they will be sized to vent air during the fill proc-
12 ess and supply air for the drain process. Figure 3-3 presents a design solution using line orifices.
13 The vent orifice design is completely passive and eliminates problematic valves; however, the
14 vents will continually flow a small quantity of salt into the outlet vessel during receiver opera-
15 tion, which reduces receiver efficiency. Individual vent lines from the panel jump over to the
16 outlet vessel are required to assure that recirculation/back flow between panels does not occur.
17 The individual vent lines will require EHT and insulation.


18 Vent valves. If vent valves are used, a reliable high temperature nitrate salt valve 565°C
19 (1050°F) that eliminates stem packing will have to be tested and qualified. A common vent line
20 may be used. The major design issue is how to confirm that all receiver panels are filled, and
21 that all air is vented before closing the valves to transition to serpentine flow. Infrared (IR) cam-
22 era images of the receiver panels during the fill, back of receiver tube temperatures, and header
23 temperatures outlet temperatures down stream of the valves are possible indications of a uniform
24 fill.

25 The individual return headers may be consolidated into a single header with larger line size, as
26 long as the common header pressure is maintained approximately equal to the downcomer pres-
27 sure. This is to assure that receiver recirculation flow does not occur. A multiport vent valve
28 will further reduce piping, but will require both a development program and a test program to
29 qualify the valve before actual use.

30 Common to all options are the vent headers from the panel jumper piping to the receiver outlet
31 vessel. It is critical that the vent headers are sloped and that the outlet vessel tie-in points are at
32 the elevation high point under all thermal expansion conditions. Each header must be capable of
33 self-draining back through the panel jumper. The piping design near the panel headers, jumpers,
34 and vent headers is congested and very complex.

35 Receiver drain valves are two position valves - full open or full closed gate valves. Valve posi-
36 tion indication, as well as flow indication through each circuit, is required.

37

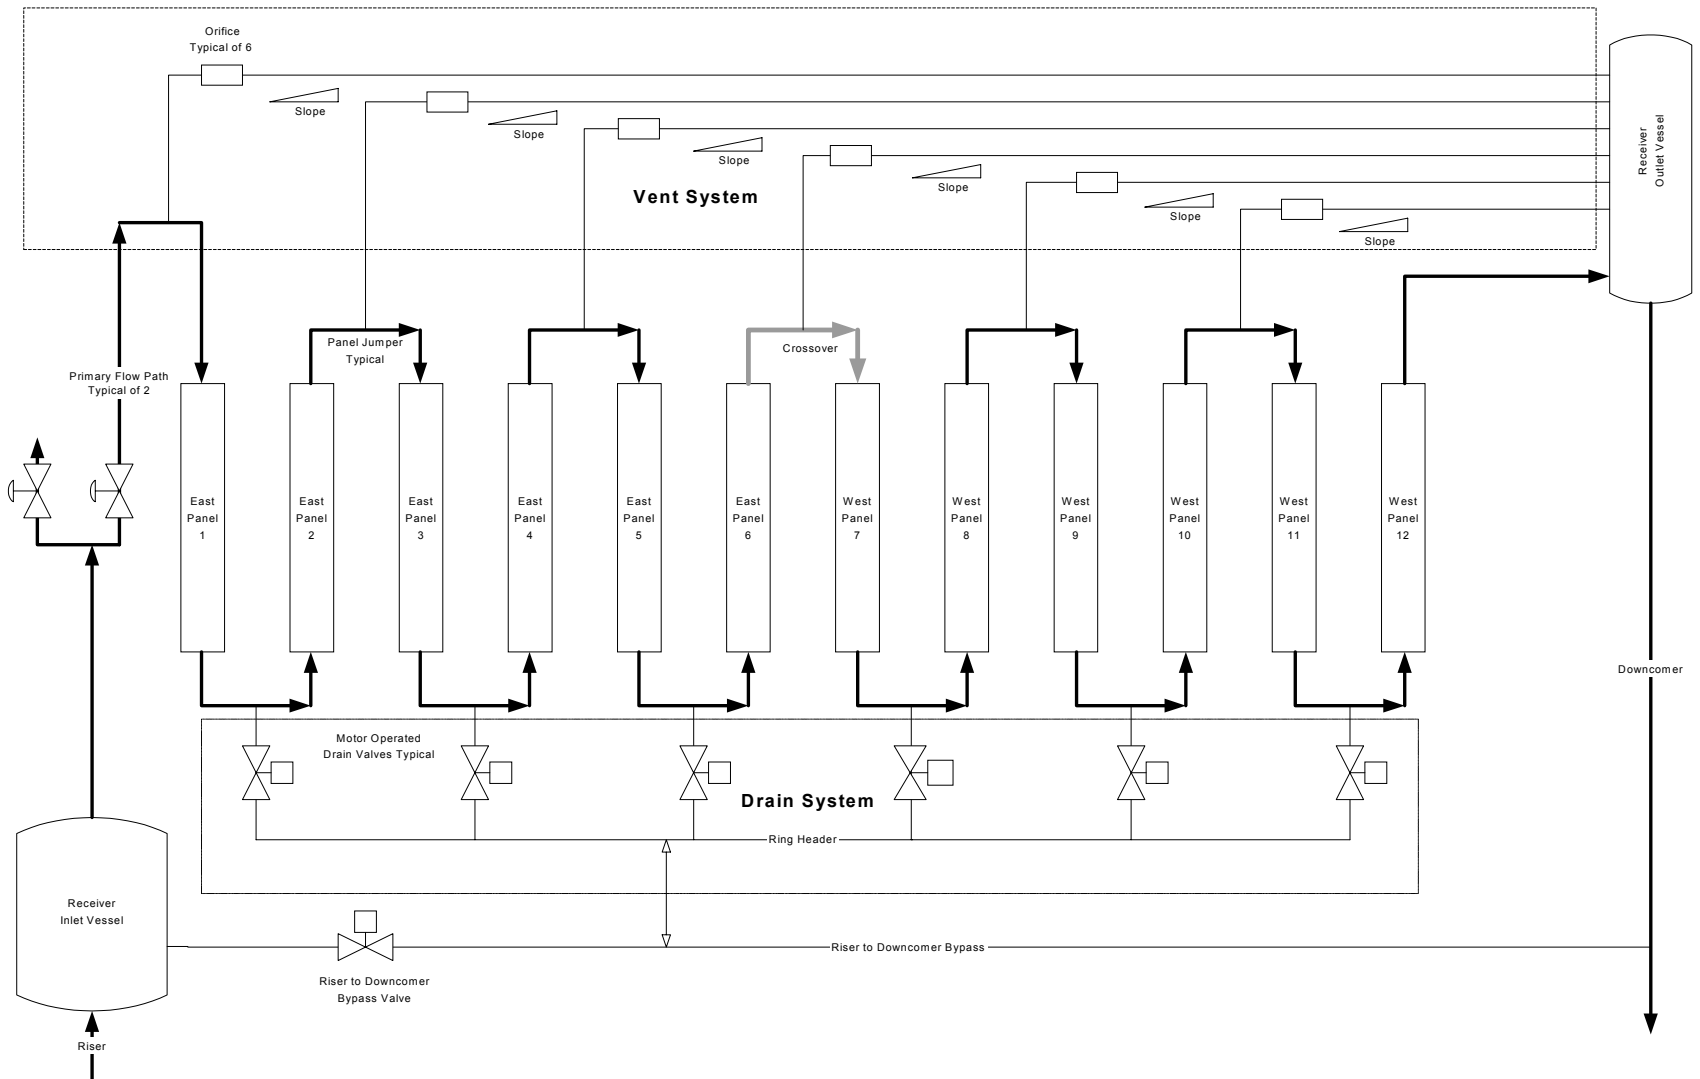


1
2

Figure 3-3. Design Solution Using Line Orifice.

1 **3.3.4.3 Oven Boxes**

2 Panel headers, inlets, and outlets, will be protected by removable insulated thermally-
 3 conditioned (electrically heated) oven boxes. The oven box radiant heaters are required to pre-
 4 heat the header assemblies to 315°C (600°F) within 0.5 hour while exposed a wind speed of 23
 5 m/s (35 mph) during the transition from preheat to normal operation. Figure 3-4 is a conceptual
 6 sectional view of the oven box assembly.

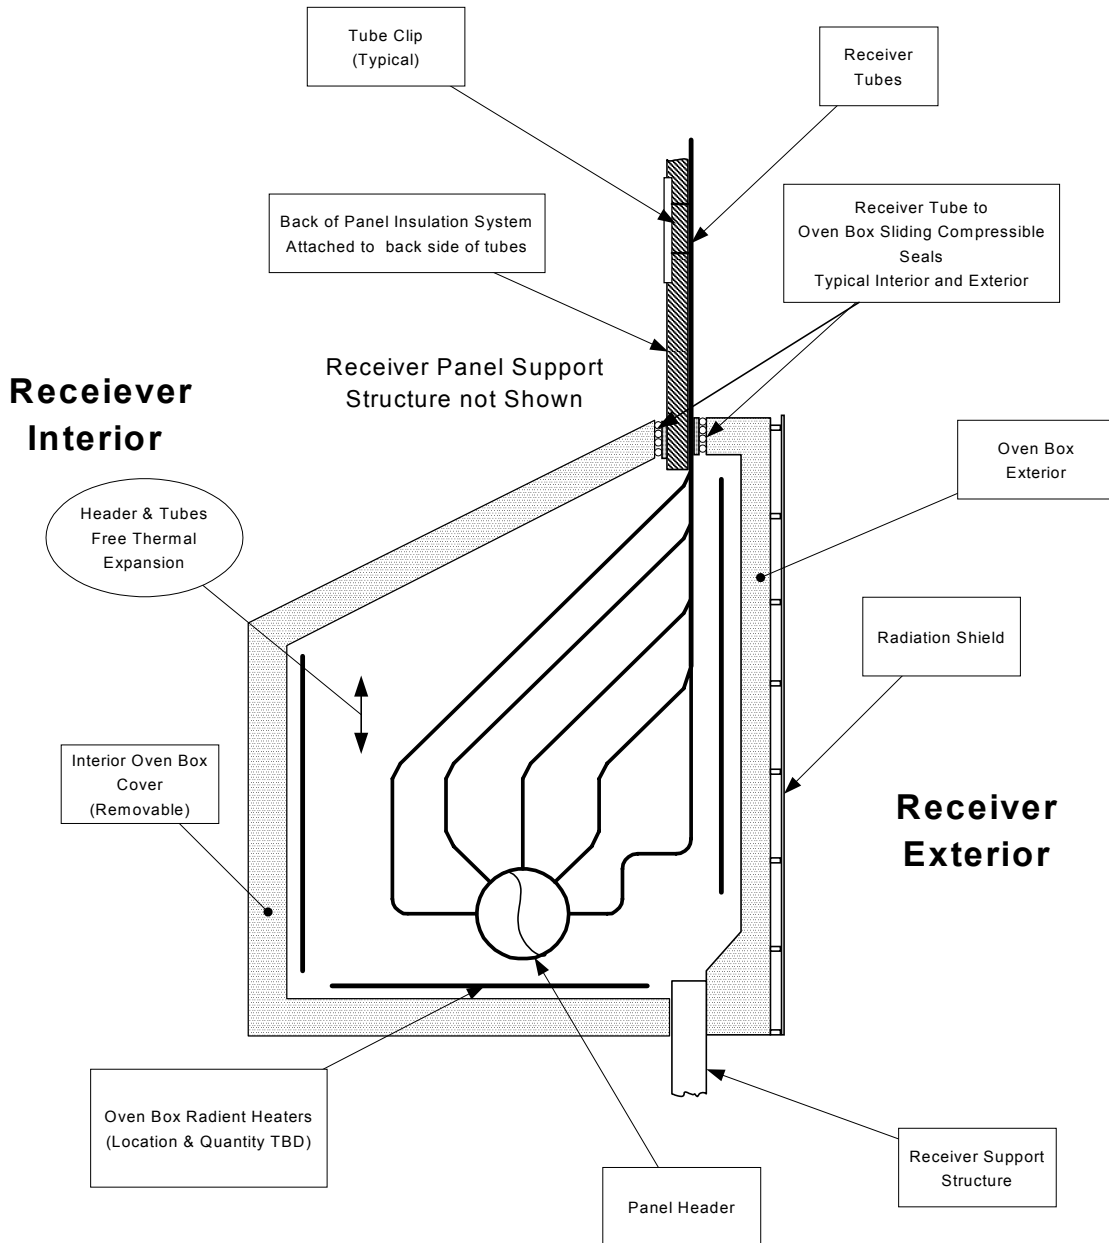

7
8

Figure 3-4. Conceptual Sectional View of Oven Box Assembly.

1 The physical configuration of the oven box makes it practically impossible to completely seal
2 gaps and spaces between the receiver tubes and the oven box. There are air passages at the oven
3 box interface with the tubes on both sides that allow for tube expansion. There are also gaps
4 between tubes themselves. These openings will result in convection heat losses, especially on
5 windy days, if not sealed.

6 The oven box-to-tube interface design will include a means of sealing the interface while allow-
7 ing for tube expansion e.g., compressible seal, spring loaded sealing surface. The backside of
8 the panels will be sealed with insulation.

9 Radiant electric heating elements will be located on the oven box wall surrounding the header
10 assembly. In addition, the receiver panel tube penetration interface with the oven box must be
11 analyzed to determine if additional EHT is required on the panel surface with the oven box.

12 The header orientation relative to the receiver panel will be such that the header and the tube
13 bends are located facing towards the inside of the receiver to reduce convection losses. The de-
14 sign and clearance envelopes and available space to accommodate the oven box inside the re-
15 ceiver is non-trivial and must address:

- 16 • Removal of the oven box assembly,
- 17 • Removal and access for maintenance of the heater elements,
- 18 • Removal and replacement of individual tubes and complete panel assemblies,
- 19 • Clearances for intrareceiver piping and its insulation and electrical heating,
- 20 • Pipe supports and receiver panel support structures,
- 21 • Instrumentation and electrical raceway and conduit,
- 22 • Secondary support steel, ladders, platforms, etc.,
- 23 • Removable weather sealing and thermal insulation, and
- 24 • Weather sealing the receiver, oven boxes, and the insulation to reduce wind losses and pro-
25 vide rain protection.

26 Refer to page 63, line 9 on receiver sizing to address the cost trade-off on receiver size versus
27 reduction of thermal losses. Accommodating the oven boxes inside the receiver will result in a
28 receiver of larger diameter.

29 An oven box exterior radiation shield is required to protect the oven boxes from excessive flux
30 spillage from the heliostats. Both the top and bottom oven box exteriors require protection. The
31 radiation shield requirements are as follows:

- 32 • The shield will be designed to accommodate 150 to 200 kW/m².
- 33 • The shield will be designed to be replaceable in a single night shift of eight hours.
- 34 • Shield material will be Type 304 or 316 stainless steel sheet 1.6 to 2 mm- (~0.07 in.-) thick
35 coated with white Pyromark[®] ceramic paint.

- 1 • The coverage area will extend 360 degrees circumferentially around the receiver with a TBD
2 panel height. Shield height is TBD m (TBD ft) and will be specified as part of the receiver
3 and heliostat field design.

4 **3.3.4.4 Receiver Sizing Methodology**

5 The analysis required to determine receiver thermal duty MWt for the RS is discussed in Section
6 1.4.1. This section determines the basis for sizing the receiver and receiver panels.

7 Establish the allowable incident flux as a function of bulk salt temperature, allowable cumulative
8 tube strains, and tube corrosion rates at the salt film temperature.

9 Allowable receiver flux. The receiver size is driven by the maximum allowable flux on a re-
10 ceiver panel (MW/m^2). Cost of energy from a heliostat is relatively expensive, which provides
11 economic incentive to design receivers with high thermal efficiency. High receiver efficiency is
12 achieved by reducing the radiation and convection thermal losses by reducing the absorber
13 area—the smaller the receiver, the higher the efficiency and higher the flux levels. Current re-
14 ceivers are designed to operate with very high flux levels, which, in turn, produce a temperature
15 gradient through the tube wall. Based upon the tube metallurgy selected, these fluxes are large
16 enough to develop plastic strains. Plastic strain is cumulative and receiver tubes eventually fail
17 through low cycle fatigue. In addition, thin-walled receiver tubes allow high heat transfer rates,
18 reduce the temperature gradient, and therefore improve efficiency. The receiver tube to header
19 connection is the point of greatest thermal stress in the receiver due to rapid temperature changes
20 associated with cloud transients and the difference in wall thickness between the receiver tube
21 and the header.

22 Establish curve of allowable incident flux as a function of circumferential position on the re-
23 ceiver.

24 Estimate annual receiver spillage losses, reflection losses, and heat losses due to convection
25 (wind velocity), conduction, and radiation for various combinations of receiver height and di-
26 ameter. The height and diameter (aspect ratio) are selected consistent with the allowable maxi-
27 mum fluxes at the top and bottom of the receiver.

28 Receiver aspect ratio (height to diameter) will be 1.2 to 1.5. A taller height receiver is desirable
29 due to the pointing accuracy that heliostats can be aimed at the receiver while minimizing spill-
30 age. A larger diameter receiver is desirable to maximize interior volume necessary to accom-
31 modate header tube bends and oven header boxes, internal piping, outlet vessel, crossover pip-
32 ing, support structure, ladders, and platforms losses. A space allocation design analysis is re-
33 quired to optimize the selection of aspect ratio with respect to loss in receiver efficiency
34 resulting from increased thermal losses (convection and conduction) due to larger diameter.

35 Receiver oven box radiation shield height and depth may be as large as necessary to protect
36 equipment including the crane, receiver outlet vessel, etc.

37 Receiver dimensions should be selected that give the best combination of CS cost and RS cost.

3.3.4.5 Receiver System Design Temperatures

RS design temperatures are shown in Table 3-4.

Table 3-4. Receiver Maximum Design Temperatures

Operating Condition	Maximum Temperatures		Cumulative Time (hours)
	Bulk °C (°F)	Film °C (°F)	
Steady State	580°C (1075°F)	600°C (1112°F)	Unlimited
Transient (5 minutes)	602°C (1115°F)	616°C (1140°F)	2500 Hrs in 30 Yrs
Receiver Trip	616°C (1140°F)	630°C (1165°F)	None

Receiver operating design temperatures

Receiver inlet temperature: 285°C (550°F)

Receiver outlet temperature: 565°C (1050°F)

Design temperatures for equipment and piping upstream and downstream of the receiver. Cold salt loop piping maximum design temperature will be 400°C (750°F). This includes the cold salt circulation pump, receiver inlet tank, cold salt pumps riser piping, supply piping to the receiver, and bypass piping up to the isolation valve. The minimum cold salt loop design temperature shall be 260°C (500°F).

Hot salt loop piping design temperature shall be 593°C (1100°F). This includes the piping outlets from the receiver, receiver crossover piping, receiver outlet vessel, downcomer piping, and bypass piping to and including the isolation valve.

3.3.4.6 RS Panels Coatings

Receiver panels and housing will be coated with a Pyromark[®] ceramic coating. Application and curing of the coating to receiver elements requires care because the thickness is critical to its performance. Pyromark[®] is located at:

Tempil, Inc.
2901 Hamilton Boulevard
South Plainfield, NJ 07080
Phone: 1 (800) 757-8301
Facsimile: 1-908-757-9273
Email: tempil@tempil.com

1 Absorption – Receiver panel tubes will be coated with black Pyromark[®] Coating to enhance in-
 2 solation absorption. The Pyromark[®] 2500 Series product has the following characteristics for
 3 thermal design:

- 4 • 0.96 (new) solar absorptivity
- 5 • 0.93 (effective over life time) solar absorptivity
- 6 • 0.83 IR emissivity

7 Reflection - Receiver oven boxes and non-absorbing structural elements exposed to focused in-
 8 solation will be protected with a white Pyromark[®] coating. The Pyromark[®] 2500 Series product
 9 has the following characteristics for thermal design.

- 10 • 0.80 Solar – reflectivity
- 11 • 0.84 IR emissivity

12 **3.3.5 Receiver System Materials**

13 The receiver, inlet and outlet vessels, and pump are defined in Table 3-5.

14 **Table 3-5. Receiver Materials Specification**

Equipment/Component	Materials	Corrosion Allowance and Remarks
Receiver		
Tubing	High Nickel Alloy	
Tube Clips	High Nickel Alloy	
Headers	High Nickel Alloy	Corrosion allowance 0.7mm (25 mils)
Nozzles, Forged	High Nickel Alloy	
Inlet Vessel		
Plate	Carbon Steel, ASTM A516, Gr 70	Corrosion allowance 0.3mm (10 mils)
Nozzles	Carbon Steel, ASTM A105	
Outlet Vessel		
Plate	Stainless Steel, ASTM A240, Gr 321 or 347	Corrosion allowance: Type 347 0.7 mm (25 mils) Type 321 TBD (refer to Section 4.3.1.1)
Nozzles	Stainless Steel, ASTM A182, Gr F321 or F347	
Receiver Circulation Pump		
	Carbon Steel, ASTM A216, Gr WCB	

1 3.3.6 Receiver Inlet Vessel Design Basis

2 The inlet vessel performs the following functions:

- 3 • Stores a quantity of salt adequate to supply the receiver for 60 seconds following a failure of
4 the cold salt pump or power.
- 5 • Provides a free surface for establishing a level during system filling and initial normal opera-
6 tion. The level in the inlet vessel is monitored by a nuclear level detector, a passive device;
7 refer to page 63, line 16 and Section 4.6.6.1 for source of supply. It uses two cesium sources
8 on one side of the inlet vessel and a vertical tube detector on the other. Salt level inside the
9 vessel attenuates the radiation. The vertical radiation distribution is measured by the detector
10 and the distribution converted to level reading.
- 11 • Provides a free surface for establishing a level during standby; the position of the throttle
12 valves in the downcomer is adjusted to maintain a set point for the inlet vessel level.
- 13 • Provides an ullage volume above the salt inventory for compressed air (oil free plant service
14 air); the ullage pressure is set once during startup to provide the potential energy to supply
15 the receiver for 60 seconds following a failure of the cold salt pump.

16 Receiver inlet vessel design characteristics

- 17 • The vessel shall be designed and fabricated to Section VIII of the ASME Pressure Vessel
18 Code and shall be code stamped.
- 19 • The dimensions of the vessel are selected so that
 - 20 – The inventory of salt is adequate to supply the receiver for 60 seconds following a loss of
21 the receiver pumps with a flow rate adequate to protect the receiver. The initial ullage
22 pressure is established during the daily startup using the plant air system with a maxi-
23 mum available pressure of (typically) 862 kPa (125 psig). Refer to line 16, above.
 - 24 – The ullage volume is large enough that the decay in the pressure does not cause the salt
25 flow rate to drop below that required to protect the receiver.
- 26 • Inlet Vessel design pressure will be receiver cold salt circulation pump shut off head plus
27 10%.
- 28 • Provides a 862 kPa (125 psig) 100% oil-free compressed air supply connection to the inlet
29 vessel. No vent connection is required. The connection will be used for an initial inlet ves-
30 sel pressurization during startup. A fixed mass of air is trapped in the ullage volume when
31 the vessel is filled. The air supply must be regulated from TBD kPa (TBD psig) minimum to
32 the plant air system maximum, and provided with check valve and a positive shutoff to as-
33 sure that nitrate salt, liquid or vapor, does not enter the system.

- 1 – The speed of the receiver circulation pump is controlled to establish a calculated ullage
2 pressure; the pressure is that required to overcome the pressure losses through the re-
3 ceiver with a salt flow rate suitable for clear sky conditions.

- 4 – Preliminary calculations have shown an inlet vessel with passive level and pressure con-
5 trol is somewhat larger than one with an active control. However, the additional expense
6 for the larger vessel is justified by improvements in the reliability of the receiver.

- 7 • Receiver inlet vessel level instrument will be a nuclear level detector or equivalent manu-
8 factured by:
 - 9 TN Technologies
 - 10 Round Rock, Texas
 - 11 Telephone: 512-388-9100
 - 12 Web Address: <http://www.tn-technologies.com>.

- 13 • Receiver inlet vessel pressure instruments will be diaphragm-type with a fluid filled capillary
14 to isolate the sensor from the molten salt. Capillaries may be filled with NaK (liquid at am-
15 bient conditions), organic salt (liquid at ambient conditions), or HITEC XL Salt (must be
16 heat traced).

17 **3.3.7 Receiver Outlet Vessel Design Basis**

18 The outlet vessel performs the following functional requirements:

- 19 • Provides a free surface for establishing a level during normal operation; the position of the
20 primary downcomer throttle valve is adjusted to maintain a set point for the level. The level
21 in the vessel is monitored by two independent level gages.

- 22 • Provides a storage volume for the salt inventory in the inlet vessel. If the flow in the down-
23 comer were blocked, the outlet vessel would store the inventory from the inlet vessel for a
24 period of at least 60 seconds. During this time, the collector field must be defocused and the
25 cold salt pump stopped.

26 Receiver outlet vessel design characteristics:

- 27 • Vessel shall be designed and fabricated to Section VIII of the ASME Pressure Vessel Code
28 and shall be code stamped.

- 29 • The diameter will allow fluid levels to vary at a rate comparable to the flow rate into and out
30 of the vessel so that small variances in flow do not result in large changes in level. Vessel
31 diameter will be constant.

- 32 • The bottom of vessel elevation will be above the top of receiver panel header elevation in all
33 modes of operation and at all temperatures.

- 1 • Thermowell elevation will be below the low liquid level (LLW) to assure the probe is always
2 in wetted region of the vessel.
- 3 • Atmospheric level instrument should be a bubbler type.
- 4 • Pressure instruments will be diaphragm type with a fluid filled capillary to isolate the sensor
5 from the molten salt. Capillaries may be filled with NaK (liquid at ambient conditions), or-
6 ganic salt (liquid at ambient conditions), or HITEC XL Salt (must be heat traced).
- 7 • Base line design for receiver outlet vessel will include an atmospheric vent TBD m (TBD ft)
8 height above the top elevation of the receiver. A failure modes study will be performed to
9 determine what surge conditions will result in a vent over flow. Design solution must con-
10 sider accommodating one minute of full flow conditions from the receiver. The lowest cost
11 design solution will be selected that will accommodate the surge condition considering the
12 following options:
 - 13 – Route the molten salt to the TSS hot tank through a dedicated vent line. The vent and
14 drain line will be insulated and heat traced.
 - 15 – Capture the event in a tank located at the receiver deck elevation.
 - 16 – Provide a vent spray nozzle that will disperse the flow into fine droplets (prill size) that
17 will allow cooling and solidification before reaching ground elevation under the maxi-
18 mum ambient temperature with no wind. Spray nozzle will direct molten salt away from
19 the tower structure. This approach will require safety review and possible approval from
20 local environmental authorities.

21 **3.3.8 Receiver Circulation Pump Design Basis**

22 **3.3.8.1 Pump type**

23 The receiver circulation pump will be a single vertical turbine pump with VSD. The pump will
24 be supported by a bridging structure on top of the cold salt tank and take suction directly from
25 the cold salt tank. The shaft length will be between 12 to 14 m (40 to 45 ft) measured from the
26 minimum liquid level elevation (heel) approximately 1 m (3 ft) above bottom of tank. The pri-
27 mary supply source for qualified receiver circulation pumps, SGS circulation pumps, and SGS
28 attemperation pumps is:

29 Nagle Pumps, Inc.
30 1249 Center Avenue
31 Chicago Heights,
32 Illinois 60411
33 Telephone: 1 (708) 754-2940
34 Facsimile: 1 (708) 754-29944
35 Email: www.naglepumps.com
36 Technical Contact Mr. Daniel L. Barth

1 The baseline approach is to install a single nitrate salt pump in each service and warehouse a
2 complete spare pump and motor with additional spare parts as recommended by the manufac-
3 turer. The traditional approach of having an installed spare results in additional piping and
4 valves, which lowers overall system reliability. Each pump will be supplied with a tail pipe of
5 sufficient length to extend into the heel to empty a tank in case of a leak.

6 **3.3.8.2 Pump rating**

7 The pump will be sized for 100% receiver flow through both circuits plus 10% margin. Pump
8 will be capable of operating from 0% flow through 110% of capacity. Pump head is determined
9 by the sum of the line and control valve losses, static head due to receiver tower measured to top
10 of receiver, pressure drop through the receiver, and the ullage pressure necessary to maintain
11 flow through the receiver for 60 seconds on the “best” day, summer solstice (maximum ullage
12 pressure).

13 **3.3.8.3 Pump discharge interface**

14 The pump discharge may be either a ring-type joint (RJT) or Reflange R-Con Connector type.
15 Ring gasket or Hub ring shall be TBD 321 or 347 stainless steel.

16 **3.3.8.4 Pump mounting interface**

17 Pump will be flange mounted to the structural support frame and its shaft will extend into the
18 cold salt tank through an insulated gland. The pump will be capable of being removed and re-
19 placed during a single shift.

20 **3.3.9 Receiver Control System**

21 Typical receiver system operations are discussed below:

22 The basic objective is to maintain tube strains within acceptable limits while simultaneously
23 regulating salt flow temperature to 565°C (1050°F). Refer to attached ASME Paper: *Automatic*
24 *Control of Solar Two Receiver* for an overview of the flow-control algorithm implemented at
25 Solar Two. Baseline control system is recommended as follows:

- 26 • A combination of feed-forward signal sets flow rate control demand signal on the control
27 valves from two groups of photometers viewing concentrated flux reflected from each of the
28 receiver panel flow circuits.

29 The photometers consist of a filter, a collimator, and a photodiode. Refer to Section 4.6.5 for
30 the manufacturer. A receiver with a 24-panel configuration uses eight photometers each
31 viewing the average reflected light from three adjacent panels. The incident flux on the
32 semiconductor diode produces a voltage proportional to the flux. Photometer calibration is a
33 trial-and-error process where the feed-forward calculation is adjusted until it closely matches

1 the flow rates determined by experimentation to yield an outlet nitrate salt temperature of
2 565°C (1050°F).

- 3 • Two proportional-integral feedback temperature signals from thermowells (redundant ele-
4 ments) on the outlet of each flow circuit trim the flow rate signal.
- 5 • Flow from the receiver inlet vessel through the east and west receiver panel circuits is con-
6 trolled a single flow control valves (fail open) in each circuit.
- 7 • Flow control to the receiver inlet vessel is based upon modulating the speed of the cold salt
8 pump's VSD to maintain either a pressure or level set point of the receiver inlet vessel.
- 9 • Panel high temperature protection and heliostat defocus basic algorithm will defocus ap-
10 proximately 30% of heliostats on a high temperature alarm, approximately 60% on a high -
11 high temperature alarm, and defocus all heliostats on a high – high – high temperature alarm.
12 Protection system will comprised of back of tube thermocouples. The number and location
13 of thermocouples will be such that the entire surface of each panel is protected to include the
14 top, center, bottom, and four edges, seven thermocouples per panel minimum.
- 15 • Four permanent IR cameras capable of viewing the entire receiver surface will be used by the
16 plant operators to support the daily preheat, daily receiver flood fill/serpentine fill processes,
17 and daily receiver drain. Cameras should be collocated with the BCS cameras. IR cameras
18 will be used to check the receiver for cold spots to prevent freezing salt during the fill pro-
19 cess and drain process and for receiver hot spots. Refer to Section 4.6.7 for IR camera re-
20 quirements and the manufacturer.

21 **3.3.10 Typical Sequence of Operations**

22 **3.3.10.1 General Discussion**

23 Heliostats transition from Standby to Preheat when receiver panels are preheated to between
24 260°C to 320°C (500°F to 600°F). A typical daily receiver flood fill and serpentine fill proce-
25 dure begins with the receiver in Long Term Hold/Overnight Hold and proceeds as described in
26 the sections below. Two receiver filling processes are described; however, the flood fill proce-
27 dure is preferred since it offers the least risk.

28 **3.3.10.2 Flood Fill Procedure**

29 Step 1. Receiver inlet vessel is under level control—minimum level with a minimum ullage
30 pressure and receiver circulation pump speed above point at which pump will stall. Downcomer
31 is filled. Heliostats are in Standby.

32 Step 2. Receiver drain and vent valve are closed and receiver flow valves are closed.

33 Step 3. Air valve is opened and inlet vessel pressurized to a TBD kPa (TBD psig). The design
34 pressure is driven by the size of the receiver inlet vessel and is limited by the maximum pressure

1 of the BOP utility air system. Level is maintained. Receiver pumps speed increases to compen-
2 sate driving the pressure up with a slight increase in level.

3 Step 4. Receiver panels are confirmed preheated and ready. Receiver transitions from Preheat
4 to Normal Operation.

5 Step 5. Open vent and drain valves.

6 Step 6. Verify receiver bypass valve is open. Pump is maintaining level in inlet vessel and flow-
7 ing salt through the bypass and downcomer returning salt to the cold.

8 Step 7. Downcomer throttle is in manual operation and open.

9 Step 8. Verify receiver flow valves are closed, pump speed is ramped to increase receiver inlet
10 vessel level, and initiate flood fill of receiver.

11 Step 9. Receiver flood fill confirmed by receiver inlet vessel level, temperature rise is detected
12 by IR cameras on receiver panels and by thermocouples in vent header outlets detecting rise in
13 temperature above EHT 260°C (500°F) set point.

14 Step 10. Close receiver drain valves; open receiver flow control valves and close bypass valve.
15 When outlet vessel level reaches normal liquid level (NLL), change the set point on throttle
16 valve from manual to automatic outlet vessel level control.

17 Step 11. Switch control of the receiver circulation pump from the level control set point to the
18 pressure control set point. The vessel level and ullage pressure are coupled by the ideal gas law
19 ($pV = NRT$). The nuclear level controller monitors level to ensure that leakage through the air
20 supply line or relief valve does not cause the level to drift.

21 **3.3.10.3 Serpentine Fill Procedure**

22 Step 1. Receiver inlet vessel under level control—minimum level with a minimum ullage pres-
23 sure and receiver circulation pump speed above point at which pump will stall. Downcomer is
24 filled. Heliostats are in Standby.

25 Step 2. Receiver drain and vent valve are closed.

26 Step 3. Air valve is opened and inlet vessel pressurized to a TBD kPa (TBD psig). The design
27 pressure is driven by the size of the receiver inlet vessel and is limited by the maximum pressure
28 of the BOP utility air system. Level is maintained. Receiver pumps speed increases to compen-
29 sate driving the pressure up with a slight increase in level.

30 Step 4. Receiver panels are confirmed preheated and ready. Receiver transitions from preheat to
31 normal operation.

32 Step 5. Verify that drain valves are closed. Verify that vent valve(s) are open.

- 1 Step 6. Receiver bypass valve closed.
- 2 Step 7. Downcomer throttle is in manual operation and closed.
- 3 Step 8. Receiver flow valves are opened, throttle valve is opened, and pump speed ramped to
4 maintain receiver inlet vessel level.
- 5 Step 9. Receiver fills serpentine flow is established.
- 6 Receiver serpentine flow is confirmed by receiver inlet vessel level, temperature rise detected by
7 IR cameras and by thermocouples in vent headers detecting rise in temperature above EHT
8 260°C (500°F) set point.
- 9 Step 10. When outlet vessel level reaches NLL, change the set point on throttle valve from man-
10 ual to automatic outlet vessel level control.
- 11 Step 11. Switch control of the receiver circulation pump from the level control set point to pres-
12 sure control set point. The vessel level and ullage pressure are coupled by the ideal gas law (pV
13 = NRT). The nuclear level detector monitors level to ensure leakage through the air supply line
14 or relief valve do not cause the level to drift.

15 **3.3.10.4 Minimum Receiver Fill Conditions**

16 Minimum receiver fill conditions required to initiate preheat and fill sequence are:

- 17 • Wind Speed < 35 mph
- 18 • Sun >2° above the horizon
- 19 • No minimum ambient temperature condition
- 20 • Minimum receiver surface temperature of 230°C (450°F)

21 **3.4 Thermal Storage System**

22 **3.4.1 System Description**

23 The TSS baseline system elements are comprised of:

- 24 • Cold nitrate salt storage tank. An American Petroleum Institute (API) 650 atmospheric tank
25 includes manways, pressure relief, vents, tank sparger ring, instrumentation, and tank insula-
26 tion system. The tank stores cold salt from steam generator and supplies cold salt to RS cir-
27 culation pump and SGS attemperation pump.
- 28 • Hot nitrate salt storage tank. An API 650 atmospheric tank includes manways, vents, tank
29 sparger ring, pressure relief components, instrumentation, and tank insulation system, and
30 stores hot from the receiver and supplies hot salt to the SGS circulation pump.

- 1 • Cold and hot nitrate salt tank foundations, including insulation, passive foundation cooling
2 system, and leak detection system.
- 3 • Cold nitrate salt storage tank immersion heaters that maintain tank temperatures above 260°C
4 (500°F) and are capable of heating cold tank salt inventory to 400°C (750°F).
- 5 • Hot nitrate salt storage tank immersion heaters that maintain tank temperature above 260°C
6 (500°F) and are capable of heating hot tank salt inventory to 540°C (1000°F).
- 7 • Internal volume air heater system used to thermally condition air volume in both tanks during
8 initial startup and to thermally condition hot tank air volume to prevent tank heating rate
9 from exceeding 56°C/hr (100°F/hr).
- 10 • Hot nitrate salt storage tank mixer. A mechanical system to mix the content of the hot tank
11 to prevent temperature gradients in excess of 56°C (100°F).

12 **3.4.2 Scope of Supply**

13 TSS design, physical design, and integration package includes PFDs, process and instrument
14 diagrams, technical specifications, general arrangement drawings, nozzle orientation schedule,
15 physical design of interconnecting piping, structural, electrical, and control systems, tank sub-
16 contract package, specification and procurement of the bulk premixed nitrate salt, shop drawing
17 review, construction and startup and activation. The site work includes tank foundations, berms,
18 and a passive cooling system. Also included is the design task to thermally condition the TSS
19 from the long term hold state through the transition to normal operation while minimizing para-
20 sitic electrical power loads and thermal heat losses.

21 The TSS salt storage tank design, fabrication, field erection, and startup support subcontract
22 package includes the design calculations, detailed tank design, shop drawings, insulation mat and
23 insulation systems, leak detection system, tank insulation systems, tank material procurement
24 and tank erection, tank testing, and tank startup and activation support.

25 The nitrate salt procurement package includes the supply and transportation from the point of
26 manufacture to the plant site of bulk premixed nitrate salt.

27 The nitrate salt handling and melting subcontract or equipment procurement package includes
28 providing the melting process equipment, bulk material handling equipment, and performing the
29 work. Depending upon the cost to the project, the package may be structured as either an
30 equipment rental or an equipment purchase. Work includes all required melting equipment and
31 process fired heater fuel, operating the equipment on a 24-hour, seven-day-per-week basis until
32 the entire solid bulk inventory has been melted and installed in the hot tank. Plan for and ac-
33 commodate the nitrous oxides (NOX) off gassing. Long lead delivery nitrate salt unique pumps,
34 valves, and instruments may be provided by the project on a loan basis.

1 3.4.3 Thermal Storage System Design Basis

2 3.4.3.1 Hot and Cold Tank Design Basis

3 Tanks will be designed in accordance with API 650. Tanks will be an insulated vertical cylin-
4 drical design with flat or domed roofs.

5 Tank Sizing. Tank sizing will be based upon the following criteria:

- 6 • The volume of nitrate salt required to sustained operations for base time period, e.g., 16
7 hours of storage for a 24-hour-per-day SPT operation. Height is limited by the maximum
8 length of the vertical turbine pump barrels both in liquid and dry minus the following:
 - 9 – 1.0 m (3 ft) for tank heel
 - 10 – 1.0 m (3 ft) for the tank heel from the other tank, an emergency condition if the other
11 tank has a leak
 - 12 – 0.3 m (1 ft) allowance for the inventory from the RS and SGS piping and equipment (ac-
13 tual liquid volume will need to be converted to equivalent height to confirm the allow-
14 ance)
 - 15 – 0.3 m (1 ft) for ullage (free board)
 - 16 – 1.5 m (5 ft) for dry exterior pump barrel length (used for pump barrel length sizing crite-
17 ria, not tank sizing)
- 18 • Pumps will be mounted on a ridged structural steel support bridging the storage tanks in-
19 cluding structural support member depth and platform steel.
- 20 • Insulation and jacketing thickness on the top of the tanks
- 21 • Tank thermal expansion clearance
- 22 • Vertical access clearance
- 23 • The maximum barrel length on vertical turbine pumps from preliminary contact with indus-
24 try is in the range of 12 to 14 m (40 to 45 ft). This includes tank liquid/dry level data above
25 that will establish the tank height.
- 26 • The thermal fatigue life of the tank floor to wall joint is dependent upon the magnitude and
27 frequency of the pressure and thermal cycles of each tank. The tank internal pressure cycles
28 can be controlled and are not an issue. A commercial SPT with 24-hour dispatchable power
29 will have substantially larger tanks than Solar Two. Thermal fatigue at this joint may be an
30 issue. The tank design/erector should evaluate both the welded orthogonal joint and a curved
31 joint (lower outside section of a torus) as an option to reduce thermal fatigue.

1 **3.4.3.2 Tank Vents and Pressure Reliefs**

2 Tank vents and pressure reliefs are required to:

- 3 • Equalize daily swings in tank levels due to normal tank liquid volume changes.
- 4 • Accommodate tank overpressure events based upon an SGS tube rupture, which allows
5 steam into the salt flow causing high overpressure surge into either storage tank.
- 6 • Accommodate tank vacuum pressure event resulting from blockage in the vent system, which
7 will preclude the tank from breathing or a rapid decrease in tank temperature from cold salt.

8 Vent and Relief Requirements. Provide an atmospheric tank vent on each tank to accommodate
9 daily volumetric air changes within the each tank. Provide tank overpressure protection to ac-
10 commodate the worst case scenario of a SGS tube rupture, which allows steam flow back into
11 the tanks. Provide tank vacuum pressure protection in the event the atmospheric vent becomes
12 plugged.

13 Salt mists are present inside each tank. The salt mist will condense on any surface when the
14 surface temperature falls below 240°C (465°F). Therefore, the vent and relief systems must be
15 electric heat traced and insulated from the intake/discharge point to the entry point into each
16 tank. A common vent system tying the two tanks together is not acceptable since the EHT
17 power consumption requirements will far exceed any benefit of tying the two together.

18 Independent pressure and vacuum relief devices are required. All components will be exposed
19 to nitrate salt and shall be selected on the basis that they will be subject to both nitrate salt mist
20 and water vapor simultaneously. All components will be corrosion-resistant stainless steel mate-
21 rial minimum American Society for Testing and Materials (ASTM) 321 for housings, springs,
22 seats, etc.

23 The overpressure relief system will use the cross-sectional area available from the man-ways
24 rather than use specialized overpressure relief devices. Just raising the man-ways cover off the
25 seats results in excessive heat losses and is not acceptable. The design solution developed in
26 conjunction with the tank subcontractor should consider:

- 27 • Compliance with API 650
- 28 • Minimizing thermal losses (sealing, insulation, and EHT)
- 29 • Blockage due to salt mist condensation
- 30 • Long-term corrosion protection of the device and the surrounding insulation system.
- 31 • Reliability with possible redundancy

32 The vacuum pressure relief system may have to be independent from the tank vents due to cross-
33 sectional area requirements. The vacuum relief must comply with API 650 requirements and
34 provide reliable protection.

35 Tank vents will be electric heat traced, insulated, and use corrosion-resistant materials. Both
36 vent designs will take the initial NOX off gassing into consideration, but will be converted to

1 “goose neck” configurations after the chemical reaction has completed. The off gassing vent
 2 may be a stack TBD feet tall, if environmental regulations allow direct NOX discharge. The
 3 thermal system design will consider that the airflow will fluctuate as a function of temperature
 4 and varying tank liquid levels. The rate of ambient (cool) airflow into the tank will determine
 5 EHT: watt density, location of the temperature sensors limits, possible zone definition, etc.

6 Vent and Relief Protection System Sizing. Tank overpressure and vacuum relief size will be in
 7 accordance with API 650.

8 Overpressure relief will be sized to accommodate a tube rupture in the SGS that allows steam
 9 into the tanks. It is intended that pressure relief system design use the tank “man-ways” as the
 10 relief device, rather than specialized relief valves. An analysis must be performed in conjunction
 11 with SGS system/equipment designer to determine the maximum steam pressure pulse criteria
 12 and the area necessary to protect each tank.

13 Vacuum relief will be sized for abnormal decreases in tank pressure caused either by a blocked
 14 vent, or a rapid decrease internal tank temperature caused by the introduction of cold salt into
 15 tank with low salt level at a higher temperature.

16 Tank vents will be sized to accommodate normal operating changes in tank liquid level, atmos-
 17 pheric pressure changes, etc. In addition, the vent systems must accommodate the NOX off gas-
 18 sing during initial salt melting.

19 **3.4.3.3 Tank Immersion Heaters**

20 Tank immersion heaters are required in each tank to:

- 21 • Prevent salt from freezing due to conduction, radiation, and convection heat losses from tank
 22 floor, sidewalls, and roof during long-term holds.
- 23 • Have the capability to raise bulk salt storage temperature in each tank to
 - 24 – 400°C (750°F) cold tank
 - 25 – 540°C (1000°F) hot tank

26 The temperature heat-up rate is TBD, differs for each tank, and will be determined by analysis.
 27 The heat-up rate is not critical.

28 System Requirements. Immersion heater housing assemblies are capped pipes mounted in the
 29 tank walls that extend radially into each tank. The heater will be installed at an elevation within
 30 the heel (<1 m [3 ft] from tank floor), allowing permanent submergence.

31 The capped pipe will form the heater element to liquid pressure boundary and provide a means to
 32 easily replace heater elements. The pipe schedule will be a minimum schedule 40. The capped
 33 pipe material will operate at a higher temperature than the bulk liquid temperature in the tank,
 34 and therefore material selection must be coordinated between the tank designer and the immer

1 sion heat manufacturer. The capped pipe material metallurgy may be different from the tank
2 material and the penetration interface fitting.

3 The capped pipe assembly will be supported from the tank floor to minimize the bending stresses
4 at the wall joint. A mounting flange will be provided on the tank wall to retain and support the
5 heater assembly.

6 The design of the heater must accommodate the power and control connections and the interface
7 with tank wall insulation system. The exterior heater assembly will be insulated with an easily
8 removable/replaceable maintenance jacket. The thickness of the jacket will match the tank in-
9 sulation thickness.

10 Immersion Heater Sizing. The immersion heaters will be selected so that the immersion heat
11 flux through the pipe will not cause a pipe wall surface temperature to exceed 593°C (1100°F)
12 for the hot tank, and 430°C (800°F) for the cold tank when fully immersed in molten nitrate salt.
13 Immersion heater load will be determined to meet the most severe requirement stated above.

14 A minimum of 100% installed and connected spare capacity will be provided in each tank.

15 **3.4.3.4 Air Tank Heating System**

16 An air tank heating system (temporary or permanent) is required for the hot salt tank and tempo-
17 rally for the cold tank to:

- 18 • Thermally condition the hot and cold tanks in conjunction with initial liquid salt loading oper-
19 erations. Tank internal temperature must be raised to a minimum of 370°C (700°F) before
20 any liquid salt filling operations can occur and until the salt liquid level covers the immersion
21 heaters and they can be energized.
- 22 • Prevent extreme thermal gradients from forming within the hot tank due to low salt liquid
23 levels and low salt temperature when transitioning from long-term hold to normal operations.
24 Temperature ramp rates in excess of 120 to 180°C/hr (250 to 300°F/hr) are possible when the
25 hot tank bulk salt temperature is 370°C (700°F) with a LLW and hot salt from the receiver is
26 introduced at 510°C (950°F). The hot tank volumetric temperature must be raised to TBD°F
27 within TBD hours; refer to Section 3.4.4.
- 28 • Determine if the immersion heaters, if properly sized, can raise the hot tank internal tem-
29 perature (liquid and volumetric) to TBD°F within TBD hours after a long-term hold to meet
30 this requirement rather than a permanent air heating system. A temporary system is still re-
31 quired for the initial nitrate loading and melting.

32 System Requirements. The air tank heating system may be either an electrical- or fuel-based
33 system, e.g., electric duct heater, propane heater exhaust, natural gas, etc. (Solar Two used a
34 portable propane heater and directed the exhaust gas into each tank. The propane burner was
35 able to heat and maintain the tank volumetric temperature at (370°C (700°F)). Heated air for
36 initial operations must be supplied near the tank bottom (snorkel) to assure that the tank floor

1 and floor to wall joints are thermally conditioned. The snorkel is no longer required once liquid
2 salt reaches the 1 m (3 ft) heel level and the immersion heater can be energized.

3 The air heating system inlet and outlet points will be through the tank roof. Heating systems
4 using exhaust directly must use a clean fuel (propane, natural gas, etc.) or exchange the exhaust
5 against a clean air flow stream before introducing it into either tank.

6 The tank inlets/outlets will be valved (butterfly) or blind flanged to positively seal the tank and
7 heater ducts from each other when not in use. Valves and a portion of the duct system may have
8 to be electrically heat traced to prevent salt buildup on sealing/setting surfaces.

9 The commercial heating system specified should have sufficient spare capacity and a turndown
10 capability.

11 Air Heater Sizing. Evaluate the costs and the minimum time duration to raise internal hot salt
12 tank temperature with 1 m (3 ft) heel of salt at 370°C (700°F) to TBD°F in TBD hours so 510°C
13 (950°F) salt can be introduced into the hot tank without exceeding the maximum tank heating
14 rate; refer to Section 3.4.4. Determine if this system is adequate without the 370°C (700°F) heel
15 for initial tank thermal conditioning considering tank thermal conduction, convection losses, and
16 the minimum amount of time.

17 **3.4.3.5 Hot Salt Tank Agitator**

18 Evaluate options and provide an active hot salt tank inventory tank mixing capability to prevent
19 a liquid temperature gradient from forming inside the hot tank during long-term hold. (Experi-
20 ence from Solar Two operations determined that salt density differences as a function of tem-
21 perature were not large enough to establish natural circulation within the hot tank and large
22 temperature gradients developed.) Mixing options to be investigated are:

- 23 • Using the hot salt SGS circulation pump at a low flow rate to pump salt from the bottom of
24 the tank and returning it via a ring header at the top. This will require additional piping,
25 valves, including a riser valve, controls, and EHT, all of which, from experience, are prob-
26 lematic.
- 27 • Providing a separate recirculation system with dedicated pumps and their own dedicated
28 piping systems. This system will have similar issues – more piping, more valves, and more
29 potential for problems. However, a means of transferring the heel inventory from the hot salt
30 tank to the cold salt tank, or the reverse, may be required, and the same pumping system
31 could serve double duty.
- 32 • Using a mechanical mixer, motor-driven paddle-wheel-type mounted on the TSS bridging
33 structure.

1 **3.4.3.6 Tank Heel Salt Inventory Transfer Capability**

2 As part of the design, provide a capability for transferring the heel salt inventory from the hot
3 salt tank to cold salt tank, or the reverse, in case of a TSS tank leak. The recommended approach
4 is to provide tail pipe extensions for the SGS circulation pump, RS circulation pump, and SGS
5 attenuation pump that will allow the pump to take suction from the heel in an emergency.
6 Separate pump and piping systems are not recommended since these will increase to the overall
7 complexity of the TSS.

8 **3.4.3.7 Tank Manway**

9 Tank manway(s) access will be provided to each tank in accordance with API 650 requirements
10 but should be limited to top entry, if possible, to avoid flanged access in the tank side walls.

11 **3.4.3.8 Tank Inlet Sparger Ring**

12 Each tank will be provided with a tank inlet sparger ring(s) to inject salt upwards into each tank
13 to enhance mixing to minimize thermal stratification of the operating salt volume. The sparger
14 ring will be located just within the 1 m (3 ft) heel elevation of each tank with the ejectors facing
15 upwards to minimize mixing within the heel volume. The temperature of the tank heel liquid
16 volume should be allowed to remain relatively constant to act as a buffer volume to minimize the
17 affects of temperature cycling on the tank floor and between the floor and wall joint.

18 **3.4.3.9 Tank Instrumentation**

19 Provide thermowells and sensors to measure and map temperature gradients within each tank.
20 Temperature measurement points should be provided both circumferentially and at regular ele-
21 vation intervals.

22 Provide standpipe mounted and supported by tank sidewall for level gage, air-bubbler-type to
23 measure tank level in each tank. Gage will be capable of measuring tank level to within 3.85 cm
24 (1.5 in.) of tank bottom. Reference leg for bubbler will be vented to the inside of each tank into
25 the ullage volume.

26 Provide high-temperature strain gauges on the tank sidewall to floor joints to confirm analytical
27 thermal stress models. Since these will be the largest high temperature tank systems ever con-
28 structed, it is critical to verify the analytical model against actual performance.

29 **3.4.4 Design Temperatures, Heating Rates, and Tank Thermal Cycles**

30 The design temperatures, heating rates, and tank thermal cycles are shown in Table 3-6 and dis-
31 cussed in Section 3.4.4.1 to 3.4.4.4.

Table 3-6. Design Temperatures and Heating Rates

Tank Operating Condition	Cold Salt Tank	Hot Salt Tank
Operating Temperature °C (°F)	290°C (550°F)	565°C (1050°F)
Maximum Design Temperature °C (°F)	400°C (750°F)	593°C (1100°F)
Maximum Tank Temperature Rate of Change (°F/hr)	56°C/hr (100°F/hr) TBD (Section 3.4.4.1)	56°C/hr (100°F/hr) TBD (Section 3.4.4.1)
Maintenance outages, including annual plant outages and long-term outages due to equipment failures exceeding 72 (TBD) hours. Immersion heaters maintain both tanks at 260°C (500°F) set point. Assumes hot salt inventory at minimum level –heel. Cycle basis and time durations are based upon a maximum salt inventory in cold tank. Where the volume of salt resides is only important in the rate and amount of time to condition the inventories for plant startup. Air heating capability exists to thermally condition hot salt tank internal volume/shell to TBD°C (TBD°F). Immersion heaters will heat both tanks liquid inventories. Number of cycles is based upon 30 annual shutdowns and 1520 unscheduled equipment failures in 30 years exceeding 72 hours (TBD).	Shutdown – Shell & salt inventory begin full at 290°C (550°F) and cool to 260°C (500°F) at a rate of 1.1–2.8°C/day (2–5°F/day) (TBD). Startup – Shell & salt inventory start at full 500°F and are raised to 550°F over a period of TBD hours. 1550 cycles.	Shutdown – Shell & salt heel inventory begin at 565–510°C (1050–950°F) and cool at a rate of 5.5°C/day 10°F/day. Startup – Shell & salt heel inventory begin at TBD°C (TBD°F) and the immersion heaters and air heating system raise system temperature to TBD°C (TBD°F) in TBD hours at a rate not to exceed 56°C/hr (100°F/hr) before introducing 510°C–565°C (950–1050°F) salt from the receiver. (Section 3.4.4.2) 1550 cycles.
Weather outages – long-term hold. Weather outage exceeding TBD hours. Hot and cold salt tank mixers maintaining uniform bulk inventory temperature. Assume that the hot salt tank inventory is at heel level.	Beginning of weather outage – Shell & salt inventory begin at 290°C (550°F) and cool to 260°C (500°F) at a rate of 1.1–2.8°C/day (2–5°F/day). Restarting – Shell & salt inventory begin at 260°C (500°F) and immersion heaters raise bulk temperature to 290°C (550°F) at a rate not to exceed 56°C (100°F/hour). TBD Cycles (Section 3.4.4.3).	Beginning of weather outage – Shell & salt inventory begin at 565–510°C (1050–950°F) and cool at a rate of 5.5°C (10°F/day) to 370–260°C (700–500°F). Restarting – Shell & salt inventory begin at 370–260°C (700–500°F). The immersion heaters and air heating system raise the salt inventory to TBD °F at a rate not to exceed 56°C (100°F/hour) (Section 3.4.4.2). TBD cycles (Section 3.4.4.3).
Daily Operational Cycle – Charging	Shell & Salt inventory starts at full level 290°C (550°F) and reduces to heel level at 290–260°C (550–500°F) over an eight hour period. 10000 cycles.	Shell & Salt inventory start with heel at 540 – 480°C TBD (1000–900°F TBD) and increases to full at 540–565°C (1000–1050°F) over an eight-hour period. 10000 cycles.

Table 3-6. Design Temperatures and Heating Rates (continued)

Tank Operating Condition	Cold Salt Tank	Hot Salt Tank
Daily Operation Cycle – Generating	Shell & Salt inventory starts with heel at 260°C to 290°C (500°F to 550°F) and increase to full at 290°C (550°F) over a 16 hour period if plant operates on a 24 hours/day basis. 10000 cycles.	Shell & Salt inventory start at full level at 1000–1050°F and reduce to heel level at 480–540°C TBD (1000–900°F TBD) over a 16 hour period if plant operates on a 24 hour/day basis. 10000 cycles.
Salt Diversion Receiver operates at low thermal output and diverts salt at 370°C (700°F) to the cold tank for a period not to exceed one hour (TBD). Tank temperature rate of change cannot exceed 56°C/hr (100°F/hr). Number of cycles is based upon TBD.	Shell and Salt inventory start at 290°C (550°F) and salt is introduced into the cold tank over a period of one hour (TBD) until the inventory temperature reaches 370°C (700°F). 10000 cycles.	N/A

1

2 **3.4.4.1 Maximum Tank Heating Rate**

3 The stated maximum temperature rate of change, 56°C/hr (100°F/hr) TBD, is based upon Solar
4 Two tank design criteria. This temperature rate of change criteria will be revalidated in con-
5 junction with the field erected tank suppliers/erectors to select a rate appropriate for the state of
6 the technology, considering:

- 7 • materials selected for tank construction,
8 • joint designs for thermal stress loading and number of thermal cycles, and
9 • thermal conditioning approach and procedures.

10 **3.4.4.2 Startup Hot Tank Salt Inventory Temperature**

11 The storage tank inventory and tank volumetric temperatures (system temperature) receiver
12 startup must be sufficiently high that when hot salt from the receiver is introduced into the hot
13 tank at 510°C to 565°C (950°F to 1050°F), it does not result in the tank temperature rate to ex-
14 ceed 56°C/hr (100°F/hour). This requires that the hot tank system temperature be greater than
15 370°C (700°F) at startup. The startup temperature must be determined through design analysis.
16 (For example: on Solar Two, after a 72-hour weather outage, the hot tank system temperature
17 fell to 370°C (700°F). At startup, this resulted in a (139°C/hr (250°F/hr) tank heating rate if salt
18 were introduced at 540°C (1000°F). In order to not exceed the 56°C/hr (100°F/hr) rate limit, the
19 receiver was operated at a lower temperature to allow the tank sufficient time to come to tem-
20 perature. This resulted in a one- to two-hour startup period.)

1 **3.4.4.3 Weather Outages**

2 The number of weather outage cycles must be determined from historical weather data for the
3 actual SPT site. The duration of a weather outage will be determined by the cool down rate of
4 the salt inventory in the hot storage tank that results in system temperature requiring tank ther-
5 mal conditioning.

6 **3.4.4.4 Daily Receiver Startup**

7 The daily receiver startup is applicable with either the flood fill or serpentine fill processes. As
8 flow is being established through the receiver, salt is recirculated back to the cold tank until the
9 cold tank bulk temperature reaches 370°C (700°F), at which point the flow is diverted to the hot
10 tank. This operation can take upwards of 30 minutes.

11 Plant Maintenance Outage. The shutdown cycle of the cold tanks begins with a bulk storage
12 temperature of 290°C (550°F) and cools naturally to 260°C (500°F) at a rate of 1.1 to 2.8°C/day
13 (2 to 5°F/day) (TBD). The immersion heaters maintain bulk temperature at the 260°C (500°F)
14 level. The hot tank heel inventory begins with a bulk temperature of 540 to 565°C (1000 to
15 1050°F) and cools at a rate of 5.5°C/day (10°F/day) to TBD°F. The rate of temperature decay
16 was taken from direct operating experience at Solar Two and was based upon minimum tank liq-
17 uid level with the passive cooling system vents unplugged.

18 Plant Outage. The startup cycle of the cold tank salt inventory starts at 260°C (500°F). Hot tank
19 inventory starts at TBD°F. Cold tank immersion heaters raise tank inventory to 290°C (550°F).
20 Hot tank immersion heaters and air heater raises liquid and shell temperature to TBD°C (TBD°F)
21 at a rate not to exceed 56°C/hr (100°F/hr). The cold salt mixer prevents temperature stratifica-
22 tion.

23 **3.4.5 Thermal Storage System Tank Materials**

24 The TSS tank materials selection is given in Table 3-7.

25 **3.4.6 Tank Insulation**

26 **3.4.6.1 Foundation Mat Insulation**

27 Foundation mat insulation is installed on top of the passive cooling system and consists of a
28 sandwiched insulation system is constructed of “foamglass” and refractory brick. The insulation
29 system descriptions below are typical.

30 The cold salt tank insulation system is comprised of two separate radial zones. The thickness of
31 the cold tank insulation system on Solar Two was 420 mm (1 ft to 4.5 in) measured from the top
32 foundation/passive cooling system to bottom of tank floor. Typical zone construction consists of
33 the following:

1

Table 3-7. TSS Tank Material Selection

Materials	Cold Salt Tank	Hot Salt Tank
Tank Shells		
Plate	Carbon Steel, ASTM A516, Gr70	Stainless Steel ASTM A 240, Gr 321 or 347
Bar Stock	Carbon Steel, ASTM A181	Stainless Steel ASTM A193 B8R Studs A194 8R Heavy Hex. Nuts
Tank Nozzles	Carbon Steel, ASTM A181	Stainless Steel, ASTM A182, Gr F321 or F347
Internal Structural		
Structural Tubing	Carbon Steel, ASTM A 500	Stainless Steel, ASTM A249, Grade TP321H / TP347H
External Clips and Attachments	Carbon Steel, ASTM A506	Stainless Steel, ASTM A240, Gr 304
Corrosion Allowance (30 year)	(0.4 mm (15 mils))	Type 347 (0.7 mm (25 mils)) Type 321 TBD (refer to Section 4.3.1.1)

2

3

4

5

6

7

8

- The outer most zone (TBD mm (TBD ft) wide annulus) supports the tank side walls and accommodates thermal expansion. It consists of two types of fire brick—multiple bottom courses of insulating firebrick and a top course of hard firebrick. A leak detection liner, discussed below, rests on top of the hard firebrick. The firebricks courses are staggered and are dip mortared together. The refractory rings are segmented circumferentially and the gap between segments is packed with mineral wool.

9

10

11

- The inner zone supports the tank floor and consists of multiple staggered courses of foam-glass insulation, the leak detection liner, and a dry sand layer upon which the tank floor is constructed. The interface between zones is packed with mineral wool.

12

13

14

The hot salt tank insulation system is comprised of two separate radial zones. The thickness of the hot tank insulation system on Solar Two was 495 mm (1 ft to 7.5 in) measured from the top foundation/passive cooling system to bottom of tank floor. The zones consisted of the following:

15

16

17

18

19

20

- The outer zone (TBD mm (TBD ft) wide annulus) supports the tank side walls and accommodates thermal expansion. It consists of two types of fire brick—multiple bottom courses of insulating firebrick and a top course of hard firebrick. A leak detection liner discussed below rests on top of the hard firebrick. The firebricks courses are staggered and are dip mortared together. The refractory rings are segmented circumferentially and the gap between segments is packed with mineral wool.

21

22

- The inner zone supports the tank floor and consists of multiple staggered courses of foam-glass insulation, two staggered top courses of insulating brick, the leak detection liner, and a

1 dry sand layer upon which the tank floor is constructed. The interface between zones is
2 packed with mineral wool.

3 The refractory firebrick and foamglass is susceptible to chemical attack by the nitrate salt and
4 requires protection from potential tank leaks.

5 **3.4.6.2 Tank Sidewall and Roof Insulation**

6 Tank sidewall and roof insulation will be multiple staggered courses of high-temperature mineral
7 wool and/or high-density calcium silicate insulation. The calcium silicate will be used in appli-
8 cations susceptible to foot traffic, requiring structural reinforcement and access, e.g., tank roof
9 and nozzle penetrations. The insulation thickness will be determined through analysis that the
10 system selected provides the greatest degree of thermal protection using the following guide-
11 lines:

- 12 • Selecting an insulation thickness based upon cost tradeoff that compares insulation system
13 cost to the amount of thermal energy lost at a TBD \$/British Thermal Unit (Btu) rate.
- 14 • Limiting insulation jacket surface temperature for protection of personnel to <140°F (<60°C)
15 (TBD U.S. OSHA) based upon 0 m/s (0 mph) wind and a TBD ambient temperature (TBD).
- 16 • Providing insulation and the insulation jacket over instrumentation and other tank-mounted
17 devices that is capable of being easily being removed and reinstalled as a single unit.
- 18 • Providing tank insulation jacketing material of aluminum.

19 **3.4.7 Thermal Storage System Foundations**

20 TSS foundations requirements are given below.

21 **3.4.7.1 Tank Foundations Mats**

22 The tank foundations mats will be constructed under the BOP site development subcontract. The
23 foundations will include a prepared soil mat, elevated tank concrete foundation mats, and a
24 foundation ring, passive-cooling system. The tank foundation system is comprised of the fol-
25 lowing elements:

- 26 • Prepared soil mat (BOP)
- 27 • Reinforced concrete mat and ring wall (BOP)
- 28 • Passive cooling system piping (BOP)
- 29 • Foamglass and firebrick insulation system (TSS)
- 30 • Leak detection system, including liner (TSS)

1 **3.4.7.2 Tank Area Berms**

2 The TSS area will be surrounded by a tank berm. The bermed area will have sufficient volume
3 to contain the entire nitrate salt inventory in case of a tank failure and include a minimum of .6 m
4 (2 ft) of free board. Provide:

- 5 • Vehicular access into the bermed area,
- 6 • Berm drain to remove standing water, and
- 7 • Equipment laydown area within the bermed maintenance equipment and salt melting equip-
8 ment.

9 **3.4.7.3 Passive Cooling System**

10 Heat conduction through the foundation insulation system will eventually reach thermal equilib-
11 rium, e.g., temperature of the salt inventory. Concrete will begin to fail if its temperature
12 reaches 100°C (212°F) and if the water of hydration is removed. A passive cooling system is
13 required and is comprised of:

- 14 • Rows of parallel carbon steel pipes, pipe schedule TBD, installed on top of the concrete mat.

15 Both ends will be open to the atmosphere with one end attached to a vertical chimney. The
16 pipe diameter and height of the chimney will be calculated by performing an iterative heat
17 transfer analysis that will limit the foundation temperature to <90°C (<200°F). Use the
18 maximum ambient air temperature at SPT location. Air velocities in the cooling passages,
19 driven by the buoyant forces of the heated air in the chimneys, provide the cooling.
- 20 • Temperature monitoring to confirm that foundation temperatures are <90°C (<200°F).
- 21 • A cooling system that is capable of being capped during long-term shutdowns to reduce sys-
22 tem thermal losses without damaging the concrete mats.
- 23 • Cooling pipes that penetrate through the tank foundation support ring.

24 **3.4.7.4 Leak Detection System**

25 Provide a leak detection system to indicate that a tank floor has a molten nitrate salt leak. The
26 leak detection system is not indented to identify leak location, only that there is a problem. The
27 leak detection system will consist of overlapping 16 gauge stainless steel sheets, Type 304 or
28 316 with seal welded seams that form a sealed drip pan on top of the firebrick/foamglass. Liner
29 will extend through the base foundation to the tank exterior, full circumference, and be visible
30 for inspection. Provide a thermocouple grid of approximately 100 thermocouples - 1.5 to 2 m (5
31 to 7 ft) center to center spacing, underneath the drip pan to identify hot spots and potential tank
32 leaks. The signals from the thermocouple grid will be incorporated into MCS and the output
33 trended and monitored.

1 **3.5 Steam Generation System**

2 **3.5.1 System Description**

3 The SGS baseline system elements will be located in the receiver tower structure at an elevation
4 that allows the molten nitrate salt in the exchangers to self-drain back to the TSS. The SGS is
5 comprised of:

- 6 • An ASME Section VIII superheater. Tubular Exchanger Manufacturers Association
7 (TEMA) shell and tube heat exchanger with salt on the shell side and steam on the tube side.
- 8 • An ASME Section VIII pressure vessel steam drum.
- 9 • An ASME Section VIII evaporator. TEMA shell and tube heat exchanger with salt on the
10 shell side and boiler feed water on the tube side.
- 11 • An ASME Section VIII preheater. TEMA shell and tube heat exchanger with salt on the
12 shell side and boiler feed water on the tube side.
- 13 • An ASME Section VIII startup feedwater heater. TEMA shell and tube heat exchanger with
14 boiler feed water on the tube side and auxiliary/condensate on the shell side.
- 15 • An ASME Section VIII reheater. TEMA shell and tube heat exchanger with salt on the shell
16 side and extraction steam on the tube side.
- 17 • SGS circulation pump (hot salt). A VSD vertical turbine pump mounted on the hot salt tank
18 supplying hot salt to the SGS.
- 19 • SGS attemperation pump (cold salt). A VSD vertical turbine pump mounted on top of the
20 cold salt tank supplying cold salt to SGS.
- 21 • Steam drum feedwater mixer. An equipment component (B31.1 or ASME Section VIII)
22 mixing boiler feed water from the steam drum and from the preheater to supply the steam
23 generator feed water pump.
- 24 • SGS evaporator feedwater circulation pump. A horizontal centrifugal pump recirculating
25 boiler feedwater from the steam drum to the evaporator to control the steaming rate within
26 the steam drum.
- 27 • SGS preheater feedwater circulation pump. A horizontal centrifugal pump recirculating
28 boiler feedwater from the steam drum to the preheater to control feedwater temperature to the
29 evaporator.

30 **3.5.2 Scope of Supply**

31 The SGS system design, physical design, and system integration package includes PFDs, process
32 and instrument diagrams, general arrangement drawings, physical design of interconnecting

1 piping, electrical and control systems, structural design, SGS heat transfer equipment procure-
 2 ment package, specification and purchase of the SGS pumps, miscellaneous equipment and ma-
 3 terials, shop drawing review, construction, startup, and activation. Also included is the design
 4 task to thermally condition the SGS from the long-term hold and overnight hold states through
 5 the transition to normal operation while minimizing parasitic electrical power loads and thermal
 6 heat losses.

7 The SGS heat transfer equipment design, fabrication, and startup/activation support package in-
 8 cludes the design calculations, system engineering support, detailed design, shop drawings, and
 9 shop fabrication. The detailed design will also encompass SGS insulation systems, steam drum
 10 thermal conditioning, detailed analysis to determine steam pressure surge rate to TSS in the
 11 event of tube failure, recommend control schemes, SGS system calculations for partial load con-
 12 ditions, and SGS startup and activation planning.

13 The SGS installation and construction subcontract package includes all field construction activi-
 14 ties, construction testing, and activation support for the SGS. This package is included in the
 15 overall site construction package. The SGS designer and fabricator will be on contract to sup-
 16 port installation and all testing.

17 **3.5.3 Steam Generation System Design Basis**

18 **3.5.3.1 Steam Generation System Temperatures and Pressures**

19 Nominal full load SGS equipment design temperature and pressure conditions are specified in
 20 Table 3-8.

Table 3-8. Nominal Full Load SGS Equipment Design Temperature and Pressure Conditions

Equipment	Nitrate Salt		Water/Steam	
	Inlet	Outlet	Inlet	Outlet
Superheater				
Shell Side: Salt				
Tube Side: Steam				
Nominal				
Temperature °C (°F)	565°C (1050°F)	452°C (846°F)	331°C (628°F)	552°C (1025°F)
Pressure bar (lbs _f /in ²)	2.7 bar (39 lbs _f /in ²)	1.1 bar (16 lbs _f /in ²)	126 bar (1829lbs _f /in ²)	126 bar (1829lbs _f /in ²)
Maximum				
Temperature °C (°F)	593°C (1100°F)	593°C (1100°F)	593°C (1100°F)	593°C (1100°F)
Pressure bar (lbs _f /in ²)	Refer to Note 1	Refer to Note 1	145 bar (2100lbs _f /in ²)	145 bar (2100lbs _f /in ²)

Table 3-8. Nominal Full Load SGS Equipment Design Temperature and Pressure Conditions (continued)

Equipment	Nitrate Salt		Water/Steam	
	Inlet	Outlet	Inlet	Outlet
Reheater				
Shell Side: Salt				
Tube Side: Steam				
Nominal				
Temperature °C (°F)	565°C (1050°F)	452°C (846°F)	380°C (716°F)	552°C (1025°F)
Pressure bar (lbs _f /in ²)	2.7 bar (39 lbs _f /in ²)	1.1 bar (16 lbs _f /in ²)	34.4 bar (456 lbs _f /in ²)	30.6 bar (444 lbs _f /in ²)
Maximum				
Temperature °C (°F)	593°C (1100°F)	593°C (1100°F)	593°C (1100°F)	593°C (1100°F)
Pressure bar (lbs _f /in ²)	Refer to Note 1	Refer to Note 1	38 bar (550 lbs _f /in ²)	38 bar (550 lbs _f /in ²)
Evaporator				
Shell Side: Salt				
Tube Side: Saturated				
Feedwater				
Nominal				
Temperature °C (°F)	452°C (846°F)	334°C (634°F)	328°C (622°F)	331°C (628°F)
Pressure bar (lbs _f /in ²)	62 lbs _f /in ²	2.7 bar (39 lbs _f /in ²)	126 bar (1829 lbs _f /in ²)	126 bar (1829 lbs _f /in ²)
Maximum				
Temperature °C (°F)	510°C (950°F)	510°C (950°F)	510°C (950°F)	510°C (950°F)
Pressure bar (lbs _f /in ²)	Refer to Note 1	Refer to Note 1	145 bar (2100 lbs _f /in ²)	145 bar (2100 lbs _f /in ²)
Preheater				
Shell Side: Salt				
Tube Side: Feedwater				
Nominal				
Temperature °C (°F)	334°C (634°F)	290°C (550°F)	239°C (462°F)	326°C (618°F)
Pressure bar (lbs _f /in ²)	90 lbs _f /in ²	62 lbs _f /in ²	126 bar (1829 lbs _f /in ²)	126 bar (1829 lbs _f /in ²)
Maximum				
Temperature °C (°F)	400°C (750°F)	400°C (750°F)	400°C (750°F)	400°C (750°F)
Pressure bar (lbs _f /in ²)	Refer to Note 1	Refer to Note 1	145 bar (2100 lbs _f /in ²)	145 bar (2100 lbs _f /in ²)
Startup Feedwater Heater				
Shell Side: Feedwater				
Tube Side: Feedwater				
Nominal				
Temperature °C (°F)	N/A	N/A	149°C (300°F)	149°C (300°F)
Pressure bar (lbs _f /in ²)	N/A	N/A	126 bar (1832 lbs _f /in ²)	126 bar (1832 lbs _f /in ²)
Maximum				
Temperature °C (°F)	N/A	N/A	260°C (500°F)	260°C (500°F)
Pressure bar (lbs _f /in ²)	N/A	N/A	145 bar (2100 lbs _f /in ²)	145 bar (2100 lbs _f /in ²)
Steam Drum				
Feedwater and saturated				
Steam				
Nominal				
Temperature °C (°F)	N/A	N/A	328°C (622°F)	331°C (628°F)
Pressure bar (lbs _f /in ²)	N/A	N/A	126 bar (1829 lbs _f /in ²)	126 bar (1829 lbs _f /in ²)
Maximum				
Temperature °C (°F)	N/A	N/A	343°C (650°F)	343°C (650°F)
Pressure bar (lbs _f /in ²)	N/A	N/A	145 bar (2100 lbs _f /in ²)	145 bar (2100 lbs _f /in ²)

Table 3-8. Nominal Full Load SGS Equipment Design Temperature and Pressure Conditions (continued)

Equipment	Nitrate Salt		Water/Steam	
	Inlet	Outlet	Inlet	Outlet
SGS Circulation Pump				
Hot Salt				
Nominal				
Temperature °C (°F)	565°C (1050°F)	565°C (1050°F)	N/A	N/A
Pressure bar (lbs _f /in ²)	NPSHR – MaxTank	TBD	N/A	N/A
Maximum				
Temperature °C (°F)	593°C (1100°F)	593°C (1100°F)	N/A	N/A
Pressure bar (lbs _f /in ²)	N/A	Pump shut off head	N/A	N/A
SGS Attenuation Pump				
Cold Salt				
Nominal				
Temperature °C (°F)	290°C (550°F)	290°C (550°F)	N/A	N/A
Pressure bar (lbs _f /in ²)	NPSHR - Max Tank	TBD	N/A	N/A
Maximum				
Temperature °C (°F)	400°C (750°F)	400°C (750°F)	N/A	N/A
Pressure bar (lbs _f /in ²)	N/A	Pump shut off head	N/A	N/A
Steam Generator pre-heater and Evaporator Feedwater Circulation Pumps				
Feedwater				
Nominal				
Temperature °C (°F)	N/A	N/A	328°C (622°F)	331°C (628°F)
Pressure bar (lbs _f /in ²)	N/A	N/A	126 bar (1829lbs _f /in ²)	126 bar (1829lbs _f /in ²)
Maximum				
Temperature °C (°F)	N/A	N/A	343°C (650°F)	343°C (650°F)
Pressure bar (lbs _f /in ²)	N/A	N/A	145 bar (2100lbs _f /in ²)	145 bar (2100lbs _f /in ²)

Note 1. The maximum pressure is either pump shut off head +20% or the maximum pressure created by a tube rupture and the resulting high-pressure steam pulse. Refer to Section 3.5.3.3.

1

2 **3.5.3.2 Thermal Duty**

3 Gross thermal duty will be determined duty from turbine rating MWe divided by the turbine effi-
4 ciency.

5 A thorough analysis of all possible nitrate salt temperatures in all system states and during all
6 system transitions, including the effects of recirculation water flow rate and startup feedwater
7 heater performance, is essential to sizing the heat exchangers and auxiliary equipment. Solar
8 Two required a minimum of 500 computer simulations.

9 Optimize SGS/EPGS daily system startup with a goal to limit startup energy to ≤25% of one
10 hour of SGS thermal demand.

11 An SGS heat and mass balance computer model is essential for plant operations and startup. Re-
12 quired input parameters are

- 1 • Primary feedwater flow rate, temperature, and pressure
- 2 • Steam generator circulation feedwater flow rate and temperature
- 3 • Primary hot salt flow rate and temperature
- 4 • Attemperated salt flow rate to superheater or reheater
- 5 • Cold salt (attemperation) flow rate and temperature
- 6 • Evaporator water recirculation flow rate
- 7 • Steam drum blowdown flow rate
- 8 • Steam drum auxiliary steam rate, temperature, and pressure
- 9 • Heat transfer coefficients in the reheater, preheater, evaporator, and superheater.

10 The overall heat transfer coefficient is defined as follows (Note: as long as consistent unit con-
 11 ventions are used, these equations will hold for both English and Metric units):

$$12 \quad U_o = \frac{1}{\frac{1}{U_{\text{inside adjusted}}} + \frac{1}{U_{\text{outside}}} + R_{\text{inside fouling factor}} + R_{\text{outside fouling factor}} + R_{\text{tube wall}}}$$

13
 14 U_{inside} is equal to $(Nu_{\text{inside}})(k)/(D_{\text{inside}})$. The Nusselt number for fully developed turbulent flow
 15 inside a pipe is defined as follows:

$$16 \quad Nu = 0.023 Re^{0.8} Pr^{1/3} \left[\frac{\nu}{\nu_{\text{wall}}} \right]^{0.14}$$

17
 18 where Re is the Reynolds number, Pr is the Prandtl number, ν is the viscosity, ν_{wall} is the viscos-
 19 ity at the wall film temperature, k is the thermal conductivity of the fluid, and D_{inside} is the inside
 20 diameter of the pipe. The inside convection coefficient is converted to an equivalent coefficient
 21 based on the outside surface area of the tubes as follows:

$$22 \quad U_{\text{inside adjusted}} = U_{\text{inside}} (D_{\text{inside}}/D_{\text{outside}}).$$

23
 24
 25 The outside convection coefficient U_{outside} is equal to $(Nu_{\text{outside}})(k)/(D_{\text{outside}})$. The Nusselt number
 26 for fully developed turbulent flow over a tube bank is defined as follows:

$$27 \quad Nu = 0.36 \left[\frac{G_{\text{max}} D_{\text{outside}}}{\nu_{\text{absolute}}} \right]^{0.35} Pr^{1/3}$$

28
 29 where G_{max} is the peak mass flux between the tubes, D_{outside} is the outside tube diameter, ν_{absolute}
 30 is the absolute viscosity, and Pr is the Prandtl number.

31 Under part load conditions, the fluid velocities inside and outside the tubes are determined by
 32 heat and mass balances. The convection coefficients $U_{\text{inside adjusted}}$ and U_{outside} are determined di-
 33 rectly once the fluid velocities are known. The fouling factors and tube wall thermal resistance
 34 are assumed to be independent of load.

1 **3.5.3.3 Maximum Design and Over Pressures**

2 Maximum salt side design pressure will be based upon the SGS pump shut off head. Maximum
3 salt side overpressure protection will be based on exchanger tube rupture, which allows nitrate
4 salt and either feedwater or steam to come in direct contact. The overpressure pressure transient
5 can exceed shell yield stress before a pressure relief valve can operate. Yielding of the shell will
6 likely occur, requiring replacement. In addition, the high-pressure steam pulse will also impact
7 the TSS nitrate salt storage tank pressure relief system.

8 The plant designer will assess the relative probabilities of failures and determine where the pres-
9 sure safety relief valves (PSV) or rupture discs are required, where they are to be installed, and
10 appropriately size the valves/rupture discs to comply with code requirements. Refer to Section
11 3.6.4.5 on EHT for PSV EHT requirements.

12 A separate vent header system will be downstream of the PSVs/rupture discs. If PSVs are re-
13 quired, the vent system will be heat traced and insulated over its entire length.

14 Maximum steam side pressure relief valve sizing will be in accordance with code requirements.

15 **3.5.3.4 Auxiliary Steam**

16 Auxiliary steam will be produced from two sources:

- 17 • Lower demand $\leq 2\%$ of rated SGS design duty using a small electric boiler to generate suffi-
18 cient steam for turbine shaft seals and establishing the condenser vacuum.
- 19 • Higher demand $> 2\%$ of rated SGS design duty using SGS auxiliary feedwater heater, pre-
20 heater, evaporator, and steam drum will be required after the condenser vacuum has been
21 established for main steam line warm-up, feedwater heating, and rolling the turbine through
22 turbine synchronization.

23 While auxiliary steam production is not the primary function of the evaporator/steam drum, sup-
24 ply of saturated steam for startup was demonstrated at Solar Two by daily operation of the
25 evaporator/steam drum at 5% of the design duty. The benefits of using the evaporator/steam
26 drum for auxiliary steam production are:

- 27 • Thermal conditioning of the superheater and evaporator to nominal value of 360°C (675°F)
28 with the simultaneous production of preheat steam without exceeding the allowable tem-
29 perature change rates.
- 30 • Preheating the heat exchangers without steam production will require very low salt flow
31 rates, which will likely produce local regions of high thermal stresses. Salt flow rates re-
32 quired for auxiliary steam production are larger and will ensure a reasonably uniform tem-
33 perature distribution in the heat exchangers.

- 1 • To support the low demand requirement for saturated steam, the SGS circulation and attem-
 2 peration pumps and VSD must be capable of turndown on the order of 2 to 5% of rated de-
 3 sign flow.

4 **3.5.3.5 Thermal Fatigue**

5 SGS exchanger components temperature cyclic fatigue life will be 30 years. The number of
 6 thermal cycles will depend upon whether the SGS operates on a daily thermal cycle with mini-
 7 mal storage or dispatches energy 24 hours day. The SGS will remain filled with molten salt
 8 during an overnight hold and the SGS attemperation pumps will be periodically bumped to
 9 maintain temperature and prevent salt freezing. The temperature rate of change (TRC) will be
 10 selected so that the daily temperature cycle from overnight hold to operation will occur within a
 11 one-hour time frame or at a rate of not less than TBD°C/hr (TBD°F/hour). The maximum TRC
 12 will have to be established in consultation with the SGS exchanger designer/manufacturer. SGS
 13 heat exchangers will be electrically heat traced to:

- 14 • Assist with thermal conditioning of the equipment prior to flowing cold/attemperated salt,
 15 • Prevent salt freezing, and
 16 • Assist with salt thawing in the event of a freeze condition.

17 Minimum - Thermal Storage Cycles. The maximum number of daily thermal cycles, including
 18 maintenance outages for the minimum storage case, will be 11,000. The daily SGS superheater/
 19 reheater thermal cycle consists of a cold salt start from 260 to 565°C (500°F to 1050°F), while
 20 the evaporator and preheater rate will rise from 260°C (500°F) to the maximum salt inlet tem-
 21 perature for the piece of equipment. The number of maintenance cycles planned and unplanned
 22 will be 60 from 290°C (550°F) to ambient.

23 24 Hour/Day Dispatchability Cycles. The number of days that an SPT can dispatch power on a
 24 24 hour/day basis is between 60 to 90 days under the best solar insolation conditions. Therefore,
 25 the number of thermal cycles for a 24 hour/day facility will range from 8,300 to 9,200.

26 **3.5.3.6 SGS Exchanger Arrangement**

27 The SGS system heat exchangers will be located in the receiver tower structure at an elevation
 28 sufficient to allow all SGS components to drain by gravity back to either TSS storage tank. The
 29 SGS will fill from the bottom through the superheater and reheater.

30 Exchanger tube bundles will be designed so the tube bundle can be extracted, removed from the
 31 shell without removal of the exchanger from the stack, and lowered to grade elevation. A mono-
 32 rail crane or equivalent should be considered since overhead access may be restricted by the lo-
 33 cation of the stack in receiver tower structure. Consider an anchor point incorporated into the
 34 tower structure capable of accommodating the extraction loads.

1 **3.5.3.7 SGS Drain Process**

2 The SGS drain process is by gravity through the return piping. SGS is complete when there no is
3 static head measured from the preheater or reheater outlet to cold tank inlet. With the tempera-
4 tures of the SGS exchanger shell still measuring $>260^{\circ}\text{C}$ ($>500^{\circ}\text{F}$), use either NaK/HiTec/
5 Organic Salt differential pressure sensors. Evaluate if the SGS circulation pump and SGS attem-
6 peration pump counter-rotation protection is required and include check valves on the pump dis-
7 charges with a bypass return line tying into the tank return line. It is preferable to avoid
8 additional piping and valves.

9 **3.5.3.8 Heat Exchanger Tube Rupture**

10 A heat exchanger tube rupture in any of the SGS nitrate salt exchanges will introduce steam into
11 the SGS piping system and the TSS salt storage tanks. A quick method of draining feedwater
12 and nitrate salt from the SGS should be evaluated during the SGS design and, if practical, incor-
13 porated into the design baseline.

14 **3.5.4 Steam Generation System Shell and Tube Heat Exchanger Design Requirements**

15 SGS shell and tube heat exchanger design requirements (superheater, evaporator, preheater, re-
16 heater, and startup feedwater heater) are given below:

- 17 • Preferred mode of operation during overnight hold is to “button up” the exchangers and peri-
18 odically bump the SGS attemperation pump to keep the internal exchanger temperatures
19 above 260°C (500°F) without producing steam.
- 20 • All Exchangers will be insulated. All exchangers will be electric heat traced with the excep-
21 tion of the startup feedwater heater. EHTS will be designed for thermally conditioning the
22 exchanger shells and tubes prior to startup in addition to nitrate salt freeze protection.
- 23 • Exchangers will experience multiple thermal cycles, potentially daily, with the superheater
24 and reheater experiencing a temperature rise from 260 to 565°C (500°F to 1050°F). The rate
25 at which the SGS can be preheated affects plant performance. The more rapid the rate, the
26 better the performance. The maximum allowable temperature rate of change (TRC)
27 ($\text{TBD}^{\circ}\text{C/hr}$ ($^{\circ}\text{F/hr}$)) should be established in consultation with the exchanger design/manu-
28 facturers and be a specified evaluation criteria in the procurement process.
- 29 • Shell side (superheater, evaporator, preheater, and reheater) requirements will be welded
30 construction including rear end heads and inlet and outlet piping interface connections.
- 31 • Tube side channel covers will be removable to allow for periodic cleaning of tube bundles
32 with high-pressure water. Since all exchangers will experience daily thermal cycling, the
33 removable bolted channel partition plates should be double-bolted and seal-welded to avoid
34 having the bolts work loose. Solar Two experience determined that with multiple thermal
35 cycles, the bolts loosened and leakage occurred, resulting in a reduction in exchanger per-
36 formance.

- 1 • The superheater should provide a thermowell capable of accepting dual temperature elements
2 in the tube side inlet of the superheater.
- 3 • Evaporator, preheater, and feedwater heater will be sized for both full load duty and for
4 startup/auxiliary steam production.

5 **3.5.5 Steam Drum Design Requirements**

6 Steam drum design requirements are given below.

- 7 • The steam drum must be sized for both full load duty and startup/auxiliary steam production.
- 8 • The steam drum will experience daily thermal cycles and should be specified to match the
9 exchanger TRC maximum.
- 10 • Provide startup steam drum immersion heaters with sufficient capacity to preheat the flooded
11 steam drum to 260°C (500°F) within two (TBD) hours. Immersion heaters will be spared at
12 100%. Immersion heaters will controlled through the MCS to preheat the steam generation
13 system feedwater prior to introduction molten salt.
- 14 • Provide condensate drain(s) between steam drum and superheater for condensate removal
15 prior to steam drum startup from overnight hold.
- 16 • Provide steam drum level gauge cooling to maintain gauge water temperature below the satu-
17 ration value. Monitoring gauge temperature and applying correction factors for water den-
18 sity as a function of temperature are used in the level measurements.
- 19 • Provide an automated steam drum SGS blowdown system with visual sight glass. Location
20 of blowdown extraction point on steam drum will remove steam drum contents and not enter
21 feedwater.
- 22 • In sizing the BOP water treatment system, consideration should be given to higher carbon
23 dioxide (CO₂) concentrations in the feedwater than is normal. Carbon dioxide is normally
24 removed by the vacuum pump in the condenser; however, with daily cyclic plant operations,
25 much higher equilibrium concentrations of CO₂ may result. Dissolved CO₂ forms carbonic
26 acid (H₂CO₃) in regions where steam and water coexist, leading to increased corrosion. CO₂
27 is typically absorbed from the air in the makeup water tanks, the condenser, and the deaera-
28 tor, and is produced as a decomposition byproduct of chemicals added for scavenging oxy-
29 gen.
- 30 • Primary feedwater mixing will occur externally to the steam drum in feedwater piping.
- 31 • Provide redundant steam drum immersion heaters to support SGS startup/thermal condition-
32 ing from the transition form long-term hold to overnight hold in TBD (estimated two hours)
33 hours. As an option, the immersion heaters may be used to maintain steam drum temperature
34 during overnight hold in combination with circulation of cold salt.

- 1 • Steam drum will be insulated and electrically heat traced. The EHTS will be designed to
2 thermally condition the vessel for startup so that the vessel temperature rate of change does
3 not exceed the vessel cyclic fatigue design limits.
- 4 • Provide protection from rapid decay in feedwater saturation pressure by providing a rapid
5 steam drain system (isolation valve, flash tank, and pressure switch).

6 **3.5.6 Steam Generation System Circulation Pump and Steam Generation System Attenuation** 7 **Pump Design Requirements**

8 **3.5.6.1 Pump Type**

9 Both pumps will be vertical turbine pumps with VSDs. The SGS circulation pump will be sup-
10 ported by a bridging structure spanning the hot salt tank and take suction directly from the hot
11 salt tank. The SGS attenuation pump will be supported by a bridging structure spanning the
12 cold salt tank. It shares the structure with the RS circulation pump and takes suction directly
13 from the cold salt tank. Both pump shaft lengths will be between 12.2 and 13.7 m (40 and 45 ft)
14 positioned at the minimum liquid level approximately 1 m (3 ft) above bottom of the tank. In-
15 stalled spare pumps will not be provided. The baseline approach is to install a single nitrate salt
16 pump in each service and warehouse a complete spare pump and motor with additional spare
17 parts as recommended by the manufacturer. The traditional approach of having installed spare
18 pumps results in additional piping and valves, which lowers overall system reliability. Each
19 pump will be supplied with a tail pipe of sufficient length to extend into the heel to empty a tank
20 in case of a nitrate salt leak.

21 SGS circulation pump functions are to provide hot salt for steam generation and for reheat over a
22 full range of load conditions, including startup, auxiliary steam production, and for turbine op-
23 erations on a 24-hour-day basis.

24 SGS circulation pump will be sized for 110% SGS flow and head through the superheater and
25 reheater circuits. The pump will be capable of operating from 0% flow to 110% of capacity. The
26 pump head is determined by the sum of the line losses, salt mixer, static head due to SGS loca-
27 tion on the receiver tower measured to top of the SGS entry into the superheater, and pressure
28 drop through each SGS exchanger. The SGS circulation pump head characteristics need to be
29 matched to the SGS attenuation pump support startup, normal operations, and shutdown.

30 SGS attenuation pump functions are to:

- 31 • Maintain a fixed attenuating salt flow rate to the superheater during startup,
- 32 • Modulate the flow of cold salt to the superheater in the transitions to overnight hold follow-
33 ing a steam generator trip.
- 34 • Periodically flow salt to through the exchanger train during overnight hold to maintain sys-
35 tem internal temperature above 260°C (500°F).

1 The SGS attemperation pump will be sized to supply 260 to 290°C (500 to 550°F) salt to the su-
 2 perheater and reheater for thermal conditioning the SGS exchangers during filling/startup and
 3 shutdown to:

- 4 • Assure the TRC limits are not exceeded.
- 5 • Support auxiliary steam generation.
- 6 • Provide cold salt flow that fills the SGS exchanger shells without the aid of a back pressure
 7 control valve(s) on the downstream side of the return loop. Refer to Section 3.5.9 for a dis-
 8 cussion on the SGS fill process.
- 9 • Match the head characteristic of the SGS circulation pump to assure it can develop sufficient
 10 head to match the SGS circulation pump during startup normal operations and shutdown.

11 **3.5.6.2 Pump Mounting Interface**

12 Pumps will be flange-mounted to the TSS structural support frame (BOP item) and their shafts
 13 will extend into the cold salt tank through an insulated gland. The pump will be capable of being
 14 removed and replaced on a single shift.

15 **3.5.6.3 Electric Heat Tracing and Insulation Requirements**

16 Both pumps will be electric heat traced and insulated. The EHT systems will be designed to
 17 prevent salt freezing and to thermally condition the pump barrels. The EHT system must con-
 18 sider all pump operating states and transitions.

19 **3.5.6.4 Variable Speed Drive Over-Temperature Protection**

20 The VSD overt temperature protection may require external cooling systems when the pumps are
 21 either in operation and when the pumps are not in operation in an overnight hold. Motor cooling
 22 may not be operational when the pumps are not functioning.

23 **3.5.7 Steam Generation System Preheater Feedwater Pump(s) and Steam Generation System** 24 **Evaporator Feedwater Pump(s) Design Basis**

25 **3.5.7.1 Pump Type**

26 Prime and spare for both services are required. Pumps may be either horizontal or in-line cen-
 27 trifugal pumps with canned rotors or magnetic drives. Both pumps will operate through a daily
 28 thermal startup cycle from ambient to over 260°C (500°F). Standard centrifugal pumps with
 29 mechanical shaft seals proved to be very problematic on Solar Two and are not recommended.
 30 Potential supply sources for these pumps are:

1 ABS Pumps Inc
2 140 Pond View Drive
3 Meriden, CT 06450
4 Phone: 1 (203) 238-2700
5 Fax: 1 (203) 238-0738
6 E-mail: info@abspumpsusa.com
7 www.abspumpsusa.com

8
9 or

10
11 William B. McNew & Assoc.
12 225 San Marina Dr.
13 San Rafael, CA 94901 USA
14 Email: mcnew@netwiz.net
15 URL: <http://www.netwiz.net/~mcnew>
16 (415) 457-3940 (415) 457-3142 HMD/Kontro Pumps

17 **3.5.7.2 Steam Generation System Preheater Feedwater Pump(s) Functions**

18 SGS preheater feedwater pump(s) functions are to take suction directly from the steam drum
19 well and supply feedwater (near the saturation temperature) at a variable flow rate to the pre-
20 heater. Flow control is maintained by temperature control valve on the inlet to the preheater.

21 **3.5.7.3 Steam Generation System Evaporator Feedwater Pump(s) Functions**

22 SGS evaporator feedwater pump(s) functions are to take suction from the steam drum feedwater
23 mixer (near the saturation temperature) and supply feedwater at a constant flow rate to the
24 evaporator.

25 **3.5.7.4 Steam Generation System Preheater Feedwater Pump(s) Sizing**

26 SGS preheater feedwater pump(s) sizing is based upon two conditions. Initially, the feedwater
27 temperature entering the preheater must be $>230^{\circ}\text{C}$ ($>450^{\circ}\text{F}$) to prevent salt freezing in the ex-
28 changers. Flow circulation is solely through steam drum to preheater loop with no contribution
29 from the startup feedwater heater or from the turbine extraction feedwater heaters. Once auxil-
30 iary steam production commences, feedwater temperatures to preheater can be reduced and will
31 be supplied at temperatures $\geq 150^{\circ}\text{C}$ ($\geq 300^{\circ}\text{F}$) in increasing amounts for heating system steam
32 piping and turbine equipment through turbine roll/synchronization. The startup feed water
33 heater handles the supplemental heating load until the extraction feedwater temperature exceeds
34 150°C (300°F). The range of conditions that the SGS preheater feedwater pump must perform is
35 dependent upon the type of turbine, system startup pressures, temperatures, etc., and will be de-
36 termined through analysis of the system design load cases. The selection of the pump and its
37 drive depend upon this analysis.

1 Once turbine synchronization has been achieved, the blending flow rate will peak and begin to
 2 decrease as a function of feedwater temperature and turbine load conditions. When the extrac-
 3 tion feedwater heaters assume the feedwater heating load, the startup feedwater heater will self-
 4 limit and the SGS preheater feedwater pump can be shut down to reduce parasitic loads. This
 5 point in the transition from turbine synchronization to normal operations will be determined
 6 through the load case analysis and will determine maximum pump capacity.

7 **3.5.7.5 Steam Generation System Evaporator Feedwater Pump(s) Sizing**

8 SGS evaporator feedwater pump(s) sizing is based upon providing sufficient feedwater flow and
 9 mixing to prevent departure from the nucleate boiling regime within the evaporator tubes. Based
 10 upon Solar Two experience, this pump will operate at constant rate. The sizing of the SGS
 11 evaporator feedwater pump is driven by SGS heat exchanger designer/manufacturer and will be
 12 established as part of the SGS system design considering all load conditions.

13 **3.5.8 Steam Generation System Material Selection**

14 SGS material selection is presented in Table 3-9.

Table 3-9. SGS Material Selection

Equipment/Component	Materials	Corrosion Allowance and Remarks
Superheater		(Two Pass Shell, U-tube Heat exchanger, Channel Integral with Tube Sheet and Removable Cover)
Tubes	Stainless Steel, ASTM A249 or A213 Gr 321 or 347	Tubes corrosion allowance: Type 347: 0.4 mm 15 mils Type 321: TBD (refer to Section 4.3.1.1) Fouling factor 0.0005
Plate	Stainless Steel Type ASTM 240, Gr 321 or 347	Shell Corrosion allowance: Type 347 0.7mm (25 mils) Type 321 TBD Fouling factor 0.0005
Steam Drum	Carbon Steel Plate, ASTM A516 Gr 70	Corrosion allowance: 0.4 mm (15 mils)

Table 3-9. SGS Material Selection (continued)

Equipment/Component	Materials	Corrosion Allowance and Remarks
Evaporator		
Tubes	Low Chrome Alloy, Tubes, Seamless: 9Cr – 1Mo ASTM A213, T91	Tubes Corrosion allowance: 0.4 mm (15 mils) Fouling factor 0.0005
Plate	Low Chrome Alloy, Plate 9Cr – 1 Mo ASTM A387, Gr 91	Shell Corrosion allowance: 0.7mm (25 mils) Fouling factor 0.0005
Preheater		
Tubes	Carbon Steel, ASTM 192	Tubes Corrosion allowance: 1.6mm (63 mils) Fouling factor 0.0005
Plate	Carbon Steel, ASTM A516, Gr 70	Shell Corrosion allowance: 0.4 mm (15 mils) Fouling factor 0.0005
Startup Feedwater heater		
Tubes	Carbon Steel, ASTM A556, Gr B2	Tubes Corrosion allowance: 1.6mm (63 mils) Fouling factor 0.0005
Plate	Carbon Steel, ASTM A516, Gr 70	Shell Corrosion allowance: 1.6mm (63 mils) Fouling factor 0.0005
Reheater		
Tubes	Stainless Steel, ASTM A213 or A249 Gr 321 or 347	Tube Corrosion allowance: Type 347: 0.4 mm (15 mils) Type 321: TBD Fouling factor 0.0005
Plate	Stainless Steel, ASTM A240, Gr 321 or 347	Shell corrosion allowance: Type 347: 0.4 mm (15 mils) Type 321: TBD Fouling factor 0.0005
SGS Circulation Pump	316 Stainless Steel impeller, casing shaft, and bearing retainer Castings to be ASTM A351, Gr CF8C, Ferrite content of castings to be less than 10% Support Frame 316 L Bearing Materials: Journal Sleeve: NPI 420 Stainless Steel (good ware) Bearing: Gray Cast Iron Gr. 40 or Journal Sleeve: Stellite 6B (performed best, very expensive) Bearing: Ni-Resist Type I	Discharge Flanges, refer to Note 1

Table 3-9. SGS Material Selection (continued)

Equipment/Component	Materials	Corrosion Allowance and Remarks
SGS Attenuation Pump	Carbon Steel, ASTM A216, Gr WCB	Discharge Flanges, refer to Note 1
SGS Feedwater Mixer	Carbon Steel, ASTM A216, Gr WCB	
SGS Preheater Feedwater Pump	Carbon Steel, ASTM A216, Gr WCB	
SGS Evaporator Feedwater Pump	Carbon Steel, ASTM A216, Gr WCB	

Note 1: Pump discharge flange – The pump discharge flange may be either a RJT or Reflange R-Con Connector type. Ring gasket or Hub ring shall be stainless steel, either type 321 or 347)


1

2 **3.5.9 Steam Generation System Fill Process**

3 When the SGS exchanger shells are filled with salt, the heat exchanger shells and piping must be
 4 purged of air and, similarly, when drained air must be supplied to the exchangers to facilitate
 5 draining. A passive high point vent, no valves, on the preheater return line to the TSS cold tank
 6 at system high point is required to eliminate trapped air during fill process. The configuration of
 7 the passive vent is shown in Figure 3-5.

8 Fill process is judged complete when the following temperatures are equal to the salt temperature
 9 at the SGS attenuation pump discharge:

- 10 • Each of the SGS heat exchanger five vents and supply/return header;

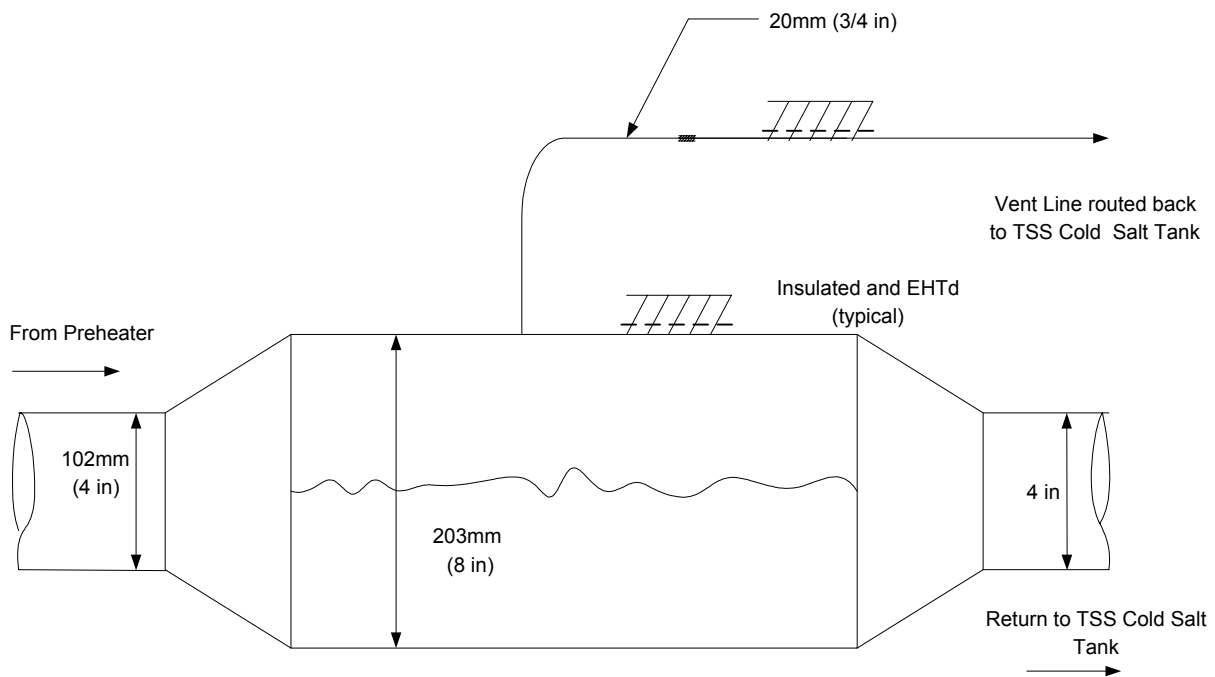

11

12

Figure 3-5. Configuration of passive vent.

- 1 • The line between the preheater/reheater and the cold salt tank.
- 2 Solar Two SGS exchanger filling process required approximately four minutes with the SGS at-
- 3 temperation pump operating at 100% capacity.

4 **3.5.10 Steam Generation System Sequence of Operation**

5 A typical SGS sequence of operation is described below. SGS circulation pump hot salt flow
6 through the superheater is controlled by the SGS circulation pump VSD. The reheater flow is
7 controlled by a TCV on the downstream side of the reheater. An optimized process-piping con-
8 figuration is depicted on the nitrate salt system PFD, which reduces restart time from the transi-
9 tion from overnight hold to normal operation.

10 SGS will remain filled with molten salt during overnight hold, operational baseline. Cold salt is
11 circulated through the SGS exchanger train to maintain temperature by the SGS attemperation
12 pump.

13 The “normally open” (NO) (hot salt supply) and “normally closed” (NC) (recirculation line)
14 isolation valves at the inlet to the superheater should be located as closely as possible to the su-
15 perheater.

16 Startup requirements for steam temperature, steam flow rate, and allowable temperature change
17 rates in the heat exchangers will be controlled by varying the SGS circulation pump speed and
18 blending increasing amounts of hot salt while maintaining essentially a fixed flow rate of cold
19 salt.

20 The typical operational sequence is as follows:

21 Step 1. SGS attemperation pump cold salt flow is set at a fixed rate through the superheater and
22 reheater; approximately 75% of rated flow. The cold salt flow rate set point is selected to assure
23 that the pump will not stall or cause oscillations in the attemperated salt temperature at the en-
24 trance to the superheater. The temperature set points will be derived from a hydraulic model of
25 the following:

- 26 • Four heat exchangers (superheater, evaporator, preheater, and reheater),
- 27 • Salt piping system line losses
- 28 • Three-dimensional surface fit of the hot salt SGS circulation pump speed, flow, and head
29 characteristics, and
- 30 • Three-dimensional surface fit of the SGS attemperation pump flow and head characteristics.

31 Step 2. SGS circulation pump VSD is accelerated to a point where its head is insufficient to
32 overcome the head developed by the attemperation pump (approximately 30%). Salt tempera-
33 ture at the superheater inlet is constant at 290°C (550°F). Recirculation bypass protects the SGS
34 circulation pump.

1 Step 3. Auxiliary Steam Production – Speed of SGS circulation pump is accelerated so that the
2 attempered salt temperature rate of increase, measured at the inlet to the superheater, does not
3 exceed either the maximum superheater or reheater temperature change rate criteria. At a super-
4 heater inlet temperature of TBD°C (°F), the sum of the hot salt SGS circulation pump flow rate
5 and cold salt SGS attemperation pump flow rate provides sufficient thermal energy required for
6 auxiliary steam production. The speed of both pumps is held constant until the operator transi-
7 tions to the next state.

8 Step 4. Turbine Synchronization – The SGS circulation pump is accelerated to provide a super-
9 heater inlet temperature of TBD°C (°F) at a rate not to exceed the maximum superheater tem-
10 perature change rate. The combined flow rates of the hot salt SGS circulation pump flow rate
11 and cold salt SGS attemperation pump flow rate provide sufficient thermal energy for turbine
12 synchronization.

13 Step 5. Normal Operation – The SGS attemperation pump is decelerated at a rate not to exceed
14 the maximum superheater temperature change rate that allows the superheater to reach inlet de-
15 sign temperature of 565°C (1050°F). When the salt temperature reaches 565°C (1050°F), the
16 SGS attemperation pump is shut down.

17 A typical SGS/EPGS trip and cooldown sequence based upon Solar Two lessons learned is dis-
18 cussed below. Leading up to an SGS/EPGS trip, the following normal temperature gradients
19 through the SGS are:

- 20 • 565°C (1050°F) salt at the inlet to the superheater,
- 21 • 454°C (850°F) to evaporator inlet, and
- 22 • 343°C (650°F) to preheater inlet.

23 There was no way of restarting the Solar Two SGS without first cooling the heat exchangers to
24 the cold salt temperature, 290°C (550°F), to comply with the heat exchanger temperature rate of
25 change criteria. This same issue will exist for the next plant, but may be obviated by exchanger
26 manufacture allowing a higher temperature ramp rate. This issue needs to be addressed and re-
27 start time shortened for the next plant. The SGS/EPGS criteria will state that the SGS/EPGS will
28 restart in TBD (recommended 60 minutes) minutes following a trip. The following Solar Two
29 cooldown sequence is described below and tied to the system PFDs.

30 Step 1. Close the NO hot salt supply isolation valve to the superheater and open the NC recir-
31 culation loop isolation valve. Start the cold salt SGS attemperation pump, establishing flow up
32 to the isolation valve at the inlet to the superheater and back through the recirculation line to the
33 cold salt tank.

34 Step 2. Start the hot salt pump.

35 Step 3. Increase the speed of the hot salt pump until the temperature of the mixed salt in the re-
36 circulation line equals the temperature of the superheater.

37 Step 4. Open the main hot salt isolation valve to the superheater, establishing a limited flow rate
38 through the steam generator.

- 1 Step 5. Establish a set point value for the evaporator pressure using the main steam throttle
- 2 valve to the condenser.
- 3 Step 6. Close the recirculation isolation valve.
- 4 Step 7. Ramp the superheat temperature downwards at a rate that does not exceed the SGS rate
- 5 change limitations.

6 **3.6 Electric Heat Tracing System**

7 **3.6.1 System Description**

8 The EHTS is a critical process temperature control system for thermally conditioning the sys-
9 tems before salt flow and steam flow and providing salt freeze protection to all systems.

10 The EHTS interfaces with the RS, TSS, SGS, and EPGS and is comprised metal-sheathed resis-
11 tance heating element cable, temperature sensors, and controllers.

12 Based upon Solar Two experience, the EHTS will be a fully integrated system with the overall
13 control residing in MCS as part of the DCS. Its functions will be directly linked with other proc-
14 ess control functions so that system thermal conditioning prior to flowing molten salt is fully
15 automated. The EHTS includes all nitrate salt freeze protection systems, nitrate salt thermal
16 piping, valve and line device conditioning, equipment thermal conditioning, and long-term tem-
17 perature maintenance of the TSS in the event of a long-term hold and maintenance shut down.

18 **3.6.2 Scope of Supply**

19 The EHTS material for equipment, in line component, piping, valves, etc., will be procured as an
20 EHT system that encompasses the physical design, heat transfer calculations/analysis, fabrica-
21 tion, installation, and testing (component and system level acceptance testing). Scope will en-
22 compass all materials and hardware comprising the system, including the heat tracing cable sets,
23 splice kits with an interface junction box, temperature sensors/temperature transmitters with as-
24 sociated junction boxes, and all installation hardware. Each circuit/zone should be supported by
25 an approved design for:

- 26 • Use in designing and sizing the power distribution and control, and
- 27 • Space allocation of equipment and the electrical power tie in points.

28 Final fabrication, assembly, and installation of each zone will be a field activity performed by
29 the manufacturer to assure that the elements are cut to length to match the actual as-built physi-
30 cal configuration of the equipment and piping systems. This is a schedule-driven decision be-
31 cause factory assembled cable sets that match the as-built configuration cannot be produced at a
32 rate to support construction. The quality and reliability of the field manufactured cable set will
33 match that of factory cable set.

1 The scope of design and supply should include circuit solid state contactors; however, installa-
2 tion and rack housings should not be included.

3 **3.6.2.1 Electric Heat Tracing System Integration**

4 The EHTS power distribution, power control center (including installation of the solid-state
5 contactors) and the connection from the temperature sensor elements to the EHTS junction
6 boxes should not be within the scope of the EHTS supply. The EHTS is a critical process con-
7 trol system and, as such, will reside in the MCS on the DCS. The SPT project integrator will be
8 responsible for the overall system design and coordination with other systems to assure that the
9 EHT design meet overall SPT process and operational requirements. Zone definition and loca-
10 tion of temperature sensors must be specified by the integrator. Temperature set point are state-
11 and state-transition dependent and must be specified by the integrator.

12 **3.6.3 Electric Heat Tracing System Design Basis**

13 **3.6.3.1 Electric Heat Tracing Control and Set Point Temperatures**

14 EHT zone definition and the selection of temperature set points is a design integrator responsi-
15 bility.

16 EHT system operating modes vary by state and transitions between states. These requirements
17 will be established by a detailed review of the plant operating states and the transitions between
18 the states at the component and line (piping) level. Zone activation/deactivation and temperature
19 set points will vary by states and transition, and the EHT zone design may be impacted. Freeze
20 protection requirements vary. In addition, the EHTS is an integral part of DCS, and will be de-
21 signed to automatically adjust the temperature set points and activate solid state contactors. Two
22 examples are provided below to emphasize the importance of this task; why it must be handled
23 as part of the process design, and not relegated to a supplier.

24 The RS system will be drained overnight and the piping EHT zones shut down to minimize para-
25 sitics losses. During daily startup in the transition from long-term hold/overnight hold to
26 standby, the riser and downcomer piping must be preheated to a required set point temperature
27 two hours before to flowing molten salt. This should be an automated function. Valve body and
28 inline device EHT zones may have to remain active overnight in order to meet the two-hour
29 limit, however, during a long-term hold, these zones would also be deactivated to reduce para-
30 sitics.

31 In RS system transition from standby to normal operation, certain line segments, e.g., crossover
32 piping, receiver drain lines will change from flowing lines to dead legs, subject to freezing. The
33 limits of the zone and where to place the temperature sensor elements relative to flowing and
34 stagnant sections, and portions subject to convection/eddy flow currents, is important and can
35 only be determined by process review.

36 The SGS system, including equipment piping, typically will remain filled with molten salt
37 through the overnight hold. The SGS attemperation pump will be periodically bumped to main

tain equipment system temperatures. Piping and inline device EHT zone will be active and will energize if temperature falls below the required set point. Zone definition is important in that there may be dead legs in parts of the piping system that require active EHT to preclude freezing.

Piping system set point temperatures on the DCS will be set to 260°C (500°F) for both hot and cold salt systems unless there is a thermal conditioning requirement, which limits the temperature rate of increase. The EHTS will operate until the system reaches operating temperature and then de-energize.

Valve and line device set point temperatures on the DCS shall be set to the actual tank salt bulk storage temperature or a maximum operating exposure temperature minus 10°C (50°F) for the particular flow stream, e.g., hot salt from the hot tank to super heater: 565°C (1050°F) minus 10°C (50°F) set point 555°C (1000°F). This will allow the line device to reach the operating temperature without being thermally shocked and allow the EHTS to de-energize once the system has reached the operating temperature.

DCS controller temperature dead band should be selected to limit contactor cycling: ±25 to 30°C (TBD) ±30 to 40°F.

3.6.3.2 System Component Redundancy

System component redundancy is as follows.

Piping systems – Each piping zone EHT element as a minimum, and as physically possible, should be spared to 150% (rounding up), e.g., a single cable zone should have three cables installed. The spare cables should not be connected, but coiled and labeled as spare circuits. Piping temperature sensor elements shall be spared to 100% and shall be connected.

Valves – Installed spare EHT cable sets are not practical on valves, inline devices, and line mounted devices; however, spare EHT cable cut to the exact length of the valve/line device shall be fabricated, tagged for its end use, and stocked in sufficient quantity to allow replacement. Temperature sensor elements on critical valves shall be spared and connected. Refer to Section 4.8 on valve and line device thermal insulation.


3.6.3.3 System Component Requirements

The recommended EHT cable type is mineral insulated (MI) cable with magnesium oxide dielectric, dual-conductor heating elements with a welded Inconel 825 sheath. Two cable diameters are recommended: 5/16 in. (nominal 8 mm) for 600 V service for long piping zones and 3/16 in. (nominal 4 mm) for 300 V service for valves and line devices. The internal conductor (resistance heating element) resistance will vary depending upon the zone length. Cable power density should be limited to 50 W/ft (nominal 164 W/m) to ensure maximum cable life.

Either thermocouple or RTD sensor elements are acceptable; however, the type selected will be standard across the entire facility.

1 **3.6.3.4 Zone Definitions**

2 Piping System EHT Zones. Piping EHT zone length shall be as long a possible. A piping EHT
 3 zone will extend through an inline device zone, but shall not be used to EHT the inline devices.
 4 Refer to Figure 3-6.

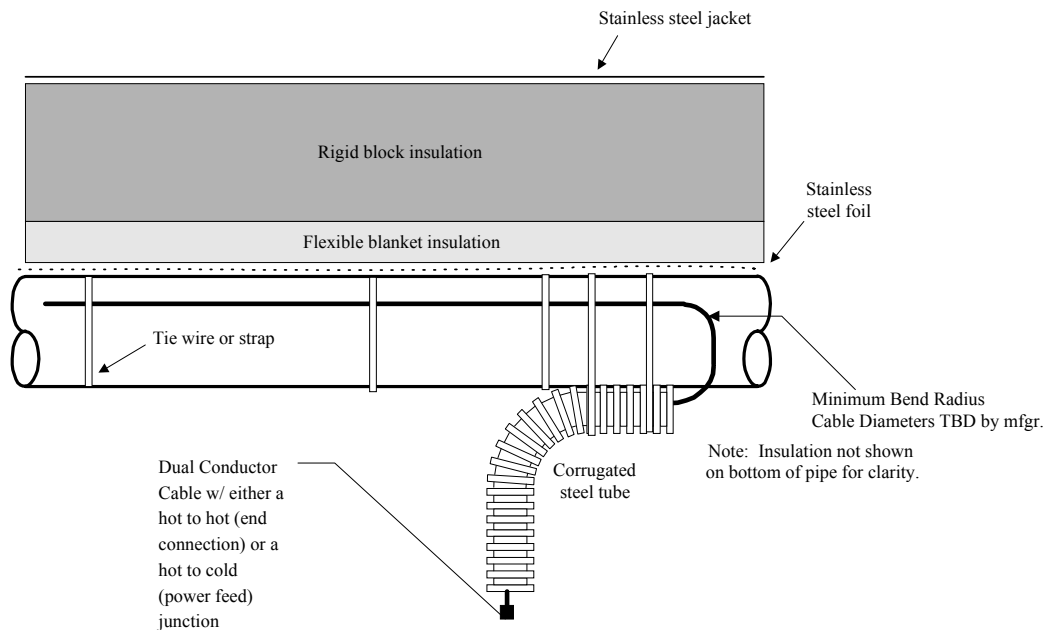

5

6

Figure 3-6. Piping System EHT Zones.


7 Pipe support EHT zones and the insulation systems at both anchor and guide locations require
 8 unique dimensioned designs detail with specific installation instructions. Typically, dedicated
 9 zones are not required. Daily thermal cycling of the piping systems and the resulting differential
 10 thermal expansion, both axially and radially, can result in accelerated wear of the insulation
 11 system if not properly specified and installed. The application details for the EHT cables at an-
 12 chor and guide location must show physical dimensions of all insulation cutouts, banding at-
 13 tachments, and handle EHT and insulation as an integrated installation and not individual
 14 elements.

15 Valve EHT Zones. Valve EHT zones will be independent of the piping EHT zone. Valve zones
 16 typically have multiple zones with independent temperature sensors. Zones will be selected
 17 based upon the physical configuration of valve or line device with the intent of preventing salt
 18 from freezing anywhere in the valve and from exceeding maximum exposure temperatures to
 19 valve/line device components. Specifically, valve zones will assure that the valve stem packing
 20 is maintained within a temperature range of 260 to 315°C (500 to 600°F). Refer to Section 4.5.2.

21 Refer to Figure 3-7 for a typical valve EHT zone definition. The valve body is electrically heat
 22 traced to maintain a process temperature while the bonnet is traced with an independent circuit to
 23 protect the valve packing from exceeding a limiting packing temperature.

1 Check valves do not have extended bonnets. Therefore, if the insulation thickness on the valve
2 and pipe are the same, the unit heat loss for the valve should be essentially the same as for the
3 adjoining pipe. Consequently, treating the pipe and check valve on a contiguous basis is an ac-
4 ceptable design practice.

5 Each of the piping EHT zone's *primary circuits*, such as the riser and the downcomer, should use
6 the fewest number of zones possible consistent with the maximum cable length available. Plant
7 availability is improved by the following: (1) reduction in the number of cables, contactors,
8 controllers, and communication lines; (2) reduction in the number of alarms monitored by the
9 operators; and (3) potential operating modes that are not used correctly. The division of a piping
10 circuit into multiple zones decreases the plant availability; the loss of one zone is equivalent to
11 the loss of the complete circuit, and multiple zone components decrease the mean time between
12 failure for the circuit. Each of the piping EHT zone's *secondary circuits*, such as the discharge
13 line between a pump and a header, should use a separate zone. The zones can then be isolated or
14 activated based on the operating mode.

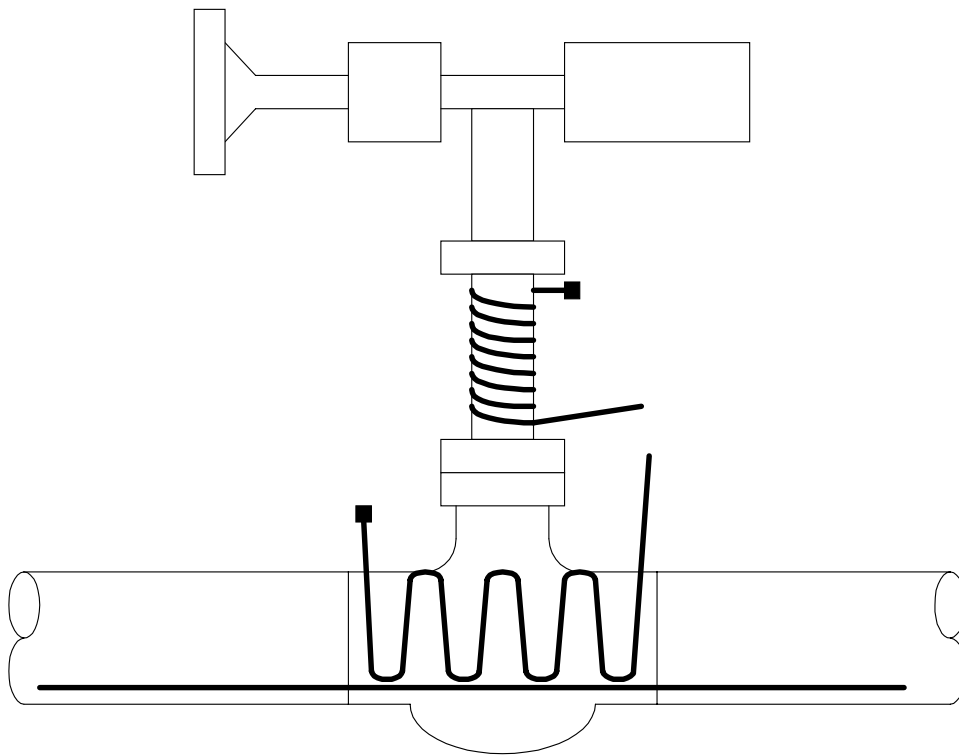

15

16

Figure 3-7. Typical Valve EHT Zone Definition.

17 If different operating modes subject a section of line to different static fluid heights, the bound-
18 ary between the zones must end above any intermediate liquid levels. For example, from Solar
19 Two experience, recirculated salt from the receiver pumps back to the cold salt tank by means of
20 (1) the pump discharge header, (2) the lower riser-to-downcomer bypass valve, (3) the lower
21 section of the downcomer, and (4) the diversion valve to the cold salt tank. In the recirculation
22 mode, the flow of cold salt caused the heat trace circuit to turn off. Cold salt also rose to a
23 height of about 9 m (30 ft) in the riser. If the heat trace zone in the lower section of the riser had

1 ended below an elevation of 9 m (30 ft), the stagnant salt in the riser above a height of 9 m (30
2 ft) would have frozen in a matter of a few hours.

3 **3.6.3.5 Temperature Sensor Location and Installation**

4 Sensor elements dependent upon the type are to be welded or banded to the pipe/line device, and
5 then covered with stainless steel foil to ensure good thermal contact. Two sensor elements shall
6 be provide on each zone and connected to the controller.

7 **3.6.4 Equipment Thermal Conditioning and Freeze Protection**

8 Hardware thermal conditioning and freeze protection requirements unique to major equipment
9 elements are discussed below.

10 **3.6.4.1 Receiver Inlet and Outlet Vessels**

11 The vessel shells and heads will be electric heat traced with MI cable with two redundant tracers
12 for vessel thermal conditioning and temperature maintenance during operation. The redundant
13 tracer will not be connected, but will be accessible to connect without having to shut down the
14 receiver. Zones boundaries will be defined based upon liquid level e.g., NLL, high liquid level
15 (HLL), etc., to prevent excessive temperature gradients developing within the vessel. All vessel
16 connections and attachments will be electric heat traced with independent zones similar to piping
17 and line device EHT.

18 **3.6.4.2 Pressure Vessel and Tank Appurtenances**

19 Vents, drains, valves, and instruments wetted by nitrate salt or in contact with nitrate salt laden
20 vapor will be insulated and electric heat traced. The EHT design and zoning will follow the
21 guidelines described in this section. Any open vent will be exposed to nitrate salt vapor and the
22 extent of the EHT zone will encompass its entire length.

23 **3.6.4.3 Receiver Panel Oven Boxes**

24 Refer to RS Section 3.3.4.3 for EHT and thermal conditioning requirements.

25 **3.6.4.4 Hot and Cold Storage Tank Immersion Heater(s)**

26 Refer to TSS Section 3.4.3.3 for hot and cold storage tank immersion heater(s) requirements.

27 **3.6.4.5 Pressure Relief Valves**

28 All nitrate salt pressure relief valves (PSVs) will be electrically heat traced and insulated. The
29 maximum exposure temperature of the valves is not the same as the springs. The maximum

1 spring operating temperature is substantially lower. From Solar Two experience, the springs
2 were over heated and valve springs damaged. PSV EHT design must specifically address the
3 heat transfer effects on valve inlet, valve outlet, valve body, and spring top works. As a mini-
4 mum, separate zones will be provided for the valve body, inlet piping, and outlet piping. The
5 valve outlet tail/vent line pipe shall be traced over its entire length. Provide a weep hole at the
6 PSV discharge low point to indicate that the valve is leaking.

7 **3.6.4.6 Vortex Shedding Flow Meters**

8 The vortex shedding flow meters reside in fittings, which are the same diameter as the pipe;
9 therefore, the zone can be traced with the piping zone. The unit heat loss from the instrument
10 body is essentially the same as that for the adjacent pipe. However, the instrument has a small
11 boss which houses the vibration sensor, and the boss extends through the pipe insulation. The
12 boss is not insulated due to temperature limits on the piezoelectric sensor. Therefore, the boss
13 acts like a fin and cools the top of the fitting. From Solar Two experience, a loop in the shape of
14 an “S” with a total length of 305 mm (12 in.) was added to each cable on the 150 mm (6-in.)
15 flow meter to compensate for the convection losses from the boss. With a unit cable rating of
16 40 W/ft (nominal 130 W/m) and two active cables, the loops increased the heat input to the me-
17 ter by 80 W over that which would have been provided by the cables on the adjoining pipe.

18 **3.6.4.7 Level Gauges**

19 Bubblers, air supply lines, and wetted or salt vapor exposed components shall be electrically heat
20 traced and insulated.

21 **3.6.4.8 Pressure Transducers**

22 No EHT is required for NaK capillary transducers since the NaK mixture melts at -4°C (25°F)
23 and is operable above 593°C (1100°F). HI TECH XL salt-filled capillaries require EHT. Tem-
24 perature ranges are TBD. A third option uses a capillary filled with an organic salt, liquid at am-
25 bient conditions to well above 650°C (1200°F), is also being considered.

26 **3.6.4.9 Vertical Turbine Pump Electrical Heat Tracing**

27 Vertical turbine pump barrels and discharge housings, including the non-wetted exposed shaft
28 inside the storage tank (ullage clearance volume), the exterior shaft, and the discharge housing
29 will be electrically heat traced. The interior section will not be insulated. The exterior portion
30 will be insulated. Separate zones will be used to trace equipment elements where the thermal/
31 physical conditions of the system change:

- 32 • From no insulation to insulation;
- 33 • If physical mass or geometry of the piece of equipment changes significantly. Specifically,
34 the pump discharge flanges, RTJ, or hub type;

- 1 • Interfaces with the VSD that consider equipment protection from potential overheating of
2 VSD;
- 3 • When thermal conditioning of the pumps prior to startup is required to avoid thermal over-
4 stresses.

5 The pump barrel that extends into the storage tank needs to be analyzed from a thermal stress
6 perspective. The tank may require a thermal condition system to prevent overstressing vertical
7 turbine pump barrels and supports.

8 **3.7 Master Control System**

9 **3.7.1 System Description**

10 The MCS handles all site process control, monitoring, management, and administrative func-
11 tions. MCS is comprised of three subsystems; the DCS, HAC, and ADAS. The primary focuses
12 of this Design Basis Document are the DCS and HAC portions of the system. While important,
13 the ADAS will not be discussed, other than to show that it is part of the overall MCS system ar-
14 chitecture.

15 The DCS controls SPT process functions for all systems and equipment and provides reliable
16 redundant coordinated control through all states and transitions in response to operator com-
17 mands. The DCS consists of the following components:

- 18 • Redundant PC network (PCN) Servers (Process Interface),
- 19 • Network server (ADAS interface),
- 20 • Redundant PLCs,
- 21 • Redundant HAC using PC-based technology,
- 22 • Data networks,
- 23 • Operator consoles,
- 24 • PLC remote cabinets with analogue and digital I/O cards,
- 25 • Data historians (data logging and acquisition equipment),
- 26 • Peripherals, and
- 27 • All software.

28 DCS functions include CS, RS, SGS, TSS, EHTS, EPGS, and BOP process control.

29 The DCS is an integrated system intended to provide a state-of-the-art HMI.

30 The DCS is resident of the PCN servers and communicates with the redundant PLCs over the
31 Process Control Network.

32 The DCS communicates with and controls the heliostats through the HAC and, subsequently, the
33 HCs. The PCN servers and network server communicate with the HAC. Refer to Section 3.2.4
34 for a discussion on the HAC requirements and functions. HCs are part of the CS.

1 DCS peripherals include printers, plotters, scanners, disc storage devices tape drives, CD writers,
2 etc.

3 **3.7.2 Preliminary System Block Diagram**

4 Figure 3–8 shows the top-level system hardware, simplified network architecture, and its con-
5 nectivity. The MCS architecture shown is notional and the actual system configuration will be
6 driven by the state-of-technology at time of design and purchase.

7 **3.7.3 Scope of Supply**

8 **3.7.3.1 Distributed Control System Design Package**


9 The DCS design package will include all system architecture, interface specifications, and design
10 for the RS, CS, TSS, SGS, EPGS, EHTS, and BOP. The development of hardware and software
11 design and specifications includes logic diagrams, loop diagrams, operational sequences, and
12 mockup HMI screens, and the procurement of the hardware and software. In addition, as the
13 overall system integrator, this package will include technical oversight, startup, and system acti-
14 vation and testing. DCS HMI screens and PLC ladder logic encoding will be developed within
15 this package.

16 **3.7.3.2 Distributed Control System Hardware/Software Procurement and Installation Support** 17 **Package**

18 A single DCS hardware/software procurement and installation support package will be released,
19 including PCN servers, network servers, PLCs, and remote I/O hardware, to one supplier. This
20 package will include peripherals, operating system, network architecture, standard packaged-
21 software, drivers, etc. It also includes support for installation, training, and HMI screen/graphic
22 development. As an option, DCS HMI and PLC ladder logic encoding may be included within
23 this procurement.

24 **3.7.3.3 HAC Hardware and Software Procurement Package**

25 A single HAC hardware and software procurement package will be released including all spe-
26 cialized HAC software encompassing the HAC CS field control, DAPS, SAPS, and BCS.

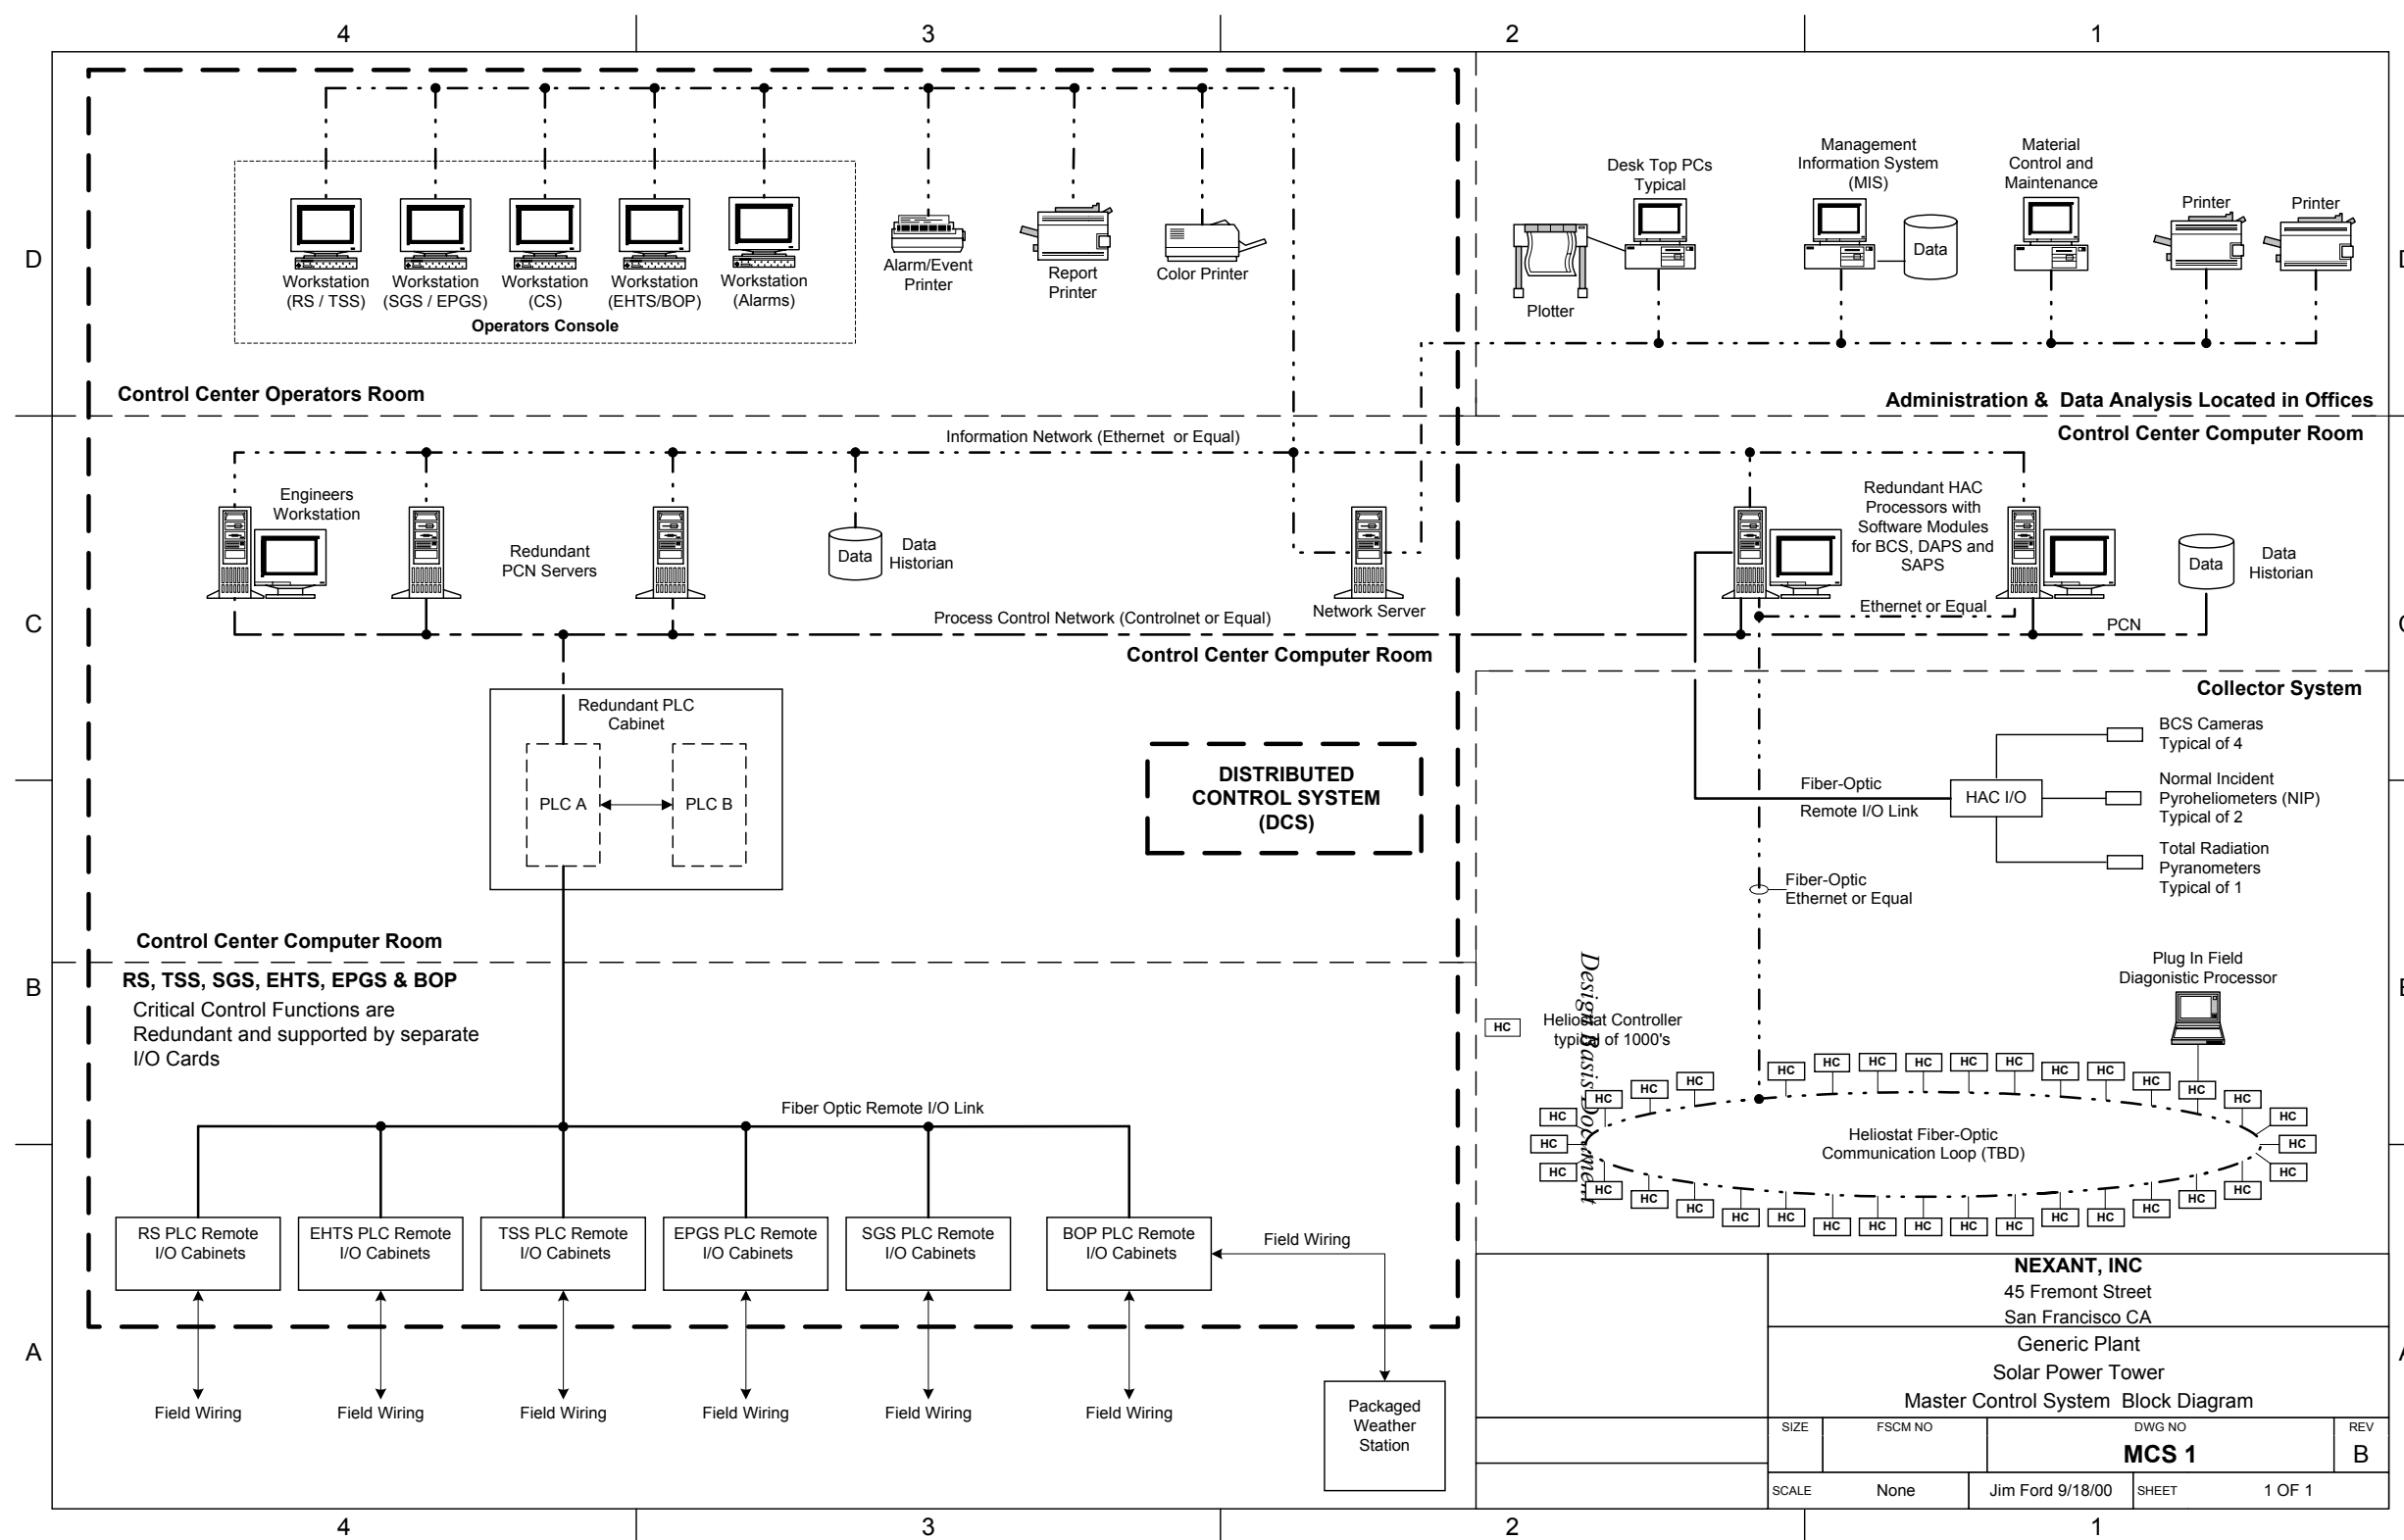

1
2

Figure 3-8. Distributed Control System

1 **3.7.3.4 Distributed Control System Hardware Installation Package**

2 The DCS hardware installation package will be included as part of the site construction package,
3 but will require that the hardware supplier(s) oversee installation, hardware burn-in, software
4 loading, and testing. All network wiring interconnectivity installation will be performed in this
5 package.

6 **3.7.4 General Distributed Control System Design and Functional Requirements**

7 General DCS design and functional requirements are as follows:

- 8 • Critical process control function will have redundancy from the process controller (PCN
9 Servers/PLCs). Process critical PLC field I/O cards, critical field instruments, and commu-
10 nication paths will also be redundant.
- 11 • The PCN servers, PLCs, and HACs hardware will include internal diagnostics to alert the
12 operator to component failures.
- 13 • The PCN servers, PLCs, and HACs primary processor (either the “A or B;” refer to the sys-
14 tem schematic) will be on hot standby with automatic fail-over to the spare. Hardware will
15 be configured to allow component replacement while the spare continues to function.
- 16 • The DCS will be the primary interface between the plant operators and all SPT systems. All
17 graphics and interactions will be through the operator consoles including the HAC graphics
18 and individual heliostat status.
- 19 • The DCS requires a data acquisition and recording capability (data historian) for all process
20 instrument data and process variables as a function of time. DCS should be capable of both
21 real time and off line trend and statistical analysis.
- 22 • All DCS and HAC computer hardware will be commercial-off-the-shelf, with the exception
23 of the HCs.
- 24 • The HAC hardware and data historian will be designed based upon the HAC software pri-
25 mary and secondary functional requirements. Primary functional requirements take prece-
26 dence in command processing time over the secondary requirements. The primary
27 requirements are:
 - 28 – Receive and execute commands from the DCS for the CS,
 - 29 – Provide status to the DCS of the CS (heliostats and HCs),
 - 30 – Provide a stable, redundant/failsafe platform to run CS heliostat control software,
 - 31 – Transmit sun position and timing signals to the HCs,
 - 32 – Transmit Operating Mode Commands to the HCs, and
 - 33 – Receive Status updates from the HCs.

- 1 • The DAPS, SAPS, and BCS software processing functions are secondary. If the computa-
2 tional complexity of the DAPS, SAPS, or BCS affect the primary HAC functions by degrad-
3 ing processing speed, affecting system stability, or reliability, these functions will be moved
4 to additional processors. Other secondary requirements are:
 - 5 – Maintain the field status database.
 - 6 – Compute collector field cleanliness by quadrant based upon the wash log and reflectivity
7 readings.
 - 8 – Analyze solar data and performance data on a daily basis and provide data to the DCS for
9 generation of reports.

10 **3.7.4.1 Communication Protocols**

11 Communication protocols between the DCS and PLCs, DCS and HAC, and PLCs and field I/O
12 will use industry standard protocols with proven performance. It is recommended that a fiber
13 optic based network system be the baseline from the DCS to the each remote field I/O card.

14 **3.7.4.2 Administrative and Data Analysis System**

15 ADAS will have read-only access to the DCS and the data historians. The overall site Materials
16 Management System (MMS) is part of the ADAS and will have read-only access of DCS data-
17 base for hardware status and component failures data. The MMS must be capable of accommo-
18 dating and tracking component parts to a large number of individual heliostats. Standard
19 commercially-available maintenance databases may not be adequate.

20 **3.7.4.3 Electric Heat Tracing System Zone Temperature Control**

21 EHTS zone temperature control will be integrated with the field I/O, PLCs, and DCS and not
22 through an EHT supplier provided interface, PC, or temperature controllers.

23 **3.7.4.4 Maximum Electronic Hardware Operating Temperatures**

24 Electronic hardware that operates near nitrate salt containing systems will be exposed to higher
25 than normal ambient temperatures. The maximum temperatures limits that electronic hardware
26 can be exposed to will be exceeded, and therefore hardware cooling provided. Refer to Section
27 4.7.3.

1 **3.8 Major Process to BOP Interfaces**

2 **3.8.1 General**

3 There are a substantial number of interfaces between RF, RS, TSS, SGS, EHTS, EPGS and
4 MCS, and the BOP. This section defines special interface requirements unique to the SPT and
5 the BOP, and does not attempt to define normal inter- and intrasystem interfaces, e.g., site, foun-
6 dations, utilities, power, grounding, etc., unless there are unique issues involved.

7 Selected BOP system equipment and hardware will operate at different design points during
8 normal operation and during overnight hold. In order to reduce parasitic power consumption,
9 BOP systems design must address the differences in load demand between normal operations
10 and overnight hold operations for compressed air, cooling water, service water, etc. The design
11 analysis will determine if small “jockey”-type compressors, pumps, or cooling tower fan with
12 smaller vessels/receivers could supply the facility overnight hold requirement without operating
13 the main equipment.

14 Consider placing electrical and electronic equipment, including power distribution panels, EHTS
15 contactor panels, MCCs including VSD cabinets, special instruments transmitters, and MCS re-
16 mote I/O cabinets inside air-conditioned prefabricated walk-in buildings to protect the equipment
17 and facilitate maintenance. Prefabricated buildings should be considered for the:

- 18 • Receiver tower structure just below the receiver deck servicing the receiver, crane, and BCS.
- 19 • Receiver tower structure at the SGS deck level servicing the SGS pumps and EHTS contac-
20 tor panels.
- 21 • Receiver tower structure servicing the TSS, RS, and SGS Motors/VSDs, and EHTS systems.
- 22 • EPGS equipment and other BOP equipment.
- 23 • TSS & CS at grade servicing TSS immersion heaters, CS, and power distribution area.
- 24 • CS field at the locations of the BCS and IR cameras.
- 25 • BOP area servicing cooling towers.

26 **3.8.2 Balance of Plant to Collector System Interface Requirements**

27 The BOP receiver tower structure mounts and supports BCS target.

28 **3.8.3 Balance of Plant to Receiver System Interface Requirements**

29 The BOP provides the tower structure upon which the RS equipment is mounted and supported.
30 There are specific requirements for tower motion and stiffness:

1 • Stiffness TBD

2 • Load TBD

3 • RSs

4 • Wind loads TBD

5 The BOP:

6 • Provides space and structural support for RS piping, piping expansion loops, and pipe sup-
7 ports.

8 • Supports and protects RS jib crane.

9 • Provides an environmentally-conditioned shelter just below the RS deck that is shielded from
10 RS nitrate salt spills/leaks, etc., to house remote MCS/BCS interface hardware.

11 • Defines the interface plane between the RS equipment and the BOP structure.

12 • Provides tower access including a combined service freight/personnel elevator.

13 • Provides spill protection to catch and retain RS leaks and spills.

14 • Provides a cooling water supply and return for cooling selected receiver instrumentation.

15 • Provides compressed air to the receiver inlet vessel – ullage pressurization, and to RS outlet
16 vessel bubbler level gage.

17 The BOP RS tower foundation must be independent from the TSS foundation mats.

18 **3.8.4 Balance of Plant to Thermal Storage System Interface Requirements**

19 BOP provides access structures (bridging/cantilevers) tied into the RS support tower structure,
20 which will span/hang over the tops of the TSS hot and cold salt storage tanks. This structure will
21 support the

22 • RS circulation pump (cold salt tank),

23 • SGS circulation pump (hot salt tank),

24 • SGS attemperation pump (cold salt tank), and

25 • TSS hot tank mixer.

26 The access structures provide rigid support for the operating equipment. The support includes
27 all piping, pipe supports, and power distribution raceway and equipment. It provides free and

1 clear access clearance around the pumps for maintenance and operations, recognizing that the
2 equipment will be at temperatures in excess of 540°C (1000°F).

3 The BOP:

- 4 • Provides access and egress from the TSS access structures in multiple directions.
- 5 • Provides and structurally supports a crane or cranes(s) to remove and install the high tem-
6 perature vertical turbine pumps from the storage tanks. The crane(s) will be able to lower
7 and raise the pumps to grade elevation. Crane control access should be provided from grade
8 and from the TSS access platform deck.
- 9 • Provides compressed air to the TSS bubbler level gages.
- 10 • Provides platform space for the VSD control panels, TSS, and remote I/O cabinet(s).
- 11 • BOP provides support for elements of the TSS tank air heating system.

12 The BOP TSS platform provides a means to access the TSS hot and cold tank interior.

13 **3.8.5 Balance of Plant to Steam Generation System Interface Requirements**

14 The BOP:

- 15 • Supports the SGS heat exchangers and provides clear space for tube bundle extraction.
- 16 • Provides space and structural support for SGS valves, insulated piping, piping expansion
17 loops, and pipe supports.
- 18 • Provides a monorail crane to extract and insert SGS tube bundles form the SGS exchangers.
- 19 • Provides a environmental/windscreen enclosure on the receiver tower structure enclosing all
20 deck levels where SGS equipment is located. This is required to protect personnel during
21 night and day shift equipment maintenance operations.

22 **3.8.6 Balance of Plant to Electric Heat Tracing System Interface Requirements**

23 BOP will provide sufficient space in the initial general arrangement/plan development for EHTS
24 panels and power distribution equipment that *will not* interfere with maintenance and operations
25 access to primary equipment. The space block-outs will be sufficient to accommodate raceway,
26 conduit, and cable runs that do not interfere with access.

27 **3.8.7 Balance of Plant to Master Control System Interface Requirements**

28 BOP hardware that may affect the operation of MCS/DCS (emits electronic noise or interfer-
29 ence) will be shielded.

1 **3.8.8 Balance of Plant to Electric Power Generation System Interface Requirements**

2 BOP provides a pipeway structure between the SGS and the EPGS for feedwater, main steam,
3 and reheat steam supply and return piping.

4

5

1 **4. General Layout, Materials, and Processes**

2 **4.1 Plant Layout**

3 **4.1.1 Layout for Access and Egress – Personnel Safety**

4 Personnel access for routine equipment and component inspections, maintenance, and for per-
5 sonnel egress in dealing with high temperature nitrate salt systems will take precedence over de-
6 sign for thermal conservation and heat loss reduction. Initial equipment layouts shall consider
7 the following issues.

8 Equipment and component handling nitrate salt that can develop leaks, will develop leaks; and
9 therefore, design provisions shall be considered in the initial equipment layout. These will im-
10 pact the footprint and equipment envelopes.

11 Elevated equipment that may have personnel access paths underneath equipment shall be pro-
12 vided integral welded sealed drip pans.

13 Splashguards will be provided where routine horizontal access paths occur.

14 Egress from elevated structures shall be provided so that personnel can escape in the direction
15 opposite to the equipment and/or component. For example: if a piece of equipment can be ac-
16 cessed from three sides, an egress paths shall be provide from three sides.

17 **4.1.2 Maintenance Access**

18 Working areas in and around high temperature system require that *generous* clearance space be
19 provided around the equipment/components. Ideally, 360-degree access should be provided. The
20 surface temperature and emitted thermal radiation from the equipment/component make working
21 around extremely difficult, and normal maintenance clearances are not sufficient.

22 Any equipment and component requiring routine inspection and maintenance shall provide per-
23 manent provisions for access/egress, including platforms with ladders or stairs.

24 Initial layouts shall consider the impact of thermal insulation systems and the added clearance
25 dimensional requirements. This includes both the thickness of the insulation and the insulated
26 pipe supports and hangers. Normal plant design clearances are not adequate.

27 Refer to Section 4.7.1 for a discussion on electrical equipment layout and space allocation.

4.2 Mechanical and Electrical Equipment Maintenance Automation

4.2.1 Solar Power Tower Mechanical and Electrical Equipment

All SPT mechanical and electrical equipment specifications will include requirements for self-diagnostics which will be incorporated into MCS and reported through the DCS. Equipment requiring self diagnostics includes:

- CS heliostat drives.
- HCs.
- All primary and secondary electrical power distribution equipment including switchgear, transformers, motor control centers, etc.
- All mechanical rotating equipment with rotation or moving parts, including pumps, motors, fans, refrigeration units, mechanical mixers, compressors, elevators, cranes, air conditioning, diesel generators, hydraulic systems, etc.
- All unattended mechanical equipment that can develop leaks, including air handling unit coils and buried and surface tanks.

4.2.2 Component Failure Diagnostics

Component failure diagnostics may include bearing temperatures, internal equipment temperature, vibration sensors, high-current, ground fault, etc.

4.3 Material Selection General

4.3.1 Material Requirements

Table 4-1 specifies material requirements for piping in nitrate salt service, and for structural steel. Material specifications for steam, feedwater and other fluid and gas services are not within scope of this design guide. Material specifications for engineered equipment are covered in Section 3.0.

Table 4-1. Material Requirements for Piping in Nitrate Salt Service and Structural Steel

Equipment/Component	Materials	Corrosion Allowance and Remarks
Nitrate Salt Piping $\leq 750^{\circ}\text{F}$ (400°C)		Corrosion allowance 0.3 mm (10 mils)
Piping	Carbon Steel, ASTM A 106 Grade B	Minimum Wall Schedule 40
Fittings	Welded: ASTM A234 Grade WPA or WPB	

Table 4-1. Material Requirements for Piping in Nitrate Salt Service and Structural Steel (continued)

Equipment/Component	Materials	Corrosion Allowance and Remarks
Flanges	ASTM A105	
Valves < 2in		
< 2in	Forged -ASTM A105 and A351	
> 3 in	Cast Steel , ASTM 216 WCB	
Bolts	A193, Gr B7	
Nitrate Salt Piping > 750°F (400°C)		Corrosion allowance Type 347 :0.7 mm (25 mils) Type 321: TBD (Note 1)
Piping	Stainless Steel, ASTM A 312 Type 321/347	Minimum Wall Schedule 40
Fittings	Stainless Steel ASTM A 403 Type 321/347	
Flanges	Stainless Steel ASTM A182 Gr F321 or F347 RTJ, Gray Lock Hubs, or approved equal Flanges per ASME B 16.5	
Valves		
< 2in	Forged ASTM A 182 Gr 321 or 347	
> 3 in	Casting ASTM A 351 Gr CF8C 347	
Bolts	ASTM A 193, Gr B8R w/ ASTM A194 Gr 8R heavy hex nuts	
Structural Steel		
Shapes	ASTM A 36	
Cold Formed Steel Tubing	ASTM A 500	
Steel Pipe (Structural Applications)	ASTM A 53 , Gr A or B	
High Strength Bolts Nuts and Washers	ASTM A 325	

Note 1: Corrosion allowance for type 321 stainless is TBD. Intergranular corrosion may be a concern with 321 stainless in nitrate salt services and until some additional test data is generated, a decision on selecting a pipe, forging, and plate corrosion allowance will be deferred.

1

2 **4.4 Piping, Fitting, and Pipe Support Requirements**

3 **4.4.1 Pipe**

4 **4.4.1.1 Pipe Connection Nitrate Salt Service**

5 Piping end connections of the following types are suitable for nitrate salt service: butt-welded
6 joints, flanged connections with RTJs, and Grayloc Hubs-type connections. Compression fit

1 tings, “Swagelock type,” while free of leaks during service at Solar Two, are not recommended
2 for hazardous service. Flat face and raised face flanged connections, as well as socket welded
3 connection, are not suitable for salt service.

4 **4.4.1.2 Pipe Schedule**

5 Minimum American (USA) pipe schedule for pipe sizes 51 mm (2 in.) and greater will be
6 Schedule 40. Minimum schedule for pipe sizes 38.1 mm (1.5 in.) and less will be Schedule 80.
7 Equivalent European metric pipe sizes and wall schedules may be substituted for the American
8 standard.

9 Pipe sizes 31.75 mm (1.25 in.), 63.5 mm (2.5 in.), 88.9 mm (3.5 in.), and 127 mm (5 in.) will not
10 be used.

11 All pipe will be specified as seamless.

12 **4.4.2 Flanges**

13 Flanges in nitrate salt service may be of the following types: RTJ or hub-type manufactured by
14 Reflange, (R-Con), Gray Lock, or equivalent. No other flange types will be used in nitrate salt
15 service. All flange gaskets/rings will be nitrate salt compatible. RTJ gaskets and hub rings will
16 be ASTM 240 Gr 304 for both low temperature and high temperature nitrate salt service.

17 **4.4.3 Fittings**

18 Butt weld fittings will be used in nitrate salt service in all pipe size ranges. Socket welded-type
19 fitting shall not be used in nitrate salt service.

20 **4.4.4 Pipe Supports**

21 Pipe guides, anchors and hangers, and sliding supports used in nitrate salt systems have unique
22 design issues.

23 • Hangers, spring hangers, and sliding supports issues are:

24 – Bolted strap on type supports (U-bolts, pipe clamps) with daily thermal cycling will work
25 loose and slip and should not be used.

26 – Pipe rolls may be used in conjunction with high density calcium silicate insulation with
27 insulation protection shields in addition to the stainless steel insulation jackets.

28 – Weld on shoes and tabs with through bolt connections are acceptable for hangers, spring
29 hangers, and sliding support. Minimizing conduction heat loss through slide or tab will
30 require additional insulation to reduce the thermal conduction losses. It may be neces-
31 sary to EHT a portion of the sliding support to dampen out cold spots on the piping;

1 however, the additional EHT may cause local hot spots on the piping that are equally as
2 bad. The caution here is that the support design must be fully integrated with the EHT
3 design and not handled as an afterthought.

4 – Pipe support, EHT, and insulation work together as an assembly and have to be designed
5 as such. Standard insulation design details and approaches require modification.

6 • Pipe Anchor design issues are:

7 – Rigid insulation clamped on pipe anchor designs will fail after repeated daily thermal
8 cycling and should not be used.

9 – A weld-on anchor tab with bolt through parallel plates with thermal insulation sand-
10 wiched between the plates to reduce conducting heat loss to the exterior are acceptable,
11 but may require additional insulation and EHT to prevent localized salt freezing.

12 **4.4.5 Stud Bolts**

13 Stud bolts used in nitrate salt service $\geq 400^{\circ}\text{C}$ ($\geq 750^{\circ}\text{F}$) or on electrically heat traced pressure
14 containing components will be specified as ASTM A 193, Gr B8R with ASTM A194 Gr 8R
15 heavy hex nuts.

16 **4.5 Valves**

17 **4.5.1 Gate Valves and Globe Valves**

18 Gate valves will be used for isolation, vent, and drain applications. Split body globe valves will
19 be used for throttling/flow control applications. Other valve types (ball, butterfly, etc.) have
20 been evaluated and are not acceptable for molten nitrate salt service. The use of valves in nitrate
21 salt service should be limited to the minimum.

22 Gate valve seats and disk/wedge will be stellited. Gate valves used in high-temperature nitrate
23 salt service shall have extended bonnets. Bonnet extensions are required for high temperature
24 salt service – refer to discussion below. SGS and RS vents and drains are operating valves and
25 will be provided with remotely-controlled pneumatic operators.

26 Globe valve disk face and seats will be stellited. Salt corrosion layers may develop on plug and
27 seats of globe valves. Split body valves move the plug away from the seat and therefore the cor-
28 rosion layer should not prevent the valve from opening or closing.

29 **4.5.1.1 Valve Stem Packing Materials**

30 A significant development effort has been expended by SNL and from Solar Two operations on
31 evaluating valve stem packing materials. Carbon/graphite-containing materials used by manu-
32 facturers in standard offerings—bonnet gaskets, seal rings, O-rings—are not acceptable in nitrate

1 salt service. There is a single exception: valve stem packing. Note: Molten nitrate salt, an oxi-
2 dizer, will react with carbon in any form and consume it.

3 The qualified valve stem packing for nitrate salt service consists of alternating layers of:

- 4 • Wire-reinforced graphite braid packing over a fiberglass core (Style 1200-PBI from Garlock
5 Engineering, or Style 387I from John Crane, Inc.), and
- 6 • Fiberglass-filled Teflon[®] washers.

7 *The maximum operating temperature range for this configuration is 260 to 315°C (500 to*
8 *600°F). The lower temperature limit is to prevent salt from freezing and destroying the packing*
9 *by abrasion. The upper temperature limit is it to prevent the Teflon from failing. The valve stem*
10 *packing will require periodic replacement regardless of what temperature it operates.*

11 Valve body EHT and insulation design are critical to assure that the temperature ranges are
12 maintained.

13 **4.5.2 Bonnet Gaskets and Split Body Gaskets**

14 Bonnet gaskets and split body gaskets will be either metallic ring-type joint or welded sealed spi-
15 ral wound.

16 **4.5.3 Extended Bonnet Valves**

17 Valves that will be used in high temperature nitrate salt service, $\geq 400^{\circ}\text{C}$ ($\geq 750^{\circ}\text{F}$), will be speci-
18 fied with extended bonnets so that the valve stem packing is provided with sufficient stand-off
19 distance from the high temperature salt. The bonnet length must be confirmed by test or analysis
20 by the manufacturer so that the stem packing temperature does not exceed 204°C (400°F) with-
21 out the supplemental EHT.

22 **4.6 Solar Power Tower and Nitrate Salt Service Instrumentation**

23 **4.6.1 Flow Instruments**

24 Vortex shedding flow meters are acceptable in cold salt service at temperatures $\leq 315^{\circ}\text{C}$
25 ($\leq 600^{\circ}\text{F}$) and when adequate piping straight runs are proved upstream and downstream of the
26 instrument.

27 NaK or HITEC XL salt pressure taps with diaphragms provide a stand-off for the temperature
28 limited transducer. This configuration is acceptable for measuring differential pressure but still
29 requires instrument qualification by SNL for nitrate salt service at required operating tempera-
30 tures.

1 **4.6.2 Temperature Instruments**

2 Industry standard thermowells with thermocouples will be used for fluid temperature measure-
3 ments.

4 RS back of tube temperatures, TSS tank wall and floor temperatures, etc., will be instrumented
5 with thermocouples spot welded directly to the component/equipment. Welding procedures
6 must be developed and qualified for each application.

7 EHT temperature sensors, either thermocouple or RTD, are acceptable, but must be standardized
8 across the entire project.

9 Thermocouple extension wire used with nitrate salt containing components, and specifically the
10 RS back of panel thermocouples, must use high-temperature ceramic fiber insulation.

11 **4.6.3 Pressure Instruments**

12 Solar Two experience with line mounted pressure instruments (NaK or HITEC XL salt-filled
13 diaphragm pressure instrumentation) was problematic. Various fixes were attempted, but reso-
14 lution was never achieved.

15 Oil overheated in the oil-filled diaphragm sensors, affecting the accuracy of the instrument and
16 causing vapor pressure problems.

17 Impedance transducer inconsistent accuracy required frequent recalibration, which affected con-
18 trol reliability and consistency.

19 A technical solution using a NaK metal, HITEC salt, or organic salt-filled diaphragm with cap-
20 illary tube to the transducer/transmitter is available, but development and qualification work
21 must be still completed. Listed below are technical attributes of each.

22 **4.6.3.1 NaK**

23 Requires no EHT since the NaK mixture melts at -4°C (25°F). The NaK mixture vapor pressure
24 is in excess of 593°C (1100°F). The diaphragm will be direct mounted with an RTJ WN flange
25 to the salt header without isolation valves. There are safety-related issues with the NaK. If the
26 capillary or diaphragm should rupture, the small quantity of liquid metal will self-ignite/oxidize.

27 **4.6.3.2 HITEC KL salt**

28 Coastal Chemical – composition 15% by weight NaNO_3 , 43% HNO_3 , and 42% CaNO_3 requires
29 EHT and insulation design. Thermal analysis will have to determine the amount of insulation,
30 EHT, and standoff. HITEC XL melts at 130°C (266°F) and has a maximum temperature limit of
31 480°C (900°F). There are no safety-related issues other than high temperature. The point of
32 contact is:

1 Coastal Chemical Co., LLC
2 3520 Veterans Memorial
3 Abbeville, LA 70510

4 Phone: (337) 898-0001
5 Phone: (800) 535-3862
6 Facsimile: (337) 892-1185
7 Internet: <http://www.coastalchem.com/contact.html>

8 **4.6.3.3 Organic salt**

9 Selection of appropriate organic salt and resolution of other technical issues will be required, and
10 are similar to the NaK diaphragm/capillary. Initial technical data appears promising and the or-
11 ganic salt should be considered before the NaK filled system. The organic salt does not have the
12 same safety considerations as the NaK. Point of contact for organic salts which have low freez-
13 ing points and low vapor pressures at high temperature is:

14 Solvent Innovation GmbH
15 AlarichstraBe 14-16
16 50679 Koln
17 Germany
18 Phone: +49-221-99990046
19 Facsimile: +49-221-2220341
20 Internet: www.solvant-innovation.de

21 Refer to Figure 4-1 below for a typical installation. Diaphragm replacement, if required, can
22 easily be performed for the RS/TSS systems overnight shutdowns and for the SGS/TSS with
23 short plant outages. The key issue is commercial availability of the instrument. This will require
24 SNL and industry support.

25 **4.6.4 Direct Normal Insolation, Total Insolation, and RS Flux Instrumentation**

26 **4.6.4.1 Dual Normal Incident Pyrheliometers**

27 Two Normal Incident Pyrheliometers (NIPs) with a two-axis SMT 3 tracker are required to pro-
28 vide input to the HAC. The NIP is manufactured by Eppley Laboratory. The contact is:

29 The Eppley Laboratory, Inc.
30 12 Sheffield Avenue, PO Box 419
31 Newport, Rhode Island 02840 USA
32 Phone: 401-847-1020
33 Facsimile: 401-847-1031
34 Email: eplab@mail.bbsnet.com

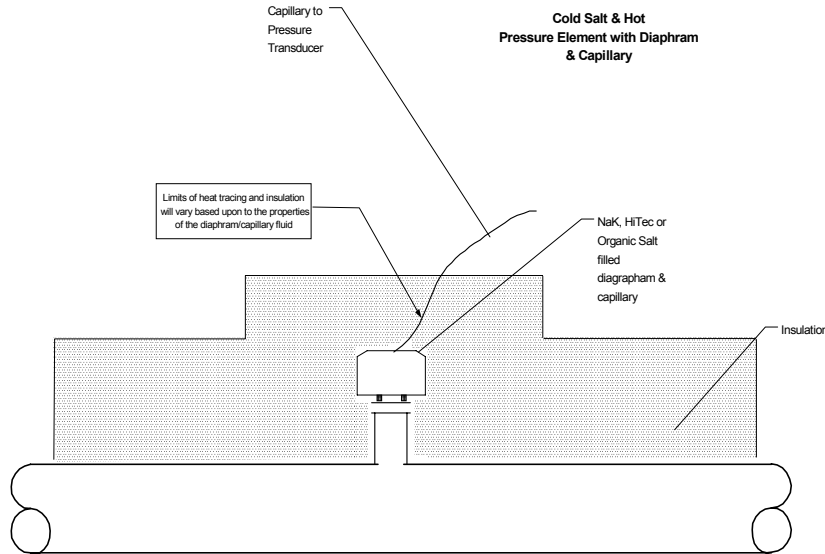


Figure 4-1. Typical Installation of Pressure Transducer

1
2
3 The NIP incorporates a wire-wound thermopile at the base of a tube, the aperture of which bears
4 a ratio to its length of 1 to 10, subtending an angle of $5^{\circ}43'30''$. The inside of this brass tube is
5 blackened and suitably diaphragmed. The tube is filled with dry air at atmospheric pressure and
6 sealed at the viewing end by an insert carrying a 1 mm- (0.039 in.-) thick Infrasil II window.
7 Two flanges, one at each end of the tube, are provided with a sighting arrangement for aiming
8 the pyr heliometer directly at the sun. Frequent “factory instrument calibration” is required;
9 therefore, operating spares must be considered in the initial procurement.

10 Automatic Solar Tracker, Model SMT-3, is a two-axis, azimuth/elevation device programmed to
11 align direct beam instruments with the normal incidence of the sun from any position on the
12 earth’s surface. Tracking is achieved using a computer program, which calculates the solar po-
13 sition for the time and location and transmits pulses to the drives, which then operate the two
14 stepping motors. Stepping motors move the elevation and azimuth axes to the correct position.
15 After initial installation, the tracker will continue to track the sun and reset during darkness. Pe-
16 riodic resetting of the system clock is required. This software is resident with in the HAC.

17 The mounting platform upon which the 2-NIPs and 1- Pyranometer are mounted must be easily
18 accessible, level, stable, and isolated from mechanical/electrical equipment vibration. The in-
19 struments must view the sun without shading from any other structures, no matter how minor,
20 during all daylight hours throughout the year. “Easily accessible” means that plant operations
21 personnel will be required to make multiple daily inspections for cleanliness and operability.
22 Stair access to an elevated platform is acceptable, whereas ladder access is *not*.

23 4.6.4.2 Total Radiation Pyranometer

24 While the NIP provides accurate measurements, it is subject to tracking misalignment and re-
25 quires frequent calibration. As such, it may yield suspect readings, which are critical for receiver
26 warm-up/startup. It is recommended that a less accurate, total radiation pyranometer with a ro

1 tating shade band be provide to approximate the direct beam radiation. A check value on the di-
2 rect normal Incident pyr heliometer measurement will be made by taking the difference between
3 the pyranometer total radiation and diffuse radiation measurements.

4 The pyranometer is comprised of a circular multijunction wire-wound thermopile that has the
5 ability to withstand severe mechanical vibration and shock. Its receiver is coated with Parson's
6 black lacquer (non-wavelength selective absorption). This instrument is supplied with a pair of
7 removable precision-ground and polished hemispheres of Schott optical glass. Both hemispheres
8 are made of clear WG295 glass, which is uniformly transparent to energy between 0.285 to
9 2.8 μm . For special applications, other Schott glasses and Infrasil II quartz hemispheres are
10 available. They included a spirit level, adjustable leveling screws, and a desiccator which can be
11 readily inspected. The instrument has a cast bronze body with a white enameled guard disk
12 (shield) and comes with a transit/storage case.

13 **4.6.4.3 Dual Normal Incident Pyr heliometers and Total Radiation Pyranometer Software**

14 Dual NIP and total radiation pyranometer software provided with the instruments will reside in
15 the HAC.

16 **4.6.5 Photometers**

17 Refer to page 63 line 24, for RS control. The photometers are industry standard PV cells, colli-
18 mators, and filters. Silicon photodiode detectors manufactured by International Light, Inc. with
19 the following description are recommended:

- 20 • Spectral response: 200-1100 nm
- 21 • Field of view: 8° with hood
- 22 • Part No Number: SED003
- 23 • Hood Number: HCS410
- 24 • Filter: QNDS2
- 25 • Cover: T2SCS280

26 Point of contact is:

27 International Light Inc.
28 17 Graf Road
29 Newburyport, MA 01950-4092
30 Phone: (508) 465 5923
31 Facsimile (508) 462-0759

1 **4.6.6 Level Instruments**

2 **4.6.6.1 Nuclear Level Detectors**

3 Nuclear level detectors are manufactured by TN Technologies, Model 5205 or equivalent, and
4 should be used on all nitrate salt vessels operating above atmospheric pressure – specifically, the
5 RS receiver inlet vessel. Solar Two used two 100 mCi sources with associated detector. The
6 instrument is sensitive to high temperature and must be protected from direct solar insolation.
7 Point contact is:

8 TN Technologies
9 2555 North IH-35
10 PO Box 800
11 Round Rock, Texas 78680-0800
12 Phone: 800.736.0801
13 Phone: (512).388-9100
14 Facsimile: (512).388.9200
15 Internet: <http://www.tn-technologies.com/contact.asp>

16 **4.6.6.2 Bubbler Level Gauges**

17 Bubbler level gauges will be used on vessels or tanks operating at atmospheric pressure condi-
18 tions – specifically, the TSS hot and cold nitrate salt storage tanks and the RS receiver outlet
19 vessel. Solar Two experience indicated that bubbler-type level gages were suitable for steady-
20 state operation; however, erroneous measurements during ullage pressure transients produced
21 level oscillations and erratic flows from receiver pumps.

22 **4.6.7 Receiver Infra Red Cameras**

23 Receiver infra red (IR) cameras will be used based upon a Model AGEMA 550 IR camera with
24 3.6–5.0 micron wave length range with the following requirements:

- 25 • Detector : Focal Plane Array
- 26 • Nominal Spectral Range: approx. 3.5 to 5 microns
- 27 • Operating Temperature Range: at least –10 to 1000°C (14 to 1832°F with high-temperature
28 filter
- 29 • Spatial resolution: approximately 256 × 256 or 320 × 244
- 30 • Dynamic Range: 12 bit
- 31 • Emittance Correction
- 32 • Cooling: Stirling cooled
- 33 • Video Output: NTSC (or S video)
- 34 • Color Viewfinder
- 35 • Zoom: 4:1
- 36 • Lenses:

- 1 – 1 - Standard (approx 20 deg FOV)
- 2 – 1 - approx. 100 mm or approx. 4 degrees

- 3 • Moveable cursor
- 4 • Operable via serial remote control including remote filter change capability
- 5 • Review stored images from the camera
- 6 • Ancillary equipment should include all cables, adapters, carrying cases, batteries, and battery
- 7 chargers
- 8 • Image viewing software PC Windows operating system compatible
- 9 • The recommended IR camera can be purchased from the source provide below using a brand
- 10 name “AGEMA.”

- 11 FLIR Systems, Inc. (FSI)
- 12 16505 S.W. 72nd Ave.
- 13 Portland, OR 97224 USA
- 14 Tel: 800-GOINFRA (464-6372)
- 15 Fax: 978-901-8532
- 16 Or call: 978-901-8000
- 17 Internet: www.FLIR.com

18 **4.7 Electrical Component Requirements**

19 **4.7.1 General Layout Issues**

20 **4.7.1.1 Electrical System Layout**

21 Generous clearance space between electrical hardware (raceway, conduit, panels, cabinets, junc-

22 tion boxes, etc.) and nitrate salt-containing equipment and components must be provided for

23 both maintenance access to nitrate salt equipment and for protection of the electrical hardware

24 from spills and high local ambient temperatures. OSHA Standard 0.9 to 1.2 m (3 to 4 ft) clear-

25 ances are not sufficient.

26 **4.7.1.2 Conduit and Raceway Routing**

27 Electrical equipment, raceway, and conduit should not be installed or routed underneath salt

28 piping and/or equipment that can develop leaks.

29 **4.7.1.3 Splashguards and Shields**

30 Splashguards and shields must be considered where it is impossible to avoid contact with liquid

31 nitrate salt. Conduit protection in and by itself is not sufficient since molten salt will conduct

32 heat through the conduit wall and destroy the wire and cable insulation.

1 **4.7.2 Cable and Raceway Materials**

2 **4.7.2.1 Electrical Conduit**

3 Electrical conduit material must be compatible with nitrate salt service. Rigid metallic conduit
4 and fittings, and extreme high/low temperature flex should be specified. Note that conduit in
5 and by itself will not provide sufficient protection from molten salt spills.

6 **4.7.2.2 Cable and Wire**

7 The space behind the receiver panels, above the receiver to and including the maintenance crane,
8 and directly below the receiver must specify high-temperature wire and cable rated insulation
9 302°F (150°C) (TBD) as normal part of the design. Conduit and duct bank will provide solar
10 insolation shielding where “heliostat spillage” can focus on conduit/raceway. The conduit by
11 itself does not provide sufficient protection.

12 **4.7.3 Enclosures, Junction Boxes, Panels, Cabinets, Motors, and Motor Housings**

13 **4.7.3.1 Enclosure Type**

14 Electrical enclosures, junction boxes, panels, and cabinets for CS, RS, TSS, and SGS systems
15 will be specified as NEMA 4/4X with compressible silicon rubber gaskets rated for 204°C
16 (400°F). Enclosures will be painted exterior high gloss white.

17 **4.7.3.2 Motor Enclosures**

18 Motor enclosures will be specified for the intended service as either TEFC or TENV (smaller
19 horsepower rating). Motor external coatings will be evaluated to determine if a similar exterior
20 high gloss white will also reduce absorbed energy.

21 **4.7.3.3 Motor Insulation**

22 Motors used in and around equipment containing molten nitrate salt will be specified with high-
23 temperature motor insulation (Class H Insulation System rated for 135°C (275°F)).

24 **4.7.3.4 Enclosure Thermal Protection and Cooling**

25 The electrical gear/electronic component housed within each enclosure will be evaluated to de-
26 termine the maximum ambient temperature at which each component will operate on a continu-
27 ous basis. This temperature may lower than the stated maximum temperature. The design
28 ambient temperature near operating nitrate salt-containing equipment around the TSS and SGS at
29 Solar Two exceeded 67°C (150°F) and was significantly higher in the volume behind the RS
30 panels. If walk-in air-conditioned enclosures are not provided under the BOP, supplemental
31 cooling systems may be required to protect the equipment. If enclosure cooling is required, the
32 BOP service water system should be used in conjunction with a standard cooling coil design on a

1 SPT-wide basis, rather than using individual electrical manufacture unique systems. A standard
2 system will simplify O&M requirements.

3 **4.7.4 Power System Reliability**

4 Refer to Section 5.2 for requirements for an RS protection trade study. As a minimum, critical-
5 MCS control functions will be protected by a UPS. Secondly, National Fire Protection Associa-
6 tion (NFPA) life safety code requirements may dictate that an emergency diesel generator be
7 used to direct drive fire pumps.

8 **4.8 Equipment and Piping Thermal Insulation**

9 **4.8.1 Economic Insulation Thickness**

10 Piping and equipment insulation thicknesses will be determined through economic analysis so
11 that the insulation thickness selected for each application results in the lowest sum of the capital
12 cost of the insulation plus the capital cost of heat loss. The capital cost of the heat loss varies as
13 a function of insulation thickness and be will derived from converting heat loss to an “annualized
14 cost of lost power production” using a levelized capital carrying charge and plant efficiency.
15 The annualized cost of lost power production should be based upon the price the SPT sells en-
16 ergy to the grid. “Each application” means each pipe diameter as a function of temperature and
17 operating time.

18 In addition, the insulation thickness must be sufficient to prevent the insulation jacket from ex-
19 ceeding a surface temperature of (60°C (140°F) TBD US OSHA) – personnel protection).

20 Based upon Solar Two experience, calculated heat loss values used to determine insulation
21 thickness should be increased by 30% for valves and components with complex geometries and
22 by 5% for piping systems.

23 **4.8.2 General Insulation System Design**

24 **4.8.2.1 Typical Insulation System Cross Section**

25 The typical insulation system cross section for piping and equipment will be as follows.

26 First Layer. 304/316 stainless steel foil, 0.08 mm- (0.003 in.-) thick wrapped and tie wired/
27 banded over all EHT elements and temperature sensors to prevent the thermal insulation from
28 coming in between the EHT element and the electric heat traced component. If insulation works
29 between tracer resistance heating element and traced component, resistance burn element will
30 result.

31 Second Layer. Mineral fiber blanket 25 mm (1 in.) thick, 8 lbs /ft³ (128 kg/m³) density mini-
32 mum to provide a flexible compressive insulation layer between stainless steel foil and the third
33 layer of rigid insulation. This layer is required to prevent radial gaps from developing as the
34 piping system or equipment thermally cycles (expands and contracts).

1 Third Layer. Multiple alternating layers of preformed or block expanded perlite insulation.
2 Multiple layers are staggered both axially and radially so there is no direct path seam exposed
3 from the innermost layer to outermost layer.

4 Calcium silicate insulation will be substituted for perlite in situations where the insulation sys-
5 tem will be exposed to exterior loading and/or personnel foot traffic to provide compressive
6 strength.

7 Vertical vessel shells should be insulated with multiple layers of mineral wool blanket in lieu of
8 the expanded perlite block. Horizontal vessels, equipment, and heat exchangers will be insulated
9 with either expanded perlite block or calcium silicate insulation cut to conform the
10 head/vessel/equipment geometry. Multiple staggered layers will be used to prevent any continu-
11 ous seams from outer to inner layers.

12 High temperature insulations contract when heated to their service temperature directly opposite
13 to the piping, vessel, or exchanger shells. Expansion joints filled with a compressible mineral
14 fiber are required to accommodate this differential expansion both axially and radially. A stag-
15 gered joint profile will be used to prevent seams from opening.

16 Fourth Layer. 304 stainless steel jacket, 0.4 mm- (0.016 in.-) thick without moisture barrier in-
17 stalled and banded with spring expansion clips as required over perlite for weather and mechani-
18 cal protection. High-temperature mastics may be used in situations where stainless steel
19 jacketing or preformed shapes are not available.

20 **4.8.2.2 Adhesives and Mastics**

21 High temperature refractory adhesives and mastics compatible for the temperature range maxi-
22 mum 565°C (1050°F) must be specified.

23 **4.8.2.3 Removable Insulation Housings**

24 Insulation and the insulation jacketing will be used on equipment, valves, instrumentation, and
25 other tank- or vessel-mounted devices requiring access for periodic maintenance or calibration.
26 These will be designed so that the insulation and jacket can easily being removed and reinstalled
27 as a single unit multiple times. The design approach will consider suitcase-type latches, quick
28 release pins, etc. Fasteners that thread or screw directly into the jacket or insulation are not ac-
29 ceptable. The removable/replaceable insulation housing shall be uniquely designed for the ap-
30 plication, including the EHT interface. The housings will be test-fitted with the EHT system in
31 place and demonstrate operation at the operating temperature. The permanent insulation system
32 abutting the removable housing will be designed to accommodate the removable housing and, if
33 necessary, compressible insulation spacers may be used at the interface.

1 **4.8.2.4 Pipe Support, Anchor, and Guide Insulation**

2 Design approaches for sliding supports, hangers, and anchors must consider daily thermal cy-
3 cling. Typical insulated stand off designs do not stand up under repeated thermal cycling.

4 **4.8.2.5 Flange Insulation**

5 All flanges and hubs in nitrate salt service will be insulated with removable insulation housings
6 to allow for periodic inspection.

7 **4.9 Nitrate Salt Handling and Melting**

8 **4.9.1 Nitrate Salt Handling and Melting Equipment**

9 The TSS design will plan for and accommodate nitrate salt handling and melting in the hot salt
10 tank either as a permanent plant installation or as a one-time subcontracted service. The han-
11 dling and melting process design should consider the following issues.

12 Premixed bulk prilled industrial grade nitrate salt is supplied in one MT “super sack.” Substan-
13 tial area is needed to store the thousands of super sacks. The delivery and off-loading period will
14 span several months.

15 This is a continuous materials handling process requiring forklifts, front-end loader, hopper,
16 conveyers, staged propane fired process heaters, tanks, pumps, piping EHT, valves, and pack-
17 aged control system. If NOX off-gas must be collected, neutralized, and disposed of an addi-
18 tional scrubber column, effluent tanks, chemical neutralization pumps, and neutralization
19 chemical storage equipment must be provided.

20 While the super sacks are sealed, moisture will wick into the nitrate salt, causing the prill to con-
21 solidate in to a large block mass. This will require addition steps and a hammer mill to breakup
22 the blocks into conveyer handable sizes.

23 The melting process is a 24 hour/7-day-per-week operation until it is completed.

24 Valves, instruments, and other components compatible with nitrate salt service may be provided
25 to the subcontractor on a loan basis since these have long delivery lead times.

26 The NOX off-gassing process, see below, requires stainless steel components and piping wher-
27 ever moisture can combine with the NOX to form nitric acid–vents, scrubber column, effluent
28 pumps, etc.

29 A critical time period in the melting process occurs with the initial tank thermal conditioning and
30 salt melting until the 1 m (3 ft) heel is filled, and the immersion heater can be energized.

31 The melting process is similar to petroleum tertiary heavy oil recovery, and a subcontractor ex-
32 perience with portable fired process heaters from this industrial segment may be capable of

1 handling the work. A project cost trade must be developed to determine whether permanent
2 plant or subcontract service is the lowest cost.

3 **4.9.2 Off-Gassing NOX**

4 The nitrate salt NOX off-gassing process is discussed below.

5 Industrial grade nitrate salt may contain trace amounts of $Mg(NO_3)$ (Solar Two was 0.05% by
6 weight) which decomposes during the melting process to NO_2 (NOX) and MgO when the salt
7 temperature exceeds $896^\circ F$ ($480^\circ C$). This is a one-time reaction and occurs over relatively long
8 period of time both as the salt is initially being melted and as it resides in the TSS hot tank. On
9 Solar Two, the reaction took approximately two months to complete and the NOX was vented
10 directly to the atmosphere.

11 Disposal options available are (1) air-dilute the NOX and discharge it into the atmosphere, and
12 (2) scrub the gas stream, neutralize it, and dispose of the effluent. Local, state, regional and/or
13 federal environmental regulations may not permit the direct release of the NOX, making option
14 (2) the only viable option.

15 As a secondary issue, moisture in the air will cause the to NOX form nitric acid (HNO_3) in high
16 enough concentrations to severely corrode system equipment. Therefore, the direct disposal
17 method must discharge the gas stream so that it does not drift through the SPT infrastructure (RS
18 tower structure, control building, etc.).

19 Salt-melting equipment must be compatible with nitrate salt (oxidizing material) and NOX.
20 Vents, stacks, and components must be selected that are compatible. Vent stack elevation must
21 be selected to assure that the off-gas is directed away from personnel and equipment.

22 The Solar Two procedures heated the melted salt to $540^\circ C$ ($1000^\circ F$) to accelerate the off gassing
23 process. This was done in parallel with the loading process at Solar Two using the immersion
24 heaters to provide supplemental heating. The process took approximately 2.5 months.

25 **4.9.3 Safety**

26 Safety is a major concern whether the handling and melting process is performed with permanent
27 plant equipment or by subcontract. If the work is subcontracted, the solicitation must require
28 that the bidder address safety both in initial design, selection of materials, and during operations.
29 There are multiple personnel and equipment hazard issues that must be addressed, including:

- 30 • Hazardous high temperature processes that will range from ambient to $540^\circ C$ ($1000^\circ F$).
- 31 • Nitrate salt is an oxidizer and organic materials (wood, carbon containing components, vehi-
32 cle tires, wire and cable insulation, etc.) that, when exposed to the molten salt, will burn/self-
33 ignite.

- 1 • Off-gassing NOX and nitric acid are personnel hazards. If the NOX is vented, it has to be
- 2 diluted and directed away from personnel. Even low concentrations of NOX will result in
- 3 respiratory system distress damaging mucus membranes and lungs. Process equipment and
- 4 components must be selected that are corrosion-resistant to nitric acid attack.

5

1 **5. Trade Studies**

2 **5.1 Elimination of the Receiver Inlet Vessel**

3 Evaluate and determine through a trade study the technical feasibility of eliminating the receiver
4 inlet vessel.

5 The objective is to simplify RS design by eliminating inlet vessel and high-pressure air system
6 and associated piping, valves, EHT, controls, etc., by relying upon the cold salt pump with its
7 VSD to provide necessary flow control for startup and operation of the receiver. The flow con-
8 trol valves for the north and south receiver flow loops, fill and drain valves and piping, and flow
9 bypass between the riser and downcomer will remain; however, options should be evaluated.

10 The focus of the study is on RS controls, process, and hydraulics. The study shall assume that
11 one cold nitrate salt pump is reliable and will maintain salt flow through the receiver. This study
12 will evaluate the system controls and system design issues involved in eliminating the inlet ves-
13 sel independent of the receiver protection issues. Receiver protection is the subject of a separate
14 study in Section 5.2.

15 The current receiver design baseline incorporates a receiver inlet vessel sized for 60 seconds of
16 resident cold salt storage, which, under the Solar Two design, allowed an emergency diesel gen-
17 erator to come on line to start a spare cold pump to maintain salt flow through the receiver. The
18 Solar Two heliostats were not protected by a UPS and their HCs had volatile memories which
19 required re-initialization of each HC, a 30-minute-plus process. A technical solution was de-
20 rived based pump sparing due to high cost of replacing/modifying approximately 2000 HC. The
21 heliostat field design basis is for non-volatile memories.

22 **5.2 Receiver Protection**

23 Provide receiver protection under loss of nitrate salt flow. Evaluate options to protect the entire
24 facility in the event of a power outage with secondary emphasis on protecting the receiver re-
25 sulting from a loss of salt flow, e.g., cold salt circulation pump failure.

26 **5.2.1 Primary Objective**

27 Address the entire facility emergency power requirements and determine what is necessary to
28 satisfy overall site operational and safety requirements. UPS and Emergency Diesel Backup
29 power may be required for fire protection, MCS reliability, critical air conditioning loads, and
30 security. The study shall address code compliance requirements, operational requirements, volt-
31 age, services, durations, etc.

1 **5.2.2 Secondary Objective**

2 A secondary objective of the study is receiver protection in the event of a loss of the cold salt
3 pump, loss of power, or loss of salt flow. RS design basis is for one cold salt pump, which will
4 result in a single point of failure. This requires that heliostats move to a defocused position.
5 Only 1 to 2 degrees of movement is required starting from the outer ring and moving inwards.
6 Determine if it is technically feasible to command the heliostats to accomplish this with the
7 specified time duration. After the initial 1 to 2 degrees, the heliostat would be moved to a
8 stowed safe position. The time to do this and how should be included in this study. Also note
9 that the heliostat motor drives are small, approximately 1/3 hp (0.25 kW), and the power distri-
10 bution system must accommodate the in rush current for motor starting.

11 **5.2.3 Receiver Protection Requirement Basis**

12 Following a loss of salt flow, the temperature of a receiver tube will rise rapidly. The tube will
13 suffer permanent damage when the combined thermal and hydraulic stresses equal the yield
14 stress and the tube plastically deforms. A worst case analysis will need to be performed to ex-
15 amine a tube in a region of the highest flux and fluid pressure, i.e., on the north side of the re-
16 ceiver at the equator. A calculation for the time required for plastic deformation will involve the
17 following:

- 18 • incident flux,
- 19 • radiation and convection losses from the tube surface,
- 20 • thermal mass of the tube and salt,
- 21 • energy absorbed in salt decomposition reactions,
- 22 • compressive tube stresses due to the incident flux,
- 23 • hydraulic pressure decay following the loss of salt flow,
- 24 • tensile tube stresses due to hydraulic pressure, and
- 25 • tube yield stresses as a function of temperature.

26 The resulting time required for plastic deformation with margin will establish the time basis for
27 which the heliostats must be defocused from the receiver.

28 **5.2.4 Protection System Reliability**

29 Protection system reliability shall be optimally 0.99999. (TBD)

30 **5.2.5 Receiver Protection Options**

31 Receiver protection options may include, but are not limited to:

- 32 • Pressurized inlet vessel with sufficient volume and driving pressure to ensure 60 seconds of
33 salt flow through the receiver until the heliostats can be defocused using emergency power
34 source, e.g., diesel, UPS.

- 1 • UPS, emergency diesel generator, or a combination.
- 2 • Heliostats failsafe mechanism on loss of power or pump.
- 3 • Ceramic curtain that drops over or is pulled over the receiver.
- 4 • Spare pump with all the valves, piping, and EHT.

5 5.3 Elimination of the Receiver Outlet Vessel

6 The objective is to simplify the RS design by eliminating the outlet vessel, level control, and
7 throttling valve by relying on pressure drop (line losses) in the downcomer piping system to dis-
8 sipate the liquid salt static head from the top of the receiver to the hot salt storage tank. The hot
9 salt will fall a distance in excess of 100 m (300 ft) before it enters the hot salt storage tank.

10 The focus of the study is upon using piping friction losses, a passive system design, rather than
11 an active throttling valve, to dissipate the static head energy:

$$12 \quad h_1 = (f*(L/D)*v^2/2g, \text{ Darcy Equation,}$$

13
14 where

- 15 h_1 = head loss (ft)
- 16 f = friction factor (dimensionless)
- 17 L = length (ft)
- 18 D = diameter (ft)
- 19 V = velocity (ft/sec)
- 20 g = gravitational constant (ft/sec²)

21 Solar Two experience with valves in nitrate salt service 290°C or 565°C (550°F or 1050°F) con-
22 cludes that if valves can be eliminated, long-term maintenance/operating costs are reduced. Ni-
23 trate salt valves are problematic – a continuous source of leaks, recurring problems with stem
24 packing failure, jamming, accelerated wear, salt freezing, etc. Do not include evaluation criteria
25 encompassing investigating valve types, stem packing materials, thermal protection options, etc.
26

27 This study shall investigate from a physical design perspective low-cost passive solutions to dis-
28 sipate head using the following guidelines:

- 29 • No prefill of the piping system down comer at startup.
- 30 • Operate over the entire range of flows conditions from minimum to maximum.
- 31 • Allowing a stepped reduction in head so that the salt velocity (impulse load) does not cause
32 excessive piping stresses from changes in line direction or excessive impact loads on pipe
33 supports/anchors.

- 1 • Use innovative design techniques, including stage flow through small line sizes, reducers,
2 elbows, line inserts, multiple expansion loops, etc., to dissipate heat.
- 3 • Determine whether the atmospheric vent is a necessary requirement.
- 4 • If the atmospheric vent is required, the study must identify the upset conditions that could
5 result in a vent overflow and make recommendations on how to prevent and/or contain the
6 salt.
- 7 • The intent is to compare the cost of these options against the capital and operating costs of an
8 outlet vessel with throttling valve. Throttling valve reliability and the impact to plant oper-
9 ating costs for the valve stem packing replacement on six-month or less intervals was the
10 Solar Two experience. Operating cost must be included in the assessment.

11

1 **6. References**

Doc No.	Title and Revision	Document Date
–	Heat Transfer, Principles of, 2 nd Ed., Frank Kreith, International Text Book Co.	1966
–	Thermal Insulation, John F. Malloy, Van Nostrand Reinhold Company, New York	1969
Catalog PH87	Pipe Hangers, Grinnell Corporation, Providence RI	1987
FSCM A10772	Collector Subsystem Requirements, Solar One Heliostats, Rev E	18 Jan 85
ASME Technical Paper	Automatic Control of The Solar Two Receiver, Gregory J. Kolb, Sandia National Laboratories & Dan Saluta, formerly of Bechtel National Inc., Copyright 1999	1999
ASME Technical Paper	Methods for reducing Parasitic Energy Consumption Associated with Use of Molten salt at the solar Two Power Plant, Gregory J Kolb, Sandia national Laboratories, Proceedings of the ASES/AIA and ASME (Solar 2000), Copyright 2000	2000
ASME B&PV Code	Code Case N-47-29, Section III (Nuclear Power) of the ASME B&PC Code, December 1990	1990
SAND 86-8009 UC 62a	A Handbook for Solar Central Receiver Design, Patricia K. Falcone, Sandia National Laboratories Livermore	Dec 1986
30C-R-013	Topical Report on the Lessons Learned, Project History, and Operating Experience, Solar Two Project, Daggett, California	5 Nov 99
Catalogue 106	McMaster-Carr Supply Company - Catalogue 106	N/A
Technical Paper No. 410	Flow of Fluids (through Valves, Fittings and Pipe) Crane Co.	1965
Design Basis, 21948	Solar Two Design Basis Document for Solar Two Project, Daggett, California, Rev 2	25 Feb 94
SAND92-7009	Wind Load Design Methods for Ground Based Heliostats and Parabolic Dish Collectors, Sandia National Laboratories Report, J. A. Peterka and R. G. Derickson	Sep 1992

2
3
4

Distribution

Mr. Donald Aitken
Union of Concerned Scientists
2625 Alcatraz Ave., #505
Berkeley, CA 94705-2702

Dr. Daniel J. Alpert
Senator Bingaman's Office
SH 703, 2nd & Constitution
Washington, DC 20510

Mr. Ian Andrews
PacifiCorp
Utah Power Generation Engineering
1407 West North Temple
Salt Lake City, UT 84140-0001

Mr. Doug Bailey
Nevada Power Co.
P.O. Box 230, MS 25
Las Vegas, NV 89151

Daniel L. Barth
Nagle Pumps, Inc.
1249 Center Avenue
Chicago Heights, IL 60411

Mr. Bud Beebe
Sacramento Municipal Utility District
6201 'S' St.
P.O. Box 15830
Sacramento, CA 95852-1830

Jose Benevente Sierra
Avda. del Puerto N 1-6
11006 Cadiz
Spain

Jerry Berquist
Southern California Edison Co.
300 N. Lone Hill Avenue
San Dimas, CA 91773

Manuel J. Blanco Muriel
CIEMAT – PSA
Apartado 22
E-04200 Tabernas (Almeria)
Spain

Dan Brake, P.E.
FPL Energy, Inc.
6952 Preston Avenue
Livermore, CA 94550

Mr. Robert A. Briffett
Los Angeles Dept. of Water and Power
P.O. Box 111, Room 1129
Los Angeles, CA 90051-0100

Gary D. Burch
U. S. Department of Energy EE-11
1000 Independence Avenue SW
Washington, DC 20585

Mr. Barry L. Butler
Science Applications International Corp.
Room 2043, M/S C2J
10260 Campus Point Dr.
San Diego, CA 92121

Mr. John Carstensen
Idaho Power
1221 W. Idaho
MS CHQ-4
Boise, ID 83702

Mr. Gilbert E. Cohen
Duke Solar
2101 - 115 Westinghouse Blvd.
Raleigh, NC 27604

Walter E. Collier
Boeing Company
499 Boeing Blvd., MC JW-63
P.O. Box 240002
Huntsville, AL 35824-6402

David L. Dean
Boeing Company
499 Boeing Blvd.
PO Box 240002
Huntsville, AL 35824-6402

John C. Dewey
Pitt-Des Moines, Inc.
9719 Lincoln Village Drive, Suite 301
Sacramento, CA 95827

David Engberg
PacifiCorp
825 NE Multnomah
Portland, OR 97232

E. A. Fletcher
University of Minnesota
1111 Church Street, SE
Dept. of Mech. Engr.
Minneapolis, MN 55455

Scott D. Frier
KJC Operating Company
41100 Highway 395
Boron, CA 93516-2109

Bobi Garrett
National Renewable Energy Laboratory
1617 Cole Blvd.
Golden, CO 80401-3393

Mr. Ranji George
South Coast AQMD
21865 Copley Drive
Diamond Bar, CA 91765

Mr. Dave Gorman
Advanced Thermal Systems, Inc.
5031 W. Red Rock Drive
Larkspur, CO 80118

Mr. William R. Gould, Jr.
Nexant
45 Fremont St., 7th Floor
San Francisco, CA 94105-2210

Mr. Tom M. Griffin
Boeing Company
P.O. Box 582808
Tulsa, OK 74158

Ignacio Grimaldi Pastoril
Ghersa
Avda. del Puerto N 1-6
11006 Cadiz
Spain

Pedro Grimaldi Pedrosa
Avda. del Puerto N 1-6
11006 Cadiz
Spain

Mr. Jose Gutierrez
Los Angeles Dept. of Water and Power
111 North Hope Street, Room 648
Los Angeles, CA 90012

Ms. Mary Jane Hale
National Renewable Energy Laboratory
1617 Cole Blvd.
Golden, CO 80401-3393

Larry Hamlin
Southern California Edison Co.
300 N. Lone Hill Avenue
San Dimas, CA 91773

Herb Hayden
Pinnacle West Capital Corporation (APS)
400 N. Fifth Street, MS 8931
Phoenix, AZ 85004

Mats E. Hellstrom
Queue Systems, Inc.
1800 St. Julian Place, Suite 2000
Columbia, SC 29204

Dr. Arlon Hunt
Lawrence Berkeley Laboratory
University of California
MS 90-2024
One Cyclotron Road
Berkeley, CA 94720

Mr. Gus Hutchison
Solar Kinetics, Inc.
10635 King William Drive
P.O. Box 540636
Dallas, TX 75354-0636

Micel E. Izygon, PhD
I-Net
NASA/Johnson Space Center
Software Technology Branch - MC BT2
NASA Rd. 1
Houston, TX 77058

Mr. Paul Jaster
3M - Solar Optics Program
3M Center, Bldg. 225-2N-06
St. Paul, MN 55144-1000

Mr. Alexander Jenkins
California Energy Commission
Energy Technology Development Div. R&D
Office
1516 9th Street, MS-43
Sacramento, CA 95814-5512

Peter Johnston
Arizona Public Service
400 N. 5th Street
Phoenix, AZ 85072

Ron Judkoff
National Renewable Energy Laboratory
1617 Cole Boulevard
Golden, CO 80401-3393

Mr. David W. Kearney
Kearney & Associates
PO Box 2568
Vashon WA 98070

Mr. Bruce Kelly
Nexant
45 Fremont St., 7th Floor
San Francisco, CA 94105-2210

Jim Kern
U. S. Department of Energy EE-11
1000 Independence Ave., SW
Washington, DC 20585

Michael J. Kiley
Boeing Company
6633 Canoga Ave. MC FA-66
P.O. Box 7922
Canoga Park, CA 91309-7922

Kurt Klunder
Klunder Consulting
4498 Larchmont Ct.
Dumfries, VA 22026

R. LeChevalier
Boeing Company
Energy Technology Engineering Center
P.O. Box 1449
Canoga Park, CA 91304

Mr. Mark Lichtwardt
U.S. Bureau of Reclamation
Code D-8230
P.O. Box 205007
Denver, CO 80225

Mr. Bob Litwin
Boeing Company
6633 Canoga Avenue
PO Box 7922 - Mail Code LA38
Canoga Park, CA 91309-7922

W. Marlatt
Boeing Company
Rocketdyne Division
6633 Canoga Avenue
P.O. Box 7922
Canoga Park, CA 91309-7922

Larry Matthews
New Mexico State University
Box 30001, Dept. 3449
Las Cruces, NM 88003-0001

Michael W. McDowell
Boeing Company
6633 Canoga Ave. MC T038
P.O. Box 7922
Canoga Park, CA 91309-7922

Mr. Mark Mehos
National Renewable Energy Laboratory
1617 Cole Boulevard
Golden, CO 80401-3393

M. Merrigan
Los Alamos National Laboratory
P.O. Box 1663, MS J576
Los Alamos, NM 87545

Jan Miller
Salt River Project
1600 N. Priest St.
Tempe, AZ 85281

Mr. Doug Morris
Electric Power Research Institute
P.O. Box 10412
3412 Hillview Avenue
Palo Alto, CA 94303

Peter G. Mueller
U.S. Department of Energy
Nevada Operations Office
P.O. Box 98518
Las Vegas, NV 89193-8518

Mr. Jay Mulki
Hawaiian Electric Company
P.O. Box 2750
Honolulu, HI 96840-0001

James Nagle
Nagle Pumps, Inc.
1249 Center Avenue
Chicago Heights, IL 60411

Mr. Don Osborne
Sacramento Municipal Utility District
6201 'S' St., P.O. Box 15830
Sacramento, CA 95852-1830

Mr. Ernie Palomino
Salt River Project
P. O. Box 52025
Mail Station ISB664
Phoenix, AZ 85072-2025

Terry Peterson
EPRI
3412 Hillview Avenue
Palo Alto, CA 94304

Lizana K. Pierce
Dept. of Energy/GFO
1617 Cole Blvd.
Golden, CO 80401-3393

Faith Puffer
Tech Reps
5000 Marble NE
Suite 222
Albuquerque, NM 87110

Mr. James E. Rannels
U. S. Department of Energy EE-11
1000 Independence Avenue SW
Washington, DC 20585

Dale Rogers
Boeing Company
6633 Canoga Avenue
PO Box 7922 - Mail Code LA38
Canoga Park, CA 91309-7922

Manuel Romero Alvarez
CIEMAT - Madrid
Instituto de Energias Renovables
Avda. Complutense, 22
E-28040 Madrid
Spain

Tommy Rueckert
U. S. Department of Energy EE-11
1000 Independence Avenue SW
Washington DC 20585

Mr. D. A. Sanchez
U.S. Department of Energy/AL
P.O. Box 5400
Albuquerque, NM 87115

Mr. Scott Sklar
Stella Group, Ltd.
733 15th Street, NW Suite 700
Washington, D.C. 20005

Glenn Strahs
U. S. Department of Energy EE-11
1000 Independence Avenue, SW
Washington, DC 20585

Steven E. Taylor
Southern California Edison Co.
2131 Walnut Grove Ave.
Rosemead, CA 91770

Mr. Robert Thomas
Advanced Thermal Systems, Inc.
5031 W. Red Rock Drive
Larkspur CO 80118-9053

Tom Tracey
6922 S. Adams Way
Littleton, CO 80122

Dr. Lorin Vant-Hull
University of Houston
Physics Department 5506
4800 Calhoun Road
Houston, TX 77204-5506

Mr. Byron J. Washom
Spencer Management Associates
P.O. Box 724
Diablo, CA 94528-0724

Mr. Tim Wendelin
National Renewable Energy Laboratory
1617 Cole Blvd.
Golden, CO 80401-3393

Mr. David White
Solar Kinetics, Inc.
10635 King William Drive
P.O. Box 540636
Dallas, TX 75354-0636

John White
Queue Systems, Inc.
1800 St. Julian Place, Suite 2000
Columbia, SC 29204

Mr. Bob Wichert
Sacramento Municipal Utility District
6201 'S' St., P.O. Box 15830
Sacramento, CA 95852-1830

Mr. Curtt N. Wilkins
U.S. Department of Energy
1309 Barnes Drive
Arlington, TX 76013

Mr. Frank (Tex) Wilkins
U. S. Department of Energy EE-11
1000 Independence Avenue, SW
Washington, DC 20585

4 Mr. Alex Zavoico
Nexant
45 Fremont St., 7th Floor
San Francisco, CA 94105-1895

MS 0131 James Chavez, 12121
4 MS 0703 James Pacheco, 6216
MS 0703 Scott Jones, 6216
MS 0703 Craig Tyner, 6216
MS 0703 Hugh Reilly, 6216
MS 0704 Marjorie Tatro, 6200
MS 0752 Earl Rush, 6218
MS 1127 Chris Cameron, 6215
MS 1127 Mike Edgar, 6215

MS 1127 Bill Kolb, 6215
MS 1127 Solar Tower Library
MS 1425 Bob Bradshaw, 8722
MS 9004 Dan Dawson, 8746
MS 9014 Scott Faas, 2271
MS 9404 Steve Goods, 8725
1 MS 9018 Central Technical
Files, 8945-1
2 MS 0899 Technical Library,
9616
1 MS 0612 Review and Approval
Desk, 9612